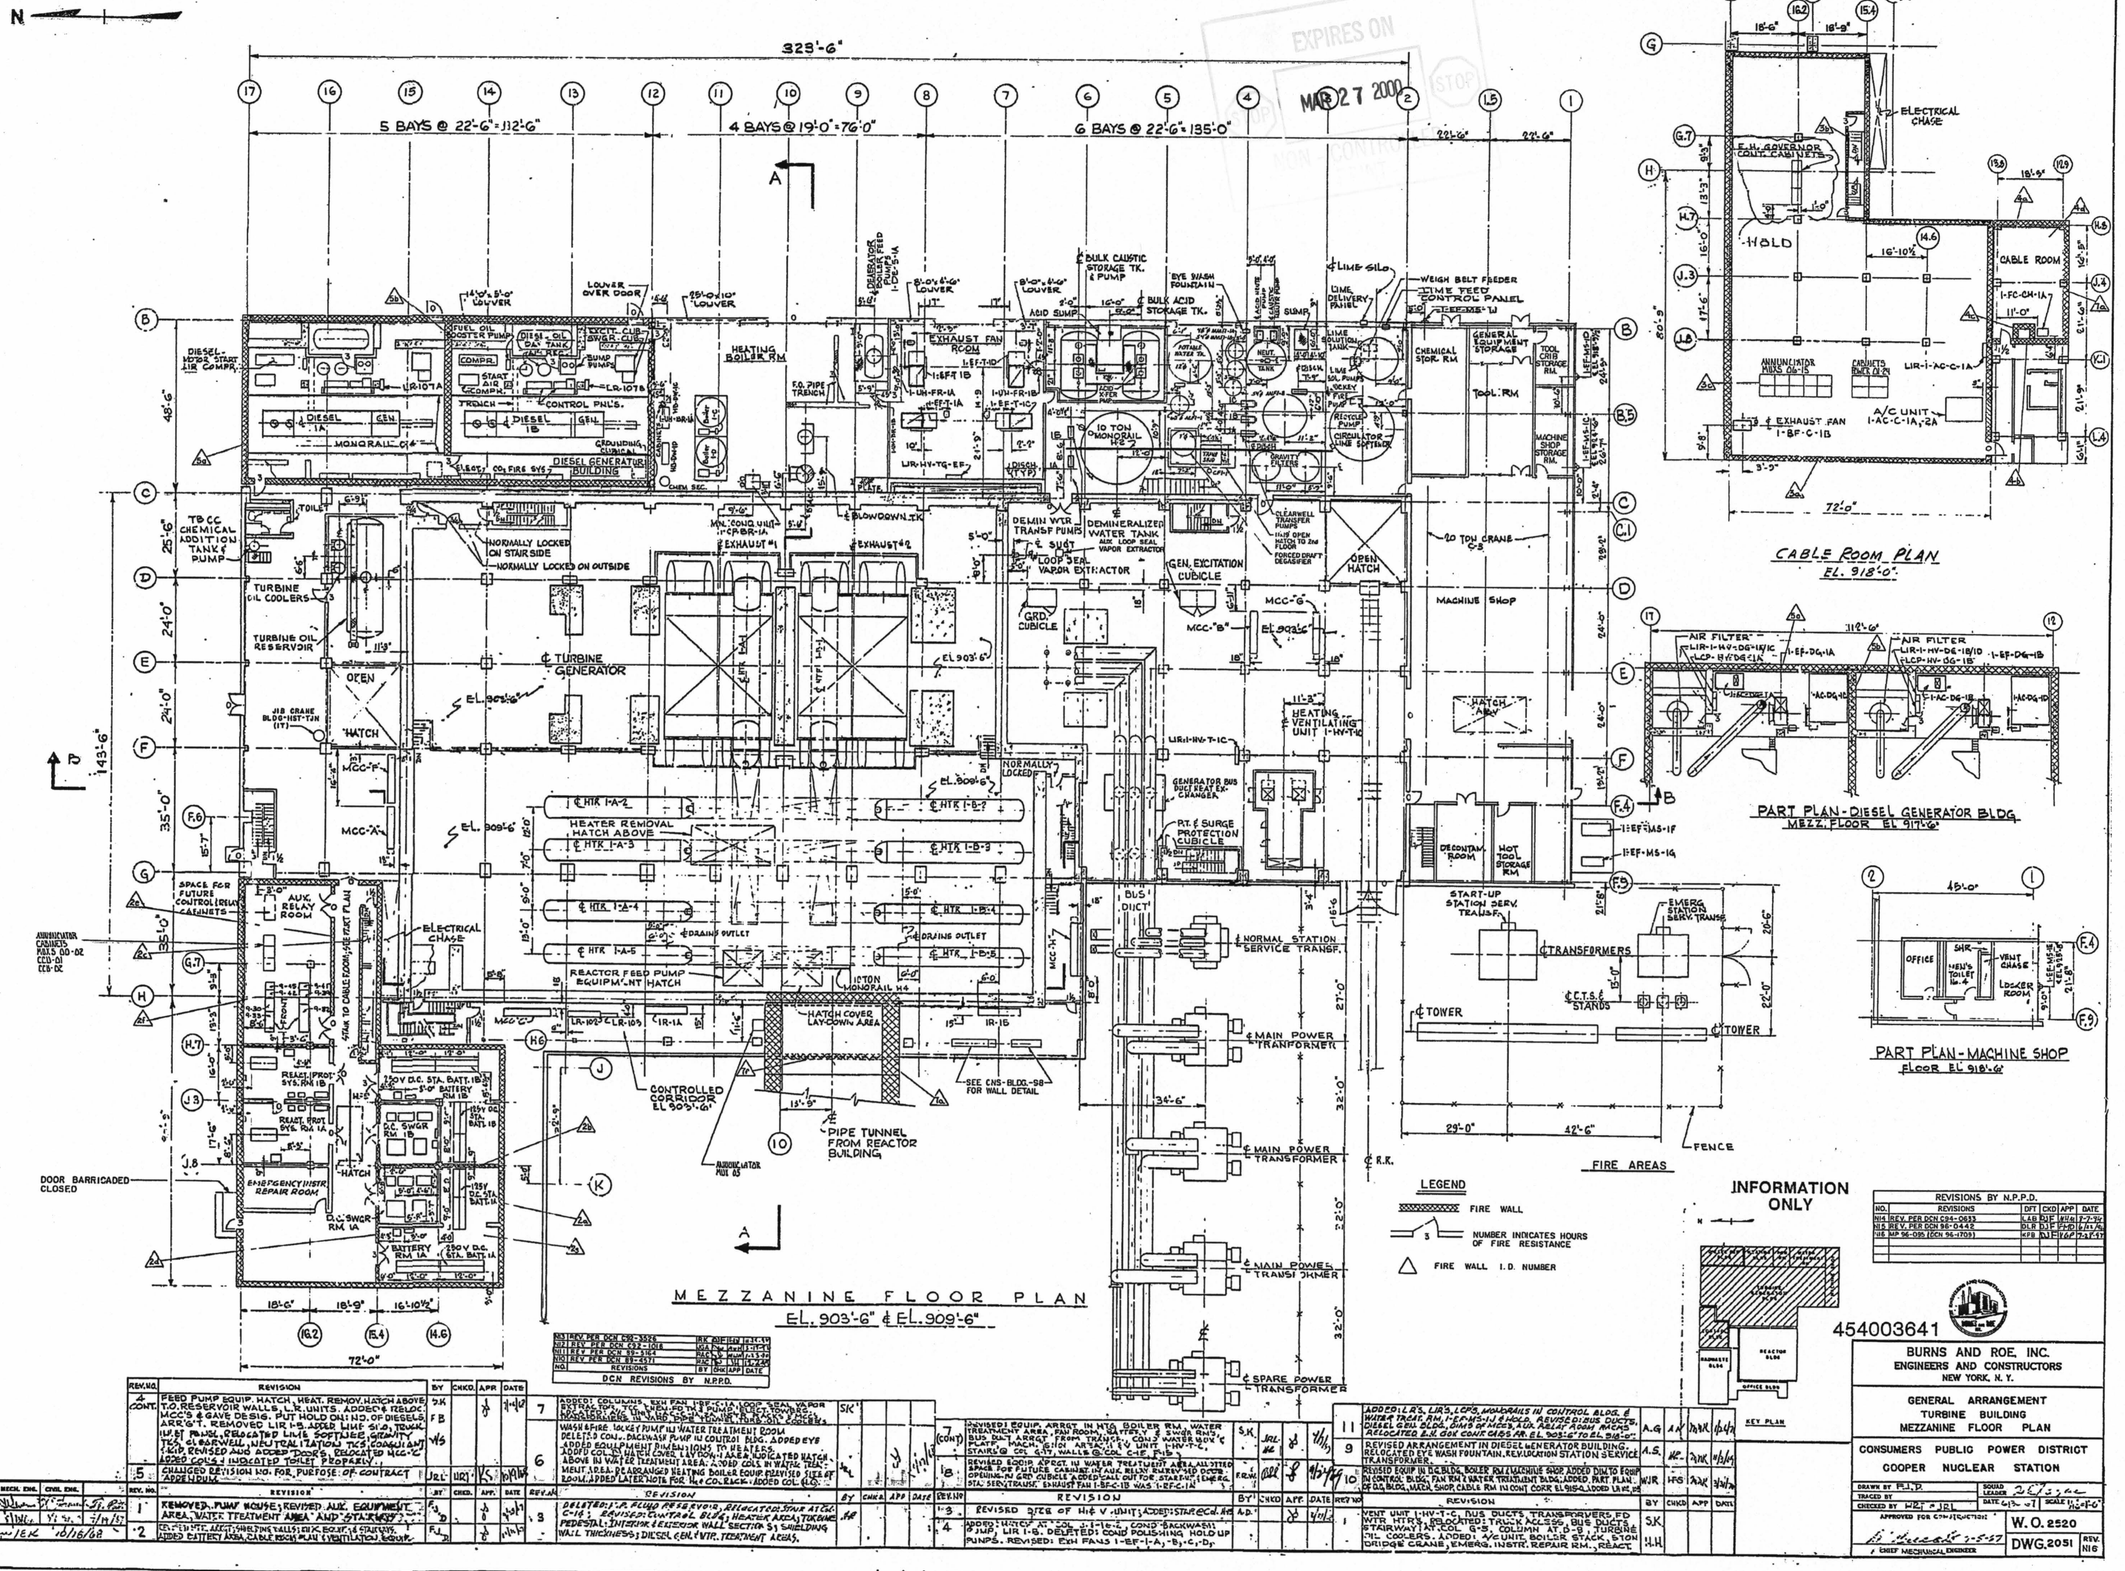

REV. NO.	REVISION	BY	CHKD.	APP.	DATE
4 CONT.	FEED PUMP EQUIP. HATCH, HEAT. REMOV. HATCH ABOVE T.G. RESERVOIR WALLS, L.R. UNITS. ADDED & RELOC. MCC'S & GAVE DESIG. PUT HOLD ON1 NO. OF DIESELS, ARR'GT. REMOVED LIR 1-B. ADDED LIME SI-O, TRUCK UNLOAD PANEL, RELOCATED LIME SOFTENER GRAVITY TKS. ELEARWELL NEUTRALIZATION TKS (CONSOLIDATED) P&ID, REVISED AND ADDED DOORS, RELOCATED MCC-"C" ADDED COLS. & INDICATED TOILET PREPARTY.	DJK			7-14-67
5	CHANGED REVISION NO. FOR PURPOSE OF CONTRACT ADDENDUM	JRL	HRT	VS	9-14-67

REV. NO.	REVISION	BY	CHKD.	APP.	DATE
1	REMOVED "PUMP HOUSE"; REVISED AUX. EQUIPMENT AREA, WATER TREATMENT AREA AND STAIRWAY	FS	D		7-14-67
2	REVISED VENT. ARRGT. SHELTING TALLIES, DUCT, BOILER & STACKS. ADDED BATTERY AREA, CABLE ROOM PLAN, VENTILATION EQUIP.	FL	JL		11-14-67

REV. NO.	REVISION	BY	CHKD.	APP.	DATE
3	REVISED SIZE OF H & V UNITS; ADDED STAR ℄ COL. NOS.	A.D.			1-11-68
4	ADDED TRENCH AT COL. 1-1 & 1-2, COND. BACKWASH PUMP; LIR 1-B, DELETED COND POLISHING HOLD UP PUMPS. REVISED: EXH FANS 1-EF-1A, B; 1-C, D;	S.K.			1-11-68
7 (CONT)	REVISED EQUIP. ARRGT IN HTG BOILER RM, WATER TREATMENT AREA, FAN ROOM, BATTERY & SWGR RMS, BUS DUCT ARRGT FROM TRANSF., COND WATER BOX'S PLATF., MACH. SHOP ARRANG'T, EV UNITS 1-HV-T-C, STAIRS @ COL G&7, WALLS @ COL C-1 & F-1 & 2	S.K.	JRL	DJK	7-14-67
8	REVISED ROOFS, EQUIP. IN WATER TREATMENT ROOM, ADDED SPACE FOR FUTURE CASING, RELOCATE ELEV. EQUIP. ROOF OPENING IN CRD CUBICLE, REVISED ELEV. MOTOR, STAIRWAY, EMERG. STA. SERV. TRANSF., EXHAUST FAN 1-EF-C-1B WAS 1-EF-1A	FRH	CRH	DJK	9-14-67
9	REVISED ARRANGEMENT IN DIESEL GENERATOR BUILDING, RELOCATED EYE WASH FOUNTAIN, REVLOCATION STATION SERVICE TRANSFORMER.	A.S.	WE	DJK	9-14-67
10	REVISED EQUIP IN C.B. BLDG, BOILER RM, LUBE OIL SHOP, ADDED DUCTS, EQUIP IN CONTROL BLDG, FAN RM, WATER TREATMENT BLDG, ADDED PART PLAN OF DG BLDG, MECH. SHOP, CABLE RM IN CONT. CORR. & REVISED LIR-1-C	WJR	HRS	DJK	9-14-67
11	ADDED LIR'S, LCP'S, MINERALS IN CONTROL BLDG. & WATER TREAT. RM, 1-EF-WSH-1 & HOLD, REVISED DUCTS, DIESEL GEN. BLDG., DUCTS & MECH. AIR, VALVE ROOM, MECH. RELOCATED & ADDED COND. TANKS, ETC.	A.G.	AN	DJK	10-24-67

REV. NO.	REVISION	BY	CHKD.	APP.	DATE
1	VENT UNIT 1-HV-T-C, BUS DUCTS, TRANSFORMERS, FD WTR. HTRS, RELOCATED TRUCK ACCESS, BUS DUCTS, STAIRWAY AT COL. G-5, COLUMN AT D-9, TURBINE TRL. COOLERS, ADDED 1 A/C UNIT, BOILER STACK, S-TON OVERHEAD CRANE, EMERG. INSTR. REPAIR RM., REACT	S.K.			1-11-68

REVISIONS BY N.P.P.D.					
NO.	REVISIONS	DFT	CKD	APP	DATE
NI4	REV. PER DCN C94-0633	LAB	DJF	[illegible]	7-7-94
NI5	REV. PER DCN 96-0442	DLR	DJF	FWD	6/1/96
NI6	MP 96-085 (DCN 96-1709)	KFB	NJF	FWD	7/24/97

DCN REVISIONS BY N.P.P.D.					
NO.	REVISIONS	BY	CHK	APP	DATE
NI3	REV. PER DCN C94-0634	RK	AW	FWD	12/14/94
NI2	REV. PER DCN 94-0161	RAC	SL	FWD	3/23/94
NI1	REV. PER DCN 93-0364	RAC	SL	FWD	3/23/93
NI0	REV. PER DCN 93-0511	RAC	SL	FWD	11/12/93

ENG. DES. CLEARED BY	ELEC'L ENG.	MECH. ENG.	CIVIL ENG.
DATE	11/17/67	11/16/67	11/16/67
REV. BY CK. DRAFT	A. Williams	I.E.K.	10/16/67

454003641

BURNS AND ROE, INC.
ENGINEERS AND CONSTRUCTORS
NEW YORK, N. Y.

GENERAL ARRANGEMENT
TURBINE BUILDING
MEZZANINE FLOOR PLAN

CONSUMERS PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

DRAWN BY	P.J.D.
TRACED BY	
CHECKED BY	W.E. + J.B.L.
APPROVED FOR CONSTRUCTION	
DATE	12-8-67
SCALE	1/8"=1'-0"
W. O.	2520
DWG.	2051
REV.	N16

CHIEF MECHANICAL ENGINEER

D-17