

BWR Vessel and Internals Project Standby Liquid Control Line Repair Design Criteria (BWRVIP-53NP)

NON-PROPRIETARY INFORMATION

NOTICE: This report contains the non-proprietary information that is included in the proprietary version of this report. The proprietary version of this report contains proprietary information that is the intellectual property of BWRVIP utility members and EPRI. Accordingly, the proprietary report is available only under license from EPRI and may not be reproduced or disclosed, wholly or in part, by any Licensee to any other person or organization.

REPORT SUMMARY

The Boiling Water Reactor Vessel and Internals Project (BWRVIP), formed in June, 1994, is an association of utilities focused exclusively on BWR vessel and internals issues. This BWRVIP report documents criteria which can be used to design a repair for the standby liquid control (SLC) line in a BWR.

Background

In the event that significant degradation is observed in BWR SLC piping, repair may be required. Utilities need criteria which can be used in the development of designs for those repairs.

Objectives

To compile the appropriate repair design criteria into a document which can be used by utility personnel performing the design and which could be submitted to appropriate regulatory agencies for approval of the generic design process.

Approach

The contractor assembled a draft document which discussed all elements which need to be considered in designing a repair. Items discussed include: design objectives; structural evaluation; system evaluation; materials, fabrication and installation consideration; and, required inspection and testing. The resulting draft was reviewed in depth by BWRVIP utility representatives as well as third party contractors. The final report incorporates comments received during those reviews.

Results

The document provides general design acceptance criteria for the repair of SLC piping. Repairs designed to meet these criteria will maintain the structural integrity of the component under normal operation as well as under postulated transient and design basis accident conditions.

EPRI Perspective

The criteria listed in the report define a standard set of considerations which are important in designing a repair. It is intended that these criteria will be submitted to the USNRC, and possibly non-US regulators, for their approval. Regulatory acceptance of these generic criteria will significantly reduce the utility effort required to obtain approval for plant-specific repairs.

PROJECT

EPRI Project Manager: Warren Bilanin
Nuclear Power Group
Contractor: General Electric Nuclear Energy

For ordering information about this report, call the EPRI Program Manager at (650) 855-2340.

For membership information, call (650) 855-2514

TR-108716NP

Interest Categories

Piping, reactor, vessel and internals
Licensing and safety assessment

Key Words

Boiling water reactor
Repair
Stress corrosion cracking
Vessel and internals
Standby liquid control

BWR Vessel and Internals Project

Standby Liquid Control Line Repair Design Criteria (BWRVIP-53NP)

TR-108716NP
Research Project B501
Final Report, February 2000

Prepared by:

GE Nuclear Energy
BWRVIP Repair Committee

Prepared for
BOILING WATER REACTOR VESSEL & INTERNALS PROJECT and
EPRI
3412 Hillview Ave.
Palo Alto, California 94304

DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITIES

This report was prepared by the organization(s) named below as an account of work sponsored or cosponsored by the BWR Vessel and Internals Project (BWRVIP) and the Electric Power Research Institute, Inc. (EPRI). Neither BWRVIP, EPRI, any member of EPRI, any cosponsor, the organization(s) named below, nor any person acting on behalf of any of them:

(a) makes any warranty or representation whatsoever, express or implied, (i) with respect to the use of any information, apparatus, method, process or similar item disclosed in this report, including merchantability and fitness for a particular purpose, or (ii) that such use does not infringe on or interfere with privately owned rights, including any party's intellectual property, or (iii) that this report is suitable to any particular user's circumstance, or

(b) assumes any responsibility for any damages or other liability whatsoever (including any consequential damages, even if BWRVIP, EPRI or any EPRI representative has been advised of the possibility of such damages) resulting from your selection or use of this report or any information, apparatus, method, process or similar item disclosed in this report.

Organization(s) that prepared this report:

GE Nuclear Energy

BWRVIP Repair Committee

ORDERING INFORMATION

Requests for copies of this report should be directed to the BWRVIP Program Manager, 3412 Hillview Ave., Palo Alto, Ca. 94304, (650) 855-2340.

ACKNOWLEDGMENTS

The members of the BWRVIP SLC Repair Team, listed below, are gratefully acknowledged for their efforts which led to the successful completion of this document.

Bill Bianco	PECO
Ed Gerlach	PP&L
Gary Park	IES
Denver Atwood	SNC
Bruce McLeod	SNC
Ken Wolfe	EPRI

GE Principal Investigators:

D.B. Drendel
G.A. Deaver
P.D. Knecht
J.E. Leatherman

Framatome Technologies, Inc. is gratefully acknowledged for their significant contribution to the discussion of potential repair techniques. Principal FTI contributors:

W.D. Fields
J.W. Mitchem

Table of Contents

1. INTRODUCTION	1
1.1 BACKGROUND	1
1.2 PURPOSE.....	1
1.3 SCOPE.....	1
2. DEFINITIONS.....	3
3. SLC&CDP NOZZLE AND INTERNALS CONFIGURATION AND SAFETY FUNCTION	5
3.1 GENERAL PHYSICAL DESCRIPTION.....	5
3.1.1 SLC&CDP Nozzle Configurations.....	5
3.1.2 Configuration of SLC&CDP Internals	6
3.2 SAFETY DESIGN BASES	8
3.2.1 SLC&CDP Nozzle Safety Design Bases.....	8
3.2.2 SLC&CDP Internal Lines Safety Design Bases.....	9
3.3 EVENT ANALYSES	10
3.3.1 Normal Operation.....	10
3.3.2 Anticipated Operational Occurrences (Upset Conditions).....	10
3.3.3 Alternative Anticipated Operational Occurrences (Upset Conditions)	10
3.3.4 Design Basis Accidents (Emergency/Faulted Conditions).....	11
3.3.5 Loading Combinations.....	11
4. SCOPE OF REPAIRS.....	13
4.1 IGSCC SUSCEPTIBLE MATERIALS.....	13
4.1.1 SLC&CDP Internal Lines	13
4.1.2 Partial Penetration SLC&CDP Nozzle.....	13
4.2 LOW ALLOY STEEL NOZZLE.....	13
5. DESIGN OBJECTIVES.....	15
5.1 DESIGN LIFE	15
5.2 SAFETY DESIGN BASES	15
5.3 SAFETY ANALYSIS EVENTS	15
5.4 STRUCTURAL INTEGRITY.....	15
5.5 RETAINED FLAW(S).....	15
5.6 LOOSE PARTS CONSIDERATIONS	16
5.7 PHYSICAL INTERFACES WITH OTHER REACTOR INTERNALS.....	16
5.8 INSTALLATION CONSIDERATIONS.....	16
5.8.1 Vessel Drain Down.....	16
5.8.2 Access For SLC&CDP Nozzle and Internals Repair	17
6. DESIGN CRITERIA	19
6.1 SLC&CDP NOZZLE	19
6.2 SLC&CDP INTERNAL COMPONENT.....	19
7. STRUCTURAL AND DESIGN EVALUATION	21
7.1 LOAD DEFINITIONS - APPLIED LOADS	21
7.2 SERVICE LEVEL CONDITIONS	24
7.3 LOAD COMBINATIONS	26
7.3.1 Mark I Plants	26
7.3.2 Mark II and III Plants.....	26

7.4 FUNCTIONAL EVALUATION CRITERIA.....	26
7.5 ALLOWABLE STRESSES.....	27
7.6 FLOW INDUCED VIBRATION.....	27
7.7 REPAIR IMPACT ON EXISTING INTERNAL COMPONENTS.....	28
7.8 RADIATION EFFECTS ON REPAIR DESIGN.....	28
7.9 ANALYSIS CODES.....	28
7.10 THERMAL CYCLES.....	28
7.11 CORROSION ALLOWANCE.....	28
8. SYSTEM EVALUATION.....	33
8.1 SYSTEMS EVALUATIONS.....	33
8.2 SLC SOLUTION DISTRIBUTION.....	33
8.3 LOSS OF THE ABOVE CORE PLATE PRESSURE READING.....	33
8.4 POWER UPRATE.....	33
9. MATERIALS, FABRICATION AND INSTALLATION.....	35
9.1 MATERIALS.....	35
9.2 CREVICES.....	36
9.3 WELDING AND FABRICATION.....	36
9.4 PRE-INSTALLATION AS-BUILT INSPECTION.....	37
9.5 INSTALLATION CLEANLINESS.....	37
9.6 ALARA.....	38
9.7 QUALIFICATION OF CRITICAL DESIGN PARAMETERS.....	38
10. INSPECTION AND TESTING.....	41
10.1 INSPECTION ACCESS.....	41
10.2 PRE AND POST INSTALLATION INSPECTION.....	41
10.3 SYSTEM HYDROSTATIC TEST.....	41
10.4 FLOW TEST.....	41
10.5 INSTRUMENTATION CHECKS.....	41
11. QUALITY ASSURANCE PROGRAM.....	43
12. DOCUMENTATION.....	45
13. REFERENCES.....	47
APPENDIX A REPAIR CONCEPTS FOR SLC&CDP INTERNAL LINES.....	49
A.1 ABANDONING IN PLACE.....	49
A.2 PHYSICAL REPAIR OF THE SLC&CDP INTERNAL LINES.....	50
APPENDIX B ALTERNATE CORE PLATE DP SIGNAL SOURCES.....	53
B.1 DP SIGNAL SOURCE MODIFICATIONS.....	53
B.2 CORE PLATE DP ALTERNATE OPERATIONAL APPROACH.....	55
<i>B.2.1 Core Plate dP.....</i>	<i>55</i>
<i>B.2.2 CRD Drive Pressure.....</i>	<i>56</i>
<i>B.2.3 Core Spray Break Detection (BWR/2,3,4).....</i>	<i>57</i>
APPENDIX C REPAIR CONCEPTS FOR SLC&CDP NOZZLES.....	59
C.1 KNOWN REPAIR TECHNIQUES.....	59
<i>C.1.1 Weld Repairing.....</i>	<i>59</i>
<i>C.1.2 Safe End and External Tee Weld Repairs.....</i>	<i>60</i>
<i>C.1.3 Roll Expanding.....</i>	<i>60</i>
C.2 NEW REPAIR TECHNIQUES.....	61

<i>C.2.1 Full Nozzle Penetration Temperbead Welding</i>	61
<i>C.2.2 Nozzle OD Structural/Seal Weld</i>	63
<i>C.2.3 Non-Structural Thermal Spray Leakage Barrier</i>	63
<i>C.2.4 Full Penetration (Through Nozzle Wall) Temperbead Repair</i>	64
<i>C.2.5 Mechanical Seals</i>	64
C.3 ADDITIONAL REPAIR CONSIDERATIONS.....	65
C.4 CODE/DESIGN CONSIDERATIONS	66
FIGURES	67

Tables

TABLE 1: BWR/2-6 SLC&CDP CONFIGURATIONS.....	7
TABLE 2: LOAD COMBINATIONS FOR MARK I PLANTS.....	29
TABLE 3: LOAD COMBINATIONS FOR MARK II AND MARK III PLANTS.....	30
TABLE 4: LOAD TERM DEFINITIONS FOR TABLES 2 AND 3.....	31

Illustrations

FIGURE 1: BWR/2 SLC&CDP INTERNALS	67
FIGURE 2: BWR/2 SLC&CDP INTERNALS DETAILS.....	68
FIGURE 3: TYPICAL SLC&CDP INTERNAL LINES (BWR/3/4).....	69
FIGURE 4: BWR/4/5 SLC&CDP ARRANGEMENT	70
FIGURE 5: BWR/6 SLC&CDP INTERNALS	71
FIGURE 6: TYPICAL BWR POWER-FLOW MAP.....	72
FIGURE 7: SLC&CDP NOZZLE TYPICAL FOR BWR/2 AND EARLY BWR/4 CE VESSELS.....	73
FIGURE 8: SLC&CDP NOZZLE FOR BWR/4 VESSELS	74
FIGURE 9: SLC&CDP NOZZLE FOR BWR/3/4 B&W VESSELS	75
FIGURE 10: SLC&CDP NOZZLE FOR BWR/3/4 CB&I VESSELS AND BWR/3 RDM VESSELS	76
FIGURE 11: SLC&CDP NOZZLE FOR BWR/4 HITACHI VESSEL	77
FIGURE 12: SLC&CDP NOZZLE FOR BWR/4/5 CB&I VESSELS	78
FIGURE 13: SLC&CDP NOZZLE FOR BWR/4/5 CE VESSELS.....	79
FIGURE 14: SLC&CDP NOZZLE FOR BWR/6 CB&I VESSELS	80
FIGURE 15: SLC&CDP NOZZLE FOR BWR/6 RDM VESSELS	81
FIGURE 16: DP SENSING ARRANGEMENT (ABOVE CORE PLATE FUNCTIONS).....	82
FIGURE 17: CONCEPT FOR REPLACEMENT DP LINE.....	83
FIGURE 18: TEMPERBEAD WELD NOZZLE REPLACEMENT.....	84
FIGURE 19: STRUCTURAL/SEAL NOZZLE REPAIR	85
FIGURE 20: CRD STUB TUBE REPAIR	86
FIGURE 21: THERMAL SPRAY REPAIR	87
FIGURE 22: ANOTHER TEMPER BEAD NOZZLE REPAIR	88

Executive Summary

The Boiling Water Reactor Vessel and Internals Project (BWRVIP) was formed in June 1994 as a utility-directed initiative to address BWR vessel and internals issues. This criteria document was developed by the Repair Technical Subcommittee of the BWRVIP.

This document provides the general design acceptance criteria for temporary and permanent repair of BWR standby liquid control and core differential pressure (SLC&CDP) nozzles and internal lines. It is provided to assist BWR owners in designing repairs which maintain the structural integrity of the SLC&CDP nozzles and internal lines during normal operation and under postulated transient and design basis accident conditions for the remaining plant life or other service life as specified by the plant owner. Discussion of SLC&CDP nozzle and internal lines repair concepts are included in the appendices to this document (separate from the design criteria).

Issuance of this document is not intended to imply that repair of the SLC&CDP nozzles and internal lines is the only viable method for resolving cracking in the SLC&CDP nozzles and internal lines. Due to variation in the material, fabrication, environment and as-found condition of the individual SLC&CDP nozzles and internal lines, repair is only one of several options that are available. The action to be taken for individual plants will be determined by the plant licensee.

1. INTRODUCTION

1.1 Background

Recently, the BWRVIP prepared a safety assessment of BWR internals as a follow-on to the activities completed on shroud cracking. As documented in this safety assessment [1], there are several BWR reactor internal components where extensive degradation can be tolerated because of the redundancy provided by the Standby Liquid Control (SLC) System. Therefore, the boron injection function of the SLC system is important to achieve reactor shutdown.

The BWRVIP have prepared generic inspection and evaluation guidelines for the Standby Liquid Control and Core Differential Pressure (SLC&CDP) internals [2] to assure the continued safety function integrity of the SLC&CDP internals. There has been only one report of cracking in any BWR SLC&CDP nozzles or internals (a 1965 failure of the standby liquid control sparger in an overseas BWR/1) however, there is reason to anticipate that such cracking is possible within the reactor service life. If the SLC&CDP nozzle or internals are found to be cracked or leaking it will be necessary to repair the nozzle or internal lines before restarting the plant, or to justify continued operation as-is. Therefore, to prepare for potential repairs, the BWRVIP have prepared this repair criteria for the SLC&CDP nozzle and internals.

1.2 Purpose

The purpose of this document is to provide general design guidance and acceptance criteria for permanent and temporary repair of: cracked or leaking SLC&CDP nozzles, and cracked or broken SLC&CDP lines inside the vessel. Appendices provide additional guidance on potential repair concepts as well as discussion of the steps that would have to be taken to qualify an alternate core dP source.

The issuance of this document is not intended to imply that a repair of SLC&CDP nozzles and internal lines is the only viable approach to resolution of the cracking/degradation issue.

1.3 Scope

This document is applicable to General Electric BWR/2, BWR3-5, and BWR/6 plants which plan to implement repairs of SLC&CDP nozzles and internal lines.

2. DEFINITIONS

Repair	Repair as used in the context of this document is a broad term that applies to actions taken to design, analyze, fabricate and install hardware that restores the structural and functional integrity of all or a portion of the SLC&CDP nozzle and internals. Procedural changes to accomplish necessary functions and allow the abandonment of SLC&CDP internal lines is considered within the definition of repair. Weld overlay, without removal of the defect, is also a repair in the context of this criteria.
SLC&CDP Nozzle	The standby liquid control and core differential pressure nozzle penetrates the reactor vessel wall. SLC&CDP nozzles are of two types: full penetration welded low alloy steel nozzles, and nickel-chrome-iron alloy (Inconel) partial penetration welded nozzles. The nozzle includes an internal stainless steel socket for attachment of the internal CDP internal line.
SLC&CDP Nozzle Safe End	A stainless steel safe end is a short cylindrical section which was welded to the exterior end of the SLC&CDP nozzle during vessel construction to provide a material transition to the external tee.
SLC&CDP Internal Lines	The core differential pressure (CDP) line provides a means to sense the static pressure above the core support plate. The standby liquid control line provides a means of delivery and distribution of the sodium penta-borate solution in the area below the core support plate and a means to sense reactor static pressure below the core support plate (see Figure 1; all figures located at the end of this document). Differential pressure (dP) across the core support is then determined as the difference in these two static pressure readings.
SLC&CDP External Tee	The BWR/2-5 standby liquid control and core differential pressure external tee assembly is a stainless steel piping assembly which is attached to the SLC&CDP nozzle safe end. It provides a means of making separate piping connections outside the RPV with the internal standby

liquid control line and the internal core differential pressure line (see Figure 2).

SLC Sparger

A sparger for distribution of the sodium penta-borate solution is part of the SLC&CDP internals. BWR/2's included a horizontal ring sparger (1-inch schedule 40 pipe) with 1/4 inch holes. This sparger is just below the shroud core support flange. BWR/3-6's use a 1-inch capped vertical pipe sparger with typically seven 1/4 inch diameter holes.

3. SLC&CDP NOZZLE AND INTERNALS CONFIGURATION AND SAFETY FUNCTION

3.1 General Physical Description

The Standby Liquid Control System is designed to shut down the reactor from full power by injecting a neutron absorber (sodium penta-borate) into the reactor core when the normal method of controlling core reactivity with control rods cannot be accomplished. In most plants, a line from the SLC&CDP nozzle in the vessel bottom head supplies liquid sodium penta-borate solution to a standpipe or sparger inside the RPV, which, in turn, distributes the liquid through holes to the coolant entering the core. In some plants, the boron solution is injected through a core spray line; however, those plants still have the SLC&CDP nozzle and internal SLC&CDP line hardware in the lower plenum. This repair design criteria is not applicable to the repair of SLC hardware used for injection through the core spray line; however, it is applicable to the repair of the SLC&CDP nozzle and internal SLC&CDP line hardware which is located in the lower plenum of these plants. The SLC line also provides the below core plate pressure reading used to determine the differential pressure across the core support.

A line around the boron injection line, or a separate line in the bottom head (BWR/6), is used in measuring the pressure above the core plate. The CDP line instrumentation provides information on core flow performance for diagnostic purposes, on Control Rod Drive (CRD) system water differential pressure indication and on core spray piping break detection.

3.1.1 SLC&CDP Nozzle Configurations

The SLC&CDP nozzle provides a penetration in the reactor vessel for delivering sodium penta-borate solution, sensing reactor static pressure above the core support plate, and sensing pressure in the lower plenum. BWR/2-5s use a single nozzle for these functions: an inner pipe running through the nozzle carries the sodium penta-borate solution and senses reactor pressure in the lower plenum. The inner pipe also functions as a thermal sleeve to minimize thermal shock on the nozzle in the event of a cold liquid control injection. BWR/6 use two separate nozzles for these functions. BWR/2-4 typically locate the SLC&CDP nozzle as a radial nozzle in the lower vessel head at 14 degrees below the horizontal tangent line of the lower head. This puts the SLC&CDP nozzle outside the vessel support skirt. BWR/5/6s typically use a vertical orientation for the SLC&CDP nozzle(s), locating the nozzle just outside the pattern of CRD penetrations. This location is inside the vessel support skirt, above the vessel bottom head insulation panels.

All SLC&CDP nozzles use either a full penetration nozzle design or a partial penetration nozzle design. In the full penetration design a low alloy steel nozzle forging was welded into the lower head plate material, through the full thickness. In the partial penetration

nozzle design an Inconel Alloy 600 nozzle forging was welded at the inside of the lower head by a partial penetration weld (typically the Ni-Cr-Fe J-groove weld is made to a Ni-Cr-Fe weld overlay). It is unlikely that cracks or leaks will develop in the low alloy steel material or the full penetration nozzle to lower head weld. On the other hand, it is reasonable to suspect that a BWR may develop a crack or leak in the Alloy 600 partial penetration SLC&CDP nozzle weld during its life time. Either design can develop cracks or leaks in the stainless steel safe end or the external SLC&CDP tee, which is attached to the nozzle safe end.

There are nine basic penetration designs among the BWRs evaluated. The designs depend upon the vessel fabricator and the vintage of BWR, because GE and the vessel fabricators changed design criteria with time. The applicable vessel fabricators are Combustion Engineering (CE), Chicago Bridge and Iron (CB&I) which later formed CBI Nuclear (CBIN), Babcock and Wilcox (B&W), Hitachi, and Rotterdam Drydock (RDM).

3.1.2 Configuration of SLC&CDP Internals

The typical configuration of the SLC&CDP internal lines for BWR/2s is shown in Figure 1 and 2. A 2-inch line attaches to a socket at the inside of the vessel nozzle.

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

Specific plant configurations are indicated in Table 1.

Table 1: BWR/2-6 SLC&CDP Configurations

**Content Deleted -
EPRI Proprietary Information**

3.2 Safety Design Bases

3.2.1 SLC&CDP Nozzle Safety Design Bases

**Content Deleted -
EPRI Proprietary Information**

3.2.1.1 Bottom Head Leakage

**Content Deleted -
EPRI Proprietary Information**

3.2.1.2 Alternative SLC&CDP Nozzle Safety Basis

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

3.2.2 SLC&CDP Internal Lines Safety Design Bases

**Content Deleted -
EPRI Proprietary Information**

3.2.2.1 Boron Mixing

**Content Deleted -
EPRI Proprietary Information**

3.2.2.2 Potential Pinching of the SLC Internal Line

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

3.3 Event Analyses

As previously stated, the purpose of this document is to provide general design criteria for repairs of degraded SLC&CDP nozzles and internal components. Accordingly, various events and operational conditions must be considered to ensure that the repair does not inhibit the ability of the SLC&CDP nozzles to perform their basic safety functions. The following general load cases shall be considered in design of the proposed repair.

3.3.1 Normal Operation

**Content Deleted -
EPRI Proprietary Information**

3.3.2 Anticipated Operational Occurrences (Upset Conditions)

**Content Deleted -
EPRI Proprietary Information**

3.3.3 Alternative Anticipated Operational Occurrences (Upset Conditions)

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

3.3.4 Design Basis Accidents (Emergency/Faulted Conditions)

**Content Deleted -
EPRI Proprietary Information**

3.3.5 Loading Combinations

**Content Deleted -
EPRI Proprietary Information**

4. SCOPE OF REPAIRS

4.1 IGSCC Susceptible Materials

The SLC&CDP nozzle and internal repairs may address cracking in IGSCC susceptible stainless steel and nickel-chrome-iron alloy components by a number of options. This repair criteria applies to the following SLC&CDP nozzle and internal components: the partial penetration nozzle weld, the nickel-chrome-iron alloy partial penetration nozzle body, the stainless steel nozzle safe end, the stainless steel external tee, the internal stainless steel SLC&CDP lines, and supports for the internals lines.

4.1.1 SLC&CDP Internal Lines

The scope of the internal SLC&CDP internals repair is to address repairs of the SLC lines and sparger, the above core plate pressure line and the double wall section of piping from the nozzle to the internal tee. The “repair” may in fact be a use as-is justification or removal of these items. Concepts for repair of the SLC&CDP internals are discussed in Appendix A. Modifications to provide alternative sources for the above core plate pressure reading are discussed in Appendix B.

4.1.2 Partial Penetration SLC&CDP Nozzle

The scope of the SLC&CDP partial penetration nozzle repair is to address repairs of a crack or leaks in the partial penetration nozzle weld, the nozzle safe end and the external tee. Concepts for these repairs are discussed in Appendix C.

4.2 Low Alloy Steel Nozzle

The repair of low alloy steel SLC&CDP nozzle body and full penetration attachment weld to the reactor vessel head is adequately covered by ASME Code Section XI and will not be discussed further in this repair criteria.

5. DESIGN OBJECTIVES

5.1 Design Life

**Content Deleted -
EPRI Proprietary Information**

5.2 Safety Design Bases

**Content Deleted -
EPRI Proprietary Information**

5.3 Safety Analysis Events

**Content Deleted -
EPRI Proprietary Information**

5.4 Structural Integrity

**Content Deleted -
EPRI Proprietary Information**

5.5 Retained Flaw(s)

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

5.6 Loose Parts Considerations

**Content Deleted -
EPRI Proprietary Information**

5.7 Physical Interfaces with Other Reactor Internals

**Content Deleted -
EPRI Proprietary Information**

5.8 Installation Considerations

**Content Deleted -
EPRI Proprietary Information**

5.8.1 Vessel Drain Down

**Content Deleted -
EPRI Proprietary Information**

5.8.2 Access For SLC&CDP Nozzle and Internals Repair

**Content Deleted -
EPRI Proprietary Information**

6. DESIGN CRITERIA

**Content Deleted -
EPRI Proprietary Information**

6.1 SLC&CDP Nozzle

**Content Deleted -
EPRI Proprietary Information**

6.2 SLC&CDP Internal Component

**Content Deleted -
EPRI Proprietary Information**

7. STRUCTURAL AND DESIGN EVALUATION

**Content Deleted -
EPRI Proprietary Information**

7.1 Load Definitions - Applied Loads

**Content Deleted -
EPRI Proprietary Information**

7.2 Service Level Conditions

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

7.3 Load Combinations

**Content Deleted -
EPRI Proprietary Information**

7.3.1 Mark I Plants

**Content Deleted -
EPRI Proprietary Information**

7.3.2 Mark II and III Plants

**Content Deleted -
EPRI Proprietary Information**

7.4 Functional Evaluation Criteria

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

7.5 Allowable Stresses

**Content Deleted -
EPRI Proprietary Information**

7.6 Flow Induced Vibration

**Content Deleted -
EPRI Proprietary Information**

7.7 Repair Impact on Existing Internal Components

**Content Deleted -
EPRI Proprietary Information**

7.8 Radiation Effects on Repair Design

**Content Deleted -
EPRI Proprietary Information**

7.9 Analysis Codes

**Content Deleted -
EPRI Proprietary Information**

7.10 Thermal Cycles

**Content Deleted -
EPRI Proprietary Information**

7.11 Corrosion Allowance

**Content Deleted -
EPRI Proprietary Information**

Table 2: Load Combinations for Mark I Plants

**Content Deleted -
EPRI Proprietary Information**

Table 3: Load Combinations for Mark II and Mark III Plants

**Content Deleted -
EPRI Proprietary Information**

Table 4: Load Term Definitions for Tables 2 and 3

**Content Deleted -
EPRI Proprietary Information**

8. System Evaluation

8.1 Systems Evaluations

**Content Deleted -
EPRI Proprietary Information**

8.2 SLC Solution Distribution

**Content Deleted -
EPRI Proprietary Information**

8.3 Loss of the Above Core Plate Pressure Reading

**Content Deleted -
EPRI Proprietary Information**

8.4 Power Uprate

**Content Deleted -
EPRI Proprietary Information**

9. Materials, Fabrication and Installation

9.1 Materials

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.2 Crevices

**Content Deleted -
EPRI Proprietary Information**

9.3 Welding and Fabrication

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.4 Pre-Installation As-Built Inspection

**Content Deleted -
EPRI Proprietary Information**

9.5 Installation Cleanliness

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

9.6 ALARA

**Content Deleted -
EPRI Proprietary Information**

9.7 Qualification of Critical Design Parameters

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

10. Inspection and Testing

10.1 Inspection Access

**Content Deleted -
EPRI Proprietary Information**

10.2 Pre and Post Installation Inspection

**Content Deleted -
EPRI Proprietary Information**

10.3 System Hydrostatic Test

**Content Deleted -
EPRI Proprietary Information**

10.4 Flow Test

**Content Deleted -
EPRI Proprietary Information**

10.5 Instrumentation Checks

**Content Deleted -
EPRI Proprietary Information**

11. QUALITY ASSURANCE PROGRAM

**Content Deleted -
EPRI Proprietary Information**

12. Documentation

The following documentation shall be prepared and maintained as permanent records:

**Content Deleted -
EPRI Proprietary Information**

13. REFERENCES

- [1] EPRI Report TR-105707, "BWR Vessel and Internals Project, Safety Assessment of BWR Reactor Internals," (BWRVIP-06), October 1995.
- [2] EPRI Report TR-107286, "Standby Liquid Control and Core Plate dP Internals Inspection and Evaluation Guidelines, (BWRVIP-27), April 1997
- [3] EPRI Document 84-MG-18, "Nuclear Grade Stainless Steel Procurement, Manufacturing and Fabrication Guidelines", Rev. 2, January 1986
- [4] EPRI Document NP-7032, Material Specification for Alloy X-750 for Use in LWR Internal Components, Revision 1
- [5] Code Case N-516, "Underwater Welding Section XI, Division", Approved August 9, 1993
- [6] EPRI Report TR-106712, "BWR Vessel and Internals Project- Roll/Expansion Repair of Control Rod Drive and In-Core Instrument Penetrations in BWR Vessels (BWRVIP-17)", November, 1996
- [7] GENE Document NEDC-32436, Qualification of Inconel 82 Overlay Repair Welding Using Machine Gas Tungsten-arc Welding Temperbead Techniques Without Preheat or Post Weld Heating, January 1995

APPENDIX A REPAIR CONCEPTS FOR SLC&CDP INTERNAL LINES

This appendix includes discussion of concepts for the repair of the SLC&CDP internal lines.

A.1 Abandoning In Place

**Content Deleted -
EPRI Proprietary Information**

A.2 Physical Repair of the SLC&CDP Internal Lines

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

APPENDIX B ALTERNATE CORE PLATE dP SIGNAL SOURCES

In the event that a crack occurs in the above core plate instrumentation line or in the outer wall of the coaxial section of the SLC&CDP lines, the core plate Dp signal will be impaired. An alternate source for this signal will be required. This appendix discusses alternate operational approaches which could be used in this situation.

**Content Deleted -
EPRI Proprietary Information**

B.1 dP Signal Source Modifications

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

B.2 Core Plate dP Alternate Operational Approach

**Content Deleted -
EPRI Proprietary Information**

B.2.1 Core Plate dP

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

B.2.2 CRD Drive Pressure

**Content Deleted -
EPRI Proprietary Information**

B.2.3 Core Spray Break Detection (BWR/2,3,4)

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

APPENDIX C REPAIR CONCEPTS FOR SLC&CDP NOZZLES

This appendix includes discussion of various concepts for the repair of the SLC&CDP nozzles. It is intended to provide the designer with an overview of potential repair approaches.

C.1 Known Repair Techniques

Four basic repair techniques have been performed on leaking small nozzles at operating nuclear power plants. Three of the techniques are weld repairs, and the fourth is roll expansion of the leaking nozzle out against the nozzle penetration.

C.1.1 Weld Repairing

**Content Deleted -
EPRI Proprietary Information**

C.1.2 Safe End and External Tee Weld Repairs

**Content Deleted -
EPRI Proprietary Information**

C.1.3 Roll Expanding

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

C.2 New Repair Techniques

C.2.1 Full Nozzle Penetration Temperbead Welding

C.2.1.1 EPRI CRD Repair

**Content Deleted -
EPRI Proprietary Information**

C.2.1.2 Japanese Owner's Group In-core Repair

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

C.2.2 Nozzle OD Structural/Seal Weld

**Content Deleted -
EPRI Proprietary Information**

C.2.3 Non-Structural Thermal Spray Leakage Barrier

**Content Deleted -
EPRI Proprietary Information**

**Content Deleted -
EPRI Proprietary Information**

C.2.4 Full Penetration (Through Nozzle Wall) Temperbead Repair

**Content Deleted -
EPRI Proprietary Information**

C.2.5 Mechanical Seals

**Content Deleted -
EPRI Proprietary Information**

C.3 Additional Repair Considerations

**Content Deleted -
EPRI Proprietary Information**

C.4 Code/Design Considerations

**Content Deleted -
EPRI Proprietary Information**

FIGURES

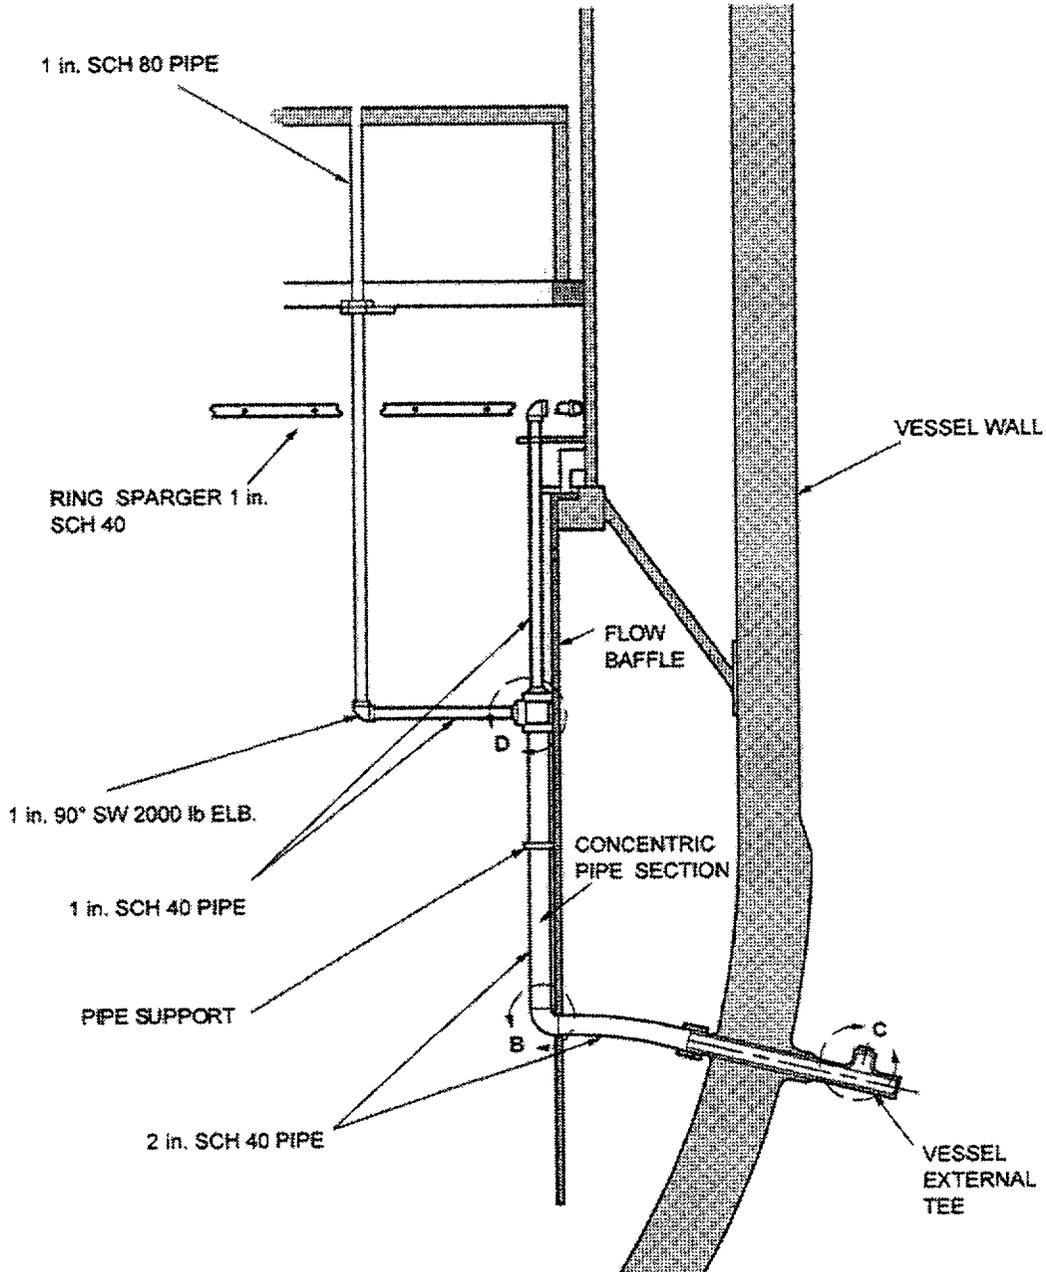


Figure 1: BWR/2 SLC&CDP Internals

**Content Deleted -
EPRI Proprietary Information**

Figure 2: BWR/2 SLC&CDP Internals Details

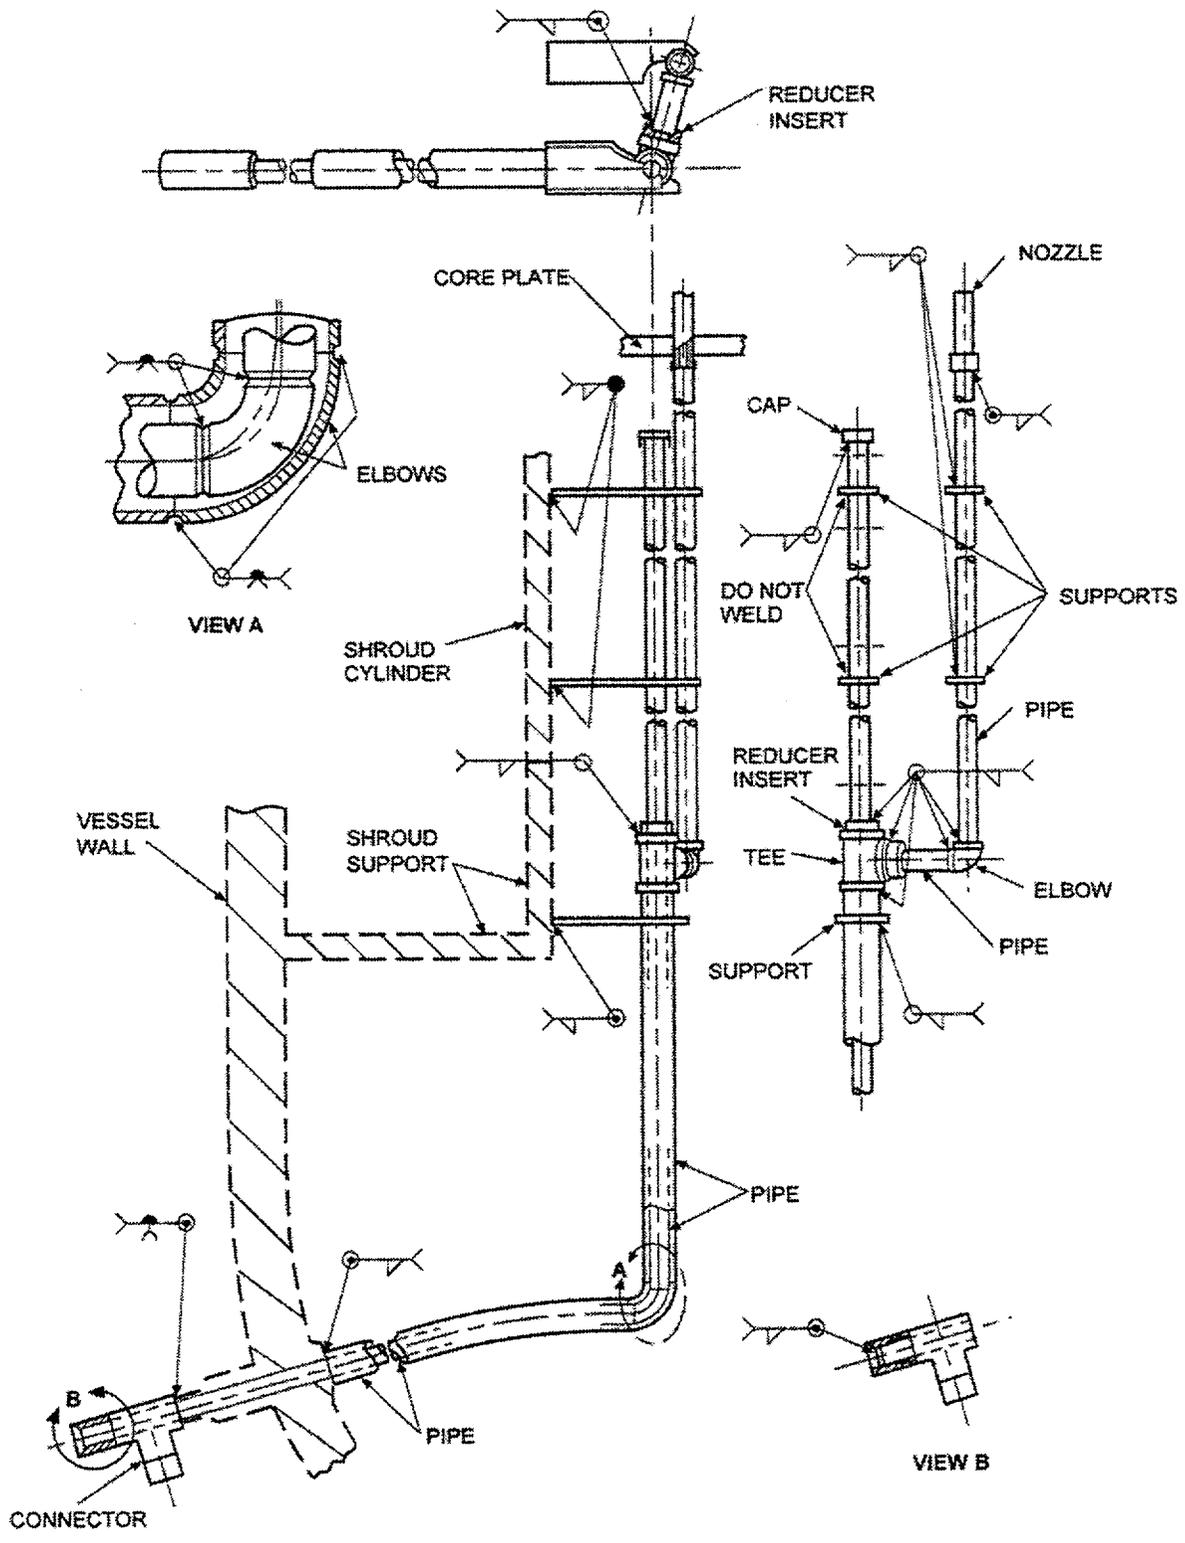


Figure 3: Typical SLC&CDP Internal Lines (BWR/3/4)

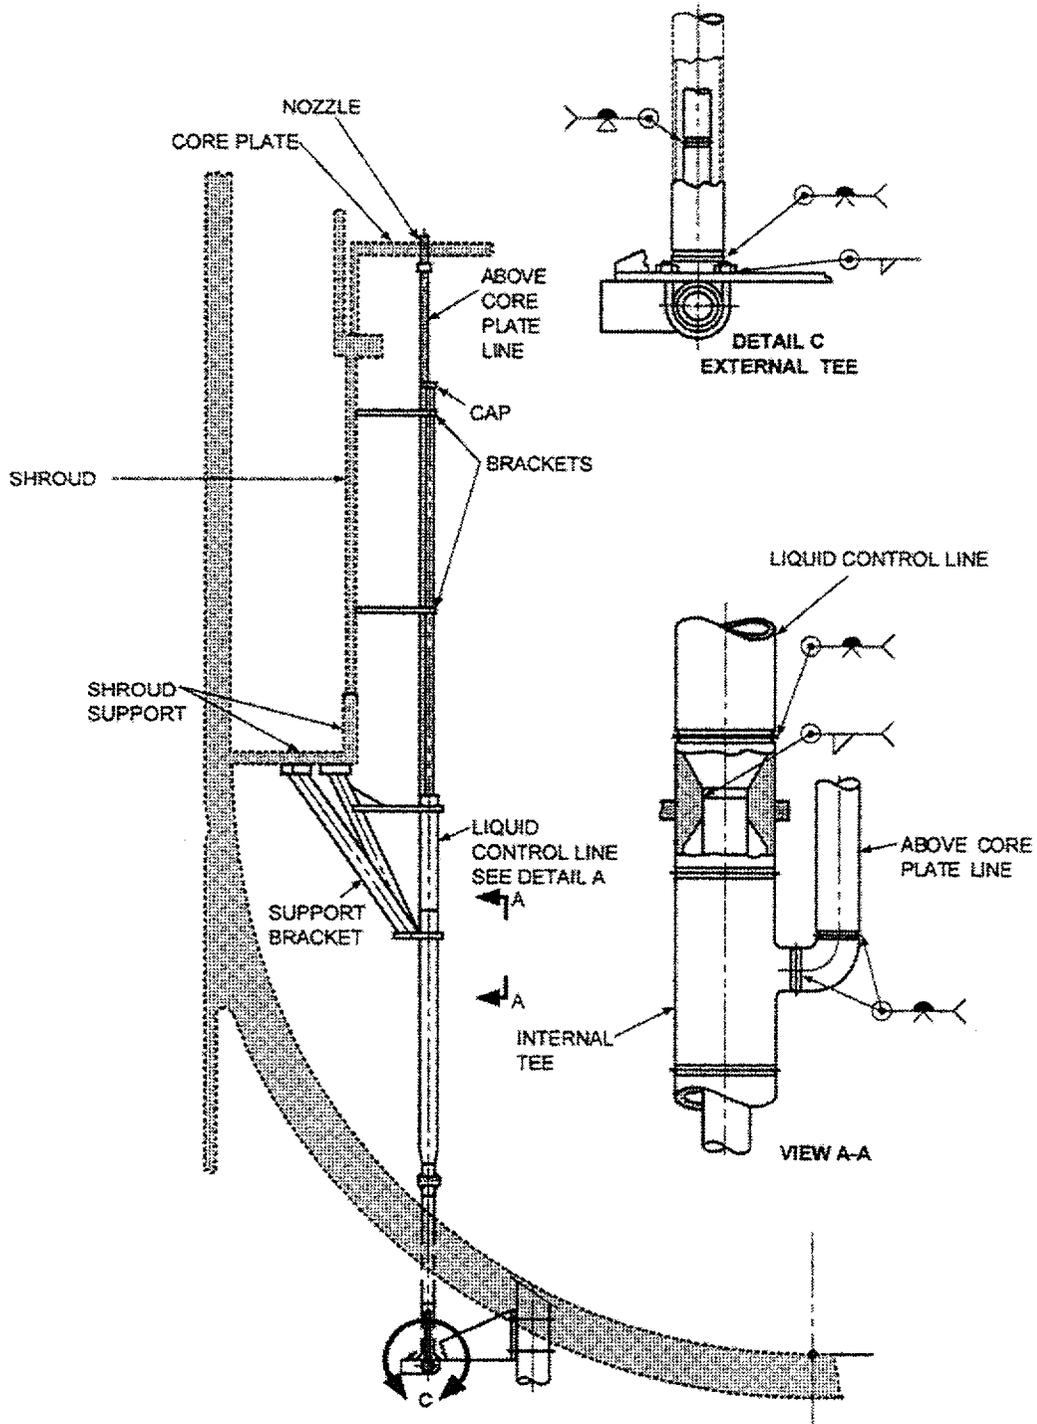


Figure 4: BWR/4/5 SLC&CDP Arrangement

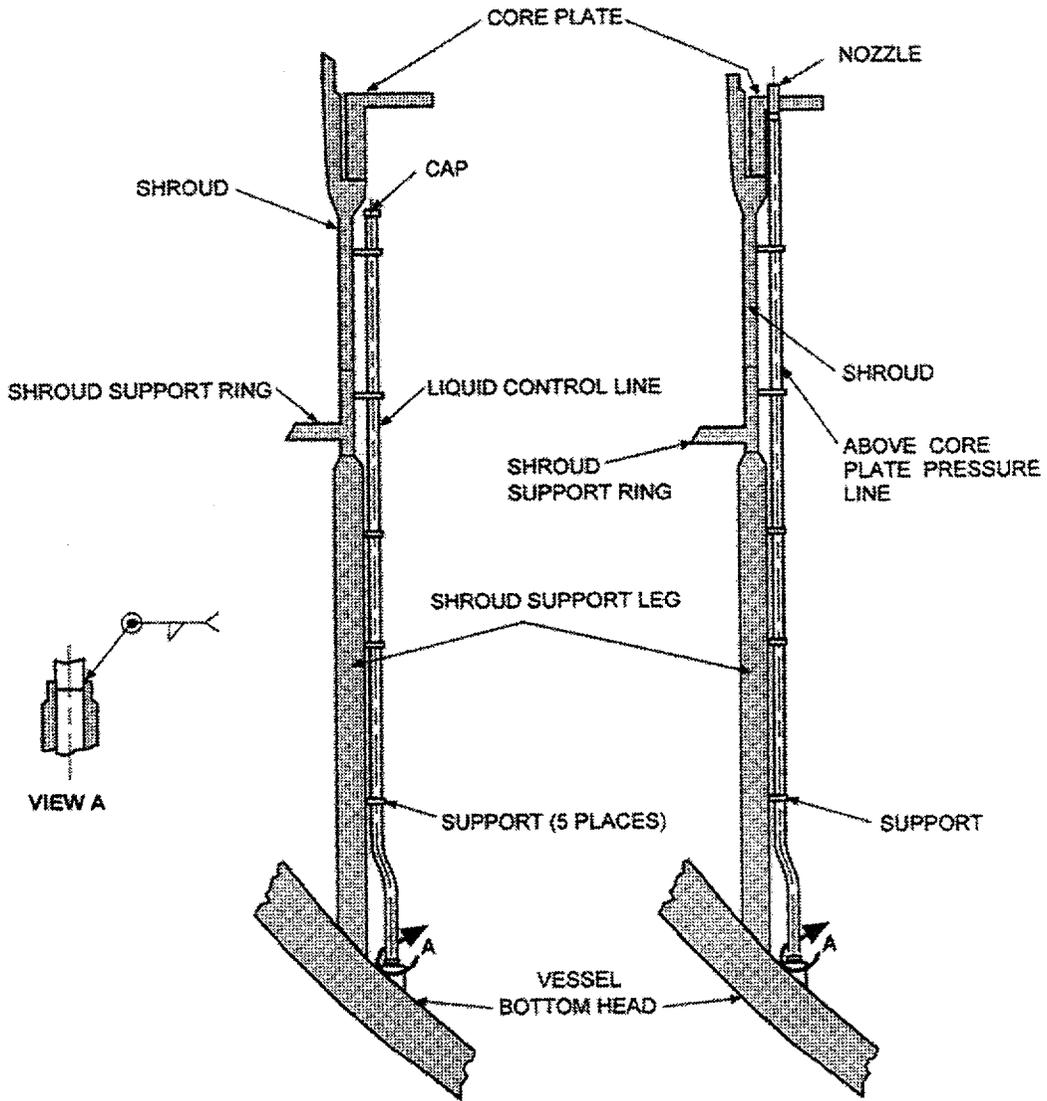


Figure 5: BWR/6 SLC&CDP Internals

**Content Deleted -
EPRI Proprietary Information**

Figure 6: Typical BWR Power-Flow Map

**Content Deleted -
EPRI Proprietary Information**

Figure 7: SLC&CDP Nozzle Typical for BWR/2 and Early BWR/4 CE Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 8: SLC&CDP Nozzle for BWR/4 Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 9: SLC&CDP Nozzle For BWR/3/4 B&W Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 10: SLC&CDP Nozzle For BWR/3/4 CB&I Vessels and BWR/3 RDM Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 11: SLC&CDP Nozzle For BWR/4 Hitachi Vessel

**Content Deleted -
EPRI Proprietary Information**

Figure 12: SLC&CDP Nozzle For BWR/4/5 CB&I Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 13: SLC&CDP Nozzle For BWR/4/5 CE Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 14: SLC&CDP Nozzle For BWR/6 CB&I Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 15: SLC&CDP Nozzle For BWR/6 RDM Vessels

**Content Deleted -
EPRI Proprietary Information**

Figure 16: dP Sensing Arrangement (Above Core Plate Functions)

**Content Deleted -
EPRI Proprietary Information**

Figure 17: Concept for Replacement dP Line

**Content Deleted -
EPRI Proprietary Information**

Figure 18: Temperbead Weld Nozzle Replacement

**Content Deleted -
EPRI Proprietary Information**

Figure 19: Structural/Seal Nozzle Repair

**Content Deleted -
EPRI Proprietary Information**

Figure 20: CRD Stub Tube Repair

**Content Deleted -
EPRI Proprietary Information**

Figure 21: Thermal Spray Repair

**Content Deleted -
EPRI Proprietary Information**

Figure 22: Another Temper Bead Nozzle Repair

Target:

Nuclear Power

About EPRI

EPRI creates science and technology solutions for the global energy and energy services industry. U.S. electric utilities established the Electric Power Research Institute in 1973 as a nonprofit research consortium for the benefit of utility members, their customers, and society. Now known simply as EPRI, the company provides a wide range of innovative products and services to more than 1000 energy-related organizations in 40 countries. EPRI's multidisciplinary team of scientists and engineers draws on a worldwide network of technical and business expertise to help solve today's toughest energy and environmental problems.

EPRI. Powering Progress

© Electric Power Research Institute (EPRI), Inc. All rights reserved. Electric Power Research Institute and EPRI are registered service marks of the Electric Power Research Institute, Inc. EPRI. POWERING PROGRESS is a service mark of the Electric Power Research Institute, Inc.

 Printed on recycled paper in the United States of America