FPL

MAR 2 2 2000

L-2000-076
10 CFR 50.36

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Re: Turkey Point Unit 3
Docket No. 50-250
Core Operating Limits Report

By letter dated October 12, 1994, the NRC issued Amendment 167 to Facility Operating License No. DPR-31 for Turkey Point Unit 3. The amendment consisted of changes to the Technical Specifications to relocate certain cycle-specific parameter limits from the Technical Specifications to a Core Operating Limits Report (COLR). In accordance with Technical Specification 6.9.1.7, the attached COLR is provided for Turkey Point Unit 3. These curves are applicable for Unit 3 Cycle 18.

Should there be any questions, please contact us.

Very truly yours,

R. J. Hovey
Vice President
Turkey Point Plant

OIH

Attachment

cc: Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, Turkey Point Plant

A001

CORE OPERATING LIMITS REPORT UNIT 3 CYCLE 18

The Technical Specifications (TS) affected by this report are:

3.1.3.2	Analog Rod Position Indication System
3.1.3.6	Control Rod Insertion Limits
3.2.1	Axial Flux Difference (AFD)
3.2.2	Heat Flux Hot Channel Factor - $F_Q(Z)$
3.2.3	Nuclear Enthalpy Rise Hot Channel Factor - $F_{\Delta H}$

The Control Rod Insertion Limits, AFD, $F_Q(Z)$, K(Z), and $F_{\Delta H}$ have been developed using the NRC approved methodology specified in Technical Specification 6.9.1.7.

TS 3.1.3.2 Analog Rod Position Indication System

The All Rods Out position for all Shutdown Banks and Control Banks is defined to be 230 steps withdrawn.

TS 3.1.3.6 Control Rod Insertion Limits

The control rod banks shall be limited in physical insertion as shown on page 2 for All Rods Out = 230 steps withdrawn.

TS 3.2.1 Axial Flux Difference

The AFD limits are provided on page 3.

TS 3.2.2 Heat Flux Hot Channel Factor - $F_Q(Z)$

$[F_Q]^L = 2.50$

$K(Z) = 1.0$ for 0 ft. $\leq z \leq$ 12 ft. where z = core height.

TS 3.2.3 Nuclear Enthalpy Rise Hot Channel Factor

$F_{\Delta H}^{RTP} = 1.70$

$PF_{\Delta H} = 0.3$

Figure A1
Turkey Point Unit 3 - Cycle 18 Rod Insertion Limit vs Thermal Power
ARO = 230 Steps Withdrawn, Overlap = 102 Steps

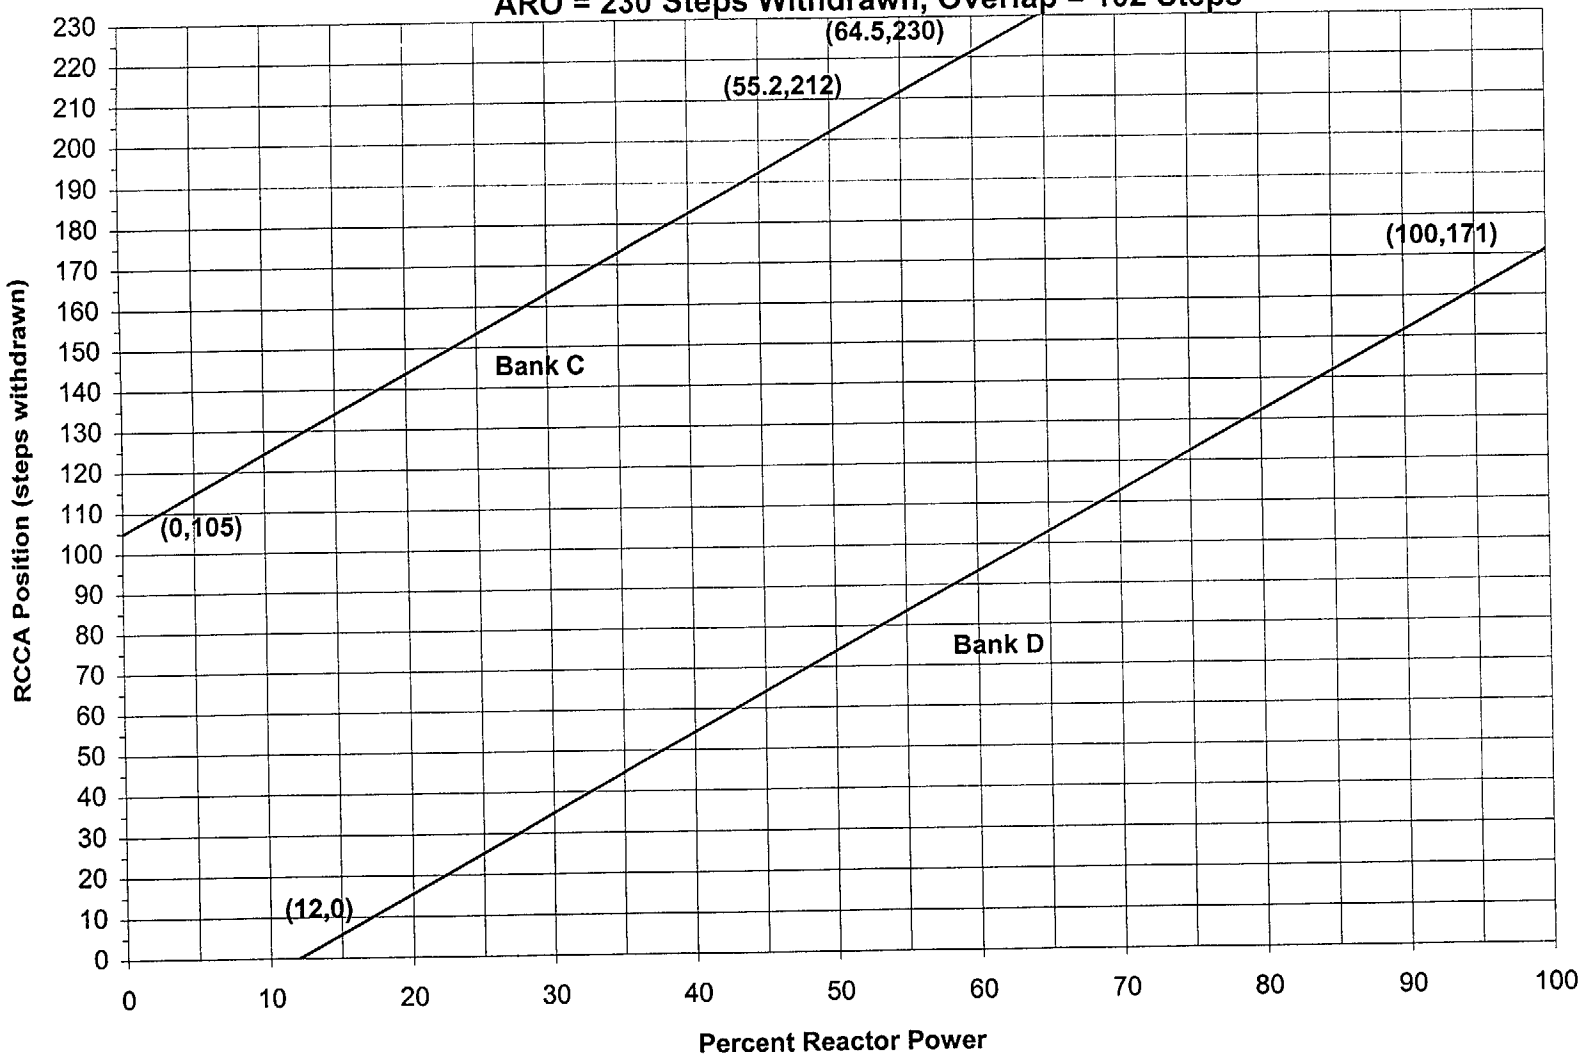

Figure A2
Axial Flux Difference as a Function of Rated Thermal Power
Turkey Point Unit 3 - Cycle 18