


# SIDE 1

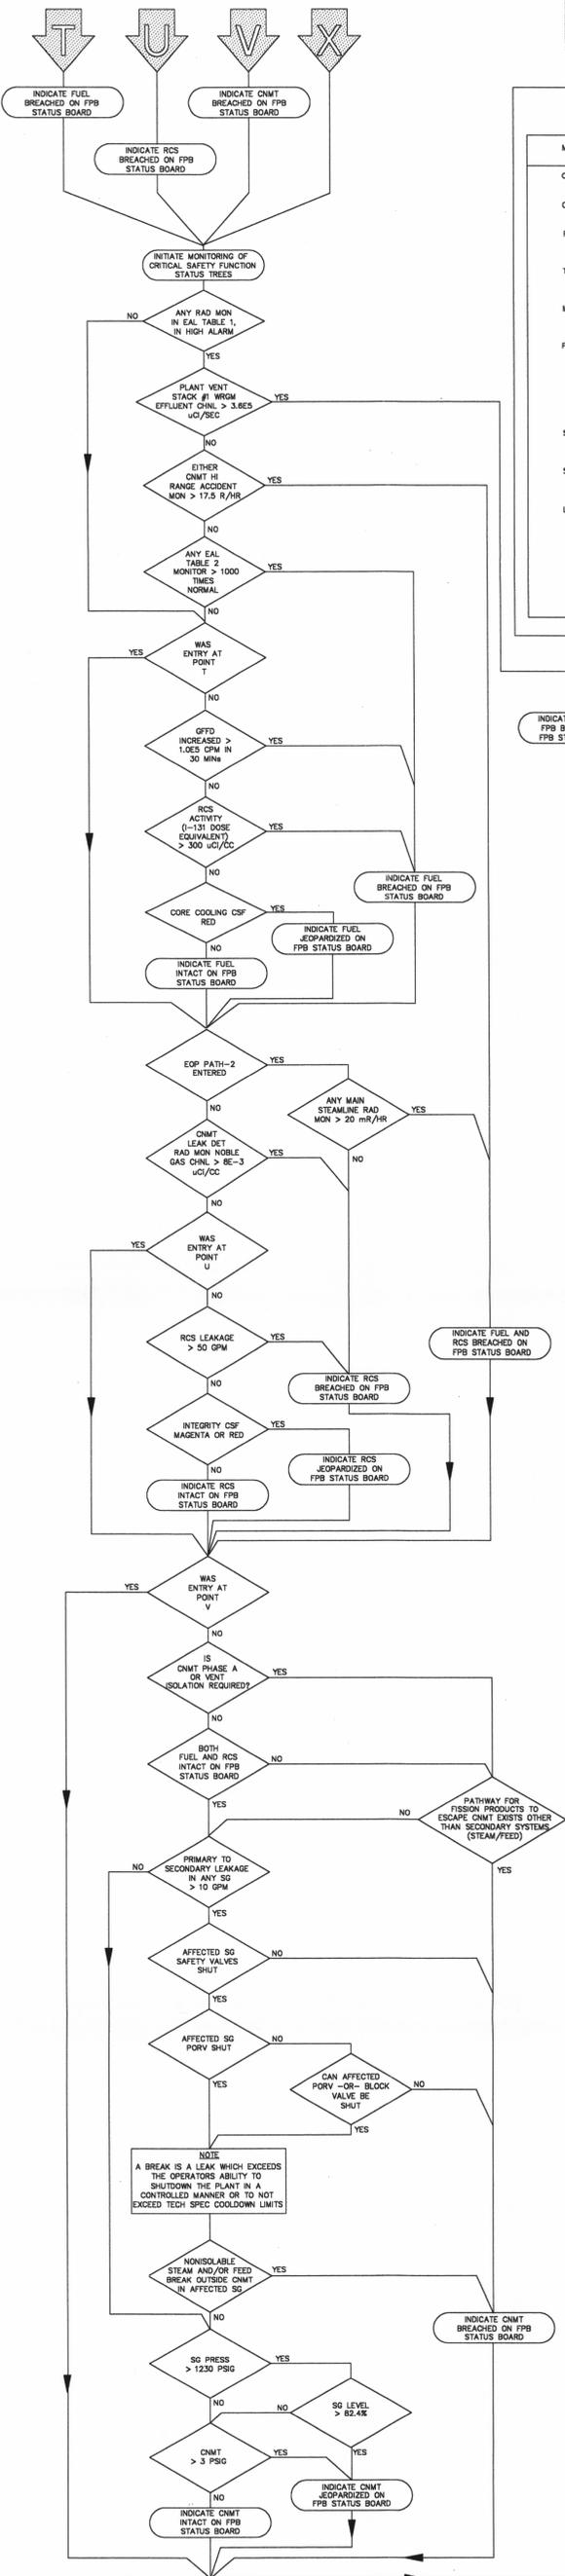



FPB STATUS BOARD		
FUEL FPB	RCS FPB	CONTAINMENT FPB
INTACT _____	INTACT _____	INTACT _____
JEOPARDIZED _____	JEOPARDIZED _____	JEOPARDIZED _____
BREACHED _____	BREACHED _____	BREACHED _____

EAL TABLE 1 RADIATION MONITOR TAG NUMBERS			
MONITOR DESCRIPTION	INSTRUMENT TAG NO.	RM-11 CHANNEL ID NO.	ERIS POINT ID NO.
CNMT LEAK DETECTION MONITOR	REM-1T-3502A-SA	20S303	RLT3502B
CNMT HI RANGE ACCIDENT MONITORS	RM-1CR-3588-SA RM-1CR-3589-SB	24X162 24X163	RCS3089A RCS3090A
PLANT VENT STACK #1 WRGM EFFLUENT CHANNEL	RM-21AV-3509-1SA	1EX817	RAV3509H
TURBINE BUILDING STACK 3A WRGM EFFLUENT CHANNEL	RM-1TV-3538-1	2EX827	RTV3538D
MAIN STEAM LINE MONITORS	RM-1MS-3591-SB RM-1MS-3592-SB RM-1MS-3593-SB	5AX164 5AX165 5AX166	RMS3591A RMS3592A RMS3593A
FUEL BREACH AREA RAD. MONITORS:			
VOLUME CONTROL TANK RM:			
CHARGING PUMP 1A ROOM	RM-1RR-3595	1AA056	RRR3595A
CHARGING PUMP 1B ROOM	RM-1RR-3598A	1AA060	RRR3598B
CHARGING PUMP 1C ROOM	RM-1RR-3598B	1AA061	RRR3598C
CHARGING PUMP 1D ROOM	RM-1RR-3598C	1AA062	RRR3598D
RECYCLE EVAP. VLV. GAL.	RM-1RR-3600	1AA063	RRR3600A
LETDOWN HX VALVE GAL.	RM-1RR-3601	1AA064	RRR3601A
MODERATING HX VLV. GAL.	RM-1RR-3602	1AA065	RRR3602A
STACK #5 MONITOR WRGM EFFLUENT CHANNEL	RM-1WV-3546-1	4EX837	RWV3546H
STACK #5A MONITOR WRGM EFFLUENT CHANNEL	RM-1WV-3547-1	4EX847	RWV3547H
LIQUID EFFLUENT MONITORS			
TREATED LAUNDRY & HOT SHOWER DISCHARGE	REM-1WL-3540	4LL866	RWL3540A
SECONDARY WASTE SAMPLE TANK DISCHARGE	REM-21WS-3542	4LL866	RWS3542A
WASTE MONITOR TANK DISCHARGE	REM-1WL-3541	4LL876	RWL3541A
TURBINE BLDG. DRAIN	REM-1MD-3528	2LL276	RMD3528A

EAL TABLE 2 FUEL BREACH AREA RAD MONITORS	
1. VOLUME CONTROL TANK RM.	
2. CHARGING PUMP 1A ROOM	
3. CHARGING PUMP 1B ROOM	
4. CHARGING PUMP 1C ROOM	
5. RECYCLE EVAP. VLV. GAL.	
6. LETDOWN HX VALVE GAL.	
7. MODERATING HX VLV. GAL.	

EAL TABLE 3 FUNCTIONS NEEDED TO ACHIEVE SHUTDOWN		
	MODE 4-5	MODE 3
CAPABILITY FOR FW FLOW $\geq 222.5$ KPPH	IF RCS PRESS. > 360 PSIG	X
SECONDARY HEAT SINK CAPABILITY	IF RCS PRESS. > 360 PSIG	X
RHR CAPABILITY		X
CCW CAPABILITY		X
ESW CAPABILITY		X
CHARGING CAPABILITY		X
STEAM GENERATOR SAFETY VALVES		X
BORATION CAPABILITY		X
RCS PRESS. CONTROL CAPABILITY		X
ACCUM. ISOL. OR VENTING CAPABILITY		X

X = REQUIRED

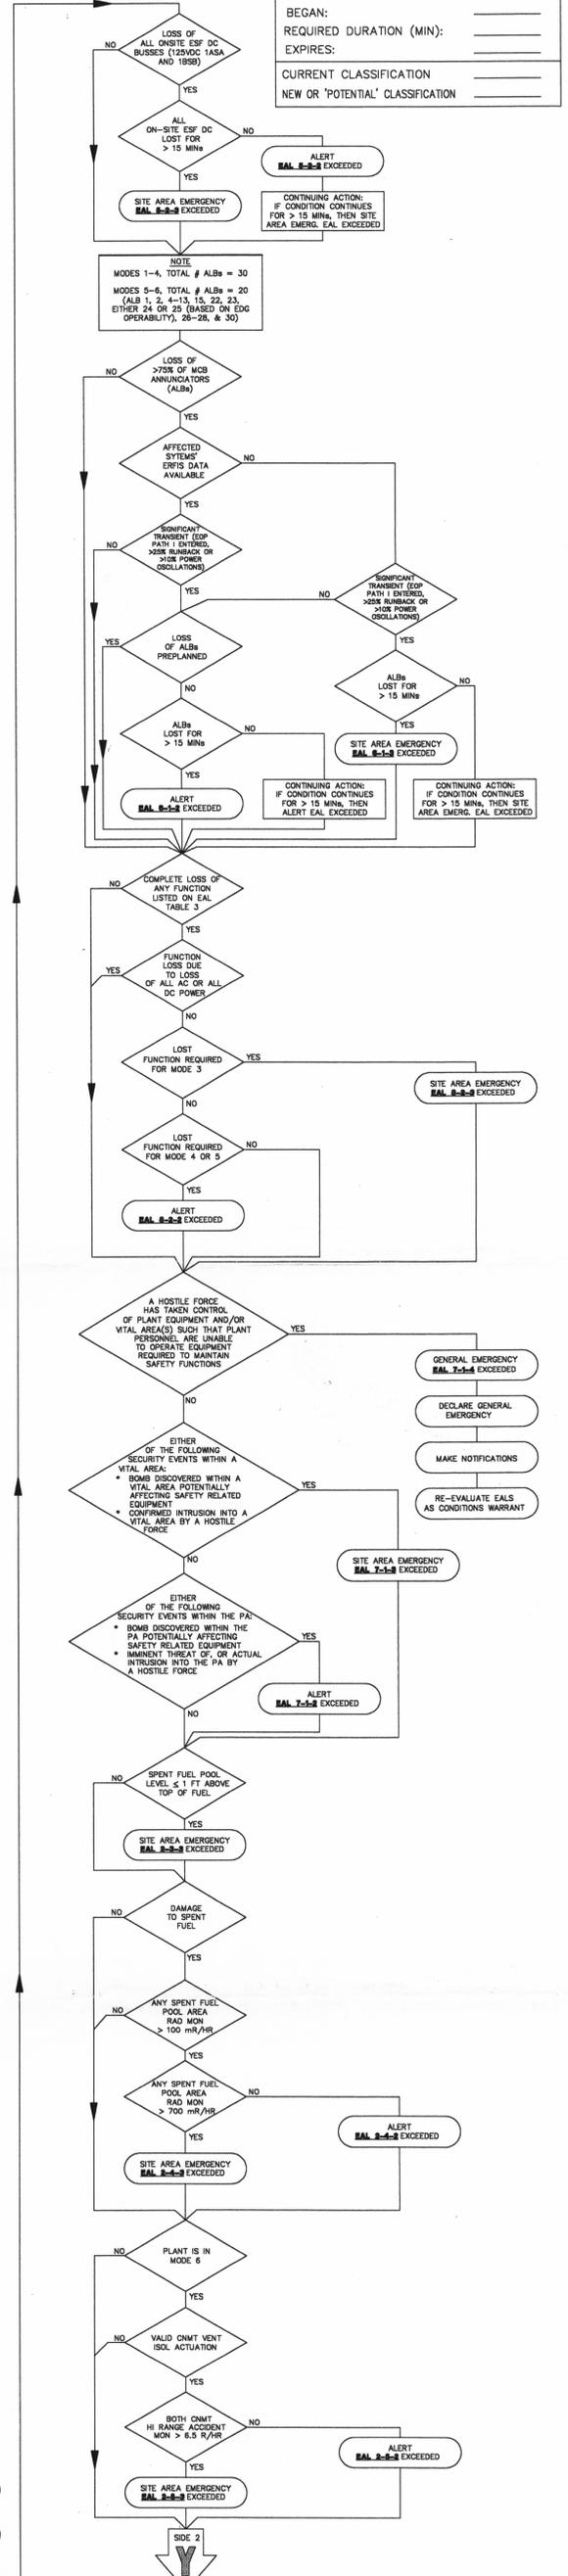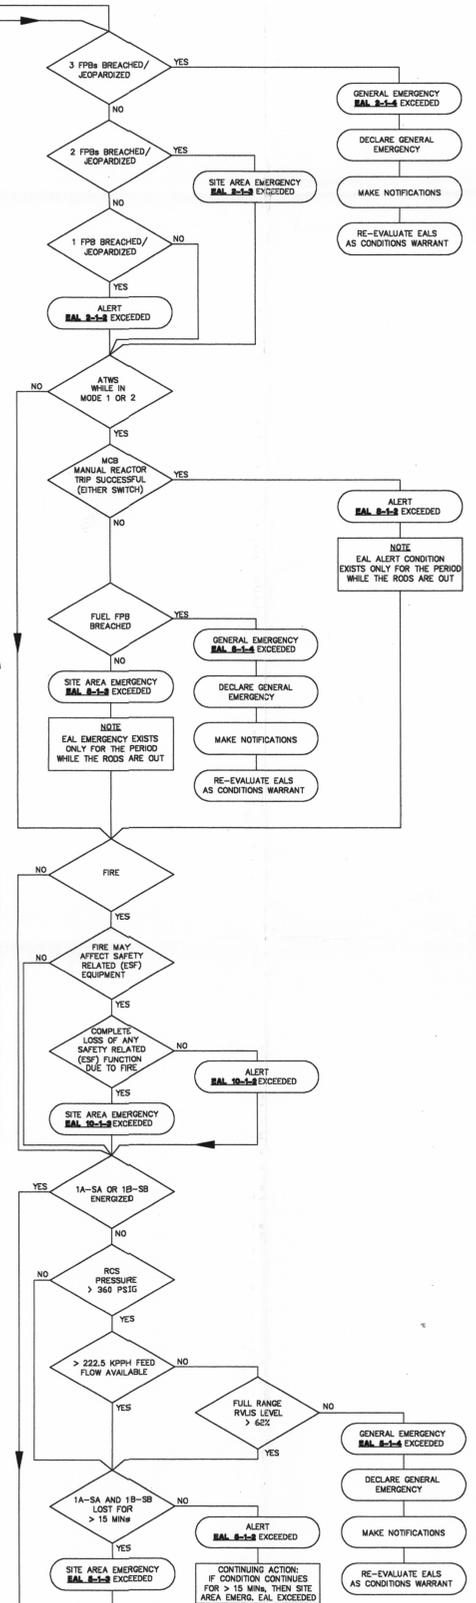

EAL STATUS BOARD	
EAL REF. NO(S):	
GENERAL EMERGENCY	_____
SITE AREA EMERGENCY	_____
UNUSUAL EVENT	_____
CONTINUING ACTION:	TIME _____
BEGAN:	_____
REQUIRED DURATION (MIN):	_____
EXPIRES:	_____
CURRENT CLASSIFICATION	_____
NEW OR 'POTENTIAL' CLASSIFICATION	_____

D1