

Commonwealth Edison Company
Quad Cities Generating Station
22710 206th Avenue North
Cordova, IL 61242-9740
Tel 309-654-2241



April 28, 2000

SVP 00-060

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D C 20555

Quad Cities Nuclear Power Station, Unit 2
Facility Operating License No. DPR-30
NRC Docket No. 50-265

Subject: 90-Day Post Outage ISI Letter

Enclosed please find the Post-Outage (90 day) Summary Report for Inservice Inspection examinations and Repair/Replacement activities conducted from the end of Q2R14 refueling outage through the Q2R15 refueling outage. This was the second refueling outage of the second period and closes the second period of the third ten year interval. This report has been submitted to you in accordance with the requirements of ASME Section XI, Article IWA-6200.

Should you have any questions concerning this letter, please contact Mr. C.C. Peterson at (309) 654-2241, extension 3609.

Respectfully,

A handwritten signature in black ink, appearing to read "Joel P. Dimmette, Jr.", written over a horizontal line.

Joel P. Dimmette, Jr.
Site Vice President
Quad Cities Nuclear Power Station

Attachment:

Post Outage (90 day) Summary Report

cc: Regional Administrator – NRC Region III
NRC Senior Resident Inspector – Quad Cities Nuclear Power Station


ACH 7

ATTACHMENT A

Post Outage (90 day) Summary Report
SVP 00-060

Quad Cities Nuclear Power Station - Unit 2
Post Outage (90 Day) Summary Report
April 28, 2000

Refueling Outage Q2R15
Outage Start Date: January 21, 2000
Outage End Date: February 11, 2000

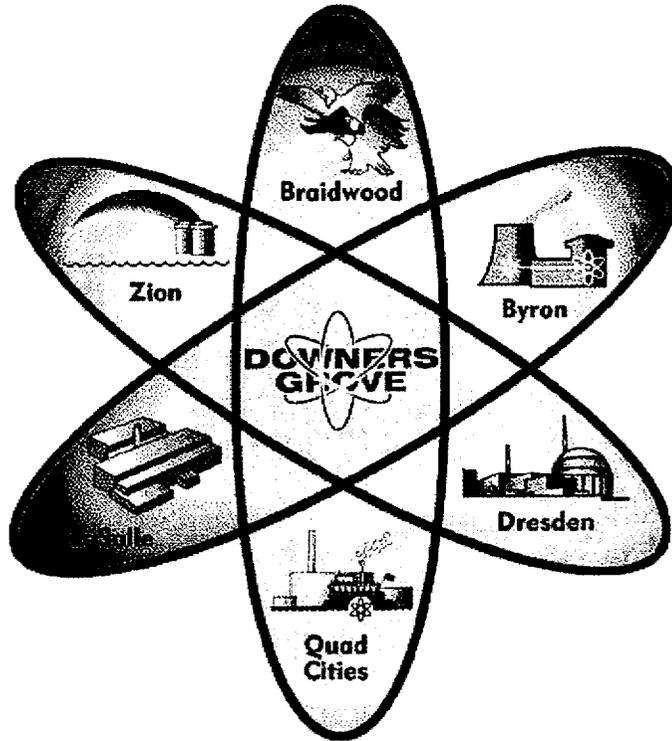

Commercial Service Date: March 10, 1973
22710 206th Avenue North
Cordova, IL 61242

Commonwealth Edison Company
P.O. Box 767
Chicago, IL 60690

Prepared by: [Signature] 4-21-00

Reviewed by: [Signature] 4-21-00

Approved by: [Signature] 4-21-00

Table of Contents

1.0 INTRODUCTION	3
1.1. OUTAGE, PERIOD AND INTERVAL START AND END DATES	3
1.2. EXAMINATION PROGRAM REQUIREMENTS	3
2.0 NIS-1 FORM	4
3.0 ABSTRACT OF EXAMINATIONS, CONDITIONS NOTED AND CORRECTIVE MEASURES.	6
3.1. SECTION XI EXAMINATIONS SUMMARY	6
3.1.1. REACTOR HEAD FLAWS	6
3.1.2. STANDBY LIQUID CONTROL SYSTEM NOZZLE INSPECTION.....	7
3.2. INVESSEL INSPECTIONS (IVI)	7
<i>Table 3.1-1</i>	8
<i>ASME Section XI Outage Scope</i>	8
<i>Table 3.1-1A</i>	12
<i>ASME Section XI Limited Coverage Summary</i>	12
<i>Table 3.1-2</i>	13
<i>Pressure Testing Summary</i>	13
<i>Table 3.1-3</i>	14
<i>Snubber Functional Tests</i>	14
<i>Table 3.1-4</i>	15
<i>Conditions Noted and Corrective Actions</i>	15
<i>Table 3.2-1</i>	16
<i>Invessel Inspection Scope</i>	16
4.0 REPAIR / REPLACEMENT SUMMARY	17
4.1. NIS-2 INDEX.....	17
<i>Table 4.1-1</i>	17
<i>NIS-2 Index</i>	17
4.2. NIS-2 FORMS.....	20

1.0 Introduction

1.1. Outage, Period and Interval Start and End Dates

This Inservice Inspection Summary Report addresses examinations performed between the end of the previous refueling outage June 22, 1997 through the end of the current refueling outage. This current refueling outage was the 15th refueling outage for Quad Cities Nuclear Power Station Unit Two. The outage started January 21, 2000 and ended February 11, 2000.

This refueling outage was the second outage during the second inspection period of the third inspection interval. The second inspection period started March 9, 1996 and ended on March 10, 2000.

This Inservice Inspection Summary Report contains the test and examinations through February 11, 2000 and is intended to close out the second inspection period.

Tests, examinations, repairs and/or replacements associated with ASME Section XI were witnessed or otherwise verified by Mr. Gordon Bosely, Mr. Duane Oakley or Mr. Raymond Spuhl. Non-ASME Section XI or augmented examinations were not witnessed or otherwise verified by Mr. Bosely, Mr. Oakley or Mr. Spuhl and are marked "Not Required" or "N/A" on the applicable examination reports. Mr. Bosely, Mr. Oakley and Mr. Spuhl are inspectors of the Hartford Steam Boiler Inspection & Insurance Company. The Hartford Regional Office is located at 2443 Warrenville Road, Lisle, Illinois, 60532-9871.

1.2. Examination Program Requirements

The examination requirements of ASME Boiler and Pressure Vessel Code, Section XI, Division 1, "Rules for Inservice Inspection of Nuclear Power Plant Components," 1989 Edition, no addenda were implemented for Class 1 and 2 components except where written relief has been granted by the NRC.

The examination requirements of ASME Boiler and Pressure Vessel Code, Section XI, Division 1, "Rules for Inservice Inspection of Nuclear Power Plant Components," 1992 Edition, with 1992 Addenda were implemented for Class MC components except where written relief has been granted by the NRC.

2.0 NIS-1 Form

FORM NIS-1 OWNER'S REPORT FOR INSERVICE INSPECTIONS
As required by the Provisions of the ASME Code Rules

1. Owner Commonwealth Edison, P.O. Box 767, Chicago, IL 60690
(Name and Address of Owner)

2. Plant Quad Cities Nuclear Power Station, 22710 206th, Ave. North, Cordova, IL 61242
(Name and Address of Owner)

3. Plant Unit Two 4. Owner Certificate of Authorization (if required) N/A

5. Commercial Service Date 3/10/73 6. National Board Number for Unit N/A

7. Components Inspected

Component or Appurtenance	Manufacturer Or Installer	Manufacturer or Installer Serial No.	State or Province No.	National Board No.
Reactor Pressure Vessel	Chicago Bridge & Iron	T-22	B0075000	N/A
Reactor Recirculation	Dravo Corp.	N/A - See Table 3.1-1	N/A	N/A
Core Spray	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Feedwater	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Main Steam	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Residual Heat Removal	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Control Rod Drive	Grinnell	N/A - See Table 3.1-1	N/A	N/A
High Pressure Coolant Injection	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Reactor Water Clean Up	Grinnell	N/A - See Table 3.1-1	N/A	N/A
Standby Liquid	Grinnell	N/A - See Table 3.1-1	N/A	N/A

Note: Supplemental sheets in form of lists, sketches, or drawings may be used, provided (1) size is 8½ in. x 11½ in., (2) information in items 1 through 6 on this report is included on each sheet, and (3) each sheet is numbered and the number of sheets is recorded at the top of this form.

FORM NIS-1 (Back)

8. Examination Dates: 6/22/97 to 2/11/00

9. Inspection Period Identification : 2nd Period - From 3/9/96 to 3/10/00

10. Inspection Interval Identification : 3rd Interval - From 3/10/93 to 3/9/03

11. Applicable Edition of Section XI 1989 Addenda None

12. Date/Revision of Inspection Plan: 3/24/99 Rev.4

13. Abstract of Examination and Tests. Include a list of examinations and tests and a statement concerning status of work required for the Inspection Plan. See Section 3.0 and Tables 3.1-1, 3.1-1A, 3.1-2, 3.1-3, 3.1-4, and 3.2-1.

14. Abstract of Results of Examinations and Tests. See Section 3.0 and Tables 3.1-1 3.1-1A, 3.1-2, 3.1-3, 3.1-4, and 3.2-1

15. Abstract of Corrective Measures. See Section 3.0 and Table 3.1-4.

We certify that a) the statement made in this report are correct, b) the examinations and tests meet Inspection Plan as required by the ASME Code, Section XI, and c) corrective measures taken conform to the ASME Code, Section XI.

Certificate of Authorization No. (if applicable) N/A Expiration Date N/A
Date APRIL 21 20 00 Signed Commonwealth Edison Co. By [Signature]
Owner

CERTIFICATE OF INSERVICE INSPECTION

I, the under signed, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State or Province of Illinois And employed by H. S. B. I. & I. Co. of Hartford, CT have inspected the components described in the Owner's Report during the period 6/22/97 To 2/11/00, and state that to the best of my knowledge and belief, the Owner has performed examinations and tests and taken corrective measures described in this Owner's Report in accordance with the Inspection Plan and as required by the ASME Code, Section XI. By signing this certificate neither the Inspector nor his employer makes any warranty, expressed or implied, concerning the examinations, tests, and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspector's Signature National Board, State, Province, and Endorsements
Date April 21, 20 00

3.0 Abstract of Examinations, Conditions Noted and Corrective Measures.

3.1. Section XI Examinations Summary

A combination of ultrasonic (UT), liquid penetrant (PT), and magnetic particle (MT) testing was performed prior to and during the 15th refueling outage on 91 ISI Program components. Examinations were performed by Lambert, MacGill, Thomas (LMT) and Commonwealth Edison (ComEd) personnel. ISI inspections comprised of 64 volumetric, 72 surface examinations. Eleven visual examinations were performed by ComEd certified personnel on Class 1 and 2 components.

Volumetric and surface examinations listed in Table 3.1-1 that did not meet coverage requirements of Section XI of the ASME Code coverage of greater than 90 percent of the specified examination volume and area, are listed in Table 3.1-1A. Supplemental examinations were performed on these components where practical to increase examination coverage. Relief requests will be generated and submitted as required by 10 CFR 50.55a(g)5(iii) and 50.55a(g)5(iv).

Volumetric and surface examinations were compared with the recorded results of previous examinations for all applicable Class 1 and 2 components.

Pressure testing VT-2 exams not related to repair/replacement activities are documented in Table 3.1-2.

ComEd performed functional tests on a total of fifteen snubbers for operability per Technical Specifications 10% sampling, Service Life Monitoring/Failure Trending Sample and ASME Section XI, Relief Request CR-09. Nine of the fifteen snubbers were ASME Section XI. All snubbers were found acceptable for continued operation. However, two (2) snubbers were degraded and not reinstalled. They were replaced with tested spare snubbers. Table 3.1-3 summarizes these inspections and the results.

Table 3.1-4 summarizes the conditions noted and measures taken to correct the conditions.

3.1.1. Reactor Head Flaws

During Q2R15 Outage, Nondestructive Examinations (NDE) were conducted on the known flaws of the Quad Cities Nuclear Power Station (QCNPS) Unit 2 Reactor Pressure Vessel (RPV) Top Head Inside Surface & Under Clad Areas, originally found during the 10th refueling outage in 1990.

These examinations, Ultrasonic Through-Wall Sizing and Visual (VT-1 & VT-3), were conducted and compared to the previous examination results of 1990, 1992 & 1995 with no changes evidenced.

The examinations were performed as committed in ComEd letter dated May 11, 1992, J. Schrage (ComEd) to T. Murley (NRC); "Results of Reactor Head Inspection: Future Reactor Head Examination Plan," and the subsequent confirmation letter from NRC dated June 23, 1992, Leonard N. Olshan (NRC) letter to T. Kovach (ComEd); "Plan for Future Examinations of the Quad Cities, Unit 2, Reactor Head."

The results have remained the same for each outage/period with no evidence of growth, increased severity or decrease in component integrity.

3.1.2 Standby Liquid Control System Nozzle Inspection

Standby Liquid Control Nozzle to Safe End weld (N10-F1) was examined in accordance with BWR Vessel and Internals Project guideline BWRVIP-27 "BWR Standby Liquid Control System/Core Plate ΔP Inspection and Flaw Evaluation Guidelines". The examinations were performed to determine if the nozzle to safe end area had developed cracks due to stress corrosion cracking (SCC). The volumetric and surface examinations performed found no evidence of cracking.

3.2. In-vessel Inspections (IVI)

To implement the requirements of the Reactor Vessel Internals Program, General Electric (GE) was contracted to perform the in-vessel inspections. The following components and assemblies were examined; Jet Pump assemblies, Core Spray Internal Piping, Core Shroud, Shroud Support and Shroud Head Hold Down Bolts. The only recordable indications were associated with Shroud Head Hold Down Bolts #5 and #6 and jet pump #15 wedge (WD-1) which showed possible signs of movement. The two Shroud Bolts were proactively replaced and the jet pump #15 scope of inspection was expanded to include the adjacent bracket weld locations, set screws, etc. as required by BWRVIP-41 "BWR Jet Pump Assembly Inspection and Flaw Evaluation Guidelines". These additional examinations were completed satisfactorily. See Table 3.2-1 for details.

In addition, the known flaws at Core Spray weld A-14A (BWRVIP-18 weld P6) were re-evaluated in accordance with BWRVIP-18 "BWR Core Spray Internals Inspection and Flaw Evaluation Guidelines". These flaws were identified during a previous outage, Q2R14 March 1997 during a ultrasonic (UT) examination. The re-evaluation demonstrated that the weld is acceptable without repair for at least 48 months of operation. Therefore, the weld was not re-examined during Q2R15 January 2000. The weld is scheduled for UT examination during Q2R16 February 2002, which is the normal inspection frequency required by BWRVIP-18 for welds examined by UT.

Table 3.1-1
Quad Cities Unit 2
ASME Section XI Outage Scope

Drawing	Component	Class	Category	Item	Inspection	Date	Results
M-3121 S02	N10 NOZ	1	B-D	B3.90	UT	01/26/2000	Acceptable
M-3121 S02	N3A IRS *	1	B-D	B3.100	UT	01/26/2000	Acceptable
M-3121 S02	N3B IRS	1	B-D	B3.100	UT	01/26/2000	Acceptable
M-3121 S02	N3B NOZ	1	B-D	B3.90	UT	01/26/2000	Acceptable
M-3121 S02	N3C IRS	1	B-D	B3.100	UT	01/28/2000	Acceptable
M-3121 S02	N3C NOZ	1	B-D	B3.90	UT	01/28/2000	Acceptable
M-3121 S02	N3D IRS	1	B-D	B3.100	UT	01/28/2000	Acceptable
M-3121 S02	N3D NOZ	1	B-D	B3.90	UT	01/28/2000	Acceptable
M-3116 S01	N10-F1	1	B-F	B5.20	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3116 S01	11-S4	1	B-J	B9.21	SURF	01/26/2000	Acceptable
M-3119 S02	1265-F18R	1	B-J	B9.40	SURF	01/25/2000	Acceptable
M-3119 S02	1265-F20	1	B-J	B9.21	SURF	01/25/2000	Acceptable
M-3119 S02	1265-F21	1	B-J	B9.40	SURF	01/25/2000	Acceptable
M-3114 S01	14A-F19	1	B-J	B9.11	UT	01/24/2000	Acceptable
					SURF	01/24/2000	Acceptable
M-3114 S02	14B-S18	1	B-J	B9.11	UT	01/24/2000	Acceptable
					SURF	01/24/2000	Acceptable
M-3111 S01	30A-F29	1	B-J	B9.11	UT	01/28/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3111 S01	30A-F32	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable
M-3111 S01	30A-S0	1	B-J	B9.11	UT	01/25/2000	Acceptable
					SURF	01/25/2000	Acceptable
M-3111 S01	30B-F35	1	B-J	B9.11	UT	01/29/2000	Acceptable
				B9.11	SURF	01/29/2000	Acceptable
M-3111 S01	30B-S10	1	B-J	B9.11	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S01	30B-S15	1	B-J	B9.31	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S01	30B-S17	1	B-J	B9.11	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S01	30B-S19	1	B-J	B9.11	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S01	30B-S20	1	B-J	B9.11	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S01	30B-S29	1	B-J	B9.11	UT	01/28/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3111 S01	30B-S7	1	B-J	B9.11	UT	01/26/2000	Acceptable
					SURF	01/26/2000	Acceptable
M-3111 S02	30C-F30	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3111 S02	30C-F32	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3111 S02	30C-S0	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable

Table 3.1-1
Quad Cities Unit 2
ASME Section XI Outage Scope

Drawing	Component	Class	Category	Item	Inspection	Date	Results
M-3111 S02	30C-S10	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3111 S02	30C-S13	1	B-J	B9.31	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3111 S02	30C-S17	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3111 S02	30C-S20	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3111 S02	30D-F22	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3111 S02	30D-F32	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable
M-3111 S02	30D-S0	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable
M-3111 S02	30D-S10	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3112 S02	32A-F14	1	B-J	B9.11	UT	01/30/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3112 S02	32A-S5	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3112 S01	32B-F11	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/28/2000	Acceptable
M-3112 S01	32B-S1	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3112 S01	32B-S5	1	B-J	B9.11	UT	01/27/2000	Acceptable
					SURF	01/27/2000	Acceptable
M-3112 S02	32D-S0	1	B-J	B9.11	UT	01/30/2000	Acceptable
					SURF	01/30/2000	Acceptable
M-3112 S01	32E-S3	1	B-J	B9.11	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable
M-3112 S01	32F-S0	1	B-J	B9.11	UT	01/30/2000	Acceptable
					SURF	01/30/2000	Acceptable
N/A	RPV INTERIOR (HEAD ONLY)	1	B-N-1	B13.10	UT	01/25/2000	Acceptable
					VT-1 & 3	01/25/2000	Acceptable
M-3136 S12	2A-1003A-2	2	C-A	C1.10	UT	01/21/2000	Acceptable
M-3141 S02	1025-48	2	C-B	C2.33	VT-2	10/13/1999	Acceptable
M-3141 S02	1025-49	2	C-B	C2.31	SURF	01/17/2000	Acceptable
M-3141 S02	1025-52	2	C-B	C2.33	VT-2	10/13/1999	Acceptable
M-3141 S02	1025-56	2	C-B	C2.33	VT-2	10/13/1999	Acceptable
M-3141 S02	1025-60	2	C-B	C2.33	VT-2	10/13/1999	Acceptable
M-3136 S12	N6A RHRHX NOZ	2	C-B	C2.33	VT-2	11/29/1999	Acceptable
M-3136 S12	N8A RHRHX NOZ	2	C-B	C2.33	VT-2	11/29/1999	Acceptable
M-3141 S02	1025-61	2	C-B	C2.31	SURF	01/17/2000	Acceptable
M-3136 S12	N8A-F1 RHRHX	2	C-B	C2.31	SURF	01/18/2000	Acceptable
M-3139 S01	0318B-W-201A	2	C-C	C3.20	SURF	01/31/2000	Acceptable
M-3136 S12	1003A-W-203A	2	C-C	C3.10	SURF	01/21/2000	Acceptable
M-3136 S07	1008A-W-203A	2	C-C	C3.20	SURF	01/13/2000	Acceptable

Table 3.1-1
Quad Cities Unit 2
ASME Section XI Outage Scope

Drawing	Component	Class	Category	Item	Inspection	Date	Results
M-3136 S04	1008B-W-202A	2	C-C	C3.20	SURF	01/19/2000	Acceptable
M-3136 S07	1010-W-204A	2	C-C	C3.20	SURF	01/18/2000	Acceptable
M-3136 S08	1012A-W-203.1A	2	C-C	C3.20	SURF	01/17/2000	Acceptable
M-3136 S03	1012B-W-203A	2	C-C	C3.20	SURF	01/20/2000	Acceptable
M-3136 S09	1024A-W-201A	2	C-C	C3.20	SURF	01/13/2000	Acceptable
M-3141 S01	1025-W-212A	2	C-C	C3.20	SURF	01/14/2000	Acceptable
M-3141 S01	1025-W-224A	2	C-C	C3.20	SURF	01/14/2000	Acceptable
M-3135 S03	1404-40	2	C-F-1	C5.11	UT	01/13/2000	Acceptable
					SURF	01/13/2000	Acceptable
M-3135 S03	1404-41	2	C-F-1	C5.11	UT	01/13/2000	Acceptable
					SURF	01/13/2000	Acceptable
M-3139 S01	0318B-2	2	C-F-2	C5.51	UT	01/30/2000	Acceptable
					SURF	01/30/2000	Acceptable
M-3139 S02	0320-2	2	C-F-2	C5.51	UT	01/30/2000	Acceptable
					SURF	01/30/2000	Acceptable
M-3139 S02	0320-5	2	C-F-2	C5.51	UT	01/30/2000	Acceptable
					SURF	01/31/2000	Acceptable
M-3139 S02	0380A-1.1	2	C-F-2	C5.81	SURF	01/31/2000	Acceptable
M-3139 S01	0380C-3	2	C-F-2	C5.51	UT	01/31/2000	Acceptable
					SURF	01/31/2000	Acceptable
M-3136 S06	1006B-2	2	C-F-2	C5.51	UT	01/13/2000	Acceptable
					SURF	01/13/2000	Acceptable
M-3136 S06	1008A-1	2	C-F-2	C5.51	UT	01/18/2000	Acceptable
					SURF	01/18/2000	Acceptable
M-3136 S06	1008A-3	2	C-F-2	C5.51	UT	01/18/2000	Acceptable
					SURF	01/18/2000	Acceptable
M-3136 S04	1008B-1	2	C-F-2	C5.51	UT	01/19/2000	Acceptable
					SURF	01/19/2000	Acceptable
M-3136 S07	1010-3	2	C-F-2	C5.51	UT	01/17/2000	Acceptable
					SURF	01/17/2000	Acceptable
M-3136 S07	1010-6	2	C-F-2	C5.51	UT	01/17/2000	Acceptable
					SURF	01/17/2000	Acceptable
M-3136 S08	1012A-1	2	C-F-2	C5.51	UT	01/21/2000	Acceptable
					SURF	01/20/2000	Acceptable
M-3136 S08	1012A-10	2	C-F-2	C5.51	UT	01/17/2000	Acceptable
					SURF	01/17/2000	Acceptable
M-3136 S03	1012B-2	2	C-F-2	C5.51	UT	01/17/2000	Acceptable
					SURF	01/17/2000	Acceptable
M-3136 S08	1013A-10	2	C-F-2	C5.51	UT	01/21/2000	Acceptable
					SURF	01/21/2000	Acceptable
M-3136 S08	1013A-8	2	C-F-2	C5.51	UT	01/21/2000	Acceptable
					SURF	01/20/2000	Acceptable
M-3136 S05	1015B-10	2	C-F-2	C5.51	UT	01/21/2000	Acceptable
					SURF	01/22/2000	Acceptable

Table 3.1-1

**Quad Cities Unit 2
ASME Section XI Outage Scope**

Drawing	Component	Class	Category	Item	Inspection	Date	Results
M-3136 S05	1016C-4	2	C-F-2	C5.51	UT	01/25/2000	Acceptable
					SURF	01/21/2000	Acceptable
M-3136 S05	1018C-1	2	C-F-2	C5.51	UT	01/19/2000	Acceptable
					SURF	01/19/2000	Acceptable
M-3137 S04	2304-31	2	C-F-2	C5.51	UT	01/29/2000	Acceptable
					SURF	01/29/2000	Acceptable
M-3141 S01	1025-M-206	2	F-A	F1.20	VT-3	01/07/2000	Acceptable
M-3141 S01	1025-M-207	2	F-A	F1.20	VT-3	01/07/2000	Acceptable
M-3141 S02	1025-M-227	2	F-A	F1.20	VT-3	01/07/2000	Acceptable

*Credit was taken for N3A Inner Radius (IRS) during the 13th refueling outage. However, the component was re-examined during the 15th refueling outage to increase coverage as committed in SVP-99-194 (Relief Request CR-32)

Table 3.1-1A
Quad Cities Unit 2
ASME Section XI Limited Coverage Summary

Drawing	Component	Class	Category	Item	Inspection	ASME % Coverage
M-3121 S02	N10 NOZ	1	B-D	B3.90	UT	58.52 *
M-3121 S02	N3B NOZ	1	B-D	B3.90	UT	29.92 **
M-3121 S02	N3C NOZ	1	B-D	B3.90	UT	29.92 **
M-3121 S02	N3D NOZ	1	B-D	B3.90	UT	29.92 **
M-3136 S03	1012B-W-203A	2	C-C	C3.20	MT	88.1
M-3136 S09	1024A-W-201A	2	C-C	C3.20	MT	85.6
M-3139 S01	0318B-W-201A	2	C-C	C3.20	MT	89.2
M-3136 S07	1008A-W-203A	2	C-C	C3.20	MT	88.1
M-3136 S08	1012A-W-203.1A	2	C-C	C3.20	MT	89.3
M-3135 S03	1404-40	2	C-F-1	C5.11	UT	88.5
M-3135 S03	1404-41	2	C-F-1	C5.11	UT	88.5
M-3136 S05	1016C-4	2	C-F-2	C5.51	UT	60.2
					MT	64.8

* Implemented supplemental examinations by using portions of applicable procedures to attain 71.23% coverage.

** Implemented supplemental examinations by using portions of applicable procedures to attain 100% coverage.

Table 3.1-2
Quad Cities Unit 2
Pressure Testing Summary

Component	Inspection	Item Number	Procedure	Exam Date	Relief Request	Remarks
Reactor Class 1 Piping	Visual, VT-2	B15.10-B15.71	QCOS 0201-08	02/08/00	PT-01, PR-09, PR-12, CR-16, CR-17	Class 1 System Leakage Test
CRD SYSTEM	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-03	04/01/98	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
2A CS & ESS Fill	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-01	07/13/99	PT-01, PT-02, PR-02, PR-04, PR-11, PR-12, CR-17	Class 2 System Leakage Test
2B Core Spray	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-01	02/12/99	PT-01, PT-02, PR-02, PR-04, PR-11, PR-12, CR-17	Class 2 System Leakage Test
2A RHR Loop	Visual, VT-2	C2.33, C7.10, C7.30, C7.50, C7.70	QCTS 0762-04	02/11/00	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
2B RHR Loop	Visual, VT-2	C2.33, C7.10, C7.30, C7.50, C7.70	QCTS 0762-04	12/17/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
SBLC Suction Piping	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-05	12/07/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
SBLC Piping To Squib Valves	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-06	12/13/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
SBLC A Pmp To Discharge Check Valve	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-06	12/07/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
SBLC B Pmp To Discharge Check Valve	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-06	12/13/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
Torus Suction Piping	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-12	10/13/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
HPCI Steam Supply	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-13	11/03/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test
HPCI Coolant Injection	Visual, VT-2	C7.10, C7.30, C7.50, C7.70	QCTS 0762-14	11/03/99	CR-17, PR-02, PR-04, PR-11, PR-12, PT-01, PT-02	Class 2 System Leakage Test

Table 3.1-3
Quad Cities Unit 2
Snubber Functional Tests

Drawing	Component	Class	Category	Item	Inspection	Date Tested	Results
M-3113 S02	0200-M-138.1	1	FA	F1.10	FT	01/21/2000	Passed
M-3113 S03	0200-W-108 A&B	1	FA	F1.40	FT	01/22/2000	Passed
M-3115 S02	1012B-W-102	1	FA	F1.10	FT	01/22/2000	Passed
M-3136 S01	1016A-M-201.1 A&B	2	FA	F1.2	FT	01/21/2000	Passed
M-3113 S03	1025-M-101 A&B	1	FA	F1.10	FT	01/25/2000	Passed
M-3113 S03	1025-M-102.1 A&B	1	FA	F1.10	FT	01/25/2000	Passed
M-3141 S01	1025-M-205	2	FA	F1.20	FT	01/26/2000	Passed
M-3114 S02	1404-W-103 A&B	1	FA	F1.10	FT	01/22/2000	Passed
M-3111 S02	3001D-M-102.1	1	FA	F1.10	FT	01/21/2000	Passed
N/A	* 2-031	N/A	N/A	N/A	FT	01/21/2000	Passed
N/A	* 2-041	N/A	N/A	N/A	FT	01/23/2000	Passed
N/A	* 2-044	N/A	N/A	N/A	FT	01/21/2000	Passed
N/A	* 2-051	N/A	N/A	N/A	FT	01/21/2000	Passed
N/A	* 2-070	N/A	N/A	N/A	FT	01/24/2000	Passed
N/A	* 2-075	N/A	N/A	N/A	FT	01/25/2000	Passed

*Component Technical Specification Number.

Table 3.1-4

**Quad Cities Unit 2
Conditions Noted and Corrective Actions**

Component ID	Description / Resolution
Pressure Test	
<p>Flange 2-1001-68A Bonnet to body flange, MO 2-1402-25A Bonnet to body flange</p> <p>“B” Recirculation Pump Casing</p> <p>CRD Flanges 22-39, 34-07, 54-15, 02-35, 22-51, 38-35, 38-55, 50-51.</p>	<p>During the Unit 2 Class 1 pressure test walk down the listed components were identified to be leaking. PIF Q2000-00682 was generated and corrective actions were taken as required.</p> <p>Corrective actions included:</p> <ul style="list-style-type: none"> • Torqued bolts on the 2-1001-68A bonnet valve and the 2-1402-25A valve. • Engineering evaluation performed by Marty Santic (System Engineer) on the 2B Recirculation Pump determined the leakage to be acceptable. • Minor leakage was evaluated for acceptability using a GE Letter and in cases of excessive leakage the CRD O Rings were replaced. Relief Request CR-16 was utilized which deletes the requirement for pulling a bolt and performing a VT-3. <p>Reference QCOS 0201-08 dated 02/08/2000 and VT report # 002V2145</p>
InVessel Inspections	
<p>Jet Pump #15</p>	<p>A recordable indication was observed at jet pump #15 wedge assembly. Specifically, jet pump #15 wedge (WD-1) showed possible signs of movement. As required by BWRVIP-41 “BWR Jet Pump Assembly Inspection and Flaw Evaluation Guidelines”, the scope of inspection was expanded to include the associated jet pump #15 bracket weld locations, set screws, etc. These additional examinations were completed satisfactorily. No additional action is required.</p>
<p>Shroud Head Hold Down Bolts #5 and #6</p>	<p>Recordable indications were observed at the Shroud Head Hold Down Bolts #5 and #6 during ultrasonic examination in accordance with GE procedure UT-QDC-501 V2 revision 1. The bolts were classified as flawed. The two bolts were proactively replaced under WR# 990070833. No additional action is required.</p>
IWE Moisture Barrier Inspections	
<p>Drywell Moisture Barrier</p>	<p>The Drywell Moisture Barrier was visually inspected and identified as defective per IWE-3513.1 standards. Portions of the Moisture Barrier were degraded. The apparent cause was age degradation (> 26 years) and environment. This was the baseline inspection required by the IWE Program.</p> <p>Corrective actions included:</p> <ul style="list-style-type: none"> • Defective Drywell Moisture Barrier was removed . • Metal Containment surfaces covered by and adjacent to the moisture barrier were visually inspected with no degradation noted. • New Drywell Moisture Barrier was installed, visually inspected and found acceptable. • To address the required sample expansion in accordance with IWE-2430, the Personnel Interlock Moisture Barrier was visually inspected and found acceptable.

Table 3.2-1
Quad Cities Unit 2
Invesel Inspection Scope

COMPONENT	REQUIREMENT	EXAMINATION METHOD	RESULTS of EXAMINATION
Core Shroud Vertical Welds (V14 – V19)	BWRVIP-63	Automated UT / ET with TEIDE II tooling	No Recordable Indications (NRI)
Core Support Structure Welds H8 & H9 (adjacent to NIB)	BWRVIP-38	EVT-1 Remote Camera	NRI
Jet Pump Assemblies (>50% of BWRVIP High & Medium Priority Welds Examined)	BWRVIP-41	Automated UT / ET with TEJET tooling or EVT-1, VT-1 or VT-3 w/Remote Camera	WD-1 movement noted at JP#15. Adjacent components at restrainer bracket examined with NRI. All other components NRI.
Jet Pump Beams (1 – 20)	BWRVIP-41	Augmented UT of center hole and beam ends	NRI
IRM / SRM Plunger Seating at Top Guide	ComEd Procedure QCAP 1700-12	VT-1	SAT
Shroud Head Hold Down Bolts (1 – 48)	GE SIL 433	Augmented UT end shot	Bolt #5 & #6 were rejected and replaced. Other bolts were NRI.
Core Spray Piping (10 welds)	BWRVIP-18	EVT-1 Remote Camera	NRI

4.0 Repair / Replacement Summary

4.1. NIS-2 Index

Table 4.1-1

Quad Cities Unit 2 NIS-2 Index			
Program Number	Component EPN	Work Request Number or Purchase Order	ASME XI Class
97-090	2-0203-3B	970091516-01	1
98-024	2-1412-3/4"-A	980020097-02	1
98-026	2-1413-3/4"-A	980034144-01	1
98-028	2-02108AA-1"	980034528-01	1
98-029	2-0756-48-09	980034504-01	1
98-030	2-1411-3/4"-A	980020097-01	1
98-031	2-1414-3/4"-A	980034144-02	1
98-038	2-0263-2-42B	980034782-01	1
98-044	2-0220-44	970104149-03	1
98-128	2-0210B-3/4"-A	980105261-01	1
98-129	2-1084A-3/4"-A	980105264-02	1
98-178	2-0305-107	980065861-02	1
99-004	2-1423B-3/4"	980116347-01	1
99-005	2-0203-4F	960102523-01	1
99-006	2-0203-4B	970084069-01	1
99-007	2-0203-4H	980109559-01	1
99-008	2-0203-4C	980121988-01	1
99-009	2-0203-4D	980121989-01	1
99-010	2-0203-4E	960102169-01	1
99-011	2-0203-4G	980109560-01	1
99-012	2-0203-4A	970084068-01	1
99-013	2-0203-3A	970099043-01	1
99-019	2-0305-107	980065876-02	1
99-021 & 99-024	2-0300-38-23	990014784-01	1
99-025	2-02106A-1/2"-A	980120984-05	1
99-026	2-02106B-1/2"-A	980121583-05	1
99-066	2-0300-22-43	990075236-26	1
99-068	2-0300-02-31	990075236-01	1
99-070	2-0300-02-35	990075236-02	1
99-071	2-0300-06-23	990075236-03	1
99-072	2-0300-06-43	990075236-04	1
99-073	2-0300-10-11	990075236-05	1
99-075	2-0300-34-07	990075236-11	1
99-076	2-0300-26-51	990075236-09	1
99-077	2-0300-34-03	990075236-10	1
99-078	2-0300-26-47	990075236-08	1
99-079	2-0300-22-51	990075236-07	1
99-080	2-0300-34-15	990075236-12	1

Table 4.1-1
Quad Cities Unit 2
NIS-2 Index

Program Number	Component EPN	Work Request Number or Purchase Order	ASME XI Class
99-081	2-0300-34-55	990075236-13	1
99-082	2-0300-34-59	990075236-14	1
99-083	2-0300-38-51	990075236-15	1
99-084	2-0300-38-59	990075236-17	1
99-085	2-0300-38-55	990075236-16	1
99-086	2-0300-42-51	990075236-18	1
99-087	2-0300-46-55	990075236-19	1
99-088	2-0300-50-23	990075236-20	1
99-089	2-0300-50-51	990075236-21	1
99-090	2-0300-58-39	990075236-25	1
99-091	2-0300-58-23	990075236-24	1
99-092	2-0300-54-43	990075236-23	1
99-093	2-0300-54-15	990075236-22	1
99-095	2-0300-10-19	990075236-06	1
99-100	2-0300-02-27	990075236-27	1
99-101	2-0300-42-47	990075236-28	1
99-114	2-0203-4G	990070545-01	1
99-115	2-0203-4D	990070540-01	1
99-116	2-0203-4H	990070547-01	1
99-117	2-0203-4C	990070538-01	1
99-123	2-0201-1	990070833-02	1
00-001	2-0203-3A	990028837-01	1
00-010	2-1025-85	990019629-01	1
00-011	2-0203-3C	970092139-01	1
00-012	2-0203-3D	990032941-01	1
00-017	M-1022D-264	990139404-01	1
00-019	2-0220-58A	990078220-01	1
00-022	0-Spare-D15	PO 118205-QC-2	1
00-023	0-Spare-D15	PO 118205-QC-2	1
00-024	0-Spare-D15	PO 118205-QC-2	1
00-025	0-Spare-D15	PO 118205-QC-2	1
00-026	0-Spare-D15	PO 118205-QC-2	1
00-027	2-0300-38-55	990143339-01	1
00-028	2-0300-50-51	990143333-01	1
00-035	2-1404-9B	990072574-01	1
00-037	2-300-30-15	990137952-01	1
97-082	2-1106B	970085421-01	2
97-083	2-2301-68	970074822-01	2
98-012	2-1402-41A	970086431-01	2
99-001	2-1106-A	980124828-03	2
99-002	2-1106-A	980124828-02	2
99-027	2-2301-23	970034798-01	2
99-039	2-1106B	990027558-02	2
99-047	2-1001-67A	990008332-01	2
99-053	2-1402-24A	930061600-01	2
99-067	2-1101-16	960036266-01	2

Table 4.1-1
Quad Cities Unit 2
NIS-2 Index

Program Number	Component EPN	Work Request Number or Purchase Order	ASME XI Class
99-106	2-1099-167	990077619-02	2
99-107	2-2301	9900542115-01	2
99-110	2-1106-B	990027558-03	2
99-111	2-1402-65B	970057340-01	2
99-122	2-2344-3/4 th -LX	990054215-04	2
99-124	2-2906-4-B	990036180-01	2
00-004	2-2301-23	990077271-01	2
00-005	2-2301-45	980028460-01	2
00-013	2-1301-17	990137421-05	2
00-016	2-1001-26A	990139750-01	2
00-021	2-2323-1	990127499-02	2

Commonwealth Edison
P.O. Box 767
Chicago, IL 60690
Commercial Service Date March 10, 1973

Quad Cities Nuclear Power Station
Unit 2
22710 206th Avenue North
Cordova, IL 61242

4.2. NIS-2 Forms

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 97-90 WR# 970091516-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-16-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1989 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Target Rock	3	N/A	2-0203-3B	UNK	Replaced	Yes
Safety Valve	Target Rock	4	N/A	2-0203-3B	UNK	Replacement	Yes

7. Description of Work: Removed and replaced the Target Rock valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1011 psi Test Temp. 209 °F

9. Remarks: Performed a VT-2 during the Class 1 Leakage Test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MAY 14 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 9-30-97 to 5-17-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 26 503
Inspectors Signature National Board, State, Province, and Endorsements

Date May 12 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-024 WR# 980020097-02

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02/24/1999
Sheet: 1 of 1
Unit: 2

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3 Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Core Spray, Class 1.

5 (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-1412-3/4"-A	N/A	Replacement	No

7 Description of Work: Cut and rerout test tap piping as required by DCP 9800070 and WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 100 psi Test Temp. 78.4 °F

9 Remarks: Pressure tested the rerouted 3/4" core spray line.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 24 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-7-98 to 3-25-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 26971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-25-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-026 WR# 980034144-01

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 04-23-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-1413-3/4"-A	N/A	Replacement	No

7. Description of Work: Cut and rerouted test taps as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replacement components are exempt from pressure testing due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date April 24 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4/7/98 to 4/17/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17 19 00
200411100

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-028 WR# 980034528-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-13-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Recirculation System, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-02108AA-1"-A	N/A	Replaced	No

7. Description of Work: Replaced elbow, pipe, coupling as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: NDE was performed on all replacement welds.
No pressure testing required due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR ISE GROUP Date APRIL 14 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-3-98 to 5-4-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 22871
Inspectors Signature National Board, State, Province, and Endorsements

Date 5-4-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-029 WR# 980034504-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/27/1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Neutron Monitoring, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
LPRM Flange	GE	N/A	N/A	2-0756-48-09 2-0756-48-49	N/A	Replacements	No

7. Description of Work: Replaced the flange bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure N/A psi Test Temp. N/A °F

9. Remarks: Performed a VT-1 on replaced bolting.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] for ISI GROUP Date MAY 3 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4/8/98 to 5/13/98, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 22903
Inspectors Signature National Board, State, Province, and Endorsements

Date 11/19/99 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-030 WR# 980020097-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3 Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 02/24/1999
Sheet: 1 of 1
Unit: 2

ComEd

Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Core Spray, Class 1.

5 (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-1411-3/4"-A	N/A	Replacement	No

7 Description of Work: Cut and rerout test tap piping as required by DCP 9800070 and WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 100 psi Test Temp. 78.4 °F

9 Remarks: Pressure tested the rerouted 3/4" core spray line.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *[Signature]* Date FEBRUARY 24 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-7-98 to 3-25-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Gordon Boskey *[Signature]* Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-25-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-038 WR# 980034782-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 04/08/1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Reactor Vessel Water Level Instrument Piping, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Excess Flow Check Valve	Chemiquip Products Co.	50FM-920704	N/A	2-0263-2-42B	N/A	Replacement	No

7. Description of Work: Replaced check valve, pipe, and union by welding as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure N/A psi Test Temp. N/A °F

9. Remarks: Replacement components are exempt from ASME Section XI replacement/pressure test requirements.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date APRIL 6 19 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-13-98 to 4-6-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 20903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 6, 2000

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-044 WR# 970104149-03

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/07/1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Globe Valve	Copes Vulcan	9220-97330-2-1	N/A	2-0220-44	N/A	Replacement	No

7. Description of Work: Replaced valve, pipe, coupling by welding as required by DCP 9700341 and WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure N/A psi Test Temp. N/A °F

9. Remarks: Exempt from pressure testing due to size in accordance with IWA-4700(b)(5).

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. QA Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date APRIL 10 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 10/14/97 to 5/26/99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 20903
Inspectors Signature National Board, State, Province, and Endorsements

Date MAY 26 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-128 WR# 980105261-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02/26/1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd

Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Recirculation Piping, Class 1

5. (a) Applicable Construction Code: USAS B31.1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping/Union	Various	N/A	N/A	2-0210B-3/4"-A	N/A	Replacement	No
Valves	Dresser	N/A	N/A	2-0262-2-1B 2-0262-2-2B	N/A	Replacement	No

7. Description of Work: Replaced piping and valves associated with the drain line as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replaced components are exempt from ASME Section XI replacement/pressure tests requirements.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 26 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 10-9-98 to 3-23-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-23-19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-129 WR# 980105264-02

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-05-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Residual Heat Removal, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Pipe	Various	N/A	N/A	2-1084A-3/4"-A	N/A	Replacement	No
Valves	Dresser	N/A	N/A	2-1001-164A 2-1001-164B 2-1001-164C	N/A	Replacement	No

7. Description of Work: Replaced piping and valves associated with the drain line as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replaced components are exempt from ASME Section XI replacement/pressure testing requirements.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ESI GROUP Date MARCH 6 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-15-99 to 3-23-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL971
National Board, State, Province, and Endorsements

Date 3-23-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-178 WR# 980065861-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 05-06-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Hydraulic Control Unit, Class 1

5. (a) Applicable Construction Code: ASA B31.1 1955 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Valve	GE	6-217370	N/A	2-0305-107	N/A	Replacement	No

7. Description of Work: Cut out and replaced the CRD accum vent valve as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR THE GROUP Date MAY 6 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-5-99 to 5-13-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 22903
Inspectors Signature National Board, State, Province, and Endorsements

Date MAY 13 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-04 WR# 980116347-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-05-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-1423B-3/4"	N/A	Replacement	No
Valves	Dresser	N/A	N/A	2-1402-29B, 2-1402-26B, 2-1402-35B	N/A	Replacement	No

Description of Work: Replaced piping and valves associated with the drain line as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replaced components are exempt from ASME Section XI replacement/pressure testing requirements.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-21-99 to 3-25-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL 971
National Board, State, Province, and Endorsements

Date 3/25/1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-005 WR# 960102523-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3 Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Main Steam, Class 1

5 (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Consolidated	BK 6306	N/A	2-0203-4F	UNK	Replaced	Yes
Safety Valve	Consolidated	BK 6529	N/A	2-0203-4F	UNK	Replacement	Yes

7 Description of Work: Replaced safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9 Remarks: Performed a VT-1 on replaced bolting
Performed a VT-2 on replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR, ISE GROUP Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL971
National Board, State, Province, and Endorsements

Date 3-11-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-006 WR# 970084069-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class I

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Consolidated	BK7159	N/A	2-0203-4B	UNK	Replaced	Yes
Safety Valve	Consolidated	BK6531	N/A	2-0203-4B	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on the replaced bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *[Signature]* Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11 1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-007 WR# 980109559-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-02-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BK 7158	N/A	2-0203-4H	UNK	Replaced	Yes
Safety Valve	Dresser	BK 6251	N/A	2-0203-4H	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on all replaced bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this Replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-008 WR# 980121988-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BK 7164	N/A	2-0203-4C	UNK	Replaced	Yes
Safety Valve	Dresser	BK 6318	N/A	2-0203-4C	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on replaced bolting.
Performed a VT-2 on replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 5 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-18-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL971
National Board, State, Province, and Endorsements

Date 3-18-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-009 WR# 980121989-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dersser	BK 6294	N/A	2-0203-4D	UNK	Replaced	Yes
Safety Valve	Dresser	BL 1132	N/A	2-0203-4D	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on replaced bolting.
Performed a VT-2 on replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR ISE GROUP Date MARCH 5 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-18-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL971
National Board, State, Province, and Endorsements

Date 3-18 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-010 WR# 960102169-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Consolidated	BL 2467	N/A	2-0203-4E	UNK	Replaced	Yes
Safety Valve	Consolidated	BL 2471	N/A	2-0203-4E	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on the replaced bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. O A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-011 WR# 980109560-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-02-1999
Sheet: 1 of 1
Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BK 6252	N/A	2-0203-4G	UNK	Replaced	Yes
Safety Valve	Dresser	BL 1120	N/A	2-0203-4G	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and flange bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on all replaced bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *J. M. For...* Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Gordon Bosley Commissions 2L971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-012 WR# 970084068-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, S-1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Consolidated	BK 7156	N/A	2-0203-4A	UNK	Replaced	Yes
Safety Valve	Consolidated	BK 6295	N/A	2-0203-4A	UNK	Replacement	Yes

7. Description of Work: Replaced the safety valve and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on all replaced bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *J. W. ...* Date MARCH 5 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-22-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Gordon Bosley Commissions IL 971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11- 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-013 WR# 970099043-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-03-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1968 Edition, W-1968 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Relief	Target Rock	172	N/A	2-0203-3A	UNK	Replaced	Yes
Safety Relief	Target Rock	198	N/A	2-0203-3A	UNK	Replacement	Yes

7. Description of Work: Replaced the safety relief and bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed a VT-1 on replaced bolting and a VT-3 on original bolts (in case of flange leakage during pressure test).
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date MARCH 5 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-21-99 to 3-11-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions DL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-11- 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-019 WR# 980065876-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 05-06-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Hydraulic Control Unit, Class 1

5. (a) Applicable Construction Code: ASA B31.1 1955 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Valve	GE	14-217370	N/A	2-0305-107	N/A	Replacement	No

7. Description of Work: Cut out and replaced the CRD accum. vent valve as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date May 6 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-15-99 to 5-13-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 22903
National Board, State, Province, and Endorsements

Date May 13 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-021 & 99-024 WR# 990014784-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-02-1999
Sheet: 1 of 1
Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1.

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, W-1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	560	N/A	2-0300-38-23	1968	Replaced	Yes
Control Rod Drive	GE	406	N/A	2-0300-38-23	1968	Replacement	Yes

7. Description of Work: Replaced the control rod drive and associated bolting in accordance with the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1005 psi Test Temp. 532.5 °F

9. Remarks: Performed VT-1 on replaced capscrews.
VT-2 was performed on replaced drive.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 5 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-15-99 to 3-16-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3-16-1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-025 WR# 980120984-05

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-04-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Recirculation System, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-02106A-1/2"-A	N/A	Replacement	No

7. Description of Work: Cut and replaced piping by welding as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replacement is exempt from ASME Section XI pressure testing requirements based on size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date March 5 1999
Owner of Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-26-99 to 3-24-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 971
Inspectors Signature National Board, State, Province, and Endorsements

Date 3/24/1999

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-026 WR# 980121583-05

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 03-04-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Recirculation System, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-02106B-1/2"-A	N/A	Replacement	No

7. Description of Work: Cut and replaced piping by welding as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replacement is exempt from ASME Section XI pressure testing requirements based on size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date MARCH 9 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-20-99 to 3-24-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or rty damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL 971
National Board, State, Province, and Endorsements
Date 3/24/ 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-031 WR# 980034144-02

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-23-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-1414-3/4"-A	N/A	Replacement	No

7. Description of Work: Cut and rerouted test taps as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Replacement components are exempt from pressure testing due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date APRIL 24 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-7-99 to 4-17-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 2907
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17 19 00
1120 11/160

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-066 WR# 990075236-26

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	563A	N/A	2-0300-22-43	UNK.	Replaced	Yes
Control Rod Drive	GE	A9000	N/A	2-0300-22-43	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 2 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 7-21-89 to 3-2-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date MARCH 2, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-068 WR# 990075236-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	213	N/A	2-0300-02-31	UNK.	Replaced	Yes
Control Rod Drive	GE	A3274	N/A	2-0300-02-31	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 7-21-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 26923
National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-070 WR# 990075236-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A2486	N/A	2-0300-02-35	UNK.	Replaced	Yes
Control Rod Drive	GE	A5020	N/A	2-0300-02-35	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-4-99 to 2-24-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 26903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb-29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-071 WR# 990075236-03

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A2242	N/A	2-0300-06-23	UNK.	Replaced	Yes
Control Rod Drive	GE	A8649	N/A	2-0300-06-23	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-3-95 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions HP03
Inspectors Signature National Board, State, Province, and Endorsements

Date FEB 29, 2000

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-072 WR# 990075236-04

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A2284	N/A	2-0300-06-43	UNK.	Replaced	Yes
Control Rod Drive	GE	A2248	N/A	2-0300-06-43	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/13/99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL 903
National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-073 WR# 990075236-05

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A3940	N/A	2-0300-10-11	UNK.	Replaced	Yes
Control Rod Drive	GE	A5358	N/A	2-0300-10-11	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] IAE GROUP Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-13-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 28503
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb-29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-075 WR# 990075236-11

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	583	N/A	2-0300-34-07	UNK.	Replaced	Yes
Control Rod Drive	GE	354	N/A	2-0300-34-07	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 11903
National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-076 WR# 990075236-09

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	9559	N/A	2-0300-26-51	UNK.	Replaced	Yes
Control Rod Drive	GE	1028	N/A	2-0300-26-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-9-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions Illinois
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-077 WR# 990075236-10

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	2061	N/A	2-0300-34-03	UNK.	Replaced	Yes
Control Rod Drive	GE	7493	N/A	2-0300-34-03	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions [Signature]
National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-078 WR# 990075236-08

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	1315	N/A	2-0300-26-47	UNK.	Replaced	Yes
Control Rod Drive	GE	912	N/A	2-0300-26-47	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-9-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 21903
National Board, State, Province, and Endorsements

Date Feb 29 2000

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-079 WR# 990075236-07

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	1019	N/A	2-0300-22-51	UNK.	Replaced	Yes
Control Rod Drive	GE	6539	N/A	2-0300-22-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 21903
National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-080 WR# 990075236-12

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	407	N/A	2-0300-34-15	UNK.	Replaced	Yes
Control Rod Drive	GE	A8220	N/A	2-0300-34-15	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] 1ST GROUP Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IP 903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-081 WR# 990075236-13

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A9019	N/A	2-0300-34-55	UNK.	Replaced	Yes
Control Rod Drive	GE	1098	N/A	2-0300-34-55	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *J. M. For...* Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

J. S. Oakley Commissions 28903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb-29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-082 WR# 990075236-14

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A9034	N/A	2-0300-34-59	UNK.	Replaced	Yes
Control Rod Drive	GE	7215	N/A	2-0300-34-59	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *J. M. Walsh* Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance with the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

C. S. Oakley Commissions *IL 903*
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-083 WR# 990075236-15

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	503	N/A	2-0300-38-51	UNK.	Replaced	Yes
Control Rod Drive	GE	A3466	N/A	2-0300-38-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions H 903
National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-084 WR# 990075236-17

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	1893	N/A	2-0300-38-59	UNK.	Replaced	Yes
Control Rod Drive	GE	1022	N/A	2-0300-38-59	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/10/99 to 2/29/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions HL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-085 WR# 990075236-16

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	535A	N/A	2-0300-38-55	UNK.	Replaced	Yes
Control Rod Drive	GE	A4708	N/A	2-0300-38-55	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR THE GROUP Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21913
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 27, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-086 WR# 990075236-18

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690
Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242
ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242
Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	8603	N/A	2-0300-42-51	UNK.	Replaced	Yes
Control Rod Drive	GE	9220	N/A	2-0300-42-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date FEBRUARY 21 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/16/99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-087 WR# 990075236-19

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	185	N/A	2-0300-46-55	UNK.	Replaced	Yes
Control Rod Drive	GE	1669	N/A	2-0300-46-55	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 21 20 00
Owner or Owner's Designee, Title ISI GROUP

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 21903
National Board, State, Province, and Endorsements

Date Feb-27 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-088 WR# 990075236-20

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A5116	N/A	2-0300-50-23	UNK.	Replaced	Yes
Control Rod Drive	GE	285	N/A	2-0300-50-23	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed *[Signature]* Date FEBRUARY 21 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions AL503
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-089 WR# 990075236-21

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	2039	N/A	2-0300-50-51	UNK.	Replaced	Yes
Control Rod Drive	GE	713	N/A	2-0300-50-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 21 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 21903
National Board, State, Province, and Endorsements

Date 2-29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-090 WR# 990075236-25

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	345	N/A	2-0300-58-39	UNK.	Replaced	Yes
Control Rod Drive	GE	342	N/A	2-0300-58-39	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR ISE GROUP Date FEBRUARY 17 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/09/99 to 2/29/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions MS913
Inspector's Signature National Board, State, Province, and Endorsements

Date Feb-29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-091 WR# 990075236-24

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A8357	N/A	2-0300-58-23	UNK.	Replaced	Yes
Control Rod Drive	GE	586	N/A	2-0300-58-23	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 17 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-09-99 to 1-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 11903
Inspectors Signature National Board, State, Province, and Endorsements

Date FEB 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-092 WR# 990075236-23

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A8733	N/A	2-0300-54-43	UNK.	Replaced	Yes
Control Rod Drive	GE	1055	N/A	2-0300-54-43	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 21 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-10-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions [Signature]
National Board, State, Province, and Endorsements

Date FEB 29 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-093 WR# 990075236-22

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	8140	N/A	2-0300-54-15	UNK.	Replaced	Yes
Control Rod Drive	GE	9174	N/A	2-0300-54-15	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 17 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/10/99 to 2/29/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb-29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-095 WR# 990075236-06

1. Owner: Commonwealth Edison
 P.O. Box 767, Chicago, IL 60690
 Date: 02-17-2000
 Sheet: 1 of 1
 Unit: 2

2. Plant: Quad Cities Nuclear Power Station
 22710 206th Ave. North, Cordova, IL 61242
 ComEd
 Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
 22710 206th Ave. North, Cordova, IL 61242
 Type Code Symbol Stamp: N/A
 Authorization No.: N/A
 Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
 (b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	1206	N/A	2-0300-10-19	UNK.	Replaced	Yes
Control Rod Drive	GE	99	N/A	2-0300-10-19	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
 Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive.
The replacement CRD was rebuilt under PO 118205 QC 2.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
 repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 22 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8-9-99 to 2-29-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 27, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-100 WR# 990075236-27

1. Owner: Commonwealth Edison
 P.O. Box 767, Chicago, IL 60690
 Date: 02-17-2000
 Sheet: 1 of 1
 Unit: 2

2. Plant: Quad Cities Nuclear Power Station
 22710 206th Ave. North, Cordova, IL 61242
 ComEd
 Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
 22710 206th Ave. North, Cordova, IL 61242
 Type Code Symbol Stamp: N/A
 Authorization No.: N/A
 Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
 (b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A3516	N/A	2-0300-02-27	UNK.	Replaced	Yes
Control Rod Drive	GE	A8969	N/A	2-0300-02-27	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
 Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
 repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 17 20 00
 Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 9/24/99 to 2/29/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions SL 923
 Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-101 WR# 990075236-28

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-17-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	8292	N/A	2-0300-42-47	UNK.	Replaced	Yes
Control Rod Drive	GE	967	N/A	2-0300-42-47	UNK.	Replacement	Yes

7. Description of Work: Replaced the control rod drive and bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on the cap screws and a VT-2 on the replacement drive
The replacement CRD was rebuilt under PO 118205 QC 2

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 17 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2/24/99 to 2/29/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 28903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 29, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-114 WR# 990070545-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-11-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Summer 1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BL1120	N/A	2-0203-4G	UNK.	Replaced	Yes
Safety Valve	Dresser	BK6306	N/A	2-0203-4G	UNK.	Replacement	Yes

7. Description of Work: Replaced the safety valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on all bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 15 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12/27/99 to 2/21/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance with the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 8903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 21, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-115 WR# 990070540-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-11-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Summer 1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BL1132	N/A	2-0203-4D	UNK.	Replaced	Yes
Safety Valve	Dresser	BK6294	N/A	2-0203-4D	UNK.	Replacement	Yes

7. Description of Work: Replaced the safety valve as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on all the bolting.
Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 12 20 00
Owner or Owner's Designee, Title IST GROUP

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12/27/99 to 2/21/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 21, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-116 WR# 990070547-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 2-11-2000
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Summer 1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BK6251	N/A	2-0203-4H	UNK.	Replaced	Yes
Safety Valve	Dresser	BK7158	N/A	2-0203-4H	UNK.	Replacement	Yes

7. Description of Work: Replaced the safety valve as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-1 on all the bolting.
Performed a VT-2 on the replacement valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 12 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12/29/99 to 2/21/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 10903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 21, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-117 WR# 990070538-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-15-2000
Sheet: 1 of 1
Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Summer 1966 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Dresser	BK 6318	N/A	2-0203-4C	UNK.	Replaced	Yes
Safety Valve	Dresser	BK 7156	N/A	2-0203-4C	UNK.	Replacement	Yes

7. Description of Work: Replaced the safety valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-2 on the replaced safety valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 15 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12/27/99 to 2/22/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions SI 903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 22, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-123 WR# 990070833-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-23-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Reactor Head Vent, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Flange Bolting	Various	Various	N/A	2-0201-1	N/A	Replacement	No

7. Description of Work: Replaced the Reactor Head Vent flange bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-1 inspection on the replacement flange bolting.
No pressure testing required.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR, ISI GROUP Date FEBRUARY 24 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-7-00 to 4-20-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 22903
National Board, State, Province, and Endorsements

Date April 20 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-001 WR# 990028837-01

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-15-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1968 Edition, Winter 1968 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Target Rock	198	N/A	2-0203-3A	UNK.	Replaced	Yes
Safety Valve	Target Rock	120	N/A	2-0203-3A	UNK.	Replacement	Yes

7. Description of Work: Replaced the Target Rock valve, stud and nuts as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-2 on the replacement valve.
Performed a VT-1 on replacement bolting.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 17 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/16/00 to 2/22/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 22, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-010 WR# 990019629-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 3-20-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Residual Heat Removal, Class 1

5. (a) Applicable Construction Code: ASME Section III 1974 Edition, Summer 1974 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Snubber	PSA	24460	N/A	2-1025-85	UNK.	Replaced	Yes
Snubber	PSA	8800	N/A	2-1025-85	UNK.	Replacement	Yes

7. Description of Work: Removed and replace snubber as required by the WR.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-3 on the replaced snubber.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. O A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 23 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-25-00 to 4-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 11, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-011 WR# 970092139-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690
Date: 02-15-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242
ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242
Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1989 Edition, N/A Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Relief Valve	Target Rock	5	N/A	2-0203-3C	UNK.	Replaced	Yes
Relief Valve	Target Rock	2	N/A	2-0203-3C	UNK.	Replacement	Yes

7. Description of Work: Replaced the PORV valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-2 inspection on the replacement valve.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date FEBRUARY 15 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/27/00 to 2/21/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions [Signature]
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb 21, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-012 WR# 990032941-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-12-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Main Steam, Class 1

5. (a) Applicable Construction Code: ASME Section III 1989 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Safety Valve	Target Rock	8	N/A	2-0203-3D	UNK	Replaced	Yes
Safety Valve	Target Rock	7	N/A	2-0203-3D	UNK	Replacement	Yes

7. Description of Work: Removed and replaced the Target Rock valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1016 psi Test Temp. 186 °F

9. Remarks: Performed a VT-2 during the Class 1 Leakage Test.
Performed a VT-1 on all bolting.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 15 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/27/00 to 2/21/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions SI 963
Inspectors Signature National Board, State, Province, and Endorsements

Date Feb. 21, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-017 WR# 990139404-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-24-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Recirculation System, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Constant Support	Berg Patterson	CSE	N/A	M-1022D-264	N/A	Replacement	No

7. Description of Work: Replaced the load pin, adjusted the strut and reset the cold position as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-3 inspection on constant support.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 2 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-4-00 to 4-17-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-019 WR# 990078220-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-24-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Reactor Feed, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Trim Set	Crane	N/A	N/A	2-0220-58A	UNK.	Replacement	No

7. Description of Work: Replaced the trim set as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 48 psi Test Temp. Ambiant °F

9. Remarks: Performed a VT-3, a LLRT test and the valve was VT-2 examined during the System Leakage Test (1016 psi & 186 deg F). The trim was refurbished under WR# 980126563-01.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date MARCH 2 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-4-00 to 4-12-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 12, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-022

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 2-6-2000
Sheet: 1 of 1
Unit: 0

GE Nuclear Energy PO 118205-QC-2
Repair Organization P.O. No., Job No., etc.

3 Work Performed by: GE Nuclear Energy
Nuclear Plant Services Department
2015 Spring Road, Suite 409 Oak Brook, IL 60522

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Control Rod Drive, Class 1

5 (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, None Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	General Electric	342	N/A	0-Spare-D15	N/A	Replacement	Yes

7 Description of Work: Replaced the piston tube as required by the PO.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9 Remarks: The piston tube was reused from rejected tube and flange DR 1647
The Control Rod Drive was returned to ComEd stores.

CERTIFICATE OF COMPLIANCE

I certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. QA Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 11 20 00
Owner or Owner's Designee, Title ISI GROUP

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors of the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 2-11-00, and state that to the best of my knowledge and belief the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspector's Signature [Signature] Commissions 21903
National Board, State, Province, and Endorsements

Date Feb 11 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-025

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-6-2000
Sheet: 1 of 1
Unit: 0

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

GE Nuclear Energy PO 118205-QC-2
Repair Organization P.O. No., Job No., etc

3. Work Performed by: GE Nuclear Energy
Nuclear Plant Services Department
2015 Spring Road, Suite 409 Oak Brook, IL 60522

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, None Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	General Electric	1022	N/A	0-Spare-D15	N/A	Replacement	Yes

7. Description of Work: Replaced the piston tube as required by the PO.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: The piston tube was reused from rejected tube and flange DR 782.
The Control Rod Drive was returned to ComEd stores.

CERTIFICATE OF COMPLIANCE

I certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 11 20 00
Owner of Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 2-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 903
Inspector's Signature National Board, State, Province, and Endorsements

Date FEB 11, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 REVISION 6 CGE

Program # 00-024

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-6-2000
Sheet: 1 of 1
Unit: 0

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

GE Nuclear Energy PO 118205-QC-2
Repair Organization P.O. No., Job No., etc.

3 Work Performed by: GE Nuclear Energy
Nuclear Plant Service Department
—2015 Spring Road Suite 409 Oak Brook, IL 60522

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Control Rod Drive, Class 1

5 (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, None Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	General Electric	285	N/A	0-Spare-D15	N/A	Replacement	Yes

7 Description of Work: Replaced the piston tube as required by the PO.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9 Remarks: The piston tube was reused from rejected tube and flange DR 21
The Control Rod Drives were returned to ComEd stores.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Date of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date FEBRUARY 11 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors in the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 2-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 11903
Inspector's Signature National Board State, Provincial and Endorsements

Feb 11 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-025

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-6-2000
Sheet: 1 of 1
Unit: 0

Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

GE Nuclear Energy PO 118205 QC-2
Repair Organization P.O. No., Job No., etc.

Work Performed by: GE Nuclear Energy
Nuclear Plant Service Department
2015 Spring Road Suite 409 Oak Brook, IL 60522

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

1. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, None Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	General Electric	A8649	N/A	0-Spare-D15	N/A	Replacement	Yes

7. Description of Work: Replaced the piston tube as required by the PO.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

Remarks: The piston tube was reused from rejected tube and flange DR 229A
The Control Rod Drive was returned to ComEd stores.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

signed [Signature] Date FEBRUARY 19 19 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 2-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspector's Signature [Signature] Commissions IL 903
National Board, State, Province, and Endorsements
Date Feb 11 2000

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-026

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-6-2000
Sheet: 1 of 1
Unit: 0

Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

GE Nuclear Energy PO 118205 QC-2
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: GE Nuclear Energy
Nuclear Plant Services Department
— 2015 Spring Road Suite 409 Oak Brook, IL 60522

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, None Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	General Electric	66	N/A	N/A	N/A	Replaced	Yes
Control Rod Drive	General Electric	1669	N/A	0-Spare-D15	N/A	Replacement	Yes

7. Description of Work: Replaced the tube and flange as required by the PO.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9 Remarks: The Control Rod Drive was returned to ComEd stores.

CERTIFICATE OF COMPLIANCE

I, _____, certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date FEBRUARY 09 19 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 2-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspector's Signature [Signature] Commissions 28903
National Board, State, Province, and Endorsements

Date Feb 11, 2000
also initial

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-027 WR# 990143339-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 2-22-2000
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1977 Edition, Summer 1977 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A4708	N/A	2-0300-38-55	UNK.	Replacement	Yes

7. Description of Work: Replaced the CRD cap screws as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-1 on the replacement cap screws.
No pressure testing required

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 23 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 4-17-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-028 WR# 990143333-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 2-22-2000
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1977 Edition, Summer 1977 Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	713	N/A	2-0300-50-51	UNK.	Replacement	Yes

7. Description of Work: Replaced the CRD cap screws as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-1 on the replacement cap screws.
No pressure testing required.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date FEBRUARY 23 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-8-00 to 4/17/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-035 WR# 990072574-01 (Q10704)

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/10/2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 1

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Testable check	Rockwell	N/A	N/A	2-1402-9B	N/A	Replacement	No

7. Description of Work: Removal of air operator from Core Spray testable check valve as required by the modification E-04-2-93-216 and accordance with the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1030 psi Test Temp. Less than 212 °F

9. Remarks: Performed a VT-2 during the system leakage test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR IST GROUP Date APRIL 13 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12/4/93 to 4/17/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 22963
Inspectors Signature National Board, State, Province, and Endorsements

Date April 17 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-037 WR# 990137952-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/14/2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Control Rod Drive, Class 1

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, Winter 1965 Addenda, 1361 Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Control Rod Drive	GE	A4585	N/A	2-300-30-15	UNK	Replacement	Yes

7. Description of Work: Replaced the bolting as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a VT-1 on the cap screws.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date APRIL 18 19 2000
Owner or Owner's Designee, Title gww

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-19-00 to 4-20-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 20, 19 2000
2004/6/10

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 97-082 WR# 970085421-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-26-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Stand By Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Inlet Plug	Contax	503619	N/A	2-1106B	N/A	Replacement	No
Trigger Assembly	Contax	81	N/A	2-1106B	N/A	Replacement	No

7. Description of Work: Replaced the inlet plug and trigger assembly as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1280 psi Test Temp. 125 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR ISE GROUP Date MAY 3 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 8/21/97 to 5/17/99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date MAY 17 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 5 CGE

Program # 97-083 WR# 970074822-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

Date: 06-22-98
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Injection System, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Rupture Disc Flange	Black, Sivalls, & Bryson Safety	93070410-01	N/A	2-2301-68	N/A	Replacement	No

7. Description of Work: Replaced one flange stud on the Rupture Disc Flange as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 30 psi Test Temp. 532 °F

9. Remarks: Performed a VT-2-1 on replacements.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date JULY 14 19 98
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 10-1-97 to 7-16-98, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 7-16- 19 98

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 98-012 WR# 970086431-01

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-14-1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Bolting	Various	Ht# EKP & FRG	N/A	2-1402-41A	N/A	Replacement	NO

7 Description of Work: Replaced bolting as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required for bolting replacement.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date APRIL 16 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 3-9-98 to 5-7-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL971
Inspectors Signature National Board, State, Province, and Endorsements

Date 5-7-99 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-001 WR# 980124828-03

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690
Date: 04/05/1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242
ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242
Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Stand By Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Inlet Plug	Contax	20047	N/A	2-1106-A	N/A	Replacement	No

7. Description of Work: Replaced inlet plug in the valve as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1320 psi Test Temp. 106 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date APRIL 10 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-15-99 to 5-17-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date MAY 17 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-002 WR# 980124828-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/06/1999
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Stand By Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Trigger Assembly	Contax	86	N/A	2-1106-A	N/A	Replacement	No

7. Description of Work: Replaced the trigger assembly as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1320 psi Test Temp. 106 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. QA Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR THE ISE GROUP Date APRIL 10 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-15-99 to 5-17-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21903
Inspectors Signature National Board, State, Province, and Endorsements

Date MAY 17, 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-027 WR# 970034798-01

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-27-99
Sheet: 1 of 1
Unit: 2

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd

Repair Organization P.O. No., Job No., etc.

3 Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: High Pressure Coolant Injection, Class 2

5 (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Relief Valve	Consolidated	TK 85332	N/A	2-2301-23	N/A	Replacement	Yes

7 Description of Work: Replaced the relief valve as required by the WR.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 24 psi Test Temp. 82 °F

9 Remarks: Performed a VT-2 with static head pressure.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 6 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 3-25-99 to 3-25-99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 26971
National Board, State, Province, and Endorsements

Date 3-25- 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-039 WR# 990027558-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03/17/2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Stand by Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Trigger Assembly	Contax	105	N/A	2-1106-B	5/1999	Replacement	No

7. Description of Work: Replaced the trigger assembly as required by the WR.

8 Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1290 psi Test Temp. 86 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] 1st GRAD Date APRIL 6 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 3-25-99 to 4-12-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspector's Signature National Board, State, Province, and Endorsements

Date April 12, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-047 WR# 990008332-01

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 08-09-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Residual Heat Removal, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Check Valve	C&S Valve Co.	1-10663-01	N/A	2-1001-67A	N/A	Replacement	No

7. Description of Work: Replaced the check valve as required by the WR

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 163.5 psi Test Temp. 82.6 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ESI GROUP Date AUGUST 10 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-22-99 to 4-18-00 and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 2903
Inspector's Signature National Board, State, Province, and Endorsements

Date April 10, 2000
2000-11-10

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-053 WR# 930061600-01 (Q08270)

Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Date: 04-23-1999
Sheet: 1 of 1
Unit: 2

ComEd
Repair Organization P.O. No., Job No., etc.

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Gate Valve	Crane	N/A	N/A	2-1402-24A	N/A	Replacement	Yes

7. Description of Work: Replaced the disc as required by the Exempt Change EO4-2-93-323 and WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 240 psi Test Temp. 80 °F

9. Remarks: Performed a VT-2 inspection.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date APRIL 23 1999
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 3-2-95 to 5/27/99, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspector's Signature [Signature] Commissions 22 703
National Board, State, Province, and Endorsements

Date May 27 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-067 WR# 960036266-01 (Q00996)

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 07-27-1999

Sheet: 1 of 1

Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd

Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A

Authorization No.: N/A

Expiration Date: N/A

4. Identification of System: Stand By Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Check Valve	Edward Valves	34AF0	N/A	2-1101-16	N/A	Replacement	No
Pipe	Various	HT# 461263	N/A	2-1133-1 1/2"A	N/A	Replacement	No

7. Description of Work: Replace valve and piping under E04-2-95-036 and the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1450 psi Test Temp. 76 °F

9. Remarks: Performed surface NDE on replaced welds and performed a VT-2 inspection during the system leakage test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date July 30 19 99
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-22-99 to 11-29-99 and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL971
National Board, State, Province, and Endorsements

Date 11-29- 19 99

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-106 WR# 990077619-02

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-08-00
Sheet: 1 of 1
Unit: 2

2 Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3 Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4 Identification of System: Residual Heat Removal / Shutdown Cooling, Class 2

5 (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6 Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	N/A	N/A	N/A	2-1099-167	N/A	Replaced	No

7 Description of Work: Replaced pipe/flange (3/4" dia.) associated with replacement of relief valve 2-1099-167 as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9 Remarks: No pressure testing performed due to size IWA-4700 (b)(5).

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replaced conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date APRIL 08 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4-16-99 to 4-12-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 22903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 12 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT
As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-107 WR# 990054215-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-09-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Coolant Injection, Class 2

5. (a) Applicable Construction Code: ASME Section III 1965 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Booster Pump	Byron Jackson	N/A	N/A	2-2301	N/A	Repair	No

7. Description of Work: Provide permanent repair for HPCI booster pump seal leakage as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1200 psi Test Temp. 87 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this repair conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date March 13 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 3/13/00 to 4/13/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions 11903
National Board, State, Province, and Endorsements

Date April 13 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-110 WR# 990027558-03

1 Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-17-2000
Sheet: 1 of 1
Unit: 2

2.Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Stand By Liquid Control, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Inlet Plug	Contax	CN 20443	N/A	2-1106-B	N/A	Replacement	No

7. Description of Work: Replaced inlet plug as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1290 psi Test Temp. 86 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date APRIL 08 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/26/00 to 4/12/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 12, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-111 WR# 970057340-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-15-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Core Spray, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Check Valve	Edward Valve Inc.	35	N/A	2-1402-65B	N/A	Replacement	No

7. Description of Work: Replaced the check valve by welding as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing was performed due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISI GROUP Date FEBRUARY 15 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 12-20-99 to 4-10-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 21923
Inspectors Signature National Board, State, Province, and Endorsements

Date April 4 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-122 WR# 990054215-04

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 3-10-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Coolant Injection, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-2344-3/4"-LX	N/A	Replacement	No

7. Description of Work: HPCI boost pump casing vent line was restored by adding a coupling as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] ISE GROUP Date MARCH 13 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/6/00 to 4/13/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL 903
National Board, State, Province, and Endorsements

Date April 11, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 99-124 WR# 990036180-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 03-08-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Shutdown Make-up System, Class 2.

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-2906-4"-B	N/A	Replaced	No

7. Description of Work: Rerouted pipe as required by DCP# 9900061 and WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 1400 psi Test Temp. 71.3 °F

9. Remarks: Performed a VT-2 during hydro. Surface and volumetric NDE on completed welds.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 13 2000
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 4/6/00 to 4/19/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 11903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 19, 2000

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-004 WR# 990077271-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04-08-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Coolant Injection, Class 2

5. (a) Applicable Construction Code: ASME Section VIII Division 1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Relief Valve	Consolidated	IKH5332	N/A	2-2301-23	1997	Replaced	Yes
Relief Valve	Consolidated	TL34633	N/A	2-2301-23	1997	Replacement	Yes

7. Description of Work: Replaced relief valve as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 25 psi Test Temp. Ambient °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date APRIL 08 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-10-00 to 4-12-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Inspectors Signature [Signature] Commissions IL 903
National Board, State, Province, and Endorsements

Date April 12, 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-005 WR# 980028460-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 2-28-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Coolant Injection, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Check Valve	C & S	92-1924-01(Q)-03	N/A	2-2301-45	N/A	Replaced	No
Check Valve	Enertech	10953	N/A	2-2301-45	N/A	Replacement	No

7. Description of Work: Installed a new design valve in accordance with DCP 9700332 and WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure 40 psi Test Temp. 240 °F

9. Remarks: Performed a VT-2 during the system functional test.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code . Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. QA Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] Date MARCH 13 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1/31/00 to 4/17/00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions 28903
Inspectors Signature National Board, State, Province, and Endorsements
Date April 17 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-013 WR# 990137421-05

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 04/13/2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Reactor Core Isolation Cooling, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Gate Valve	Crane	783-U	N/A	2-1301-17	N/A	Repaired	No

7. Description of Work: Tack weld valve body to yoke as required by the WR.

8. Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: Performed a surface NDE exam on the final weld.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this repair conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR [Signature] ISI GROUP Date APRIL 13 2000
Owner or Owner's Designee, Title [Signature]

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 1-31-00 to 4-20-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 20 2000
20041200

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-016 WR# 990139750-01

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-12-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: Residual Heat Removal, Class 2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case

(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Gate Valve	Crane	N/A	N/A	2-1001-26A	N/A	Replacement	No

7. Description of Work: Replaced the fasteners after maintenance as required by the WR.

8. Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this replacement conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. Q A Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] FOR ISI GROUP Date FEBRUARY 15 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-3-00 to 4-11-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 11 20 00

FORM NIS-2 OWNERS REPORT OF REPAIR OR REPLACEMENT

As Required by the Provisions of ASME Code Section XI

QCAP 0307-20 Revision 6 CGE

Program # 00-021 WR# 990127499-02

1. Owner: Commonwealth Edison
P.O. Box 767, Chicago, IL 60690

Date: 02-25-2000
Sheet: 1 of 1
Unit: 2

2. Plant: Quad Cities Nuclear Power Station
22710 206th Ave. North, Cordova, IL 61242

ComEd
Repair Organization P.O. No., Job No., etc.

3. Work Performed by: Quad Cities Nuclear Station
22710 206th Ave. North, Cordova, IL 61242

Type Code Symbol Stamp: N/A
Authorization No.: N/A
Expiration Date: N/A

4. Identification of System: High Pressure Coolant Injection System, Class2

5. (a) Applicable Construction Code: USAS B31.1 1967 Edition, None Addenda, N/A Code Case
(b) Applicable Edition of Section XI Utilized for Repairs or Replacements: 1989 Edition, N/A Addenda, N/A Code Case

6. Identification of Components Repaired or Replaced, and Replacement Components:

Name of Component	Name of Mfr.	Mfrs. Ser. No.	Nat'l Bd. No.	Other Identification	Year Built	Repaired, Replaced, or Replacement	ASME Code Stamped (Yes or No)
Piping	Various	N/A	N/A	2-2323-1	N/A	Repaired	No

7. Description of Work: Cut out and replaced 1" diameter pipe as required by the WR.

Tests Conducted: Hydrostatic Pneumatic Nominal Operating Pressure
Other Pressure _____ psi Test Temp. _____ °F

9. Remarks: No pressure testing required due to size.

CERTIFICATE OF COMPLIANCE

We certify that the statements made in this report are correct and this repair conforms to the rules of ASME Code, Section XI
repair or replacement

Type of Code Symbol Stamp N/A - ComEd 10CFR50 App B. QA Program

Certificate of Authorization No. N/A Expiration Date N/A

Signed [Signature] EST. GROUP Date APRIL 6 20 00
Owner or Owner's Designee, Title

CERTIFICATE OF INSERVICE INSPECTION

I, the undersigned, holding a valid commission issued by the National Board of Boiler and Pressure Vessel Inspectors and the State of Illinois, and employed by Hartford Steam Boiler Inspection & Insurance Co. of Hartford, CT have inspected the components described in this Owner's Report during the period 2-6-00 to 4-12-00, and state that to the best of my knowledge and belief, the owner has performed examinations and taken corrective measures described in this Owner's Report in accordance the requirements of the ASME Code, Section XI.

By signing this certificate, neither the inspector nor his employer makes any warranty, expressed or implied, concerning the examinations and corrective measures described in this Owner's Report. Furthermore, neither the Inspector nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

[Signature] Commissions IL 903
Inspectors Signature National Board, State, Province, and Endorsements

Date April 12, 20 00