DIV. OF COMPLIANCE
REG. 1, USAEC, N. Y.
RECEIVED
JUN 9 11 22 AM '67

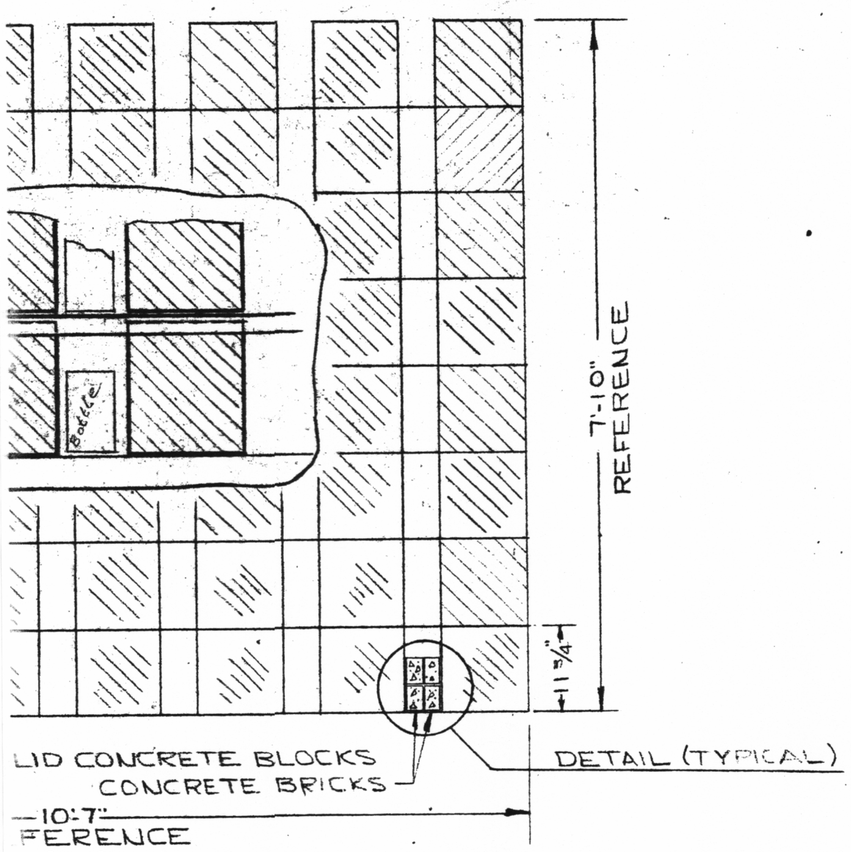

A-A (EXISTING)

SCALE 3/4"=1'-0"

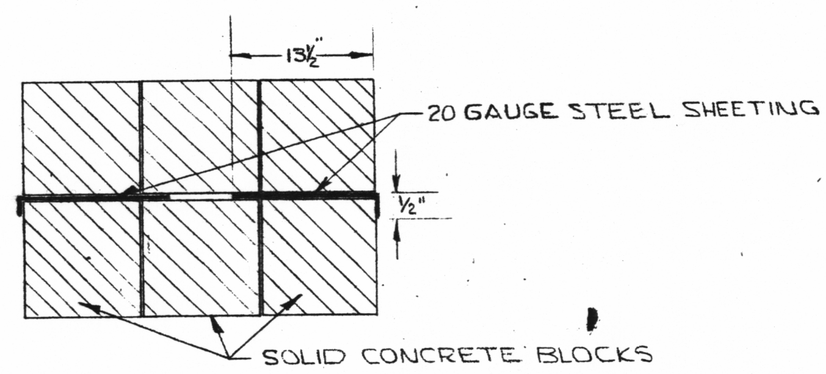

SECTION D-D

N.T.S.

CONT.)

CONNECT ANGLES 3 & 4 TOGETHER BY WELDING A PIECE OF ANGLE 2"x2"x1/4"x2'-8" LONG ACROSS TOP OF BLOCKS.

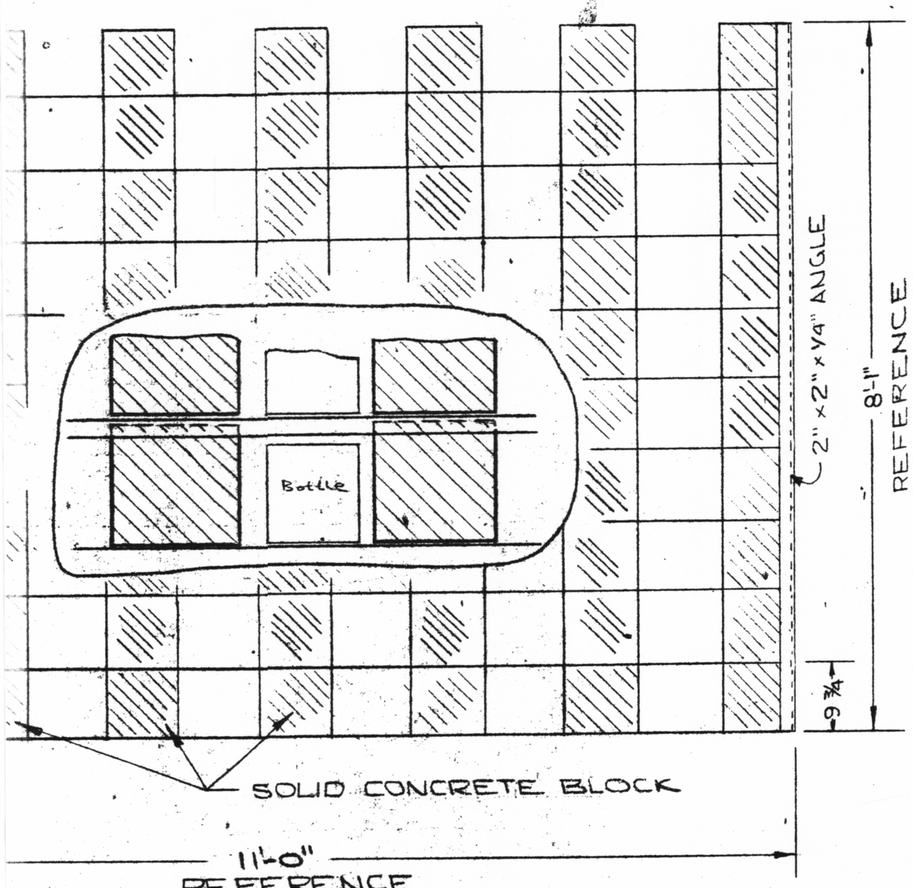

ELEVATION C-C

SCALE 3/4"=1'-0"

RECEIVED
JUN 5 1967
CS-WESTINGHOUSE ELECTRIC CORPORATION
PITTSBURGH

NOTES:

1. ELEVATION A-A IS EXISTING (15 3/4"x11 3/4"x11 1/2") BUT BLOCK MUST NOT EXCEED A HEIGHT OF 7'-10" (REFERENCE)
2. ELEVATIONS B-B & C-C ARE PROPOSED BLOCK HEIGHT MUST NOT EXCEED 8'-1" (REFERENCE)
3. ELEVATIONS (B-B) & (C-C) TO BE CONSTRUCTED W/ SOLID CONCRETE BLOCKS - 9 5/8"x9 5/8"x9 3/4"
4. 20 GAUGE STEEL SHEETING TO BE PLACED BETWEEN COURSES - SHEETS TO BE 11'-0"x14" 18 REQD.
5. TOTAL NUMBER OF BLOCK AS PER ENCIRCLED AREA 280.
6. SOLID CONCRETE BRICK TO BE PLACED IN EXISTING STORAGE RACK (ELEVATION A-A) AS PER DETAIL. 224 BRICK REQ'D - 4 PER OPENING.
7. ANGLES (1) & (2) ARE TO BE ANCHORED TO WALL - ANGLES (3) & (4) TO HAVE 1/4" PLATE WELDED TO BOTTOM OF ANGLE & ANCHORED TO FLOOR W/ LEAD ANCHORS - BOLTHEADS TO BE COUNTERSUNK FLUSH W/ PLATE.

DATE	REVISIONS	APPROVED
5-26-67	BRACING, CONCRETE BRICKS ADDED	K. GULICK

DRAWN BY	SCALE	PROPOSED STORAGE RACKS - BLDG 7	DATE
K. GULICK	As Noted		5-15-67

APPROVED BY: D. E. Lisca 5/17/67 — ARCHITECT

ELECTRICAL ENGINEER

G. W. Lucas 5-22-66 — MECHANICAL ENGINEER

DOCKET NO. 70-337 — For Div of Compliance

WESTINGHOUSE ELECTRIC CORPORATION
CHESWICK DIVISION WORKS ENGINEERING DEPARTMENT
PITTSBURGH, PENNA.

APPROVED: — WORKS ENGINEER

PROJECT NO. WED 677

SHEET NO. 1 of 1

1862

PR 7470-465

D1A