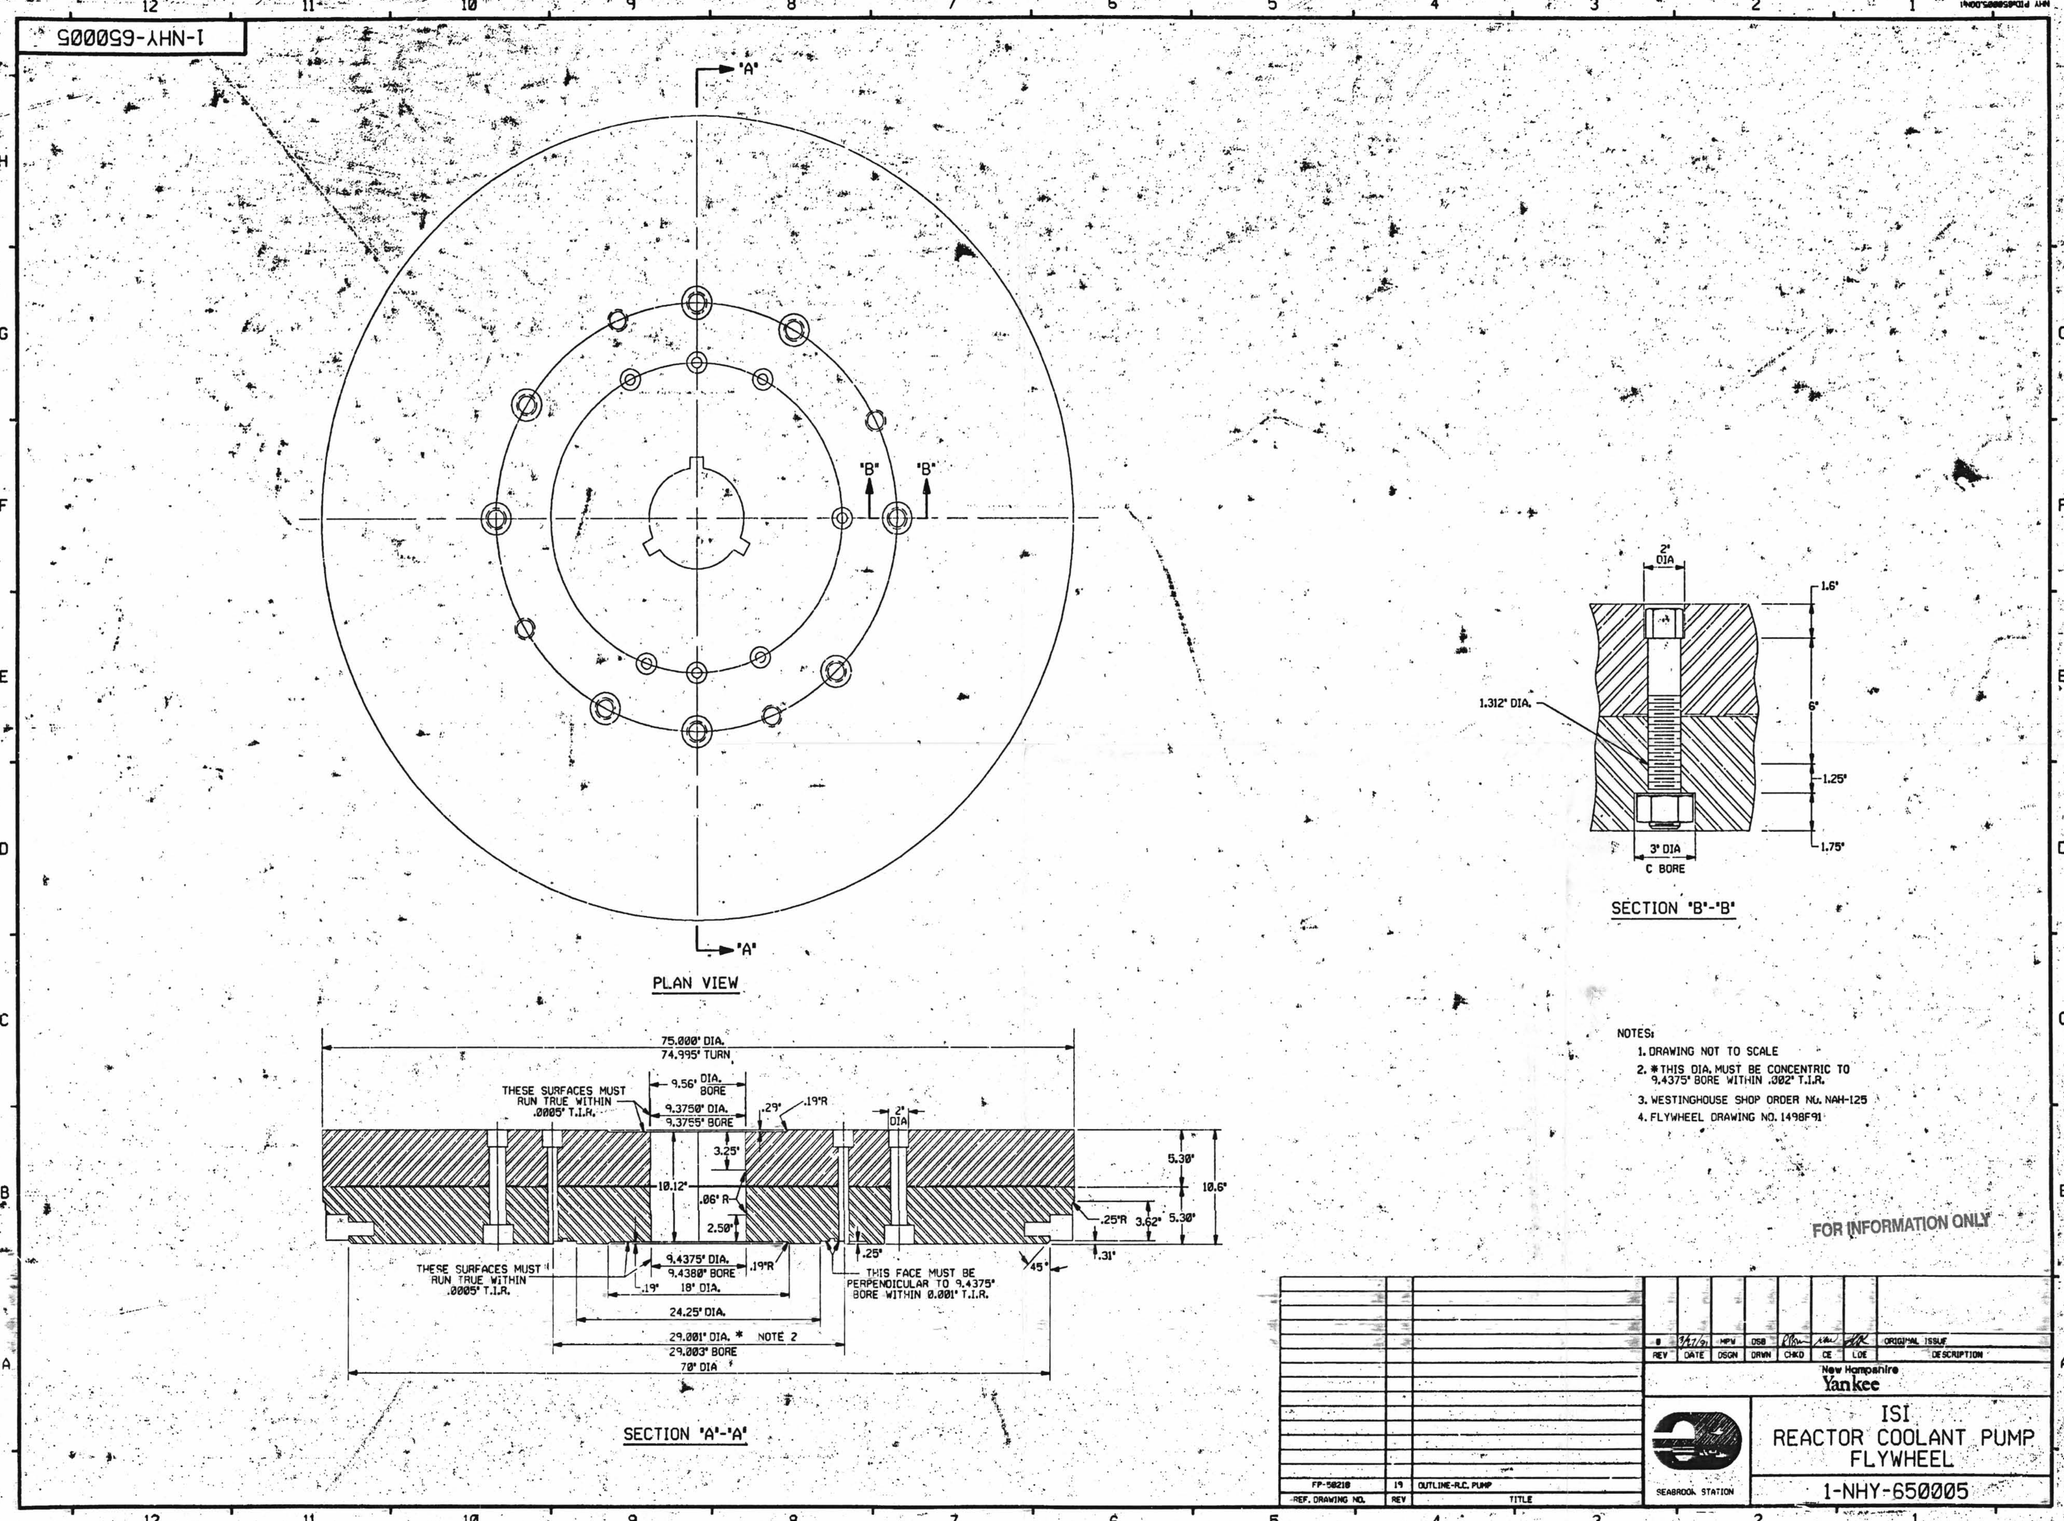

NOTES:

1. DRAWING NOT TO SCALE
2. * THIS DIA. MUST BE CONCENTRIC TO 9.4375" BORE WITHIN .002" T.I.R.
3. WESTINGHOUSE SHOP ORDER NO. NAH-125
4. FLYWHEEL DRAWING NO. 1498F91

FOR INFORMATION ONLY

REV	DATE	DSGN	DRWN	CHKD	CE	LOE	DESCRIPTION
0	3/27/91	MPW	DSB	[illegible]	[illegible]	[illegible]	ORIGINAL ISSUE

New Hampshire
Yankee

SEABROOK STATION

ISI
REACTOR COOLANT PUMP
FLYWHEEL

1-NHY-650005

REF. DRAWING NO.	REV	TITLE
FP-50210	19	OUTLINE-R.C. PUMP

D-6