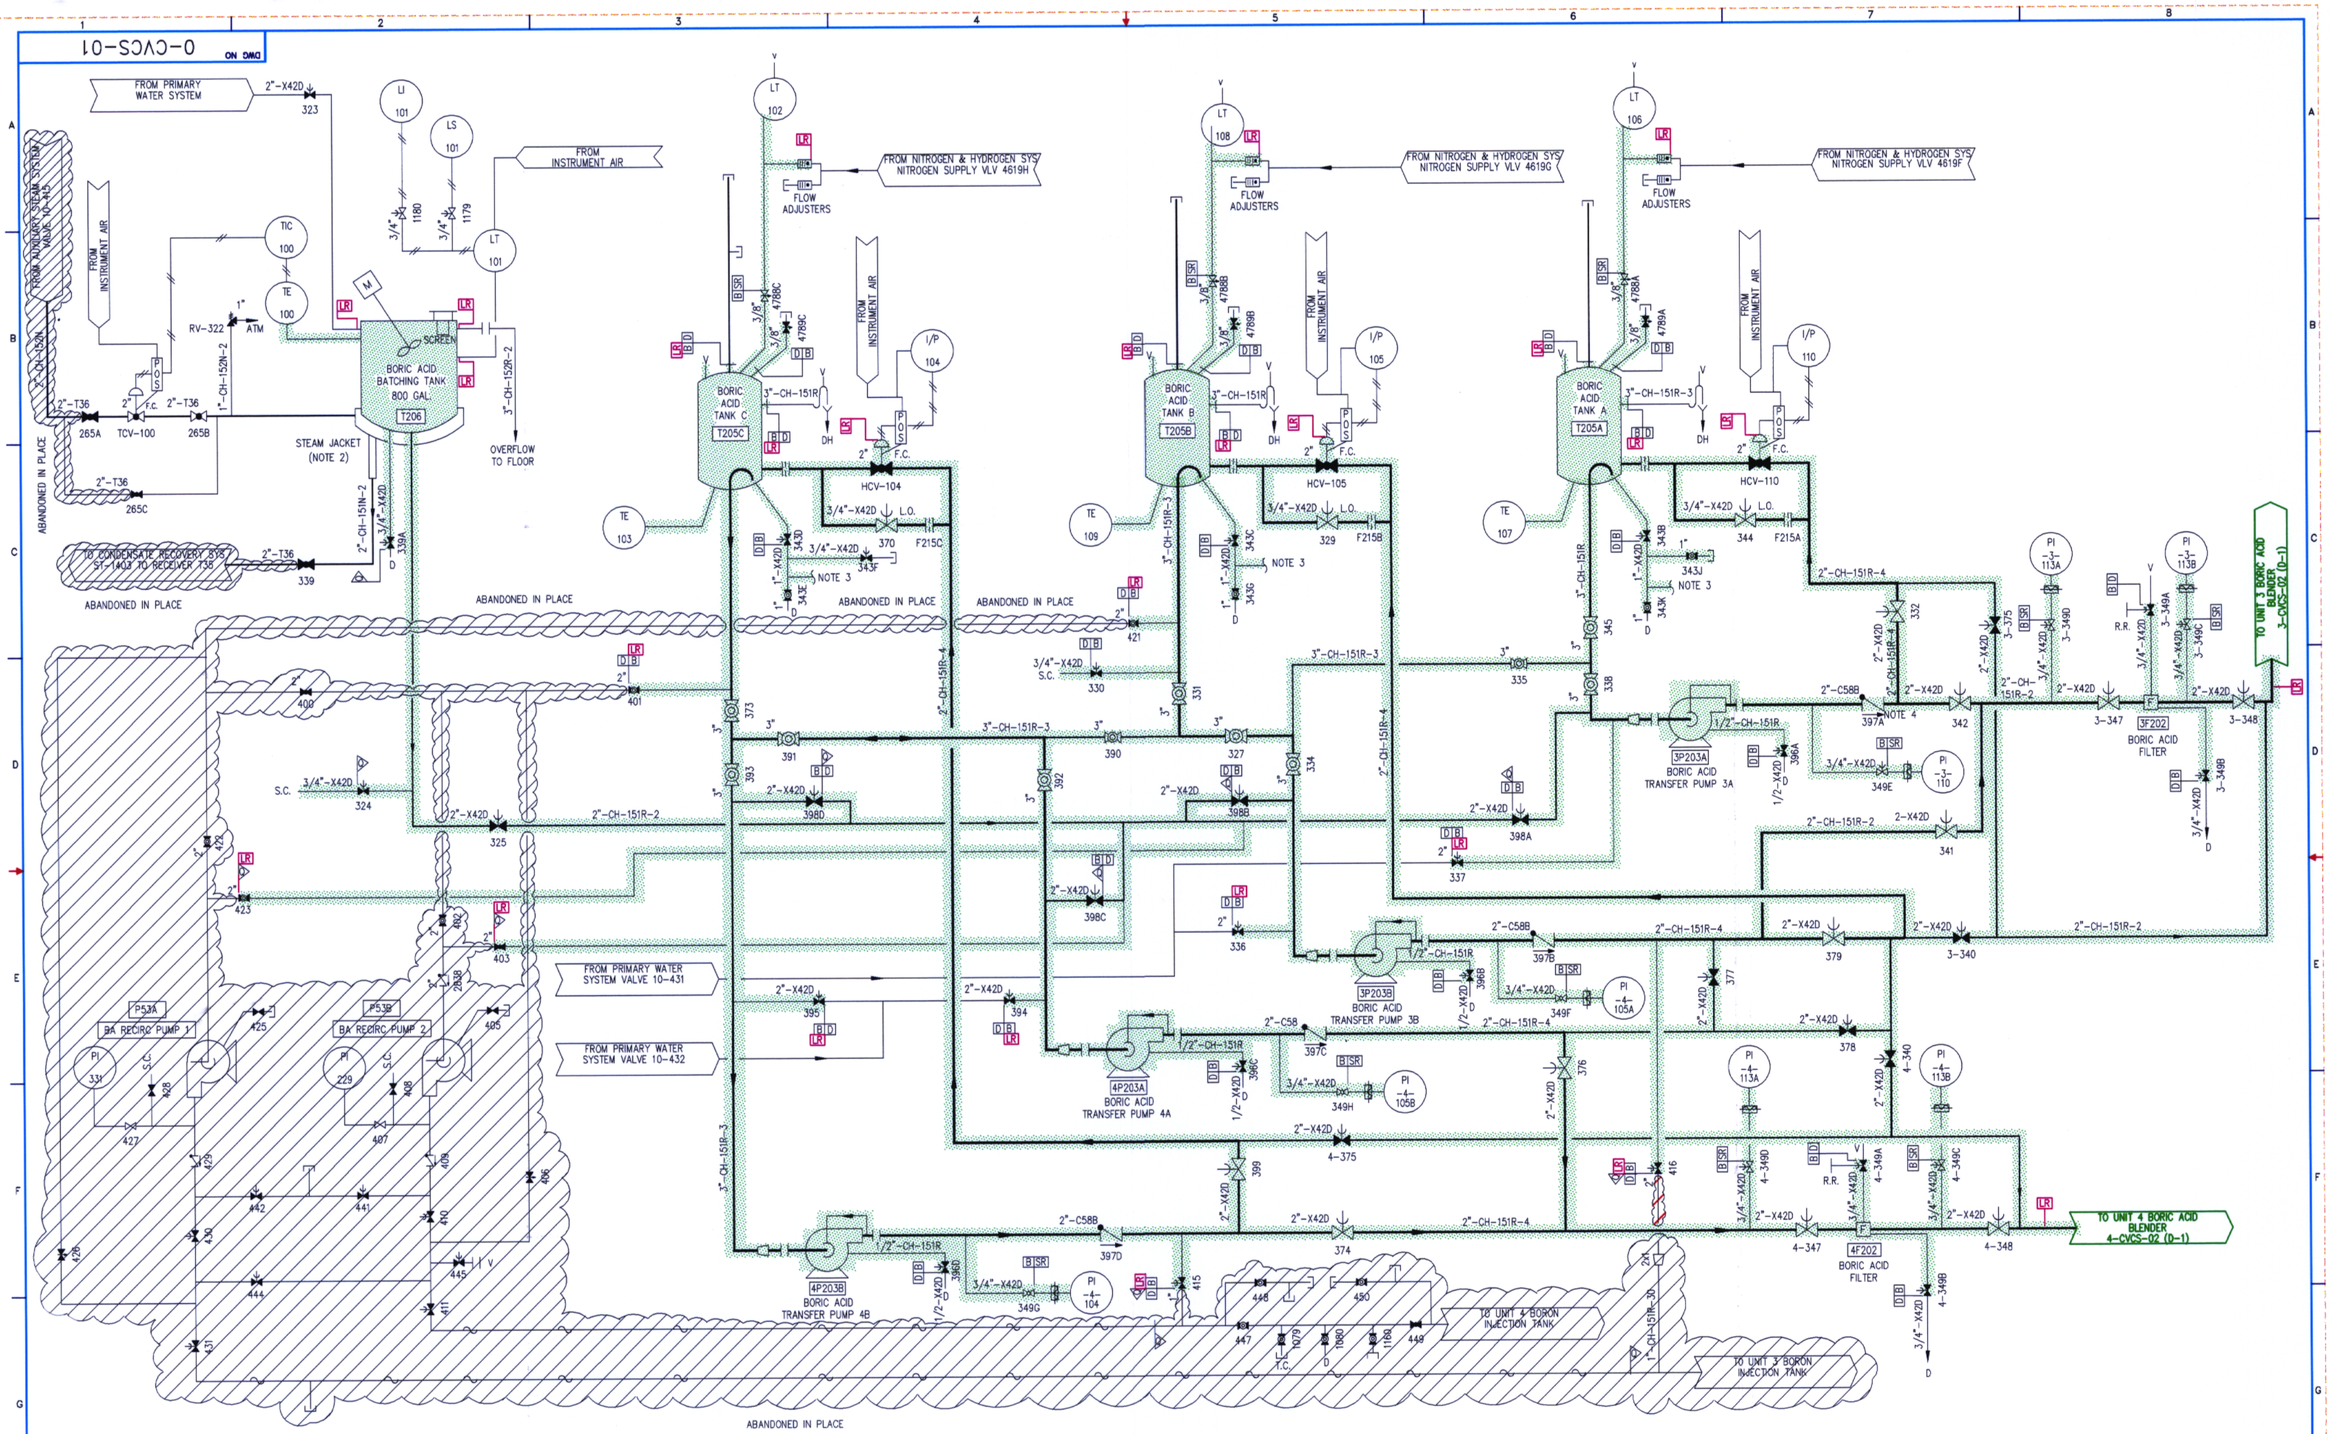

D-032

NOTES:
1. FOR GENERAL NOTES & LEGEND SEE DWG NO. 0-NOTES-01.
2. BORIC ACID BATCHING TANK STEAM JACKET STEAM SUPPLY AMD DRAIN ARE NOT WITHIN THE SCOPE OF LICENSE RENEWAL.
3. TYGON TUBE ATTACHED AT THIS POINT USED FOR LOCAL LEVEL INDICATION.

FPL

CHEMICAL & VOLUME CONTROL

FLORIDA POWER & LIGHT
TURKEY POINT NUCLEAR UNITS 3 & 4
LICENSE RENEWAL BOUNDARY DRAWING

DRAWING NUMBER	REVISION
0-CVCS-01	0

DCVCS01.DWG