DWG NO 0-PAMC-02

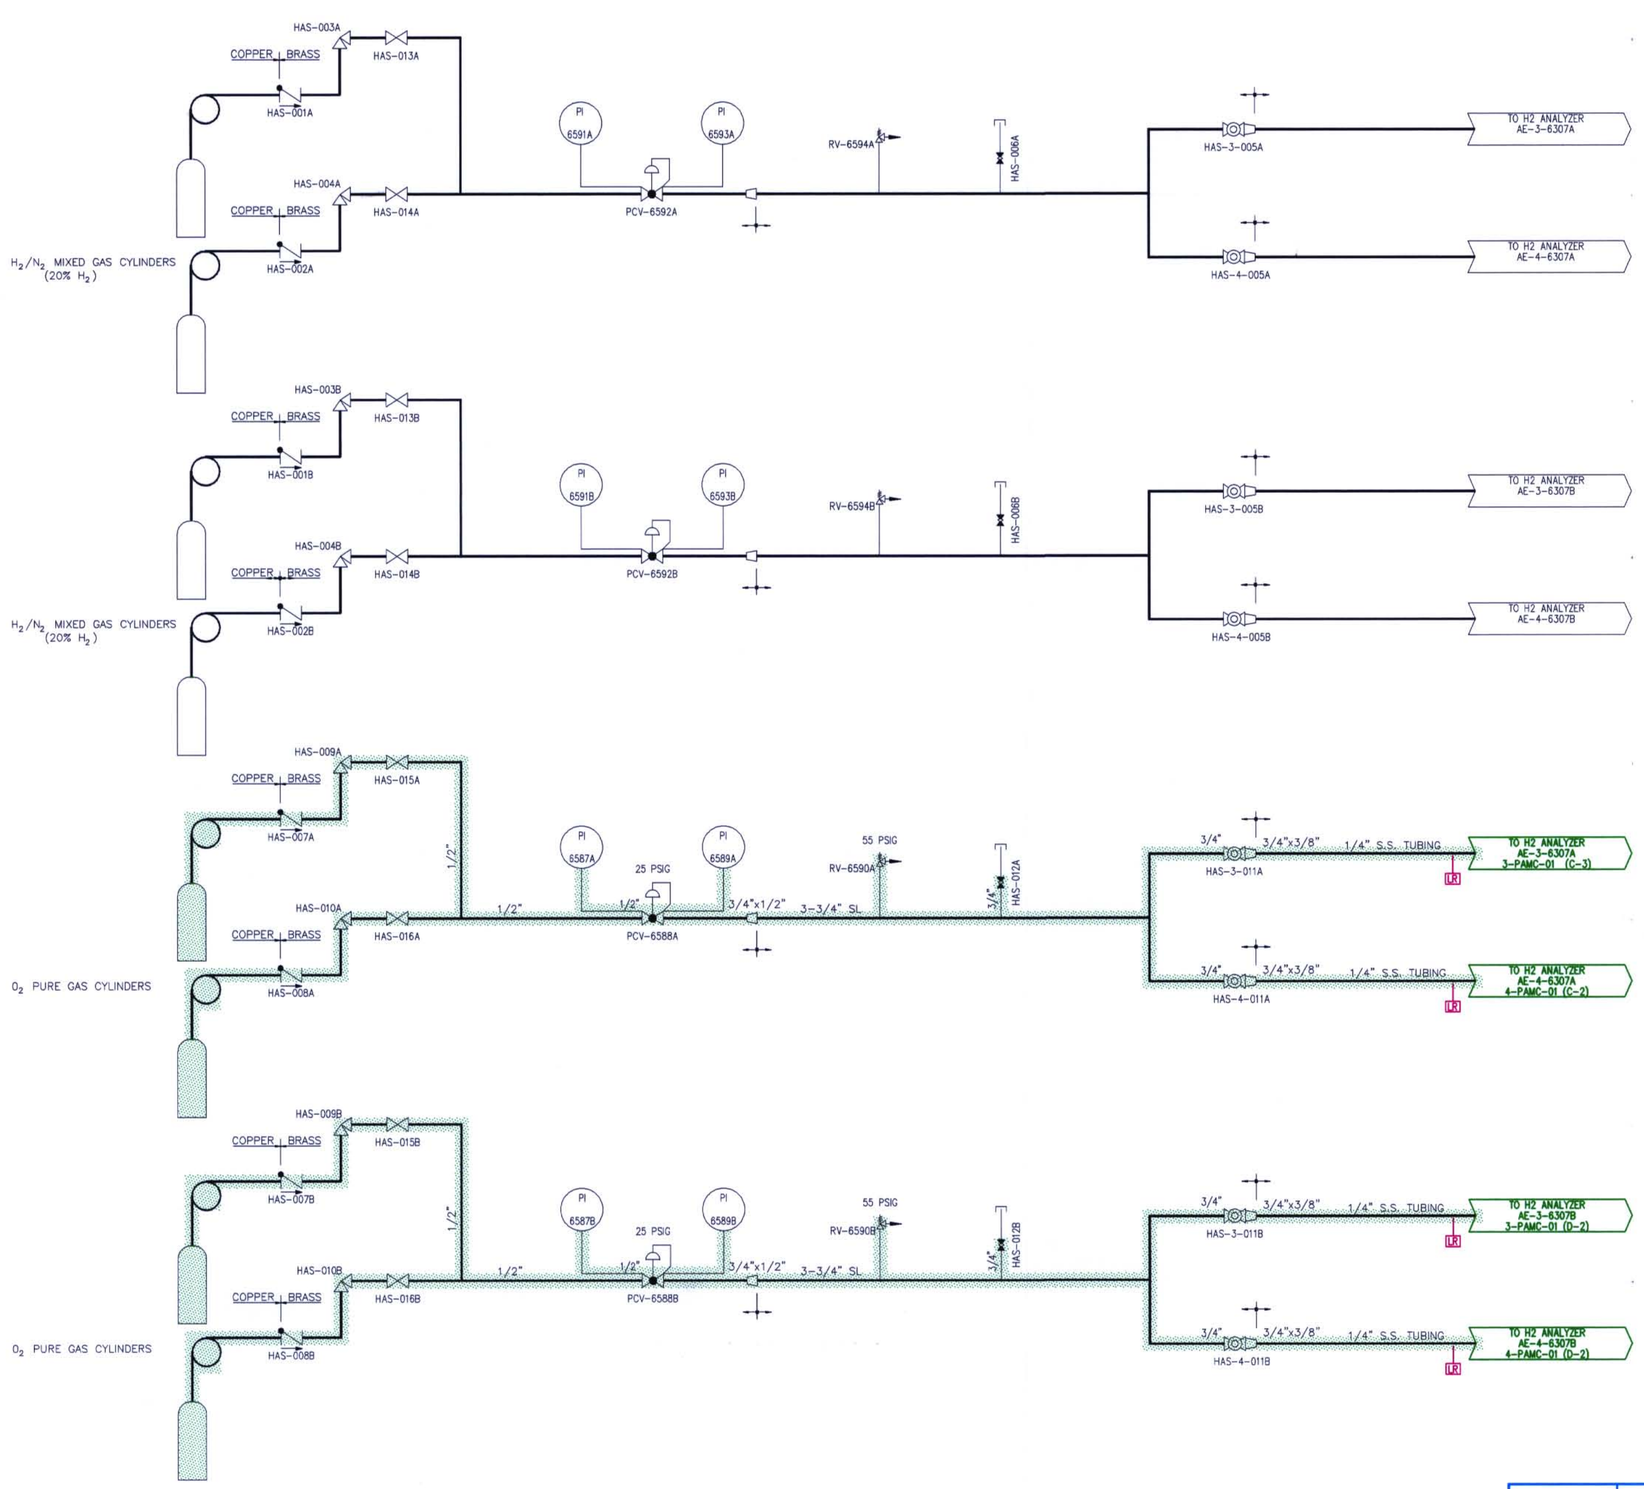

D-104

NOTE:

1. ALL PIPING COMPONENTS ARE INSTALLED CLASS D SEISMIC.
2. ONLY THE OXYGEN PURGE GAS CYLINDER AND ASSOCIATED PIPING, TUBING AND VALVES ARE WITHIN THE SCOPE OF LICENSE RENEWAL.

FPL

CONTAINMENT POST ACCIDENT MONITORING & CONTROL

FLORIDA POWER & LIGHT
TURKEY POINT NUCLEAR UNITS 3 & 4

LICENSE RENEWAL BOUNDARY DRAWING

DRAWING NUMBER	REVISION
0-PAMC-02	0

0PAMC02.DWG