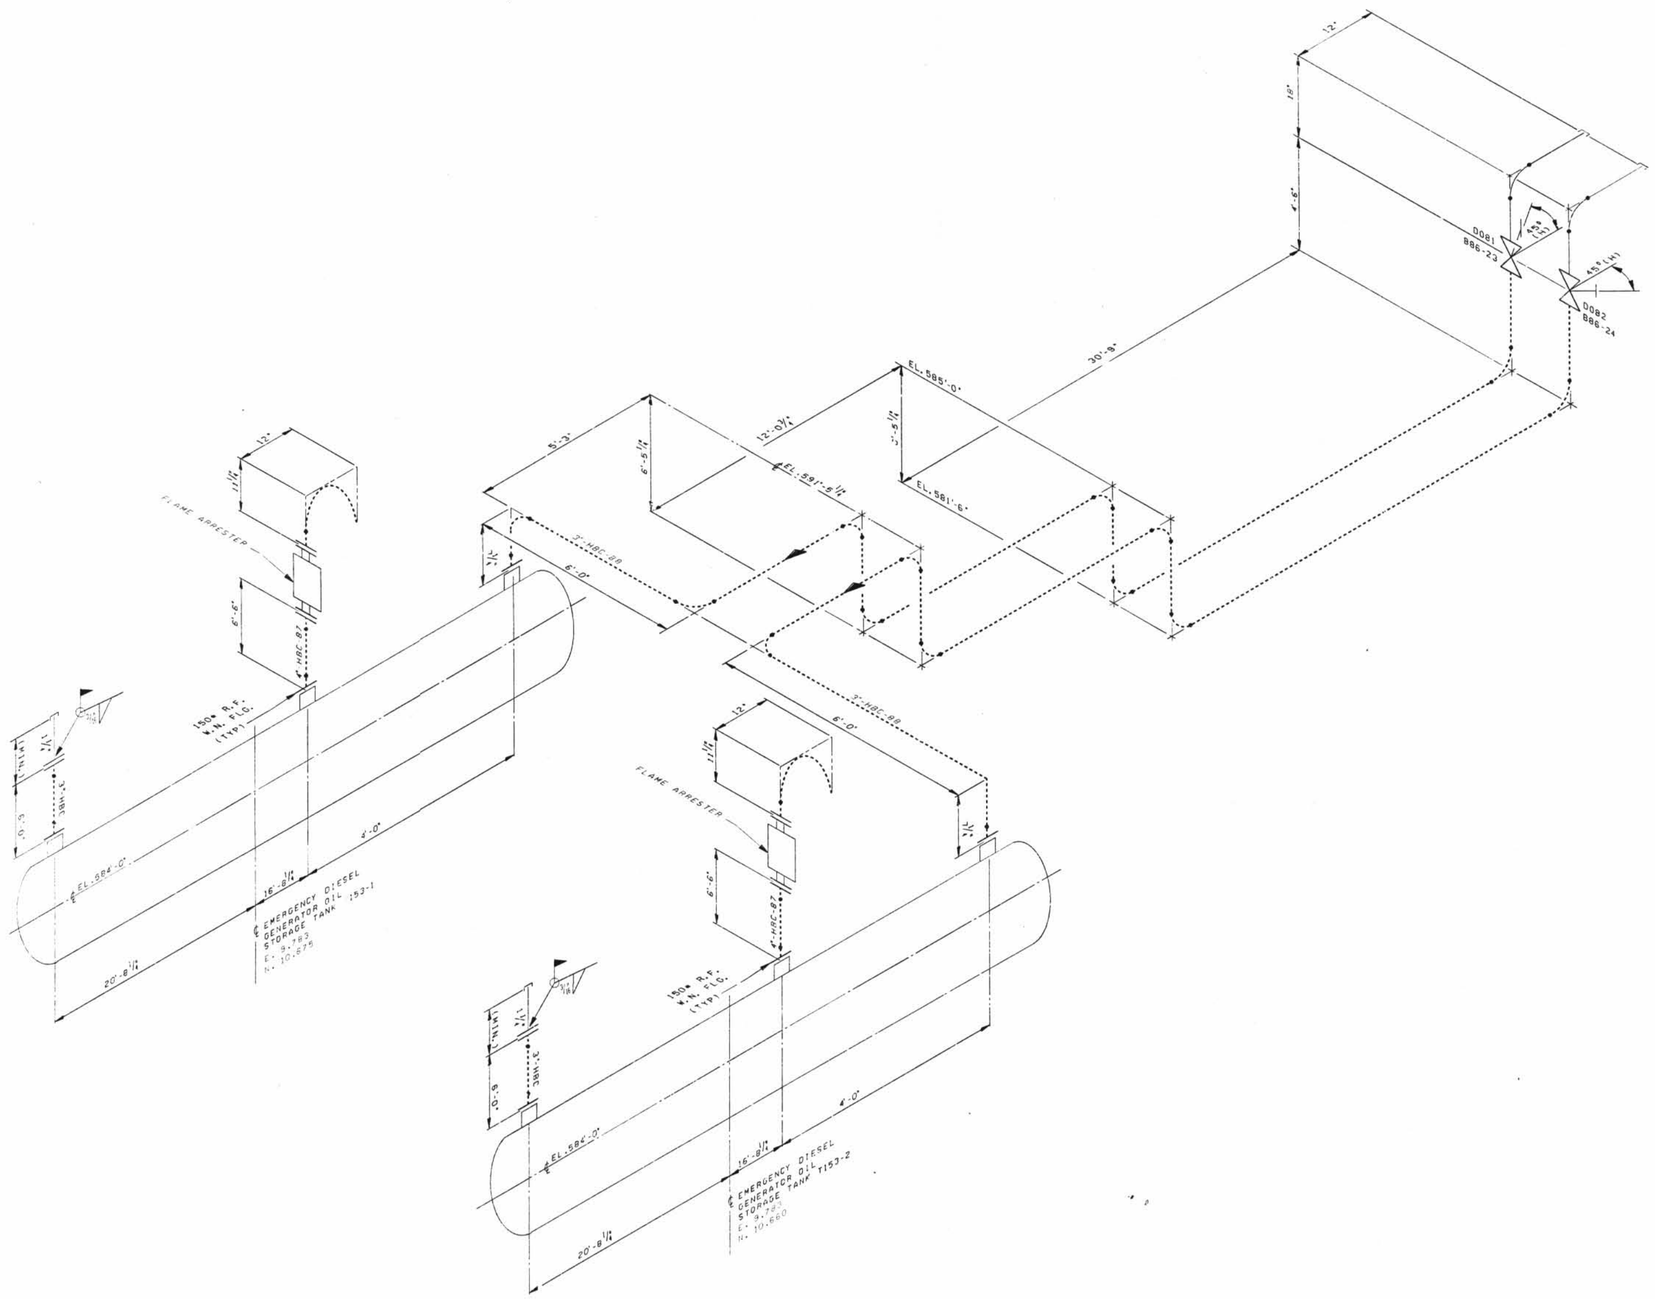

LEGEND

- ASME SECTION XI CLASS 1
- ASME SECTION XI CLASS 2
- ASME SECTION XI CLASS 3
- NON-ISI NUCLEAR CLASS 1 AND 2
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- HVAC DUCT
- A — ANCHOR
- CS — CONSTANT SPRING HANGER
- VS — VARIABLE SPRING HANGER
- HS — HYDRAULIC SNUBBER
- MS — MECHANICAL SNUBBER
- N — NON-WELDED SUPPORT ATTACHMENT
- W — WELDED INTEGRAL SUPPORT ATTACHMENT
- R — RIGID SUPPORT
- T — SWAY STRUT
- SW — SHOP WELD
- FW — FIELD WELD
- LW — LONGITUDINAL WELD
- WOL — WELDOLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. THE EDG FUEL OIL LINE 4"-HBC-87 & 3"-HBC-88 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWD 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
2. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE ISI BOUNDARY, ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISI02-017A DIESEL GENERATORS

1	INC DCN 1ISIM2-217A-2 FOR DCR 91-0011	
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1

Q

INSERVICE INSPECTION ISOMETRIC
EMERGENCY DIESEL GENERATORS
FUEL OIL SYSTEM

ISIM2-217A
(SHEET 2)

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT.
DATE 2-5-92 OPERATOR Dorothy Widle 30X

D-4