RC-CEI 1155.100 FORMATS.CEL AC-ESTD

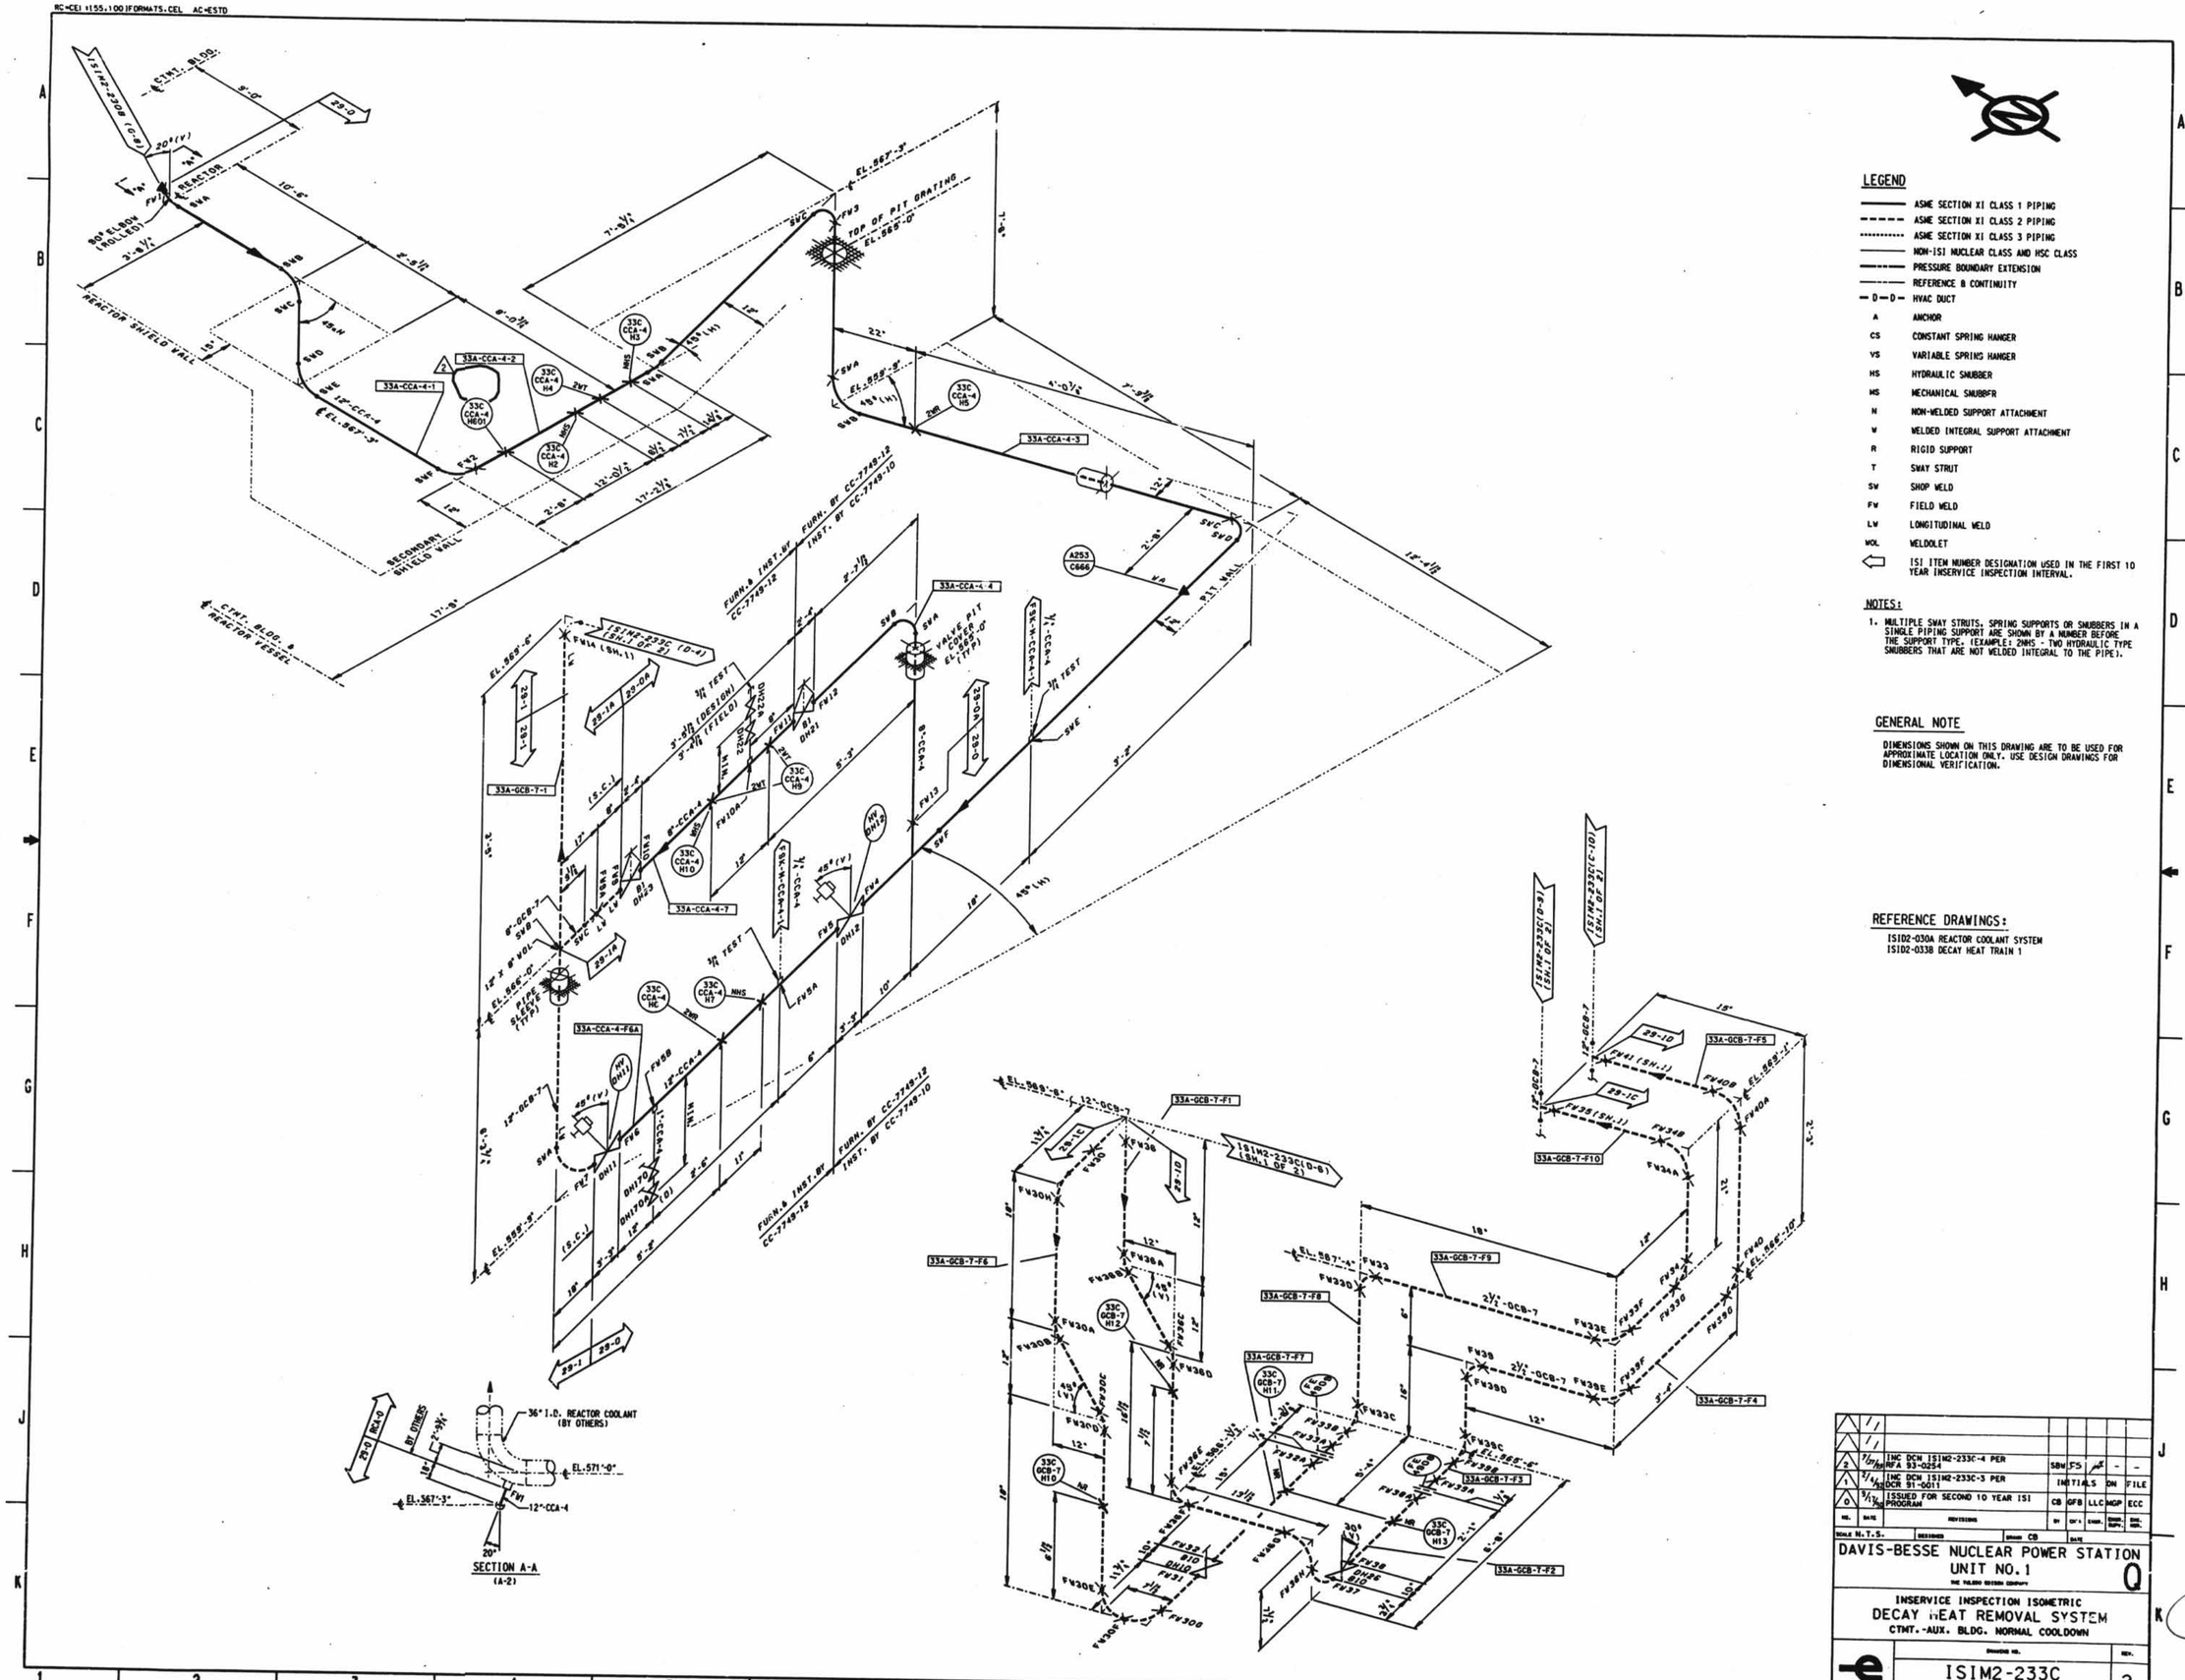

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- HVAC DUCT
- A — ANCHOR
- CS — CONSTANT SPRING HANGER
- VS — VARIABLE SPRING HANGER
- HS — HYDRAULIC SNUBBER
- MS — MECHANICAL SNUBBER
- N — NON-WELDED SUPPORT ATTACHMENT
- W — WELDED INTEGRAL SUPPORT ATTACHMENT
- R — RIGID SUPPORT
- T — SWAY STRUT
- SW — SHOP WELD
- FW — FIELD WELD
- LW — LONGITUDINAL WELD
- WOL — WELDOLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).

GENERAL NOTE

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISID2-030A REACTOR COOLANT SYSTEM
ISID2-033B DECAY HEAT TRAIN 1

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENG. MGR.
2	7/17/96	INC DCN ISIM2-233C-4 PER RFA 93-0254	SBW	FS			-
1	3/14/95	INC DCN ISIM2-233C-3 PER DCR 91-0011	INITIALS			DN	FILE
0	8/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	GFB	LLC	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1 — 0
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
DECAY HEAT REMOVAL SYSTEM
CTMT.-AUX. BLDG. NORMAL COOLDOWN

DRAWING NO. ISIM2-233C (SHEET 2) REV. 2

14 34X44 SIZE

DB 07-01 93 DFN=01/ISIM/2IM233C2.DGN LEVELS 1234567891011121314151617181920212223242526272829303132333435363738394041424344454647484950

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT.

430X

D-25