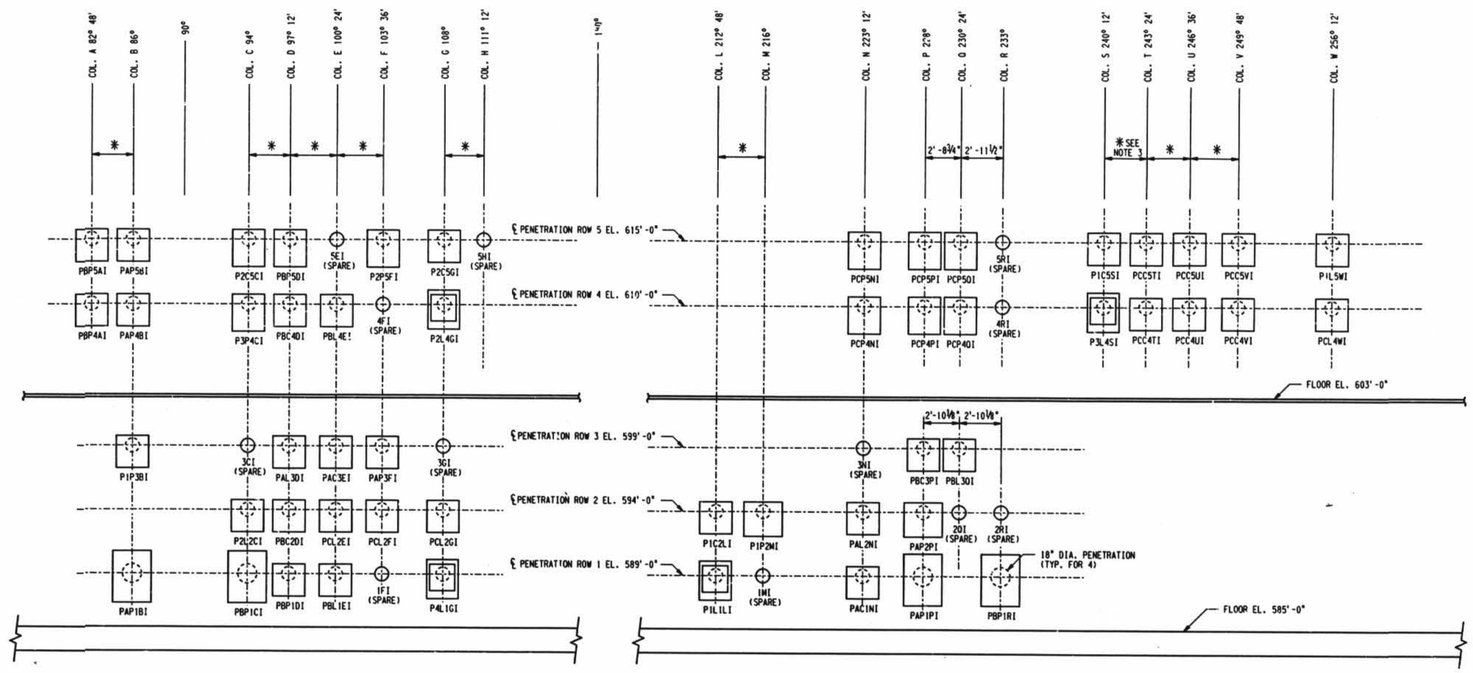

SECTION A-A
SCALE: ¼" = 1'-0"

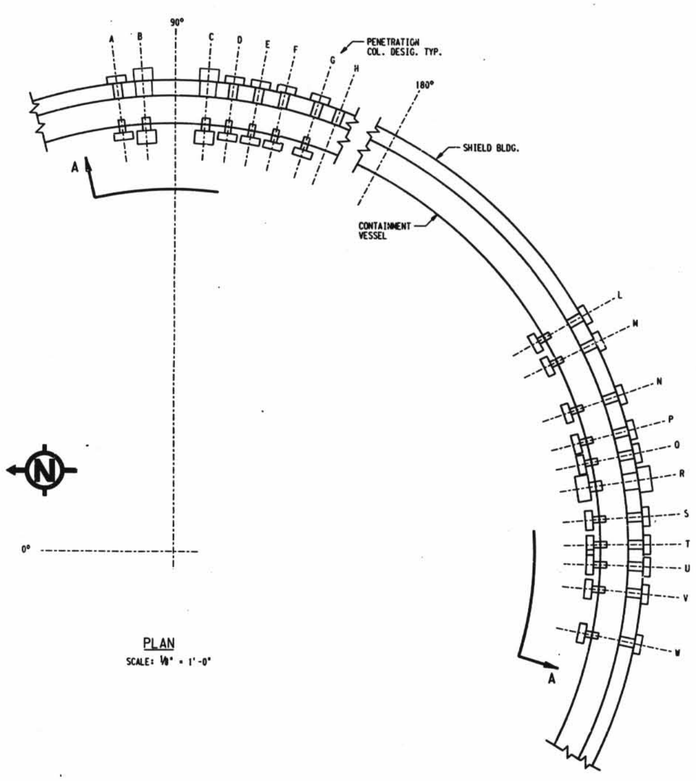

PLAN
SCALE: 1/8" = 1'-0"

NOTES

1. DIMENSIONS NOTED ✱ ARE 3'-7⅝" UNLESS NOTED OTHERWISE.
2. THE PENETRATIONS SHOWN ON THIS DRAWING ARE SUBJECTED TO THE RULES OF IWE.

REFERENCE DWGS.

E371 ELECTRICAL PENETRATION ARRG'T CONTAINMENT VESSEL

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	GEN. SUPV.
0	2/6/97	ISSUED FOR IMPLEMENTATION FOR SECTION 11 IWE	SBW				

SCALE AS SHOWN | DESIGNED CD | DRAWN SBW | DATE 12-22-96

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DRAWING
ELECTRICAL PENETRATION ARRG'T
CONTAINMENT VESSEL

DRAWING NO. ISIM2-E371 REV. 0

DB 12-22-96

DFN=/ISIM /2IME371.DGN

D-93

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT.

2.11.97 OPERATOR

30X