RC-CEL:(55,100)FORMATS.CEL AC-ESTD

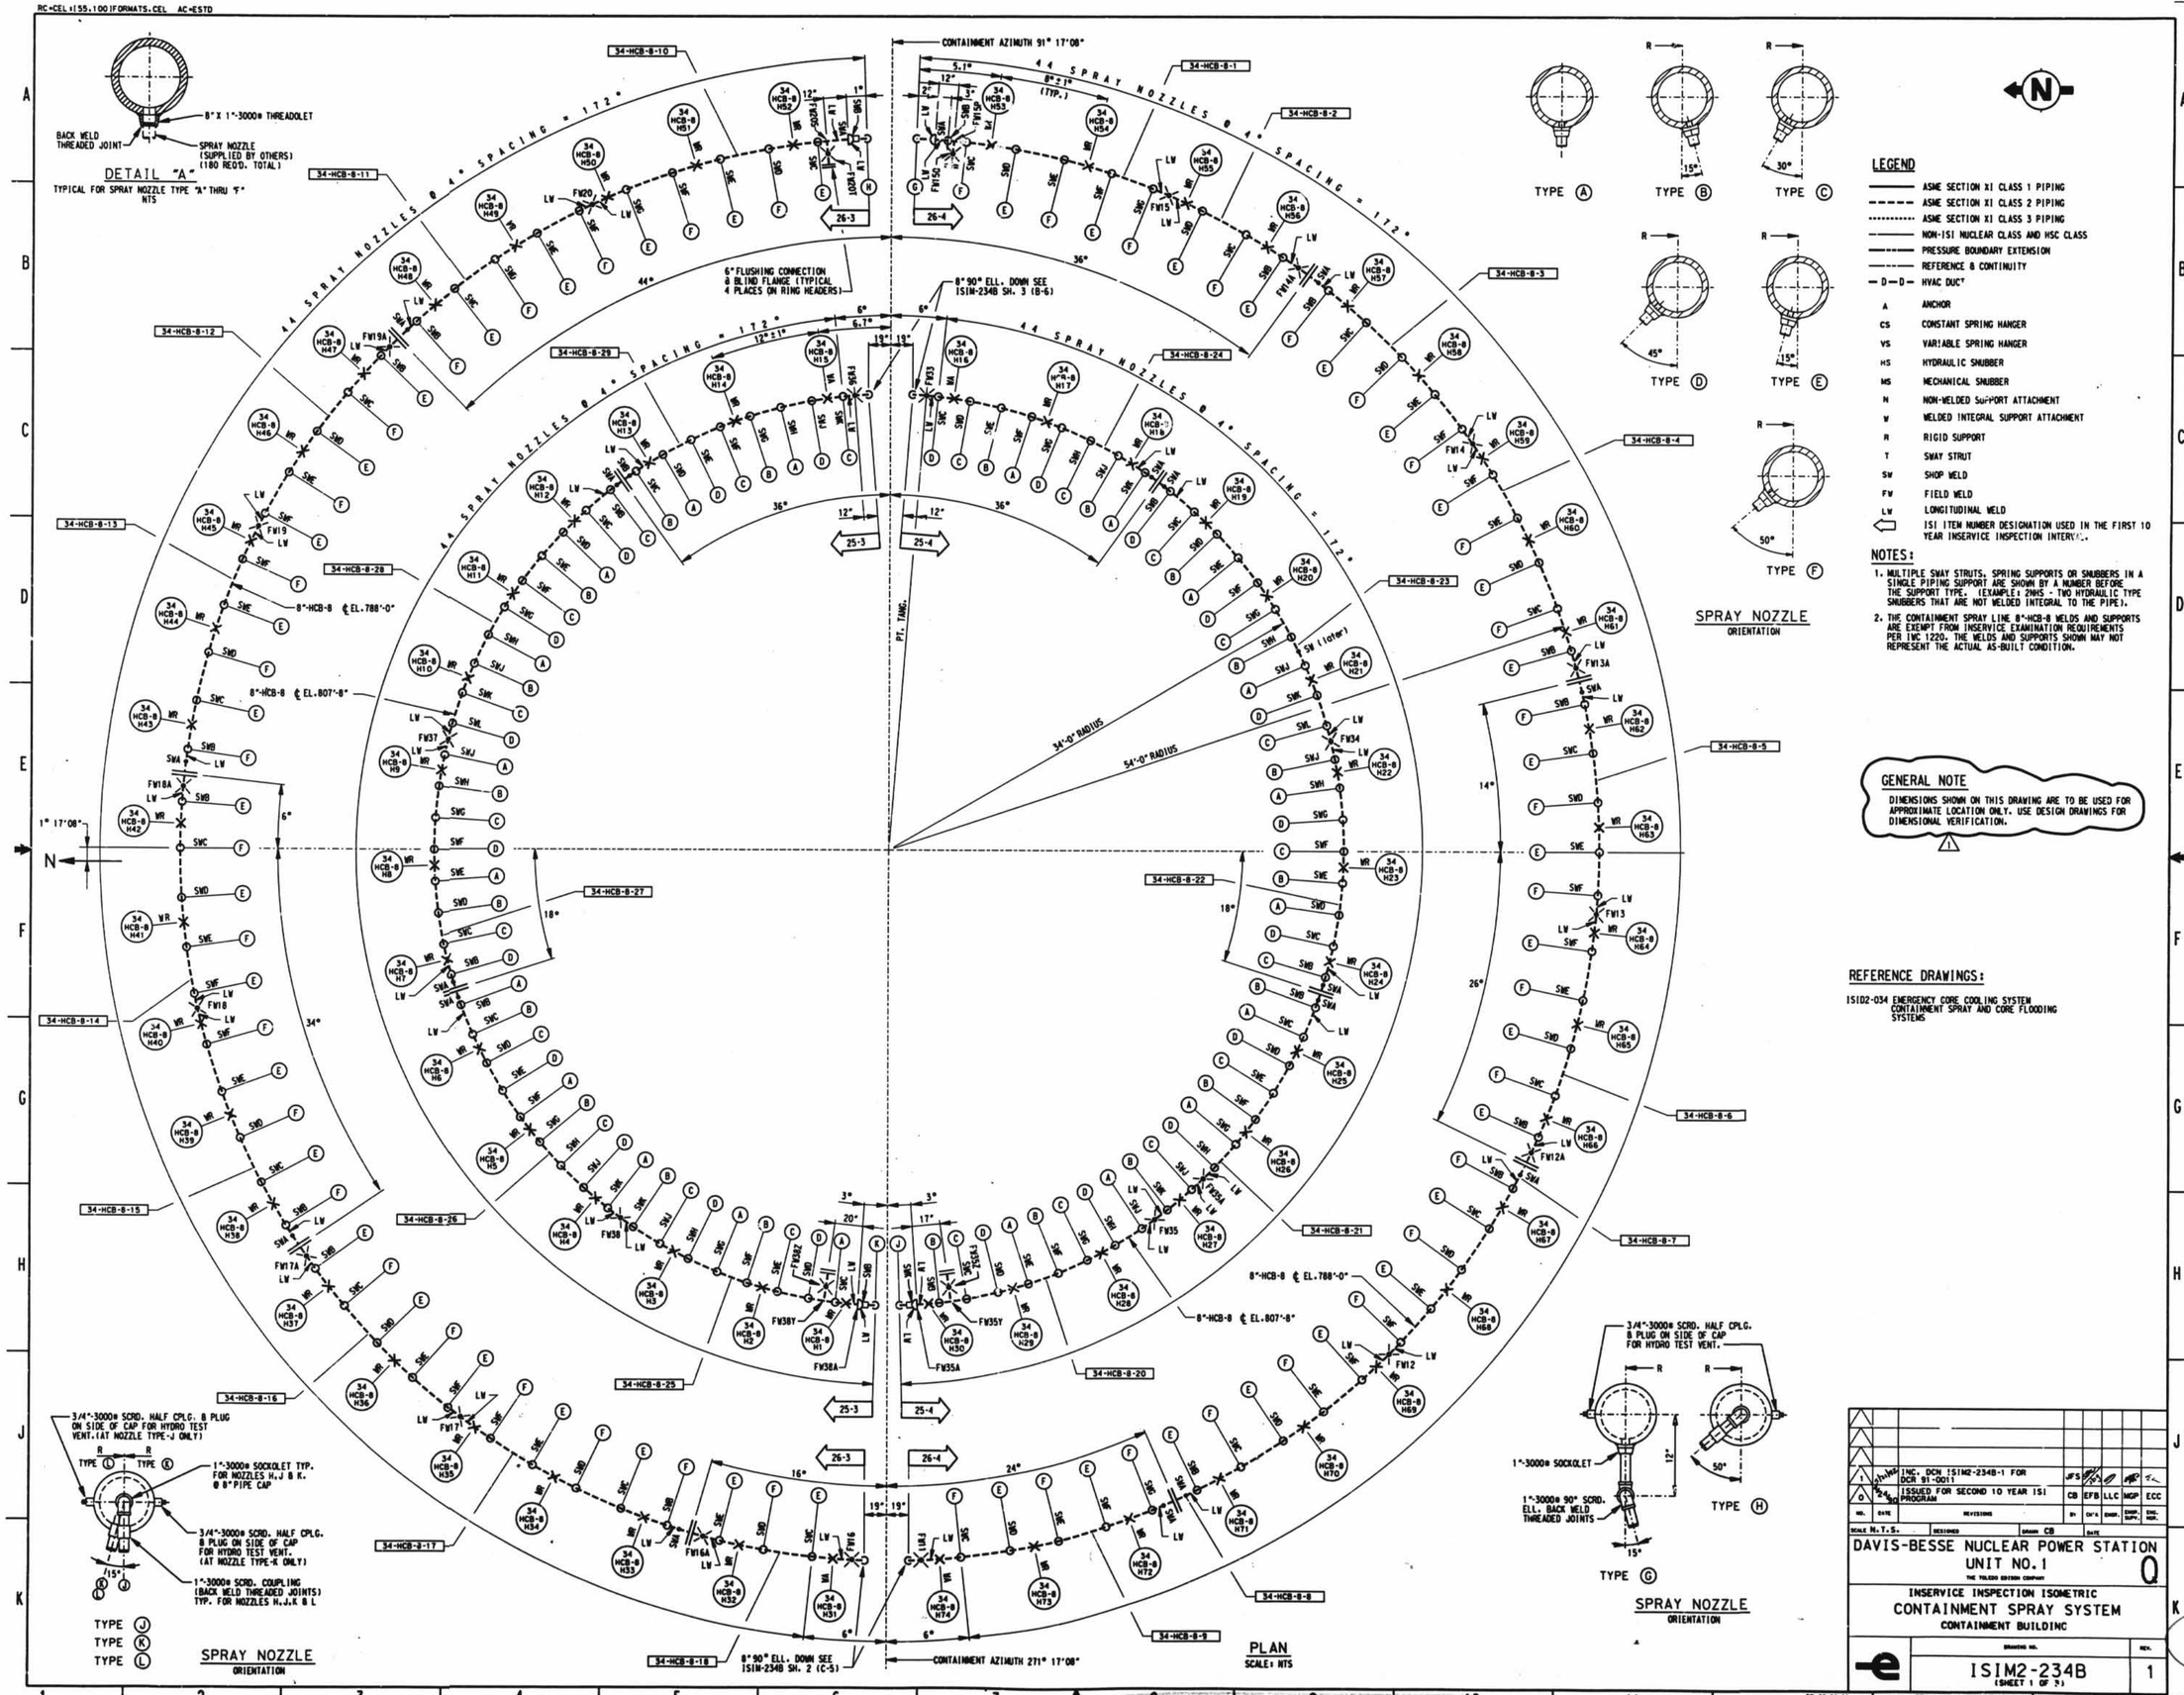

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D—D HVAC DUCT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SNUBBER
- MS MECHANICAL SNUBBER
- N NON-WELDED SUPPORT ATTACHMENT
- W WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE CONTAINMENT SPRAY LINE 8"-HCB-8 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWC 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISID2-034 EMERGENCY CORE COOLING SYSTEM
CONTAINMENT SPRAY AND CORE FLOODING SYSTEMS

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	ENGR. SUPV.	ENG. MGR.
1	2-2-92	INC. DCN ISIM2-234B-1 FOR DCR 91-0011	JFS				
0	2-2-90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	EFB	LLC	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1 — Q
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
CONTAINMENT SPRAY SYSTEM
CONTAINMENT BUILDING

DRAWING NO. ISIM2-234B (SHEET 1 OF 3) REV. 1

14 34X44 SIZE

D-38

DATA ENTRY AND CAPTURE OF THIS RECORD (F) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT. DATE 5/22/92 OPERATOR