RC=CEL(155,100)FORMATS.CEL AC=ESTD

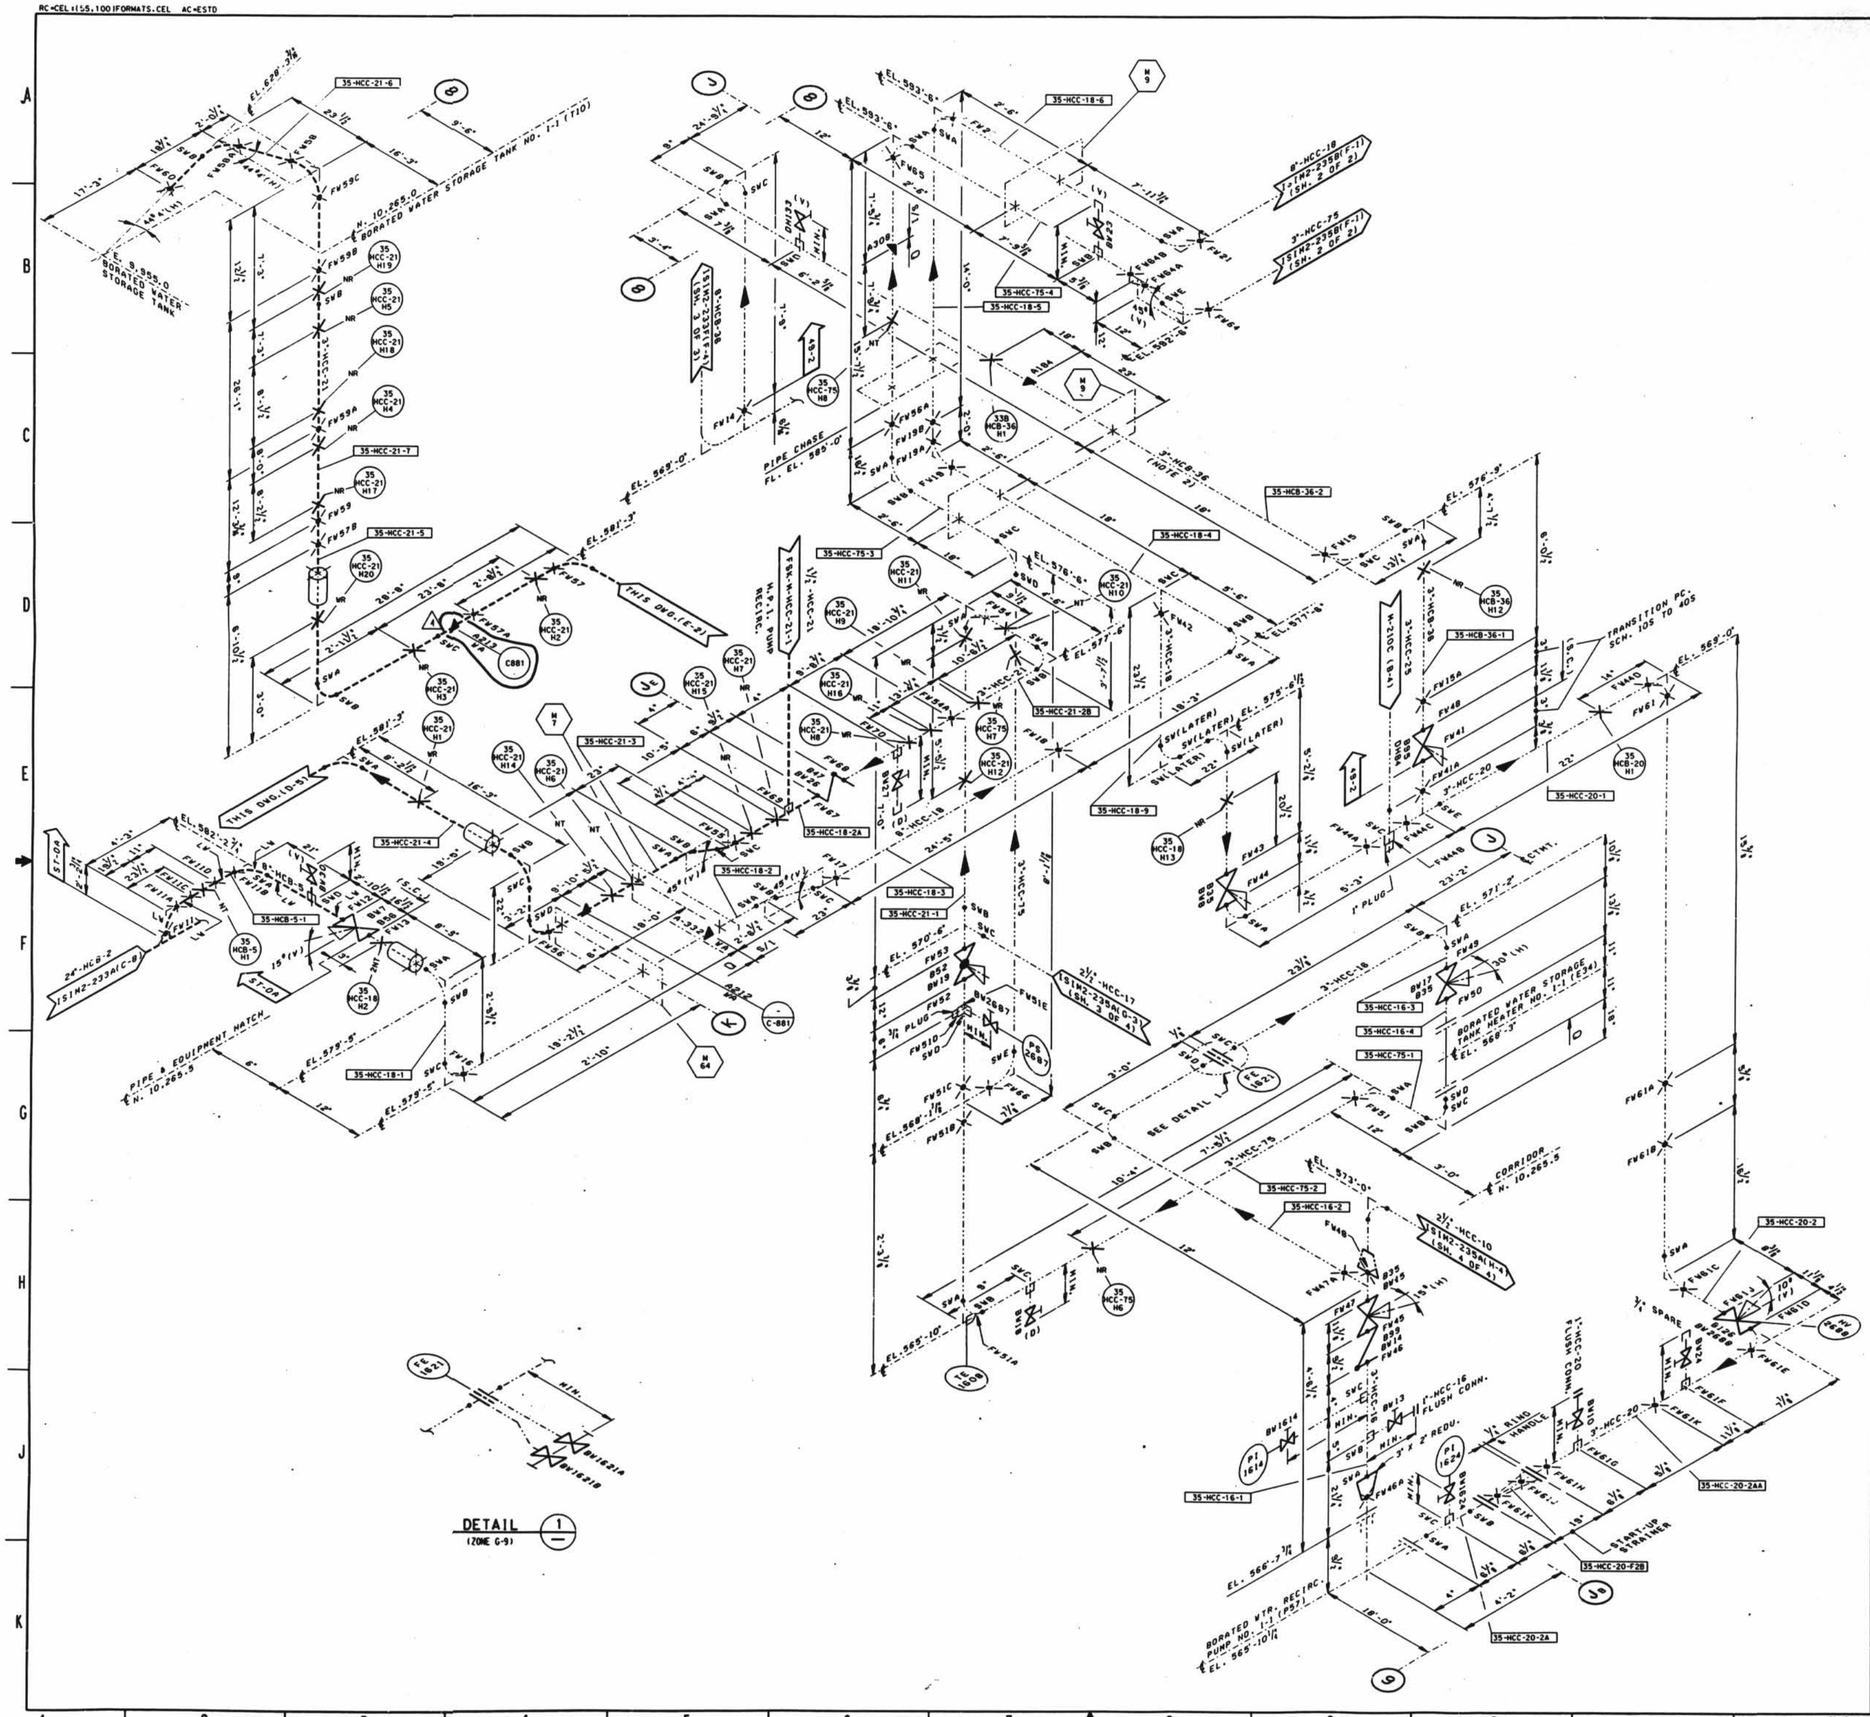

DETAIL 1 (ZONE G-9)

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D—D— HVAC DUCT

A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD
WOL	WELDOLET

⇦ ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2MHS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE SPENT FUEL POOL COOLING LINE 3"-HCB-36 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWC 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
3. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE ISI BOUNDARY, ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISID2-033A HIGH PRESSURE INJECTION
ISID2-033B DECAY HEAT TRAIN 1
ISID2-035 SPENT FUEL POOL COOLING SYSTEM

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENG. MGR.
4	8/14/00	INC. DCN ISIM2-235B-7 PER DDR 00-1746	SBW	[illegible]	[illegible]	[illegible]	—
3	8/5/93	INC DCN . M2-235B-6 FOR RFA 93-0254	"INITIALS ON FILE"				
2	1/15/93	INC DCN ISIM2-235B-5 FOR RFA 92-0689	"INITIALS ON FILE"				
1	5/21/92	INC DCN'S ISIM2-235B-1 & 3 FOR DCR 91-0011	"INITIALS ON FILE"				
0	9/11/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	EFB	LLC	MGP	ECC

SCALE N.T.S. DESIGNED Drawn CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
SPENT FUEL POOL COOLING SYSTEM
AUXILIARY BUILDING AREA 8

DRAWING NO. ISIM2-235B SHEET 1 REV. 4

DB 07-26-00 DFN=F:/ISIM/21M2358.DGN LEVELS 1234567890123456789012345678901234567890123456789012345678901 14 34X44 E SIZE PSC- 11

I CERTIFY THAT THIS IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL REPORTING OF BUSINESS OR PURPOSE ON THE DATE STATED. SALEM RECORDS MANAGEMENT DAVIS-BESSE DATE 5/7/03 OPERATOR

30X

D-48