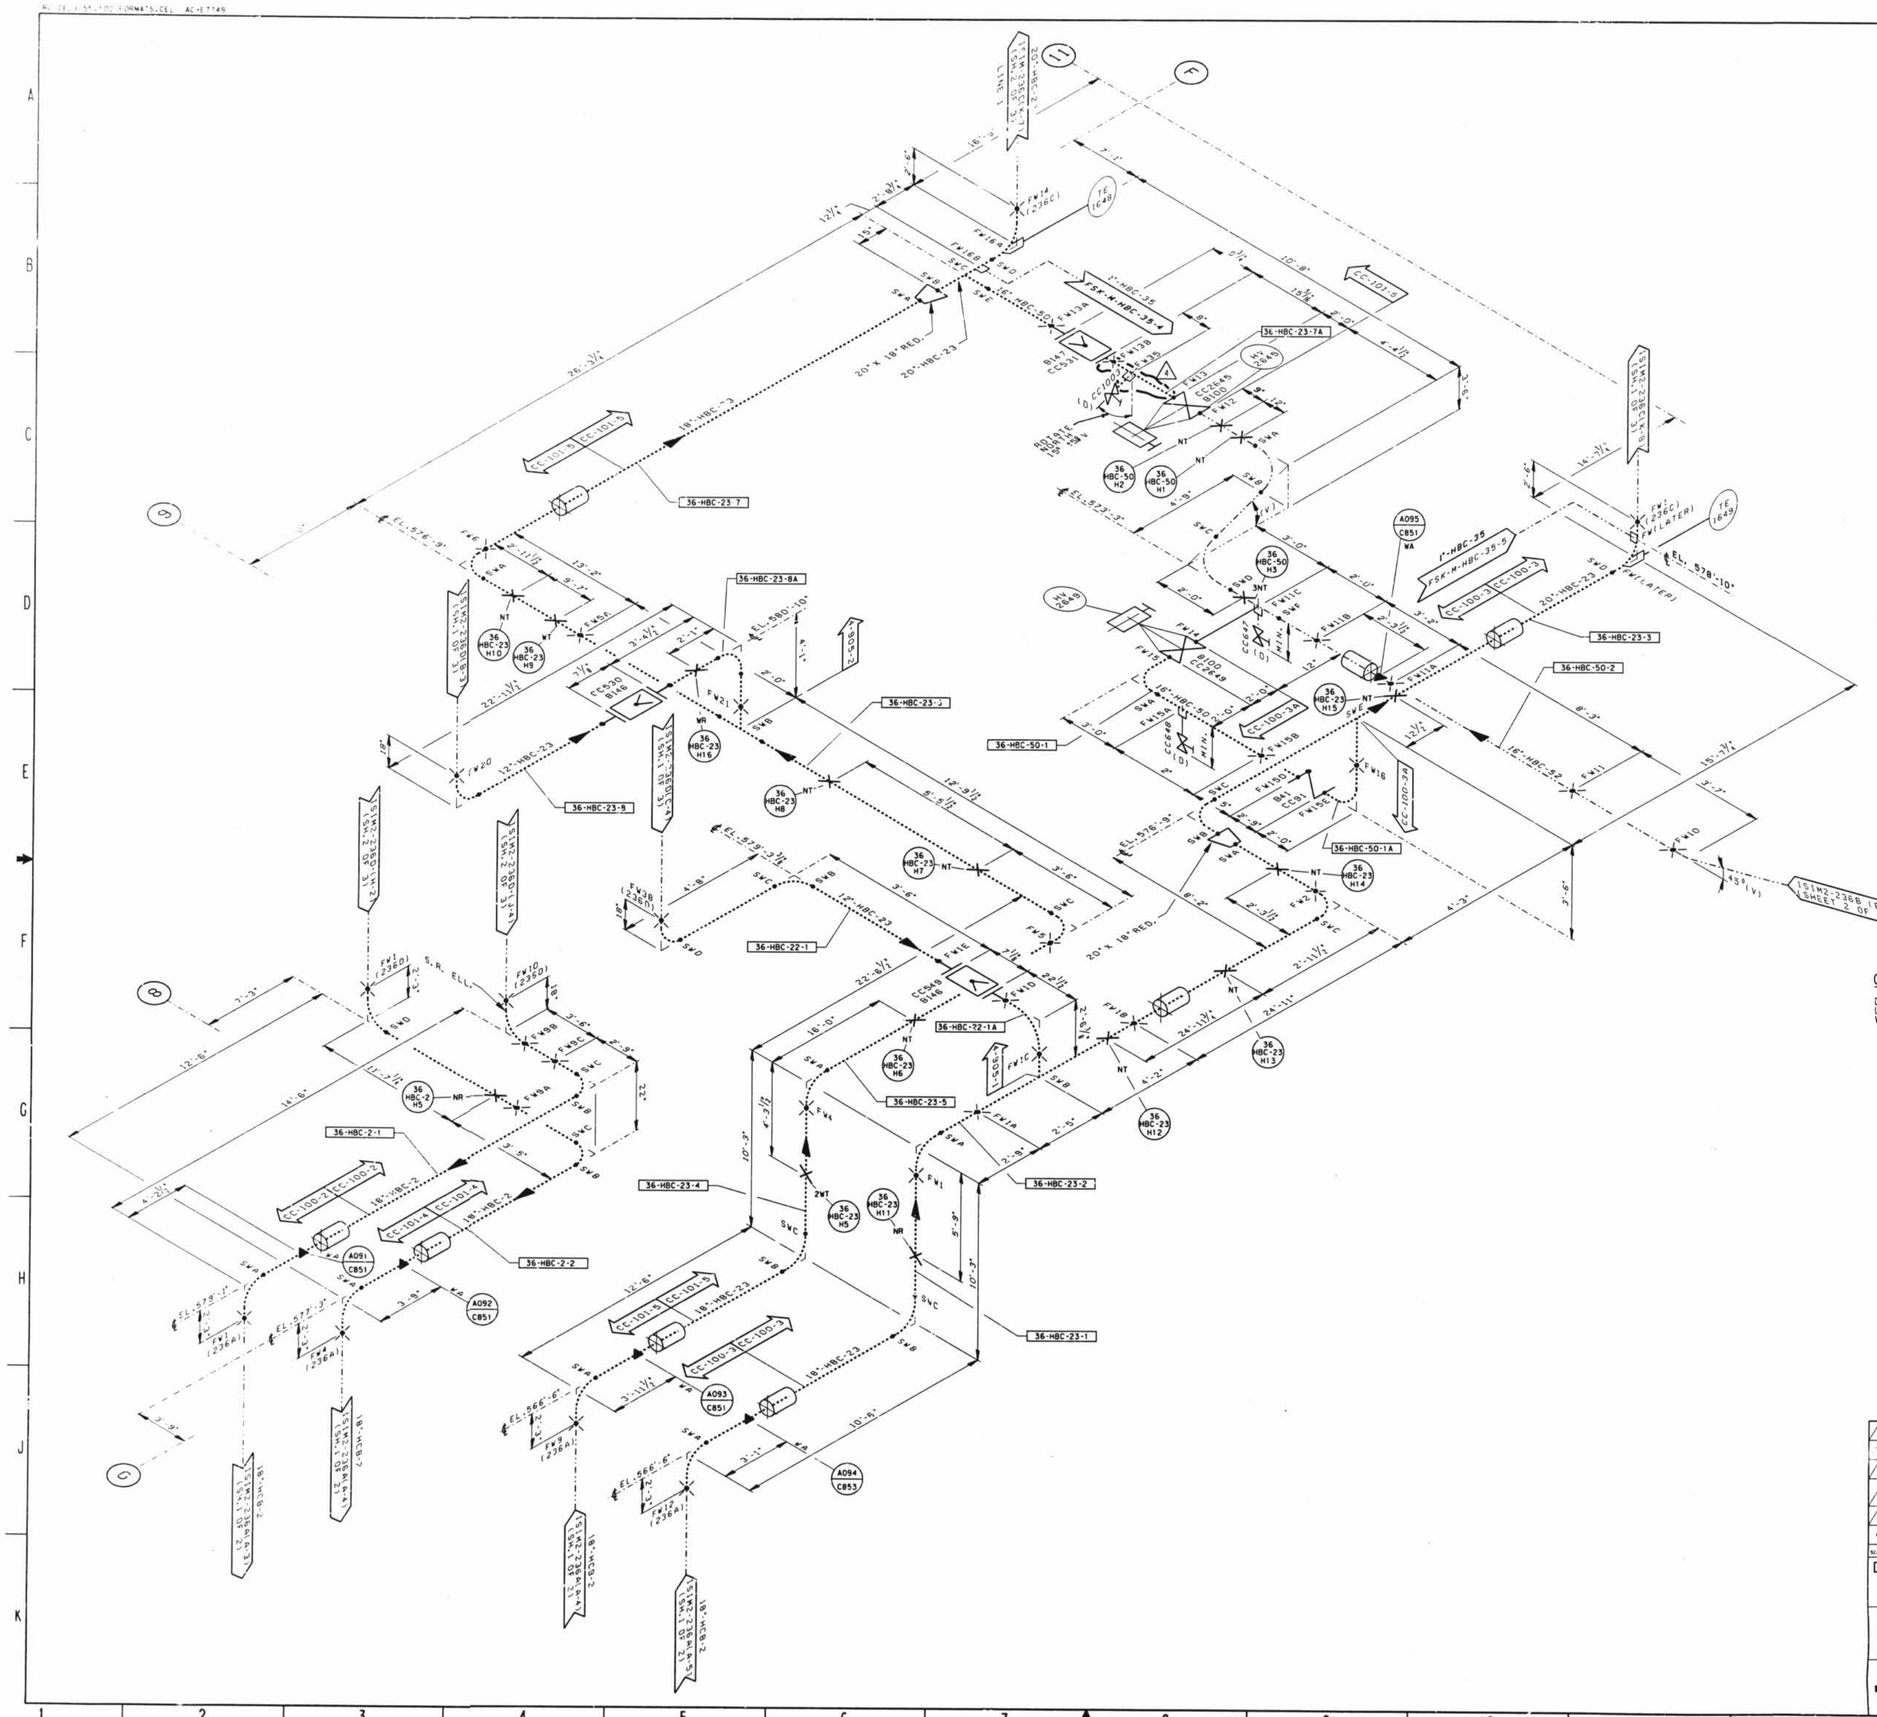

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D—D— HVAC DUCT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SNUBBER
- MS MECHANICAL SNUBBER
- N NON-WELDED SUPPORT ATTACHMENT
- W WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- WOL WELDOLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2NHS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE SUPPORTS ON THE COMPONENT COOLING WATER LINE 18"-HBC-23, 18"-HBC-2, 20"-HBC-23 & 12"-HBC-23 ARE WITHIN THE ISI EXAMINATION BOUNDARY. THE PIPING WELDS IN THESE LINES ARE SHOWN FOR REFERENCE PURPOSES ONLY. THESE WELDS MAY NOT BE REPRESENTED IN THE ACTUAL AS-BUILT CONDITION.
3. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE ISI BOUNDARY ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISID2-036B COMPONENT COOLING WATER SYSTEM.

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENG. MGR.
4	4/27/94	INC DCN ISIM2-236B-7 FOR RFA 94-0108	JFS				
3	08-17-93	INC DCN IS[illegible]-236B-6 FOR RFA 93-0254	"INITIALS ON FILE"				
2	09-22-92	INC DCN ISIM2-236B-5 FOR RFA 92-0232	"INITIALS ON FILE"				
1	4-22-92	INC DCN ISIM2-236B-2 PER DCR 91-0011 & ISIM2-236B-4 PER MOD 90-0062 SUP.0	"INITIALS ON FILE"				
0	9-17-90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	LPM	TRN RJC	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION ISOMETRIC
COMPONENT COOLING SYSTEM
AUXILIARY BUILDING EL. 565'-0"

DRAWING NO. ISIM2-236B (SHEET 1) REV. 4

D-52

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS. ON THE DATE SHOWN BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORDED SUBMITTED IMAGE. RECORDS MANAGEMENT SERVICES

6-27-94 30X