
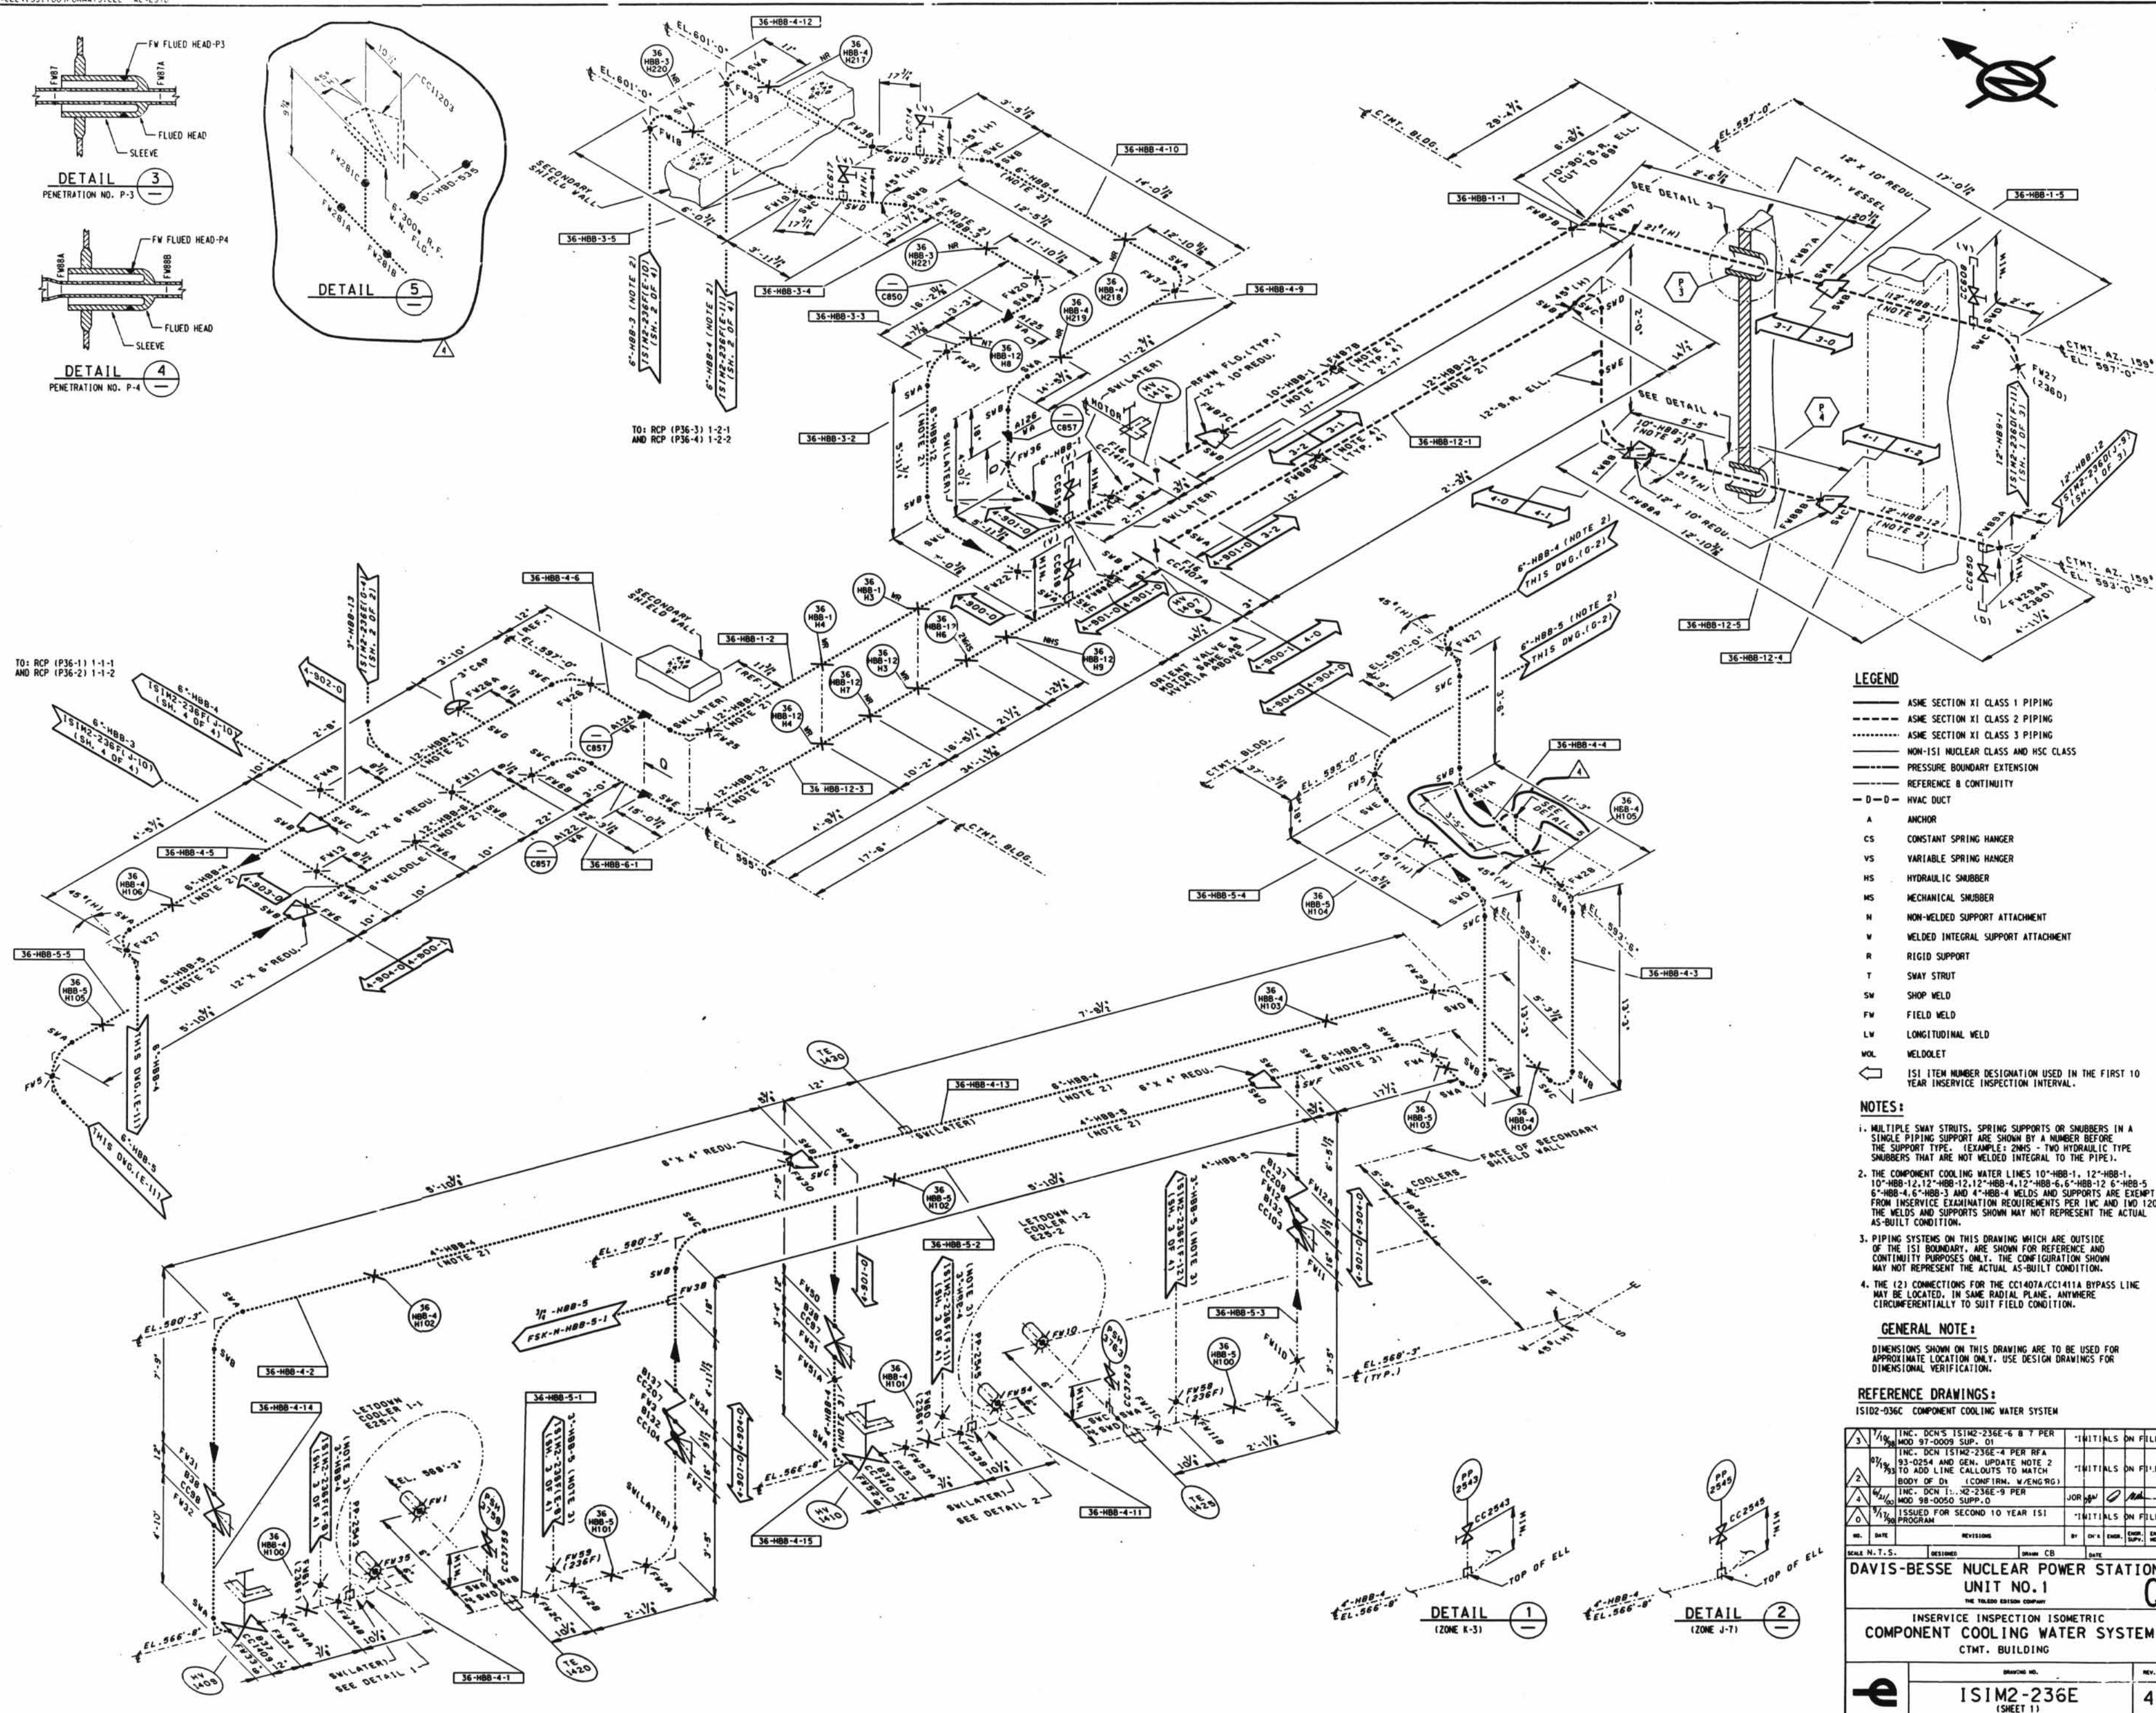
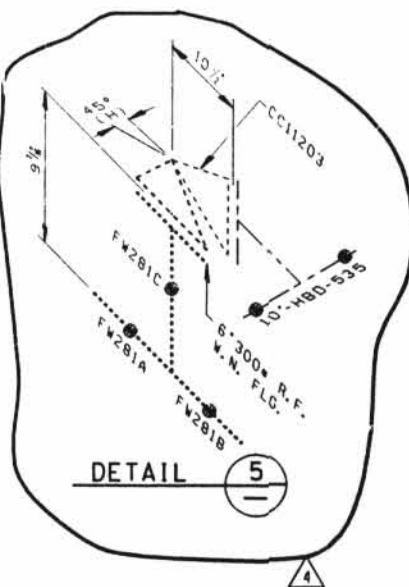
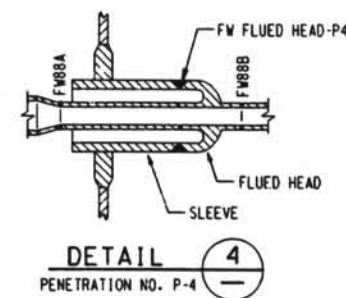


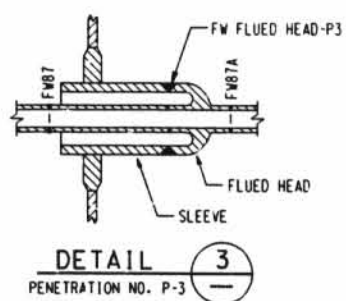

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D-D-HVAC DUCT
- A-ANCHOR
- CS-CONSTANT SPRING HANGER
- VS-VARIABLE SPRING HANGER
- HS-HYDRAULIC SNUBBER
- MS-MECHANICAL SNUBBER
- N-NON-WELDED SUPPORT ATTACHMENT
- W-WELDED INTEGRAL SUPPORT ATTACHMENT
- R-RIGID SUPPORT
- T-TWIST STRUT
- SW-SHOP WELD
- FW-FIELD WELD
- LW-LONGITUDINAL WELD
- WOL-WELDOLLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL

NOTES:

- MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2MS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
- THE COMPONENT COOLING WATER LINES 10\"/>

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

IS102-036C COMPONENT COOLING WATER SYSTEM

NO.	DATE	REVISIONS	BY	CHKD.	APP'D.	DESCRIPTION
1	10/1/79	INC. DCH'S IS102-236E-4 PER RFA 93-0254 AND GEN. UPDATE NOTE 2 TO ADD LINE CALLOUTS TO MATCH BODY OF D. (CONFIRM. W/ENGR)	JOR	AD		"INITIALS ON FILE"
2	10/1/79	INC. DCH'S IS102-236E-4 PER RFA 93-0254 AND GEN. UPDATE NOTE 2 TO ADD LINE CALLOUTS TO MATCH BODY OF D. (CONFIRM. W/ENGR)	JOR	AD		"INITIALS ON FILE"
3	10/1/79	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	JOR	AD		"INITIALS ON FILE"

DAVIS-BESSE NUCLEAR POWER STATION UNIT NO. 1

INSERVICE INSPECTION ISOMETRIC COMPONENT COOLING WATER SYSTEM CMT. BUILDING

ISIM2-236E (SHEET 1)

14 3044 C SIZE

7-11-00 Lisa Bowning 30X