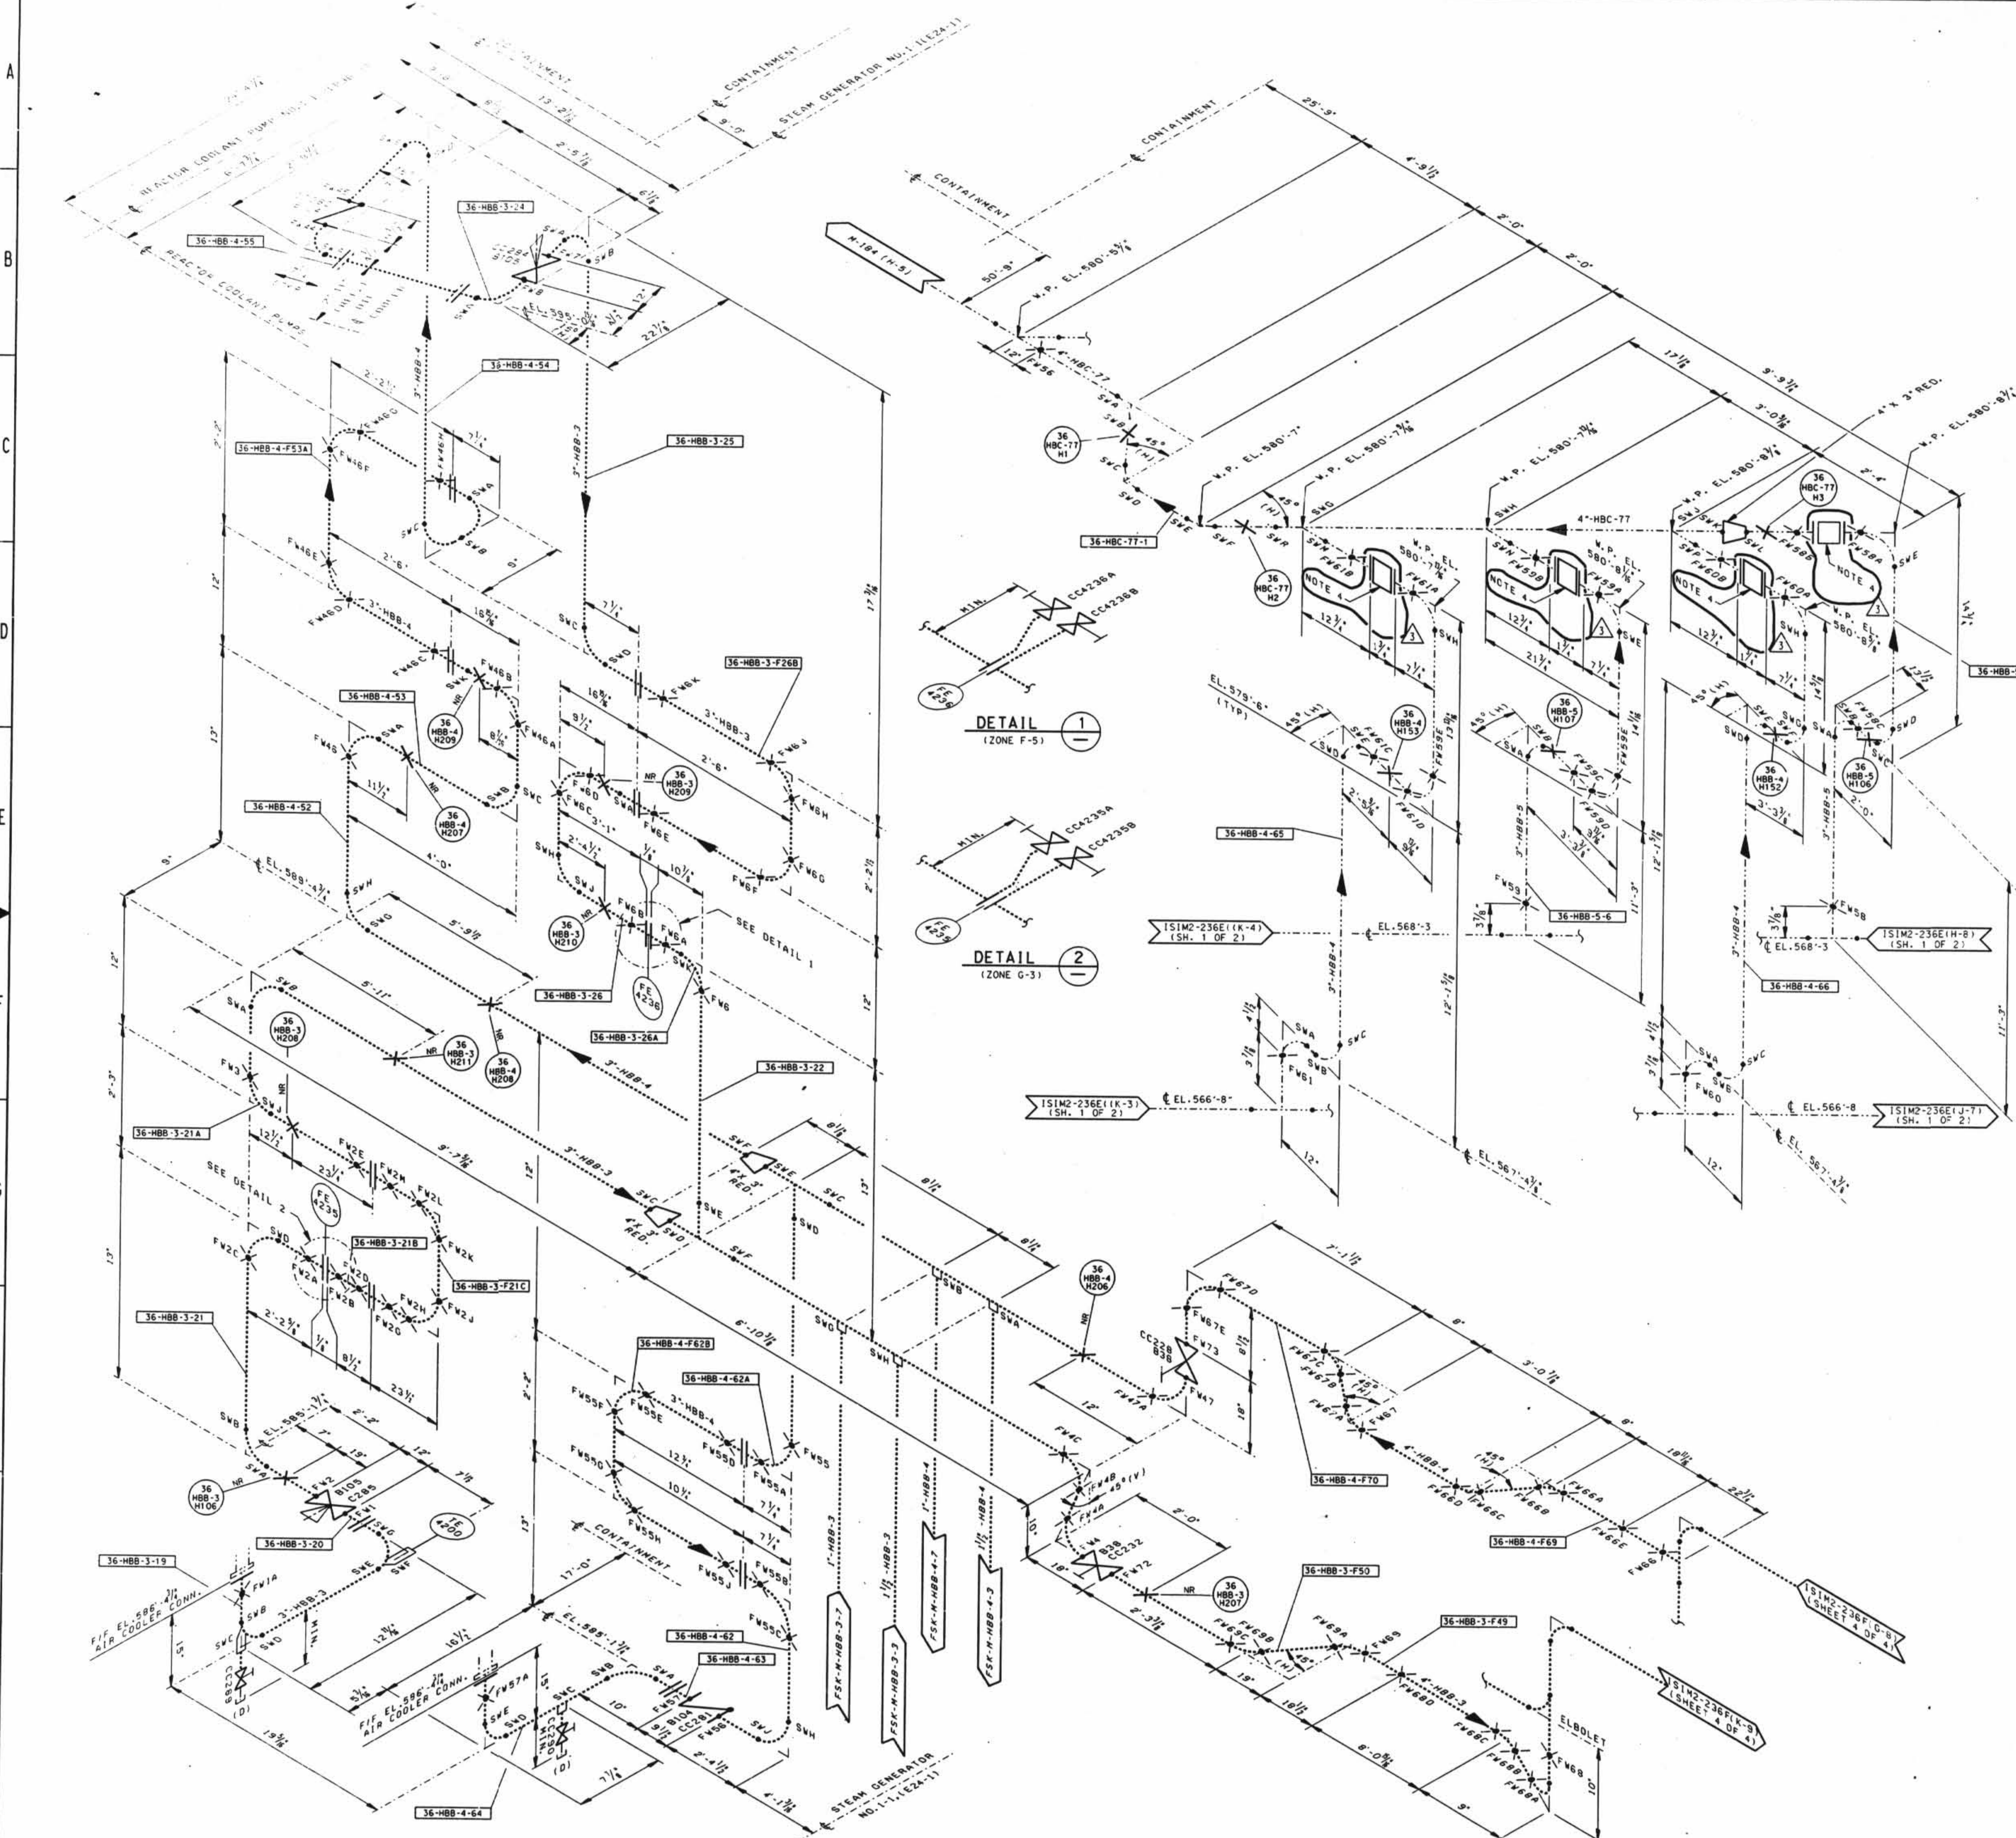

LEGEND

————	ASME SECTION XI CLASS 1 PIPING
– – – –	ASME SECTION XI CLASS 2 PIPING
··········	ASME SECTION XI CLASS 3 PIPING
————	NON-ISI NUCLEAR CLASS AND HSC CLASS
—·—·—	PRESSURE BOUNDARY EXTENSION
–·–·–	REFERENCE & CONTINUITY
–D–D–	HVAC DUCT
A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD
WOL	WELDOLET
⇦	ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2NHS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE COMPONENT COOLING WATER LINE 4"-HBB-3, 3"-HBB-3, 4"-HBB-4, 3"-HBB-4 & 3"-HBB-5 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWD 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
3. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE ISI BOUNDARY, ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
4. (3) AN 1 3/4" THICK BLANK PLATE HAS BEEN INSERTED BETWEEN THESE FLANGES PER MOD 98-0050-00.

GENERAL NOTE

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISID2-036C COMPONENT COOLING WATER SYSTEM
ISID2-040D REACTOR COOLENT PUMP & MOTOR

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENG. MGR.
3	6/16/00	INC. DCN ISIM2-236F-14 PER MOD 98-0050 SUPP.0	JOR	SBW			—
2	7/14/93	INC. DCN ISIM2-236F-12 FOR RFA 93-0254	"INITIALS ON FILE"				
1	4/9/92	INC. DCN'S ISIM2-236F-5 & 6 FOR DCR 91-001	"INITIALS ON FILE"				
0	09/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	JJK	TRN RJC	TWB	MCP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
COMPONENT COOLING WATER SYSTEM
CONTAINMENT BUILDING (P36-2)

DRAWING NO. ISIM2-236F (SHEET 3) REV. 3

DB 05-09-00 DFN=I:/ISIM/2IM236F3 .DGN
LEVELS 1234567890123456789012345678901234567890123456789012
34X44 "E" SIZE

D-64

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S)
DATE 7-11-00 Lisa Bowenige 30X