




**LEGEND**

- ASME SECTION XI CLASS 1 PIPING
- - - ASME SECTION XI CLASS 2 PIPING
- ..... ASME SECTION XI CLASS 3 PIPING
- ..... NON-151 NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D - D HVAC DUCT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SMUBBER
- MS MECHANICAL SMUBBER
- N NON-WELDED SUPPORT ATTACHMENT
- W WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- WOL WELDOLET
- ◁ 151 ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.



**DETAIL 1**  
(ZONE G-11)

**NOTES:**


1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SMUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2MS - TWO HYDRAULIC TYPE SMUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE SUPPORTS ON THE COMPONENT COOLING LINE 6"-HBC-26, AND 6"-HBC-27 ARE WITHIN THE 151 EXAMINATION BOUNDARY. THE PIPING WELDS IN THESE LINES ARE SHOWN FOR REFERENCE PURPOSES ONLY. THESE WELDS MAY NOT BE REPRESENTED IN THE ACTUAL AS-BUILT CONDITION.

**GENERAL NOTE:**

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

**REFERENCE DRAWINGS:**

15102-0368 COMPONENT COOLING WATER SYSTEM

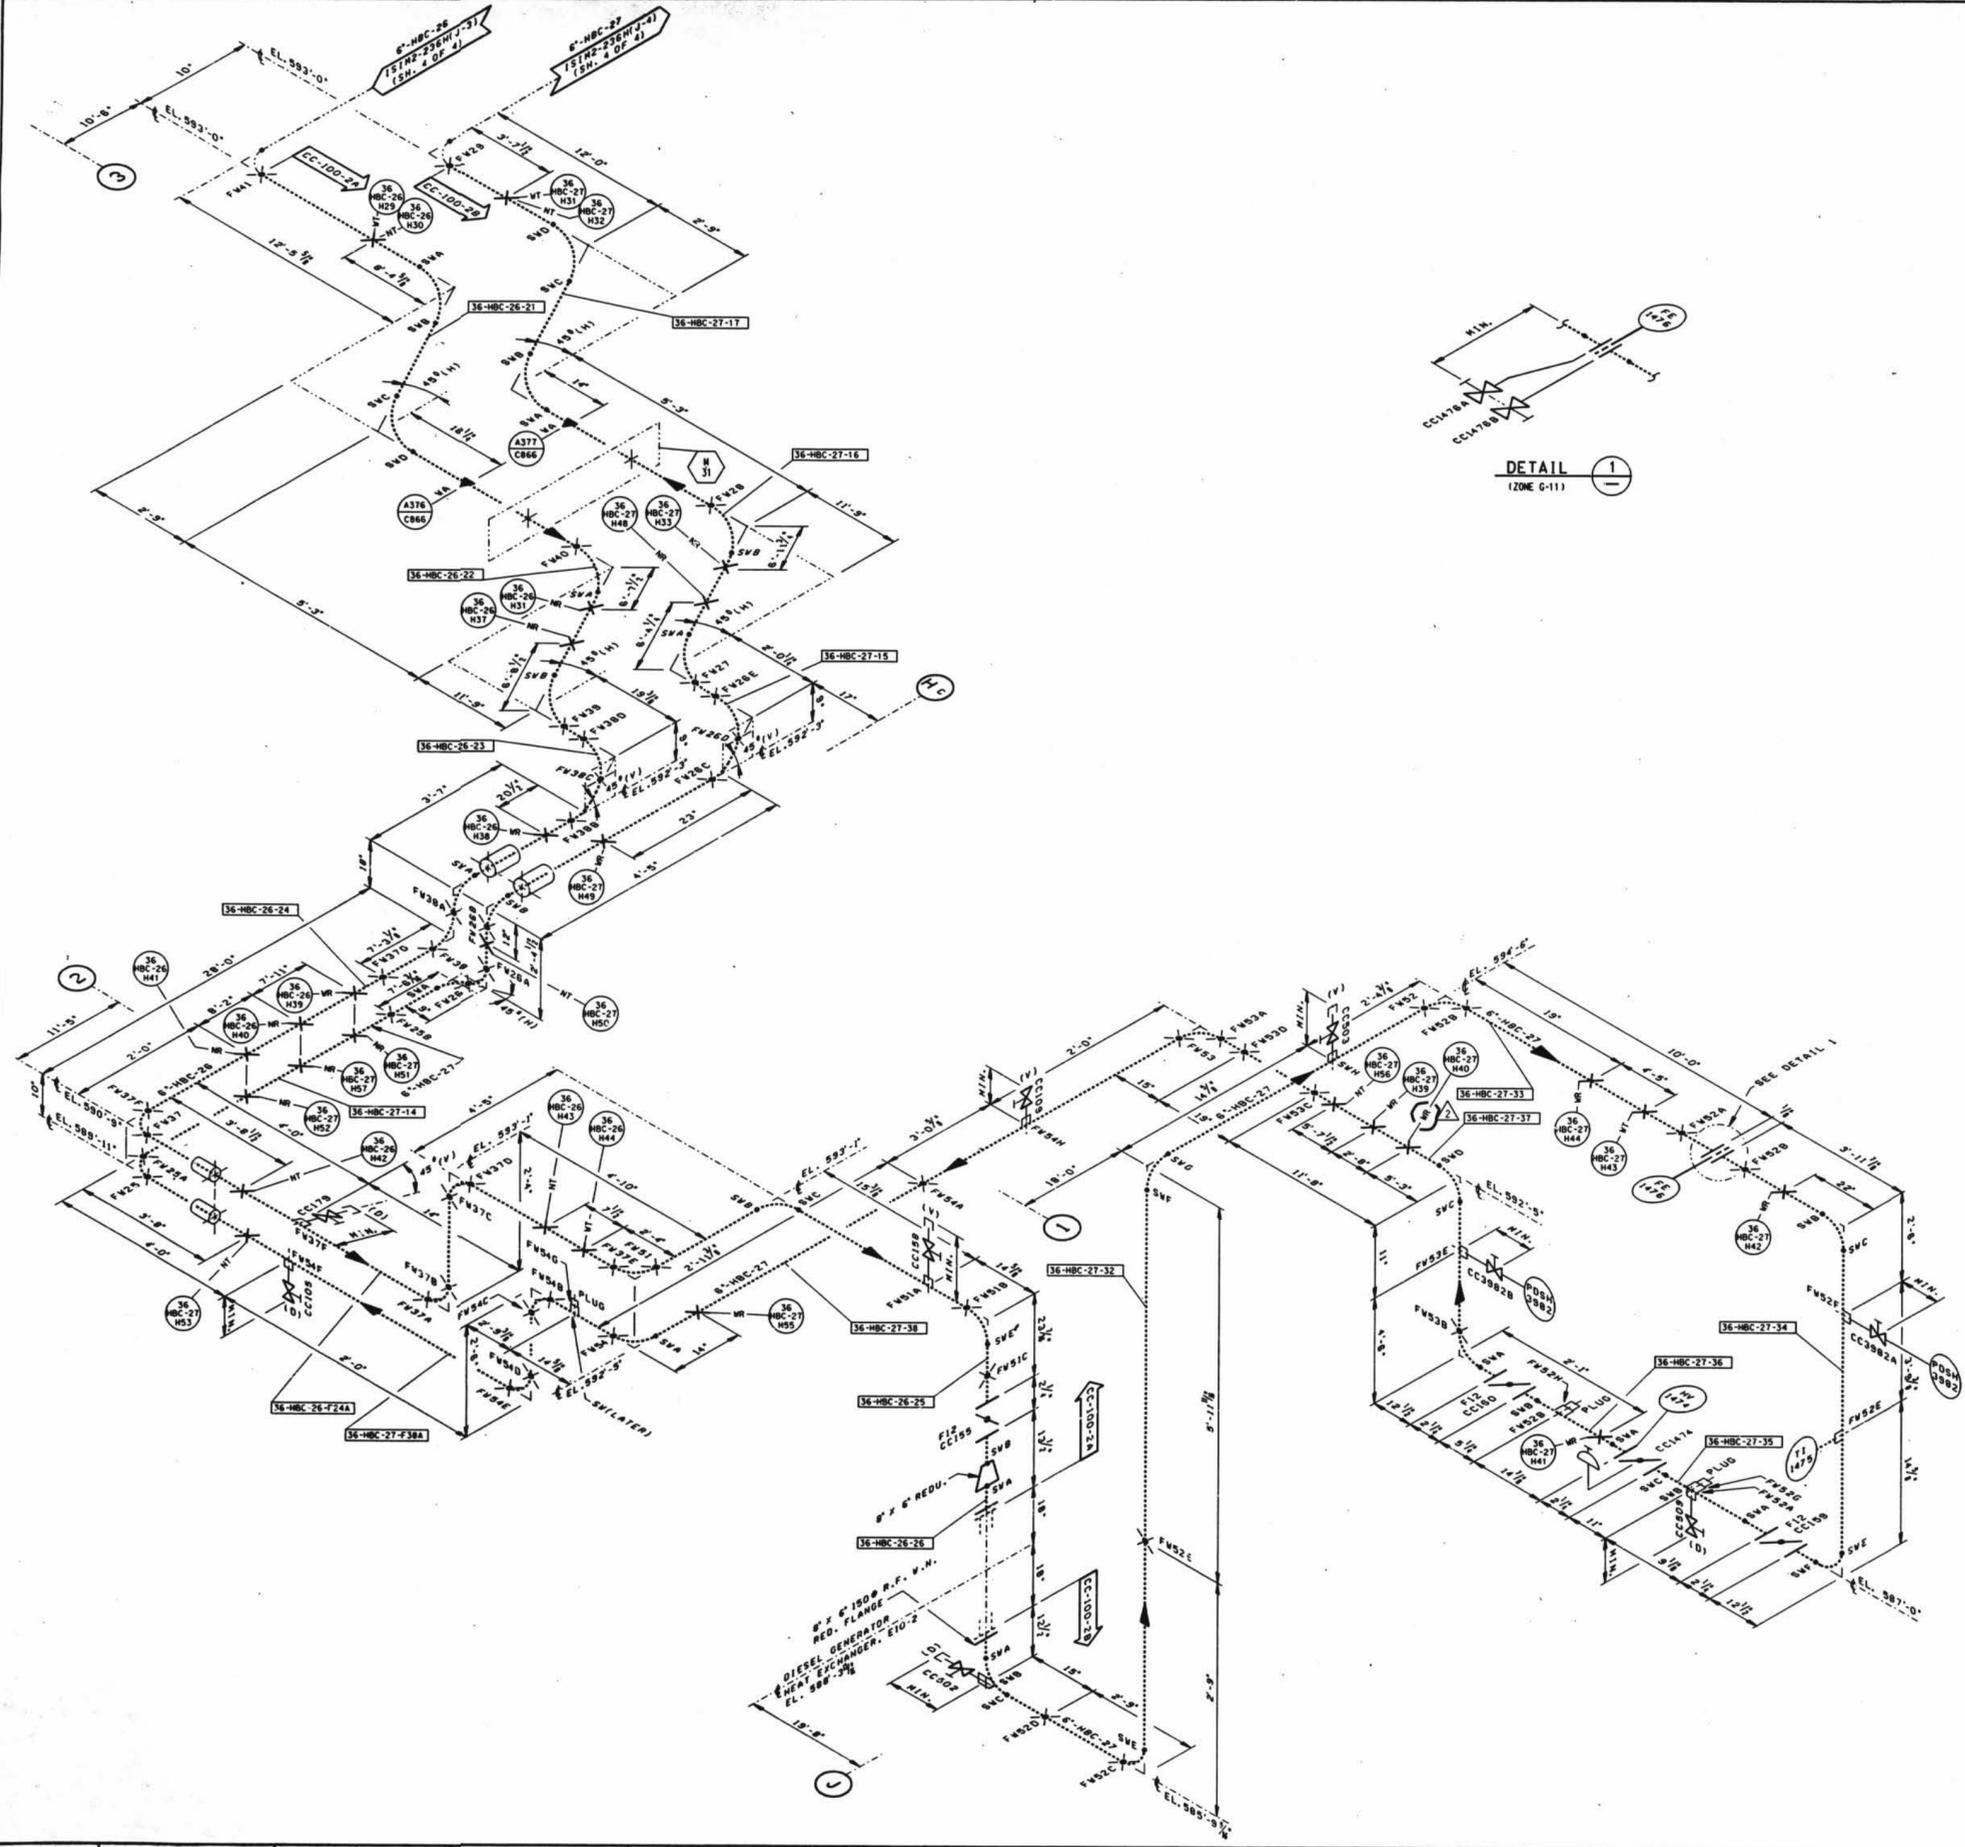

NO.	DATE	REVISION	BY	CHK'D	APP'D
1	11/14/91	INC DCN 151M2-236H-5 PER DCR 91-1047	SRV	LWK	—
2	01/17/92	INC DCN 151M2-236H-2 FOR DCR 91-001	—	—	INITIALS ON FILE
3	07/17/92	ISSUED FOR SECOND 10 YEAR 151 PROGRAM	—	—	CB EFB LLC MGP ECC

SCALE: N.T.S. DESIGNED: [ ] DRAWN: CB DATE: [ ]

**DAVIS-BESSE NUCLEAR POWER STATION UNIT NO. 1**

INSERVICE INSPECTION ISOMETRIC COMPONENT COOLING SYSTEM SUPPLY AND RETURN EMERG. DIESEL GEN.

DRAWING NO. 151M2-236H SHEET 2 REV. 2

D-67