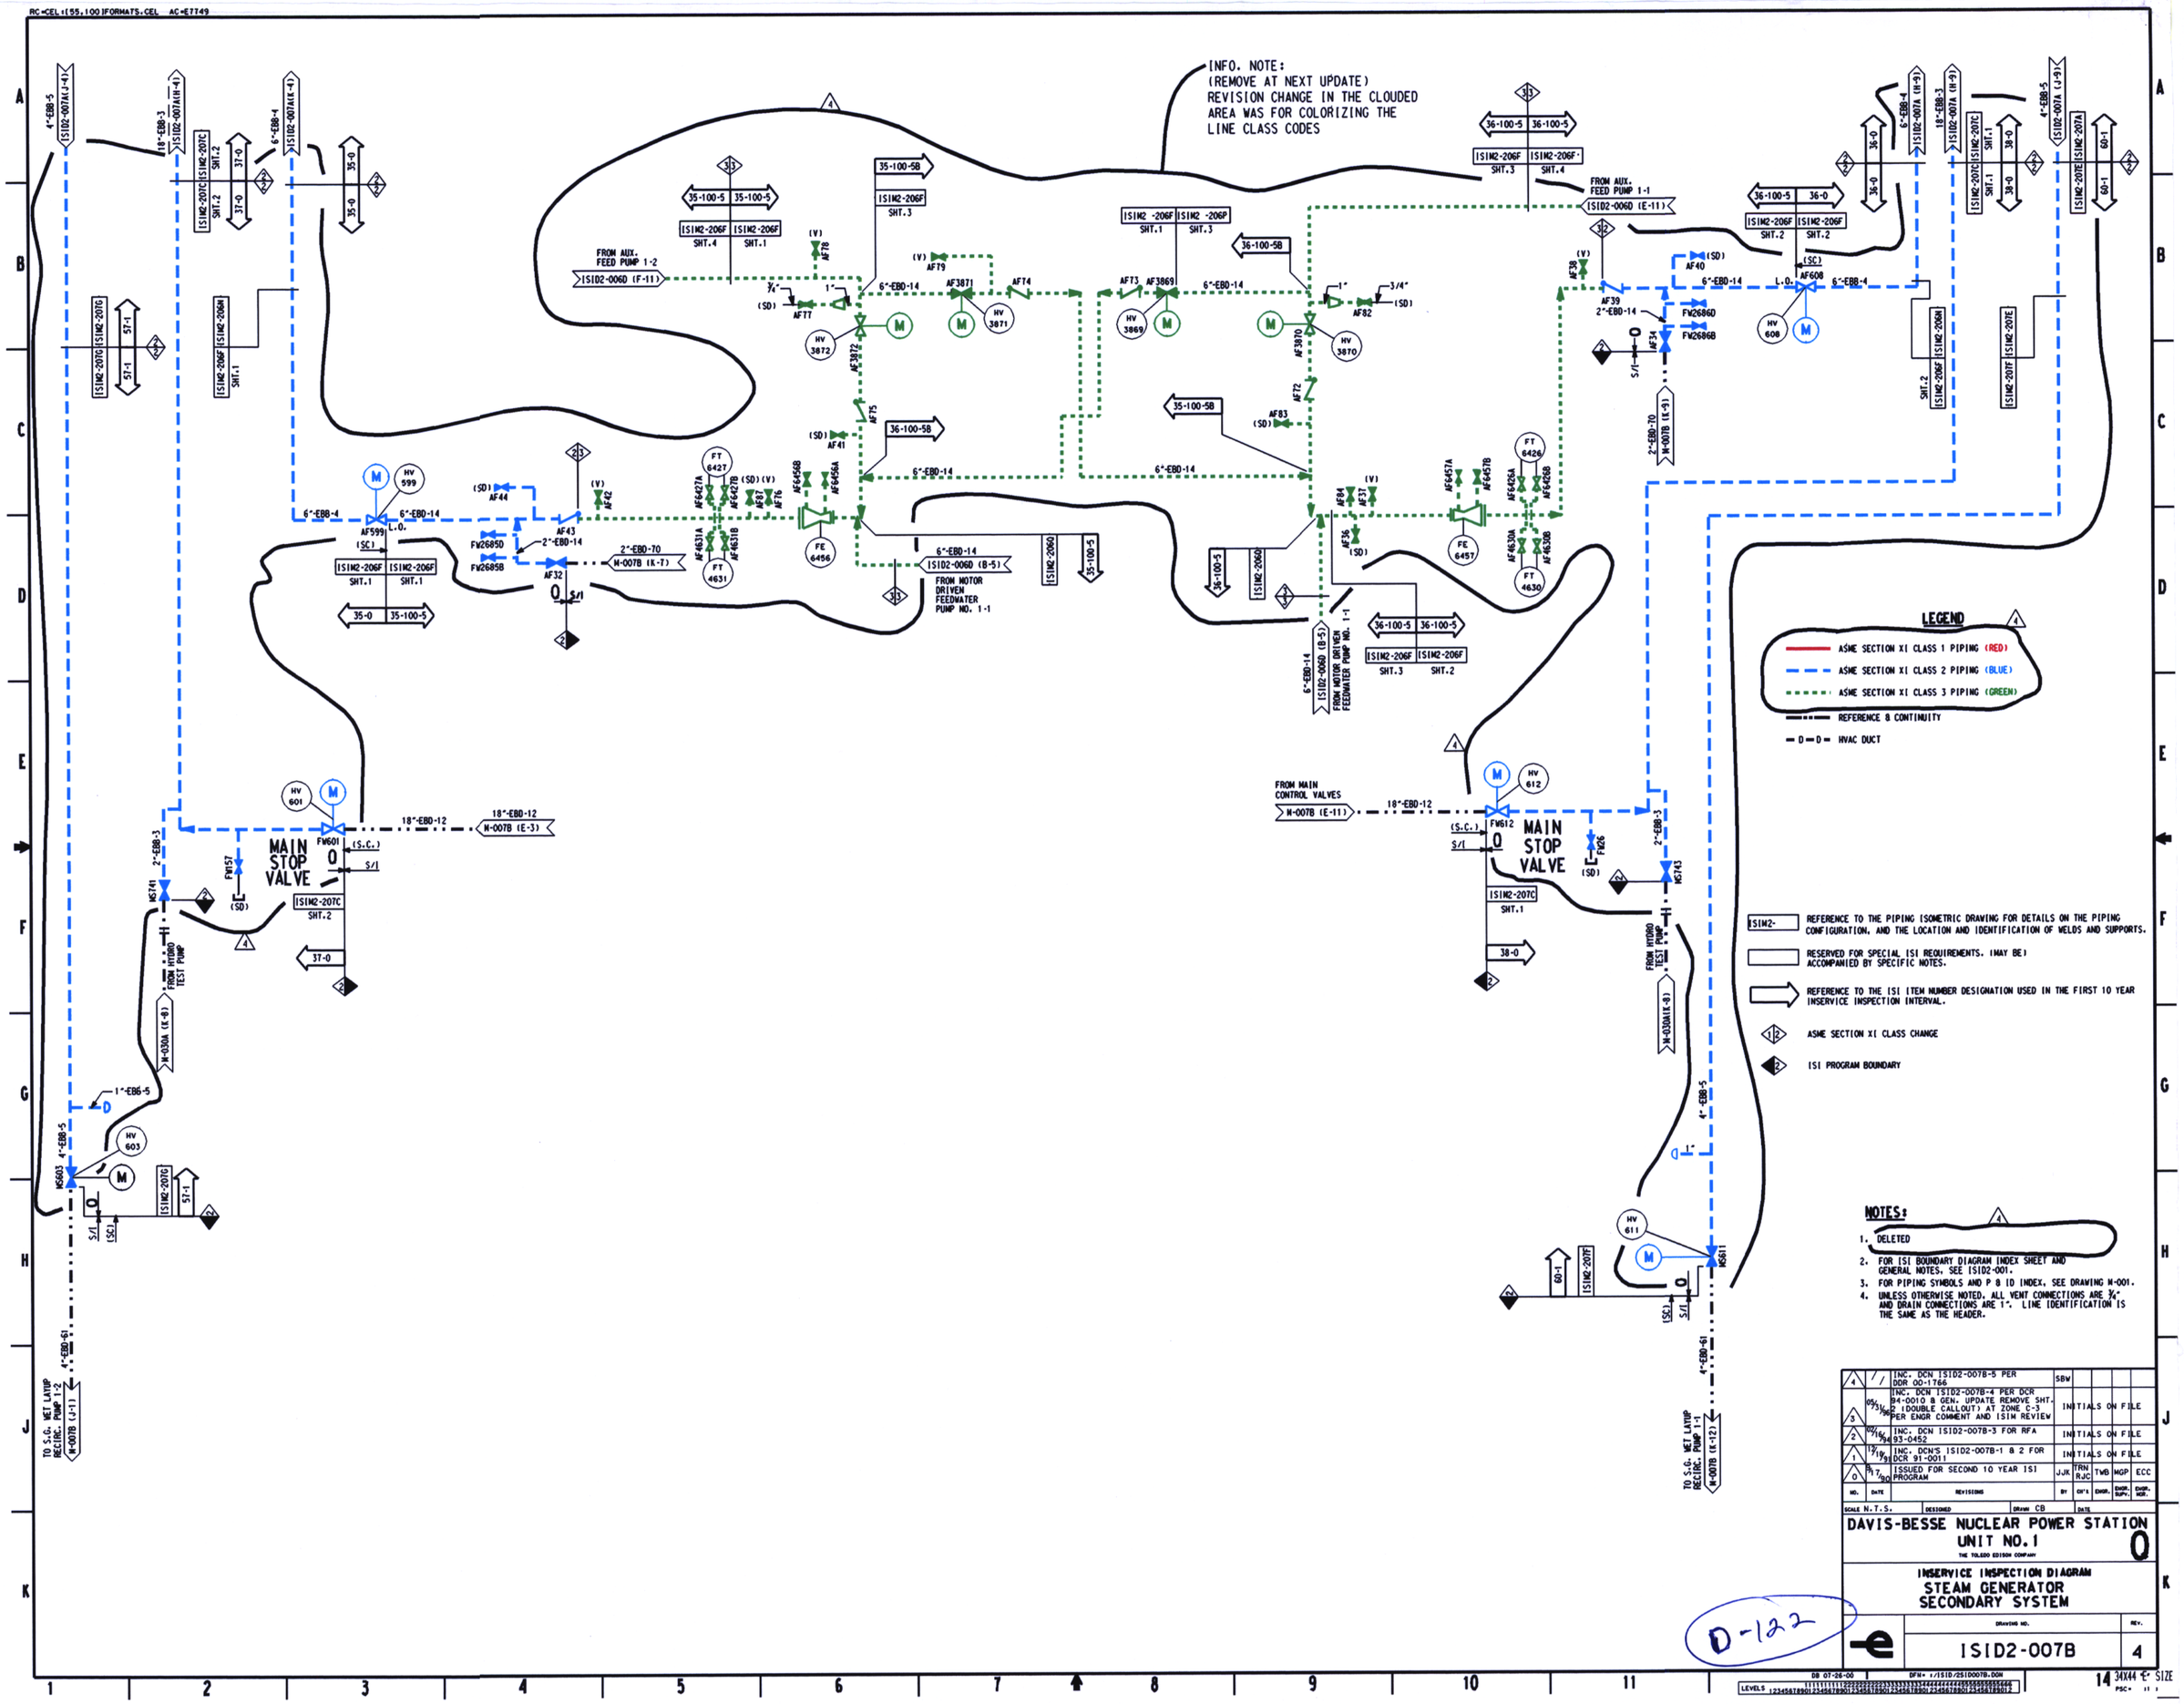

INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED AREA WAS FOR COLORIZING THE LINE CLASS CODES
MAIN STOP VALVE
MAIN STOP VALVE
FROM AUX. FEED PUMP 1-2
FROM AUX. FEED PUMP 1-1
FROM MOTOR DRIVEN FEEDWATER PUMP NO. 1-1
FROM MAIN CONTROL VALVES
FROM HYDRO TEST PUMP
TO S.G. WET LAYUP RECIRC. PUMP 1-2
TO S.G. WET LAYUP RECIRC. PUMP 1-1
LEGEND
ASME SECTION XI CLASS 1 PIPING (RED)
ASME SECTION XI CLASS 2 PIPING (BLUE)
ASME SECTION XI CLASS 3 PIPING (GREEN)
REFERENCE & CONTINUITY
HVAC DUCT
REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.
REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
ASME SECTION XI CLASS CHANGE
ISI PROGRAM BOUNDARY
NOTES:
1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE 3/4" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
4 INC. DCN ISID2-007B-5 PER DDR 00-1766 SBW
3 05/31/96 INC. DCN ISID2-007B-4 PER DCR 94-0010 & GEN. UPDATE REMOVE SHT. 2 (DOUBLE CALLOUT) AT ZONE C-3 PER ENGR COMMENT AND ISIM REVIEW INITIALS ON FILE
2 02/16/94 INC. DCN ISID2-007B-3 FOR RFA 93-0452 INITIALS ON FILE
1 12/19/91 INC. DCN'S ISID2-007B-1 & 2 FOR DCR 91-0011 INITIALS ON FILE
0 8/17/90 ISSUED FOR SECOND 10 YEAR ISI PROGRAM JJK TRN RJC TWB MGP ECC
NO. DATE REVISIONS BY CH'K ENGR. ENGR. SUPV. ENGR. MGR.
SCALE N.T.S. DESIGNED DRAWN CB DATE
DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY
0
INSERVICE INSPECTION DIAGRAM
STEAM GENERATOR SECONDARY SYSTEM
DRAWING NO. ISID2-007B
REV. 4
D-122