


LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- 0 = 0 - HVAC DUCT

NOTES:

- ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
- RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE ACCOMPANIED BY SPECIFIC NOTES.)
- REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
- ASME SECTION XI CLASS CHANGE
- ISI PROGRAM BOUNDARY

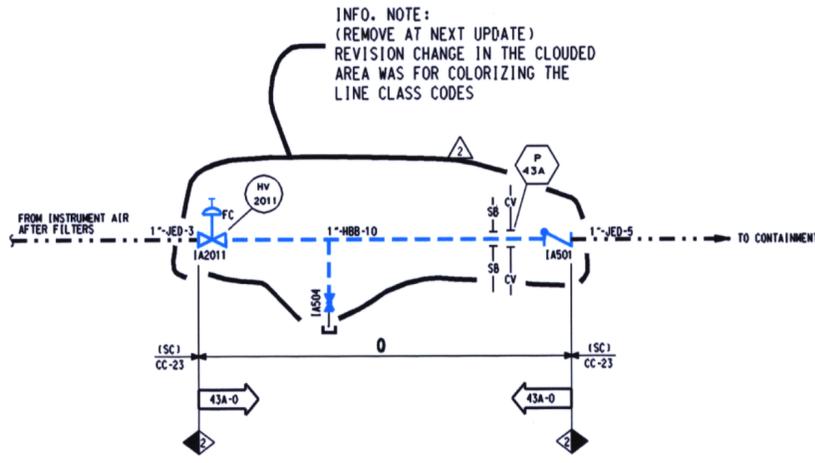

- NOTES:**
1. DELETED
 2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE IS102-001.
 3. FOR PIPING SYMBOLS AND P. 8 TO INDEX, SEE DRAWING M-001.
 4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE 3/4" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.

0-124

| | | | | | | |
|--|---------------------------------------|----------|---------|---------|-------|-----------|
| 2 | ISID DCN IS102-015A-2 PER DDR 00-1766 | SBW | | | | |
| 1 | INC. DCN IS102-015A-1 FOR DCR 91-0011 | | INITIAL | ON FILE | | |
| 0 | ISSUED FOR SECOND 10 YEAR ISI PROGRAM | CB | MTF | JBC | JDE | MGP |
| NO. | DATE | BY | CHK'D | ENGR. | SUPV. | DRW. MGR. |
| SCALE N.T.S. | | DESIGNED | DRWEN | CB | DATE | |
| DAVIS-BESSE NUCLEAR POWER STATION | | | | | | |
| UNIT NO. 1 | | | | | | |
| INSERVICE INSPECTION DIAGRAM | | | | | | |
| INSTRUMENT AIR SYSTEM | | | | | | |
| DRAWING NO. | | REV. | | | | |
| ISID2-015A | | 2 | | | | |