RC=CEL:[55,100]FORMATS.CEL AC=E7749

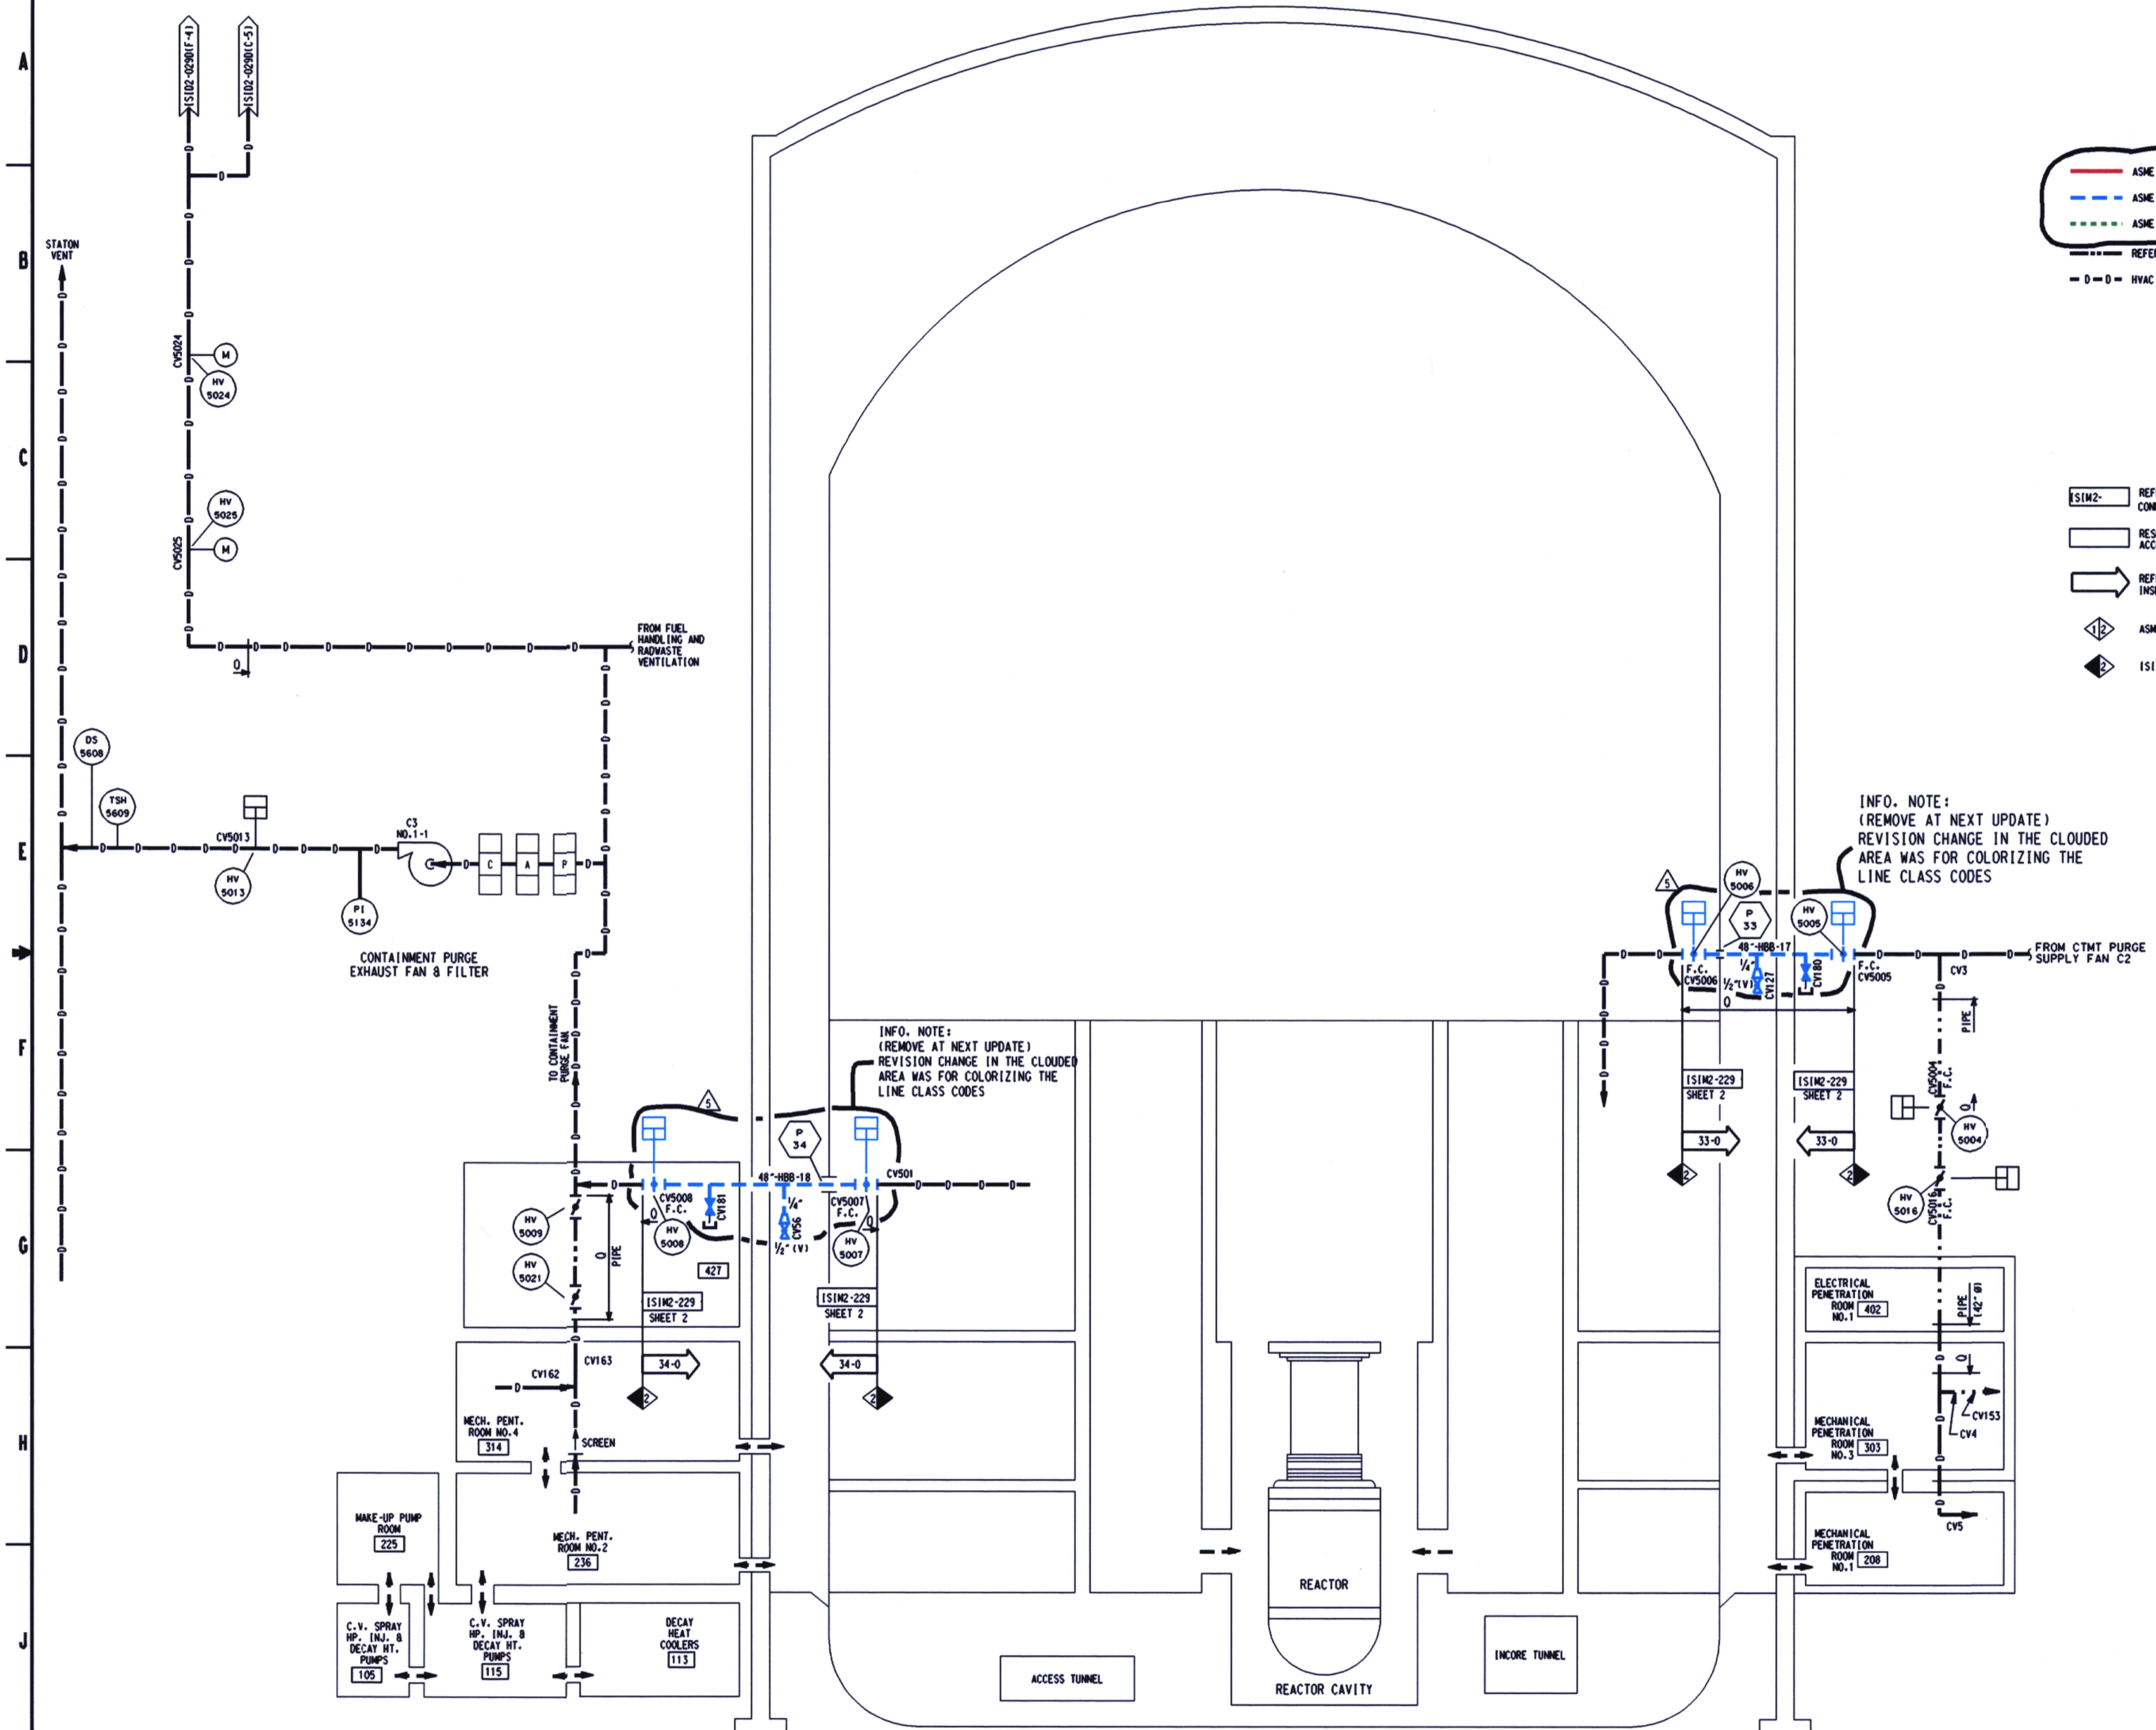

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- — D — D — HVAC DUCT

- ISIM2- : REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
- RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.
- REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
- ASME SECTION XI CLASS CHANGE
- ISI PROGRAM BOUNDARY

INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED AREA WAS FOR COLORIZING THE LINE CLASS CODES

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENGR. MGR.
5	/ /	INC DCN ISID2-029E-5 PER DDR 00-1766	SBW				
4	09/25/95	INC DCN ISID2-029E-4 FOR DCR 94-0067	"INITIALS ON FILE"				
3	02/16/94	INC DCN ISID2-029E-3 FOR DCR 93-0065	"INITIALS ON FILE"				
2	08/17/93	INC DCN ISID2-029E-2 FOR RFA 93-0171	"INITIALS ON FILE"				
1	12/10/91	INC DCN ISID2-029E-1 FOR DCR 91-0011	"INITIALS ON FILE"				
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	"INITIALS ON FILE"				

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1

THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
CONTAINMENT AND PENETRATION ROOMS SHT. 4

DRAWING NO. ISID2-029E REV. 5

D-133

DB 08-10-00 DFN=1:/ISID/2SID029E.DGN

LEVELS 1111111111222222222233333333334444444444555555555566666 1234567890123456789012345678901234567890123456789012

34X44 "E" SIZE PSC= #1 1