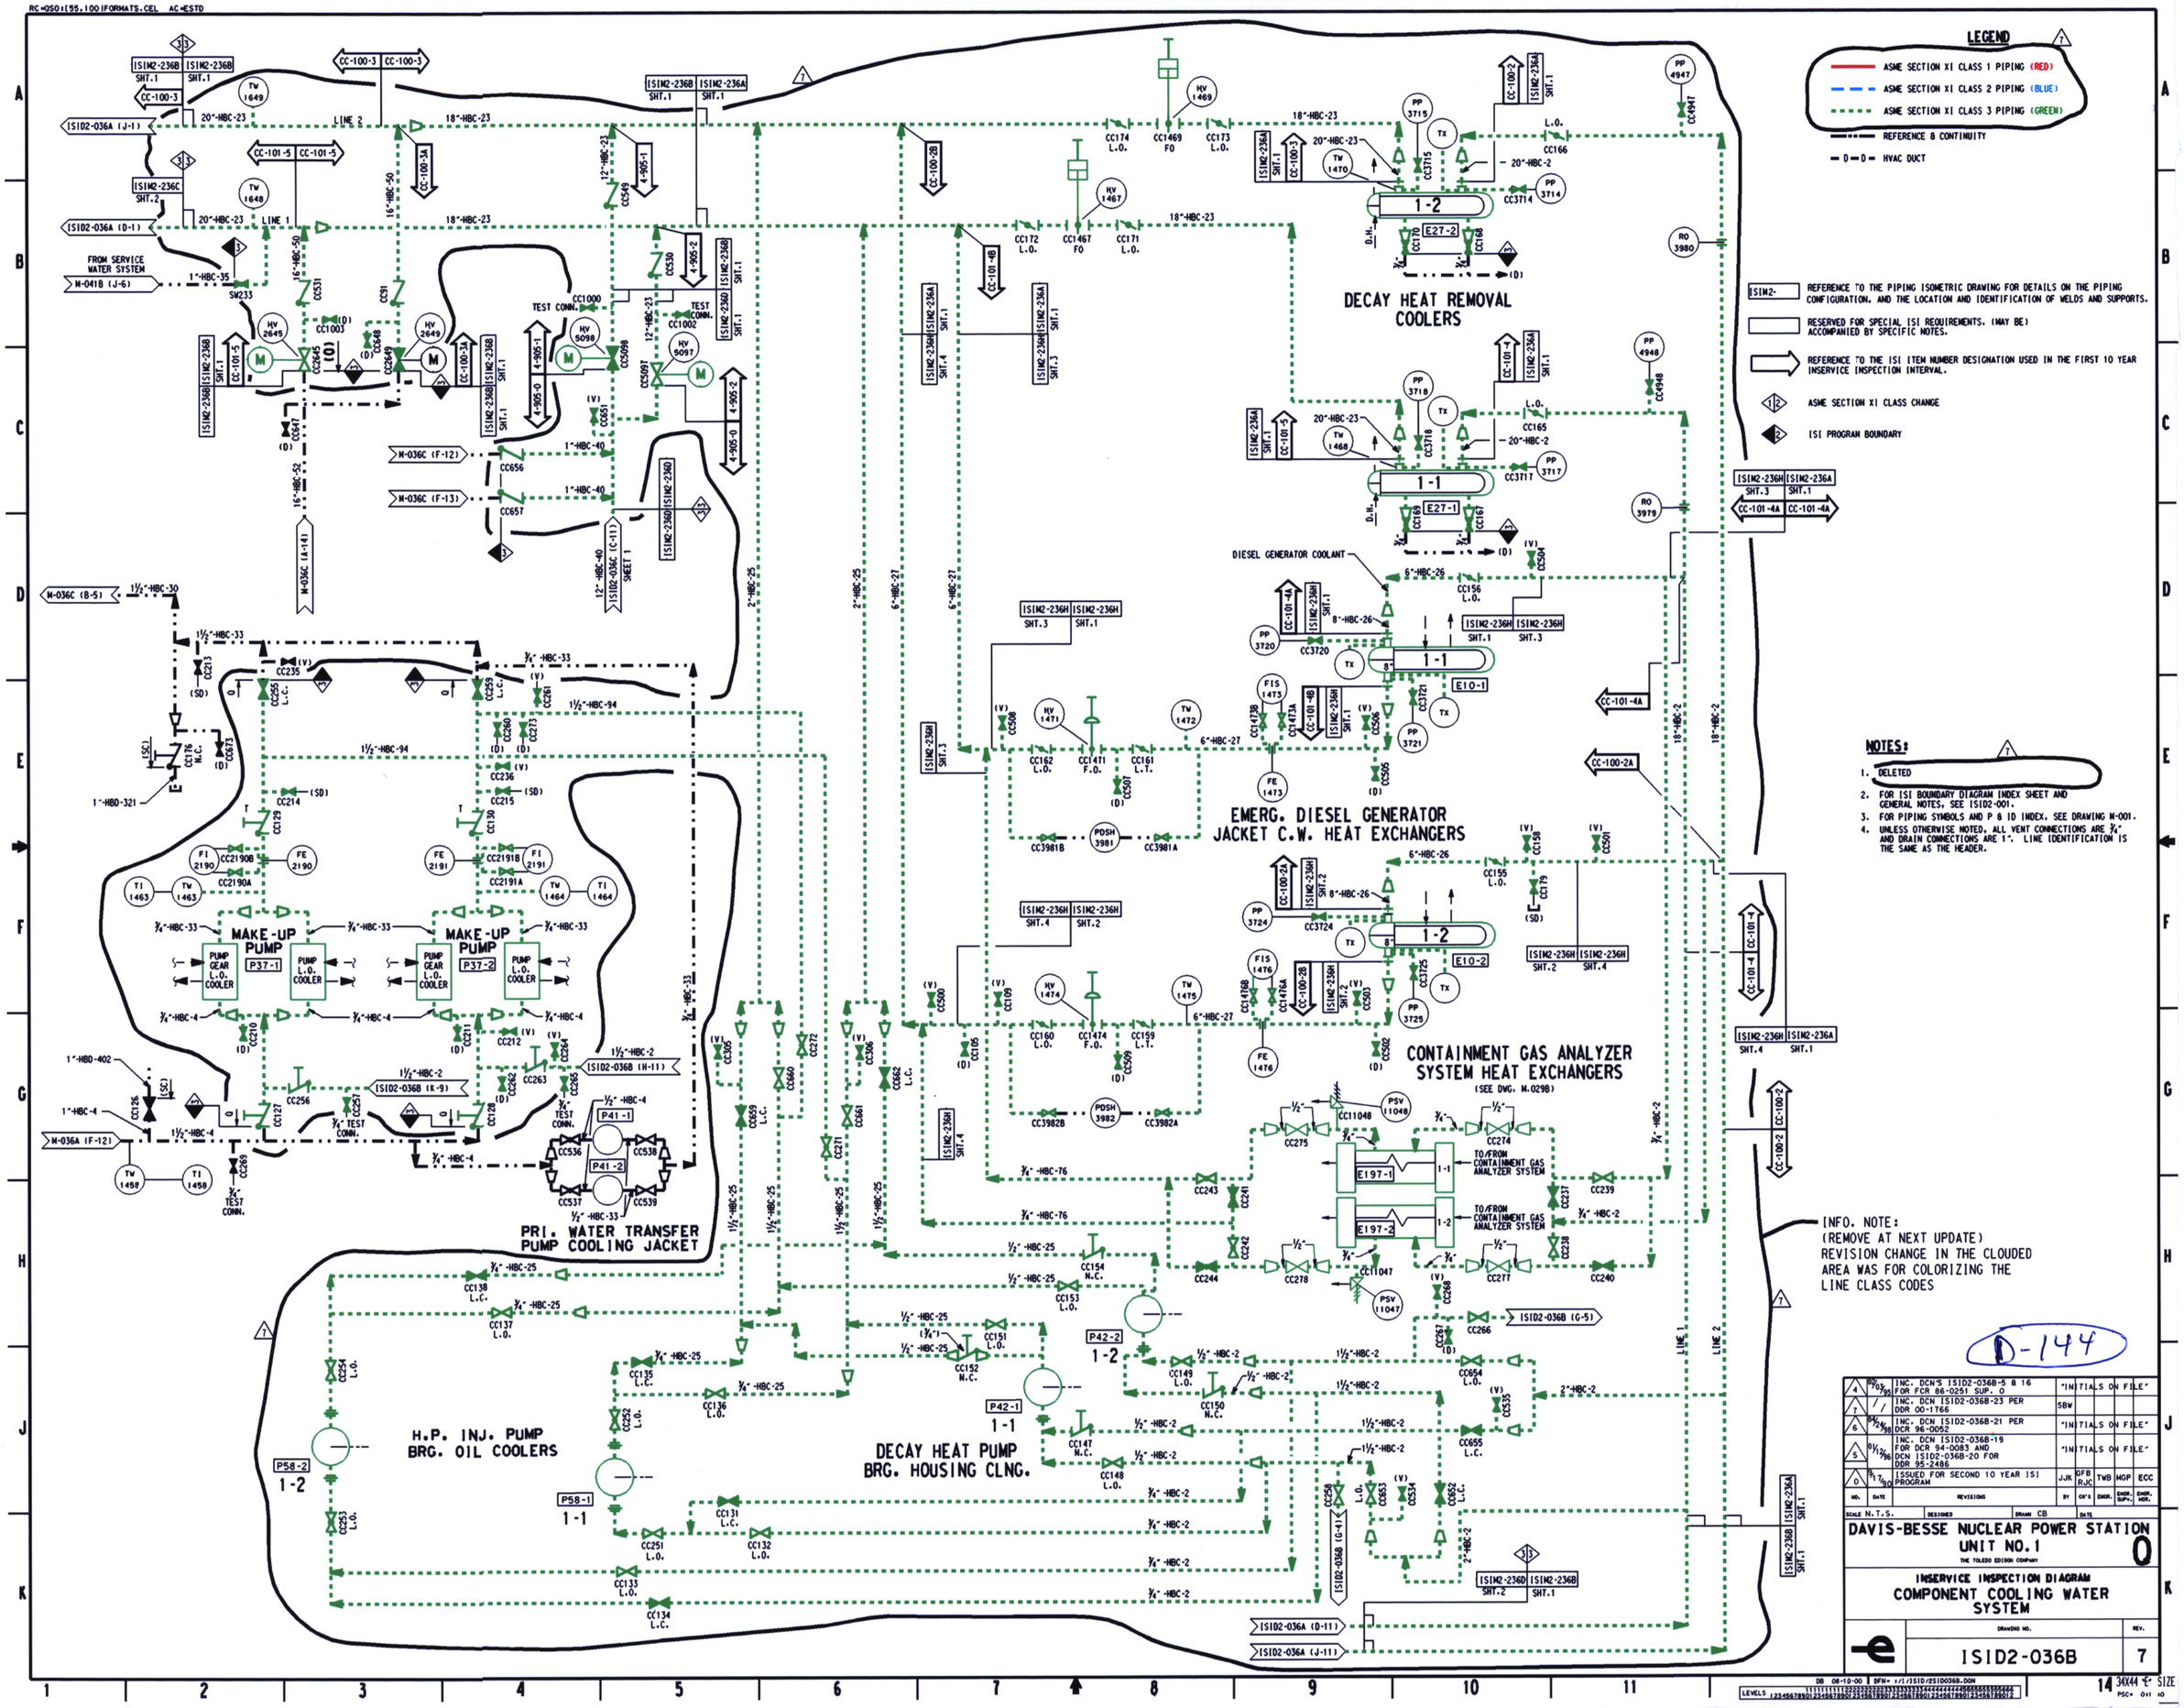

LEGEND
ASME SECTION XI CLASS 1 PIPING (RED)
ASME SECTION XI CLASS 2 PIPING (BLUE)
ASME SECTION XI CLASS 3 PIPING (GREEN)
REFERENCE & CONTINUITY
HVAC DUCT
ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.
REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
ASME SECTION XI CLASS CHANGE
ISI PROGRAM BOUNDARY
NOTES:
1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED AREA WAS FOR COLORIZING THE LINE CLASS CODES
D-144
DECAY HEAT REMOVAL COOLERS
EMERG. DIESEL GENERATOR JACKET C.W. HEAT EXCHANGERS
CONTAINMENT GAS ANALYZER SYSTEM HEAT EXCHANGERS
(SEE DWG. M.029B)
DIESEL GENERATOR COOLANT
MAKE-UP PUMP
PRI. WATER TRANSFER PUMP COOLING JACKET
H.P. INJ. PUMP BRG. OIL COOLERS
DECAY HEAT PUMP BRG. HOUSING CLNG.
FROM SERVICE WATER SYSTEM
TO/FROM CONTAINMENT GAS ANALYZER SYSTEM
INC. DCN'S ISID2-036B-5 & 16 FOR FCR 86-0251 SUP. 0
INC. DCN ISID2-036B-23 PER DDR 00-1766
INC. DCN ISID2-036B-21 PER DCR 96-0052
INC. DCN ISID2-036B-19 FOR DCR 94-0083 AND DCN ISID2-036B-20 FOR DDR 95-2486
ISSUED FOR SECOND 10 YEAR ISI PROGRAM
SCALE N.T.S.
DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1
THE TOLEDO EDISON COMPANY
INSERVICE INSPECTION DIAGRAM
COMPONENT COOLING WATER SYSTEM
ISID2-036B