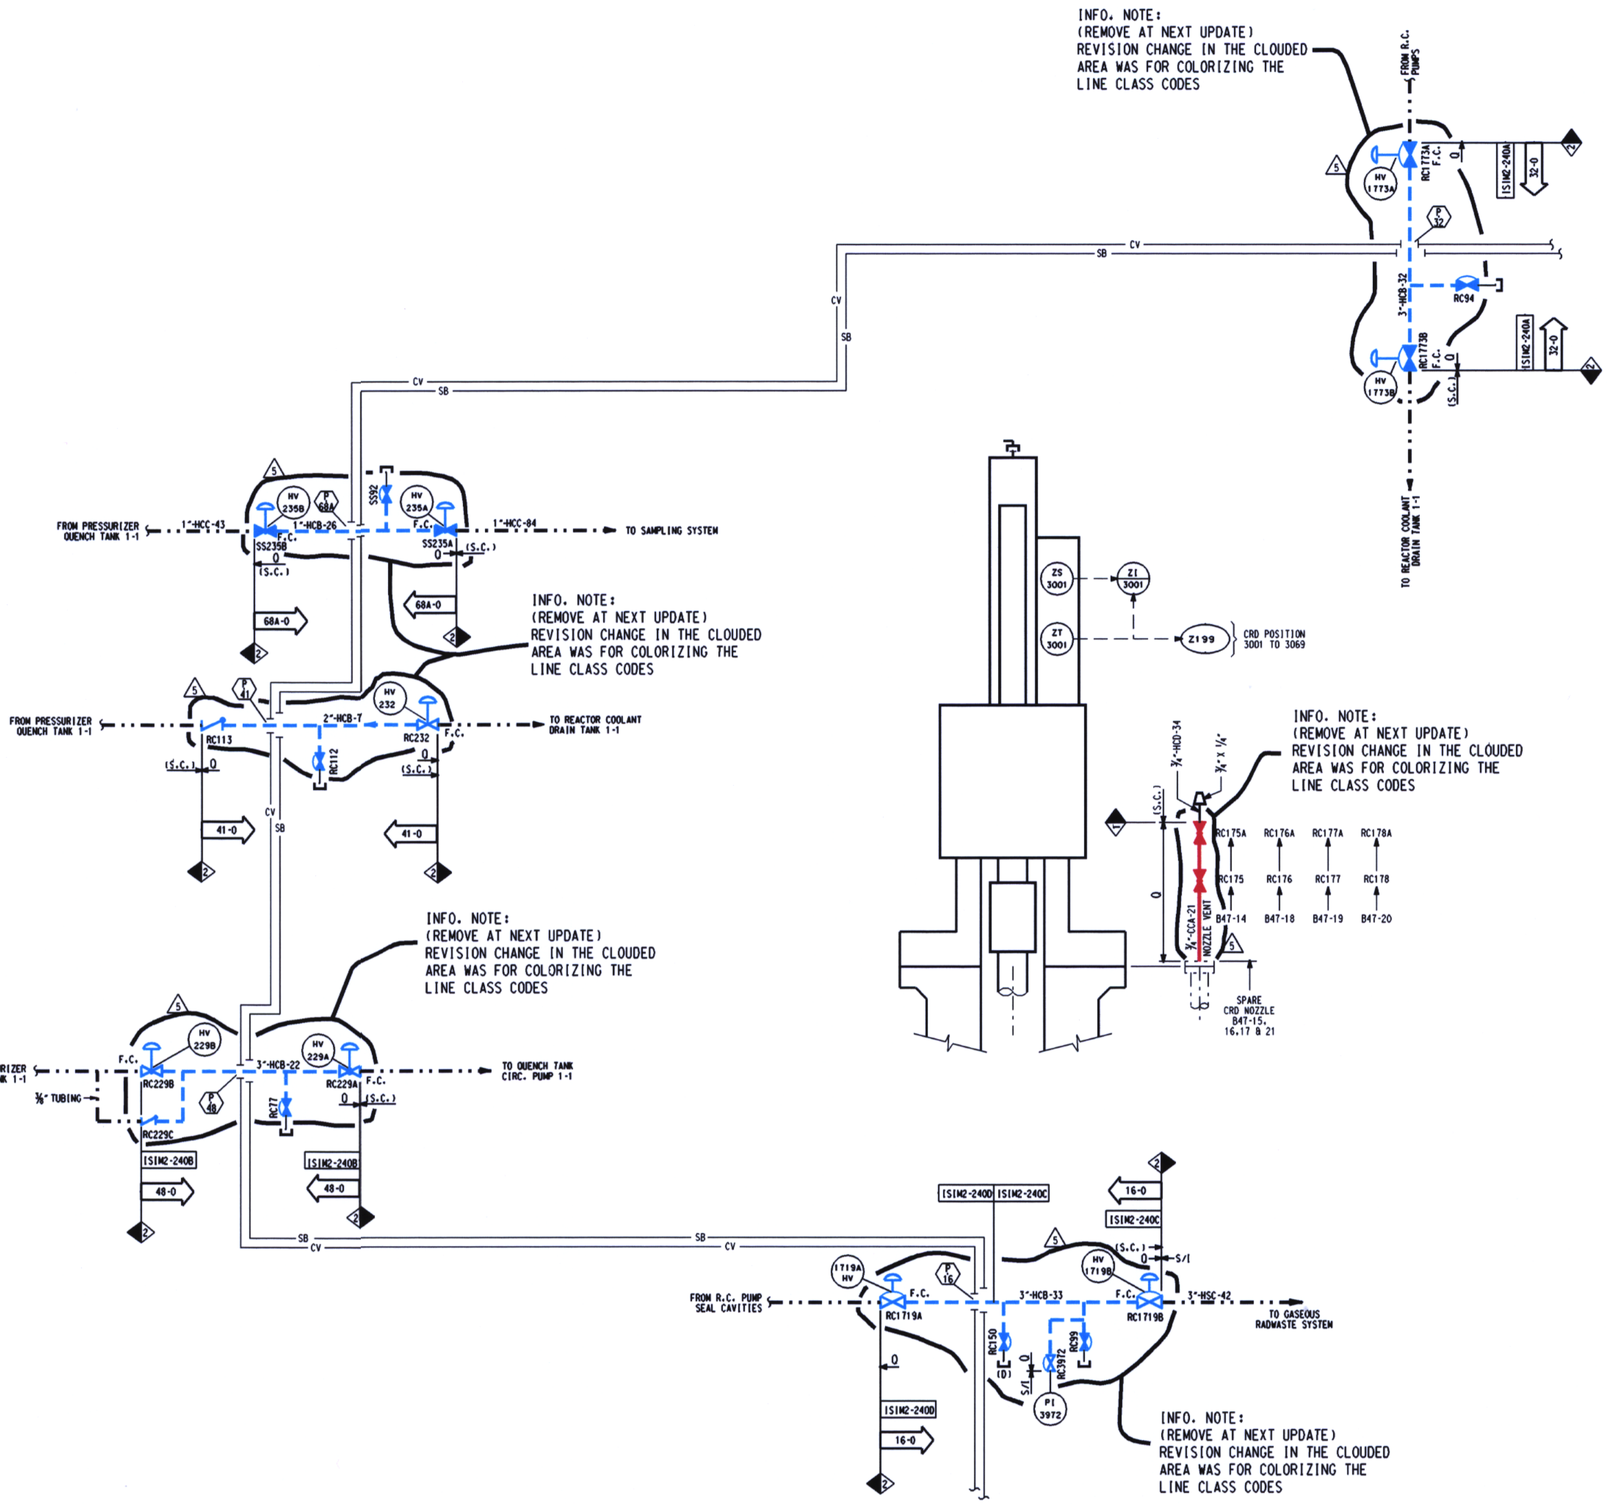

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- D—D— HVAC DUCT

ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.

RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.

REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

1|2 ASME SECTION XI CLASS CHANGE

2 ISI PROGRAM BOUNDARY

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.

D-146

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	GEN. SUPV.
5	/ /	INC. DCN ISID2-040A-5 PER DDR 00-1766	SBV				
4	0/10/98	INC. DCN ISID2-040A-4 PER MOD 97-0009 SUP. 01	"INITIALS ON FILE"				
3	11/17/95	INC. DCN ISID2-040A-3 FOR DCR 95-0033	"INITIALS ON FILE"				
2	02/03/94	INC. DCN ISID2-040A-2 FOR DCR 94-0048	"INITIALS ON FILE"				
1	1/8/92	INC. DCN ISID2-040A-1 FOR DCR 91-0011	"INITIALS ON FILE"				
0	8/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	EFB	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1 0
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION DIAGRAM
REACTOR COOLANT SYSTEM DETAILS

DRAWING NO. ISID2-040A REV. 5

DB 08-10-00 DFN= I:/ISID/2S1D040A.DGN
LEVELS 1234567891011121314151617181920212223242526272829303132333435363738394041424344454647484950 14
34X44 E SIZE PSC= 11 1