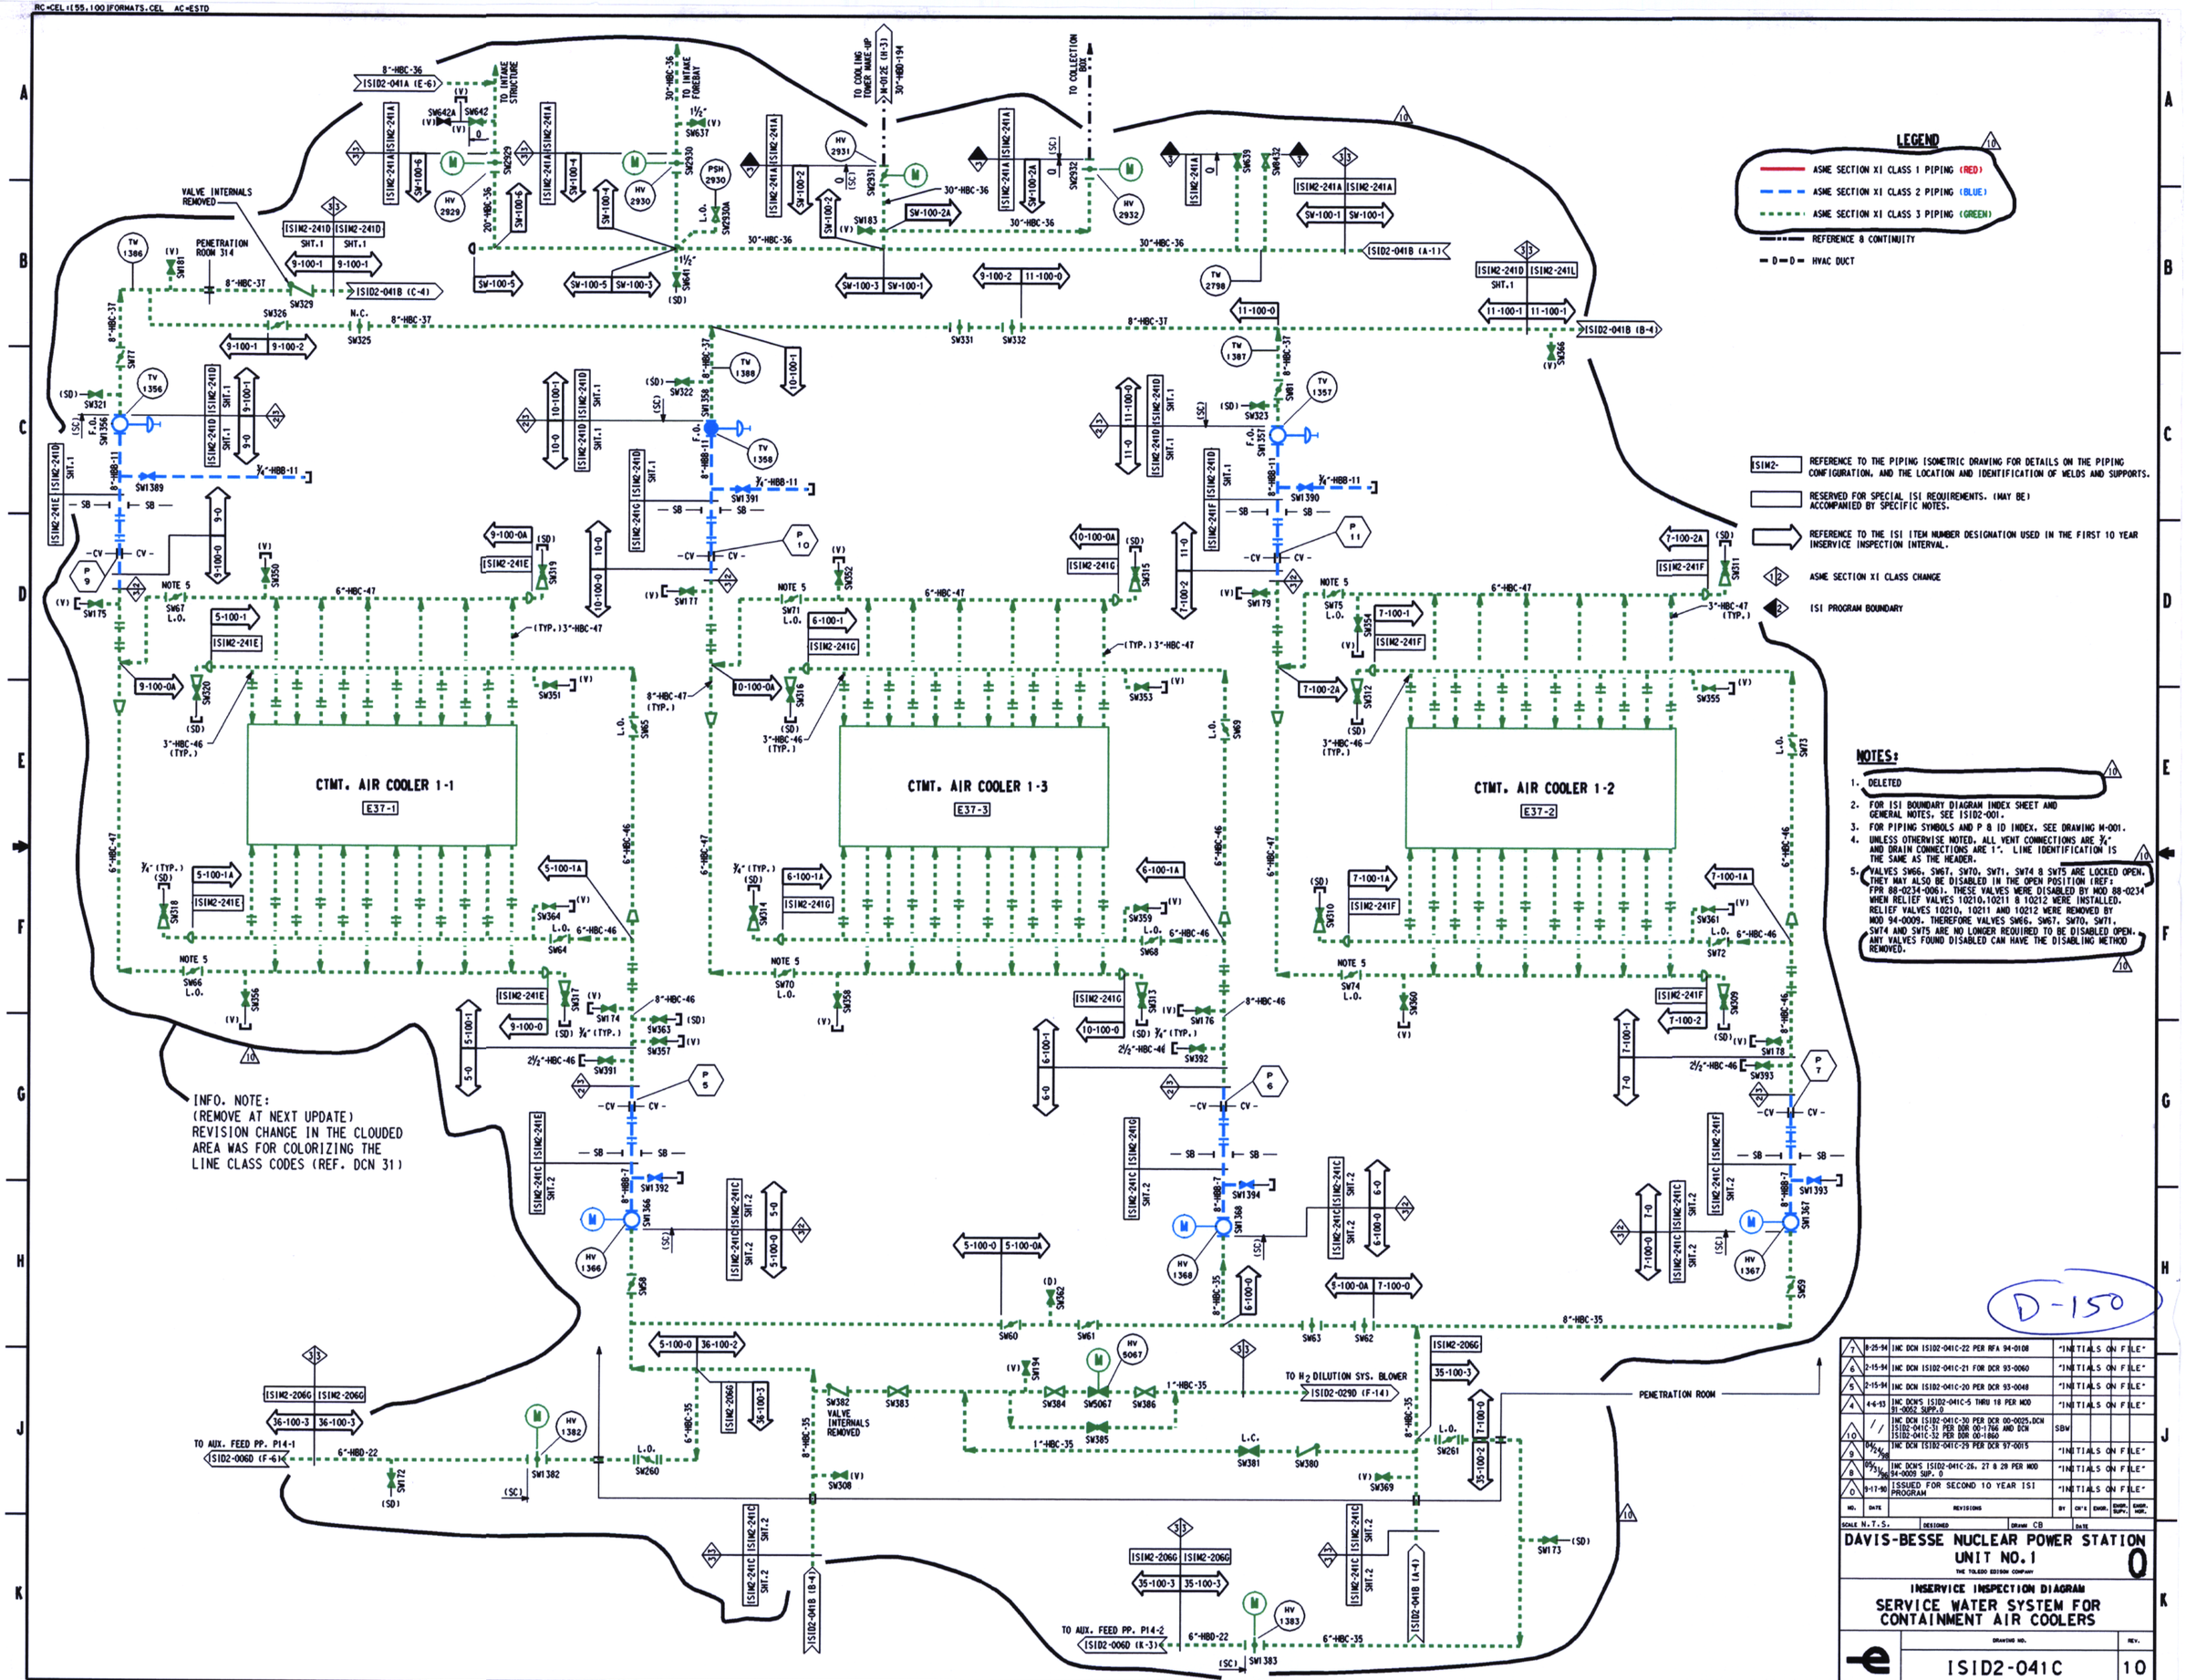

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- HVAC DUCT

ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.

RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.

REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

ASME SECTION XI CLASS CHANGE

ISI PROGRAM BOUNDARY

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
5. VALVES SW66, SW67, SW70, SW71, SW74 & SW75 ARE LOCKED OPEN. THEY MAY ALSO BE DISABLED IN THE OPEN POSITION (REF: FPR 88-0234-006). THESE VALVES WERE DISABLED BY MOD 88-0234 WHEN RELIEF VALVES 10210,10211 & 10212 WERE INSTALLED. RELIEF VALVES 10210, 10211 AND 10212 WERE REMOVED BY MOD 94-0009. THEREFORE VALVES SW66, SW67, SW70, SW71, SW74 AND SW75 ARE NO LONGER REQUIRED TO BE DISABLED OPEN. ANY VALVES FOUND DISABLED CAN HAVE THE DISABLING METHOD REMOVED.

D-150

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENGR. MGR.
7	8-25-94	INC DCN ISID2-041C-22 PER RFA 94-0108	"INITIALS ON FILE"				
6	2-15-94	INC DCN ISID2-041C-21 FOR DCR 93-0060	"INITIALS ON FILE"				
5	2-15-94	INC DCN ISID2-041C-20 PER DCR 93-0048	"INITIALS ON FILE"				
4	4-6-93	INC DCN'S ISID2-041C-5 THRU 18 PER MOD 91-0052 SUPP.0	"INITIALS ON FILE"				
10	/ /	INC DCN ISID2-041C-30 PER DCR 00-0025,DCN ISID2-041C-31 PER DDR 00-1766 AND DCN ISID2-041C-32 PER DDR 00-1860	SBW				
9	04/24/98	INC DCN ISID2-041C-29 PER DCR 97-0015	"INITIALS ON FILE"				
8	05/31/96	INC DCN'S ISID2-041C-26, 27 & 28 PER MOD 94-0009 SUP. 0	"INITIALS ON FILE"				
0	9-17-90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	"INITIALS ON FILE"				

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO.1 0
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION DIAGRAM
SERVICE WATER SYSTEM FOR CONTAINMENT AIR COOLERS

DRAWING NO. ISID2-041C REV. 10

DB 08-10-00 DFN=I:/ISID/2SID041C.DGN

14 34X44 "E" SIZE