

THIS REPORT SUPERSEDES ISSUE OF AUGUST 22, 1980

TECHNICAL EVALUATION REPORT

**PRIMARY COOLANT SYSTEM
PRESSURE ISOLATION VALVES**

METROPOLITAN EDISON COMPANY
THREE MILE ISLAND UNIT 1

NRC DOCKET NO. 50-289

NRCTAC NO. 12978

NRC CONTRACT NO. NRC-03-79-118

FRC PROJECT C5257

FRC TASK 212

Prepared by

Franklin Research Center
The Parkway at Twentieth Street
Philadelphia, PA 19103

Author: P. N. Noell
T. C. Stilwell
FRC Group Leader: P. N. Noell

Prepared for

Nuclear Regulatory Commission
Washington, D.C. 20555

Lead NRC Engineer: P. J. Polk

October 24, 1980

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, or any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.



Franklin Research Center

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000

8104280664

1.0 INTRODUCTION

The NRC has determined that certain isolation valve configurations in systems connecting the high-pressure Primary Coolant System (PCS) to lower-pressure systems extending outside containment are potentially significant contributors to an intersystem loss-of-coolant accident (LOCA). Such configurations have been found to represent a significant factor in the risk computed for core melt accidents.

The sequence of events leading to the core melt is initiated by the concurrent failure of two in-series check valves to function as a pressure isolation barrier between the high-pressure PCS and a lower-pressure system extending beyond containment. This failure can cause an overpressurization and rupture of the low-pressure system, resulting in a LOCA that bypasses containment.

The NRC has determined that the probability of failure of these check valves as a pressure isolation barrier can be significantly reduced if the pressure at each valve is continuously monitored, or if each valve is periodically inspected by leakage testing, ultrasonic examination, or radiographic inspection. The NRC has established a program to provide increased assurance that such multiple isolation barriers are in place in all operating Light Water Reactor plants designated by DOR Generic Implementation Activity B-45.

In a generic letter of February 23, 1980, the NRC requested all licensees to identify the following valve configurations which may exist in any of their plant systems communicating with the PCS: 1) two check valves in series or 2) two check valves in series with a motor-operated valve (MOV).

For plants in which valve configurations of concern are found to exist, licensees were further requested to indicate: 1) whether, to ensure integrity of the various pressure isolation check valves, continuous surveillance or periodic testing was currently being conducted, 2) whether any check valves of concern were known to lack integrity, and 3) whether plant procedures should be revised or plant modifications be made to increase reliability.

Franklin Research Center (FRC) was requested by the NRC to provide technical assistance to NRC's B-45 activity by reviewing each licensee's submittal

against criteria provided by the NRC and by verifying the licensee's reported findings from plant system drawings. This report documents FRC's technical review.

2.0 CRITERIA

2.1 Identification Criteria

For a piping system to have a valve configuration of concern, the following five items must be fulfilled:

- 1) The high-pressure system must be connected to the Primary Coolant System;
- 2) there must be a high-pressure/low-pressure interface present in the line;
- 3) this same piping must eventually lead outside containment;
- 4) the line must have one of the valve configurations shown in Figure 1; and
- 5) the pipe line must have a diameter greater than 1 inch.

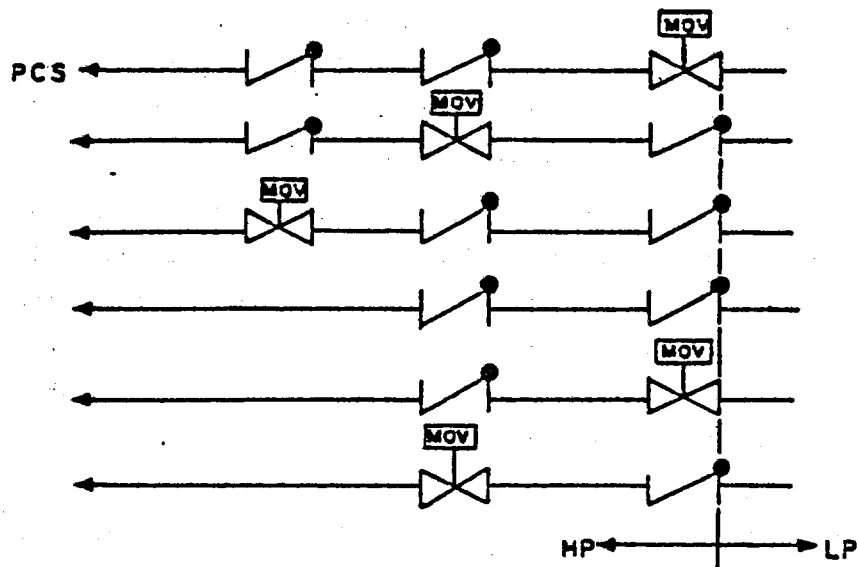


Figure 1. Valve Configurations Designated by the NRC To Be Included in This Technical Evaluation

2.2 Periodic Testing Criteria

For licensees whose plants have valve configurations of concern and choose to institute periodic valve leakage testing, the NRC has established criteria for frequency of testing, test conditions, and acceptable leakage rates.

These criteria may be summarized as follows:

2.2.1 Frequency of Testing

Periodic hydrostatic leakage testing* on each check valve shall be accomplished every time the plant is placed in the cold shutdown condition for refueling, each time the plant is placed in a cold shutdown condition for 72 hours if testing has not been accomplished in the preceding 9 months, each time any check valve may have moved from the fully closed position (i.e., any time the differential pressure across the valve is less than 100 psig), and prior to returning the valve to service after maintenance, repair, or replacement work is performed.

2.2.2 Hydrostatic Pressure Criteria

Leakage tests involving pressure differentials lower than function pressure differentials are permitted in those types of valves in which service pressure will tend to diminish the overall leakage channel opening, as by pressing the disk into or onto the seat with greater force. Gate valves, check valves, and globe-type valves, having function pressure differential applied over the seat, are examples of valve applications satisfying this requirement. When leakage tests are made in such cases using pressures lower than function maximum pressure differential, the observed leakage shall be adjusted to function maximum pressure differential value. This adjustment shall be made by calculation appropriate to the test media and the ratio between test and function pressure differential, assuming leakage to be directly proportional to the pressure differential to the one-half power.

2.2.3 Acceptable Leakage Rates:

- Leakage rates less than or equal to 1.0 gpm are considered acceptable.
- Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered acceptable if the latest measured rate has not exceeded the rate determined by the previous test by an amount

*To satisfy ALARA requirements, leakage may be measured indirectly (as from the performance of pressure indicators) if accomplished in accordance with approved procedures and supported by computations showing that the method is capable of demonstrating valve compliance with the leakage criteria.

that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.

- Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered unacceptable if the latest measured rate exceeded the rate determined by the previous test by an amount that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
- Leakage rates greater than 5.0 gpm are considered unacceptable.

3.0 TECHNICAL EVALUATION

3.1 Licensee's Response to the Generic Letter

In response to the NRC's generic letter [Ref. 1], the Metropolitan Edison Company (MEC) stated [Ref. 2] that, "Event V valve configuration is present in TMI-I in the Core Flooding System (CF) and the Low Pressure Injection System (LPIS). The Core Flooding System and the LPIS have a 'A' and 'B' train. Within the Class 1 boundary, the CF System is made up of two check valves in series (CF-V5A/B and CF-V4A/B). Within the Class 1 boundary the LPIS consists of two check valves (CF-V5A/B and DH-V22A/B) in series with an Engineered Safeguards normally closed motor operated valve (DH-V4A/B)."

The Licensee further stated "In the past, no testing has been performed to ensure the integrity of these check valves on an individual basis. However, TMI-I's ISI/IST submittal dated January 31, 1980 states that CF-V5A/B, CF-V4A/B and DH-V22A/B will be given a functional pressure isolation barrier test before or during the restart of TMI-I."

However, based on telephone conversations held between MEC and the NRC on April 7 and April 10, 1980 it was determined that the Core Flooding System did not contain a valve configuration of concern in that the entire system is contained within the reactor building. Therefore, check valves CF-V4A/B which are part of only the Core Flooding System need not be tested.

It is FRC's understanding that, with MEC's concurrence, the NRC will direct MEC to change its Plant Technical Specifications as necessary to ensure that periodic leakage testing (or equivalent testing) is conducted in accordance with the criteria of Section 2.2.

3.2 FRC Review of Licensee's Response

FRC has reviewed the licensee's response against the plant-specific Piping and Instrumentation Diagrams (P&IDs) [Ref. 3] that might have the valve configurations of concern.

FRC has also reviewed the efficacy of instituting periodic testing for the check valves involved in this particular application with respect to the reduction of the probability of an intersystem LOCA in the Low-Pressure Injection System piping lines.

In its review of the P&IDs [Ref. 3] for Three Mile Island Unit 1, FRC found the following piping system to be of concern:

The Low-Pressure Injection System (LPIS) is composed of two piping trains (A and B) each connected directly to the reactor vessel. Each train has two check valves and a motor-operated valve in one of the series configuration of concern. In each train the high pressure/low-pressure interface is located on the upstream side of the motor-operated valve (MOV). These valves contained in the LPI system are listed below:

Low-Pressure Injection System

Train A

high-pressure check valve, CF-V5A
high-pressure check valve, DH-V22A
high-pressure MOV, DH-V4A, normally closed

Train B

high-pressure check valve, CF-V5B
high-pressure check valve, DH-V22B
high-pressure MOV, DH-V4B, normally closed

In accordance with the criteria of Section 2.0, FRC has found no other valve configurations of concern existing in this plant. These findings confirm the licensee's response [Ref. 2].

FRC reviewed the effectiveness of instituting periodic leakage testing of the check valves in these lines as a means of reducing the probability of an

intersystem LOCA occurring. FRC found that introducing a program of check valve leakage testing in accordance with the criteria summarized in Section 2.0 will be an effective measure in substantially reducing the probability of an intersystem LOCA occurring in these lines, and a means of increasing the probability that these lines will be able to perform their safety-related functions. It is also a step toward achieving a corresponding reduction in the plant probability of an intersystem LOCA in the Three Mile Island Unit 1.

4.0 CONCLUSION

Three Mile Island Unit 1 has been determined to have valves in one of the configurations of concern in both A and B trains of the Low-Pressure Injection System.

If MEC modifies the Plant Technical Specification for Three Mile Island Unit 1 to incorporate periodic testing (as delineated in Section 2.2) for the check valves itemized in Table 1.0, then FRC considers this an acceptable means of achieving plant compliance with the NRC staff objectives of Reference 1.

Table 1.0

Primary Coolant System Pressure Isolation Valves

<u>System</u>	<u>Check Valve No.</u>	<u>Allowable Leakage*</u>
Low-Pressure Injection		
Train A	CF-V5A DH-V22A	
Train B	CF-V5B DH-V22B	

5.0 REFERENCES

- [1]. Generic NRC letter, dated 2/23/80, from Mr. D. G. Eisenhut, Department of Operating Reactors (DOR), to Mr. J. G. Herbein, Metropolitan Edison Company (MEC).

*To be provided by licensee at a future date in accordance with Section 2.2.3.

[2]. Metropolitan Edison Company's response to NRC's letter, dated 3/31/80,
From Mr. J. G. Herbein (MEC) to Mr. D. G. Eisenhut (DOR).

[3]. List of examined P&IDs:

Gilbert Associates Drawings:

SS-302-003, (REV. 4)

SS-302-001, (REV. 2)

SS-302-002

C-302-650, (REV. 15)

C-302-711, (REV. 12)

C-302-161, (REV. 12)

C-302-640, (REV. 21)

C-302-162, (REV. 13)

C-302-163, (REV. 11)

C-302-660, (REV. 14)

C-302-661, (REV. 13)

C-302-669, (REV. 16)

C-302-670, (REV. 8)

C-302-671, (REV. 13)