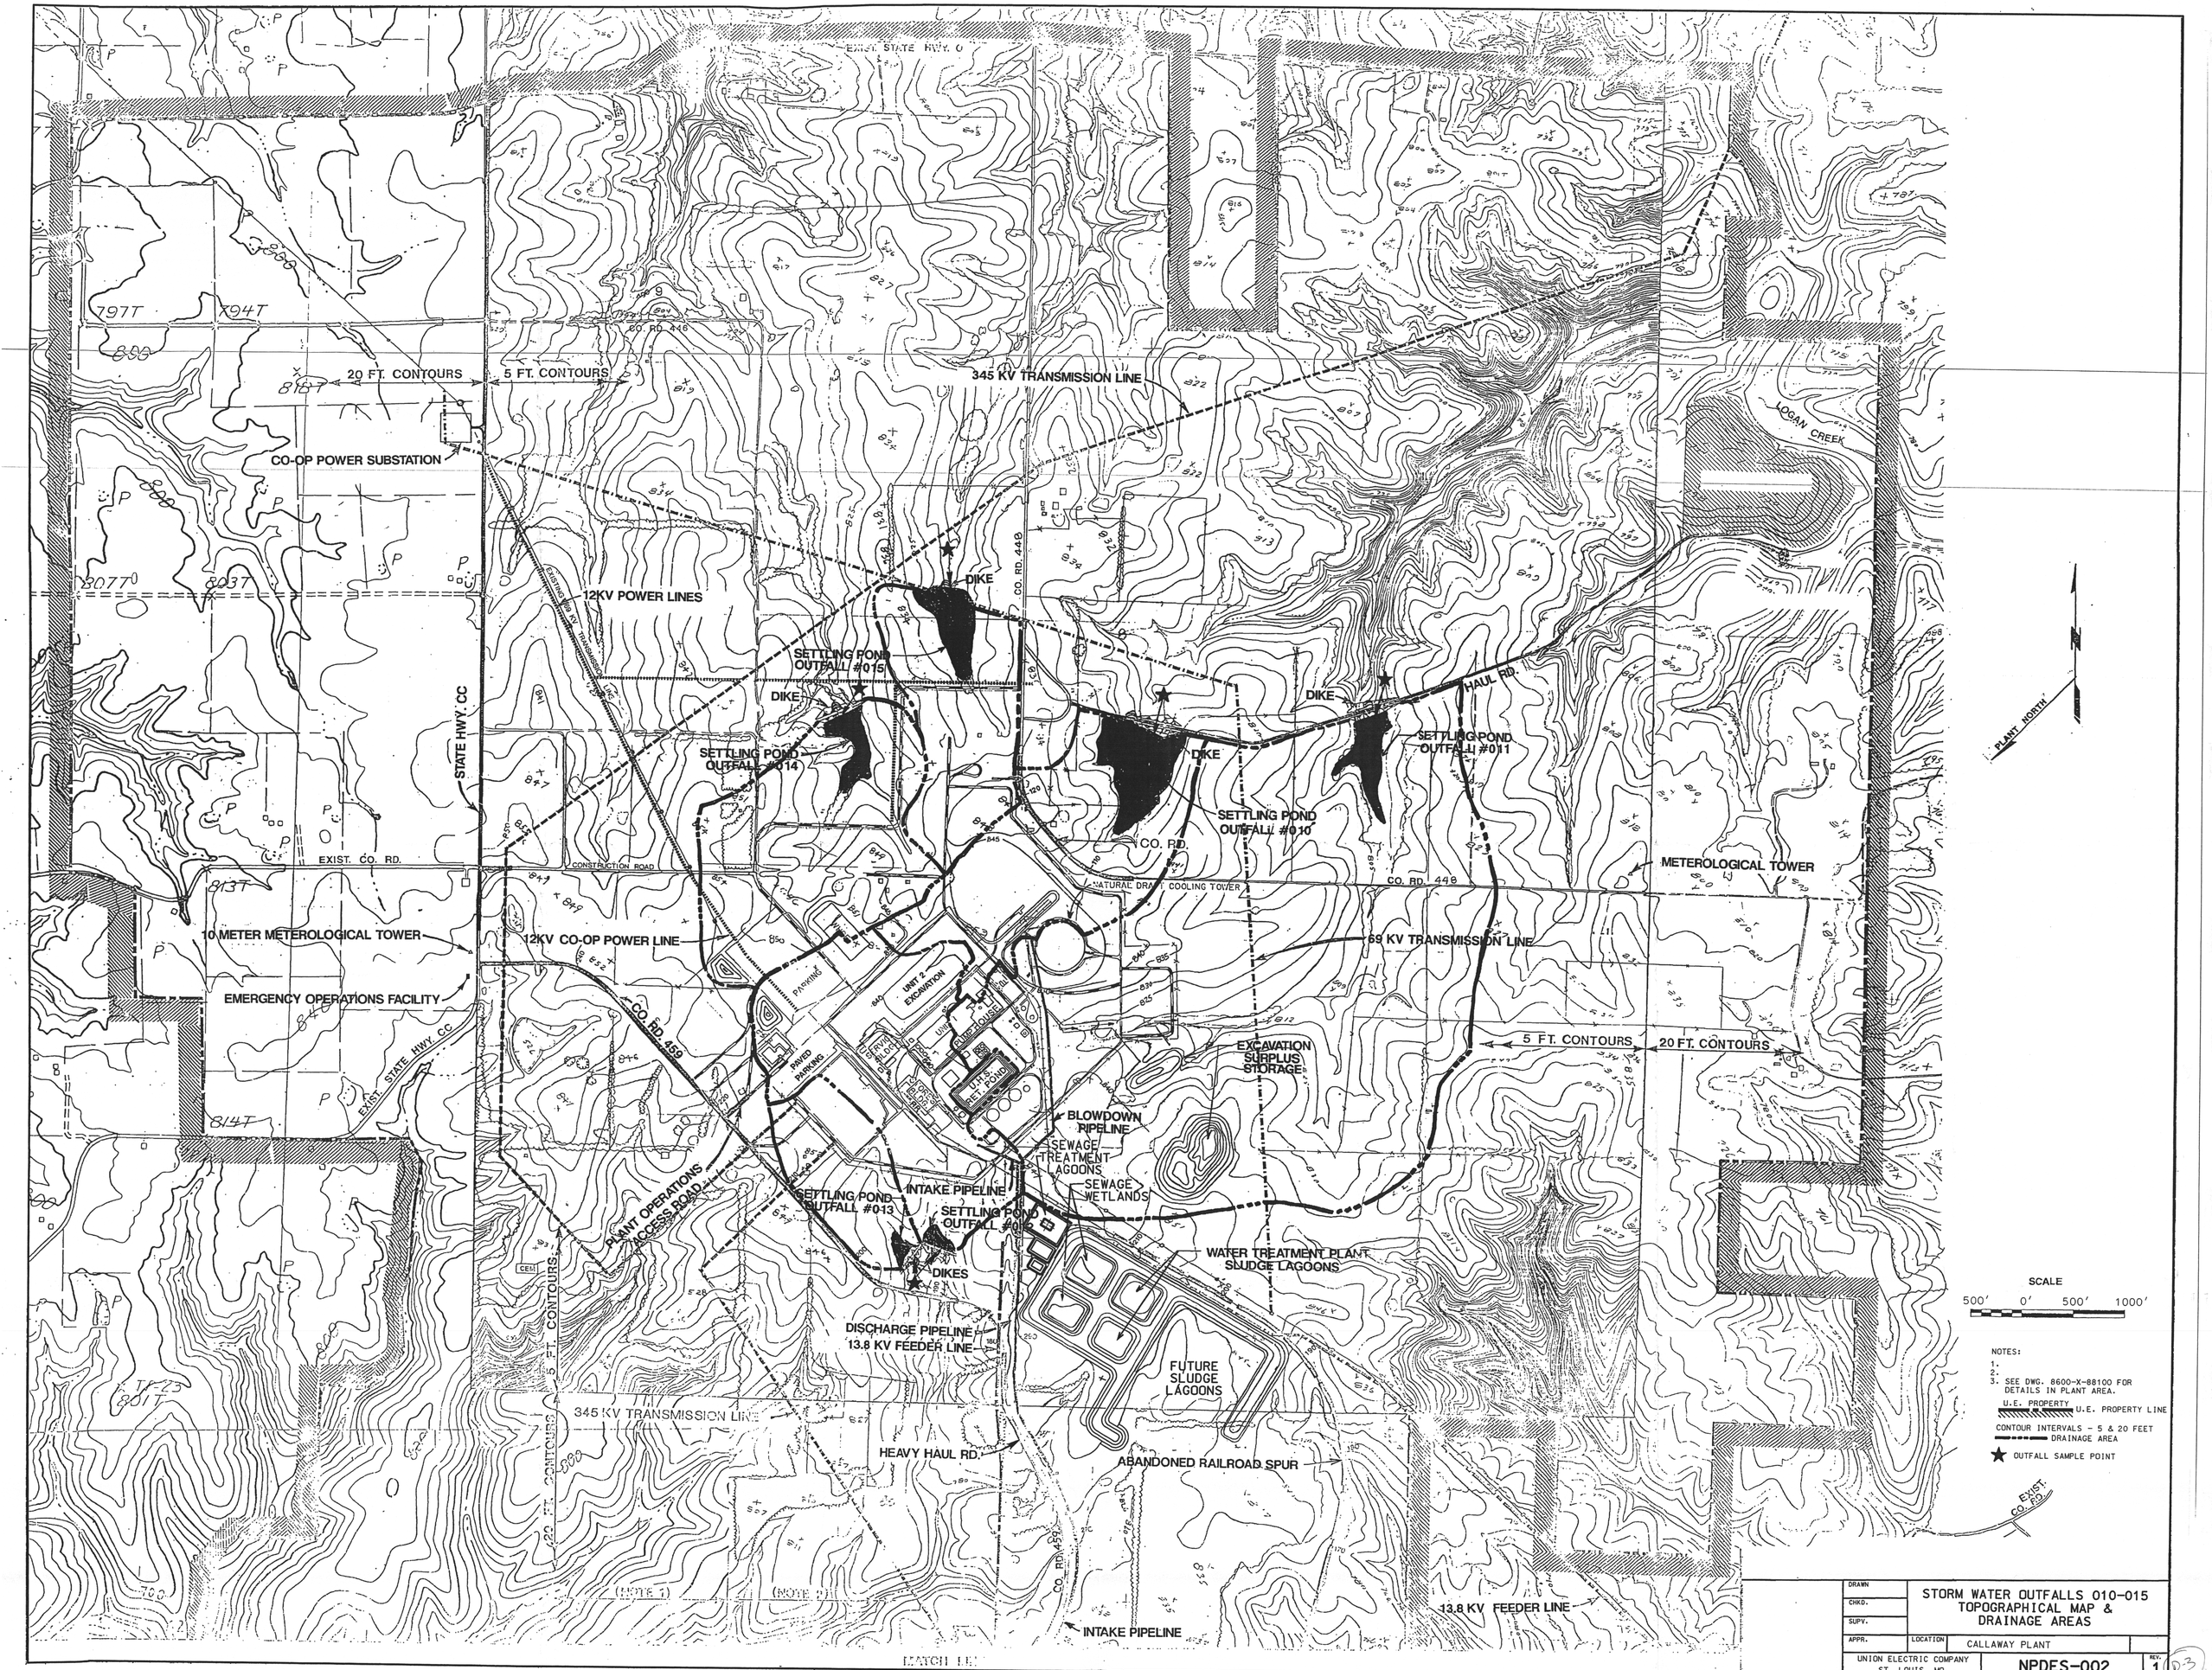

EXIST. STATE HWY. O
20 FT. CONTOURS
5 FT. CONTOURS
CO-OP POWER SUBSTATION
345 KV TRANSMISSION LINE
LOGAN CREEK
12KV POWER LINES
DIKE
SETTLING POND OUTFALL #015
SETTLING POND OUTFALL #014
SETTLING POND OUTFALL #011
SETTLING POND OUTFALL #010
HAUL RD.
STATE HWY. CC
EXIST. CO. RD.
CONSTRUCTION ROAD
CO. RD. 448
CO. RD.
NATURAL DRAFT COOLING TOWER
METEROLOGICAL TOWER
10 METER METEROLOGICAL TOWER
12KV CO-OP POWER LINE
69 KV TRANSMISSION LINE
EMERGENCY OPERATIONS FACILITY
CO. RD. 459
EXIST. STATE HWY. CC
UNIT 2 EXCAVATION
PAVED PARKING
EXCAVATION SURPLUS STORAGE
5 FT. CONTOURS
20 FT. CONTOURS
BLOWDOWN PIPELINE
SEWAGE TREATMENT LAGOONS
SEWAGE WETLANDS
INTAKE PIPELINE
SETTLING POND OUTFALL #013
SETTLING POND OUTFALL #012
PLANT OPERATIONS ACCESS ROAD
DIKES
WATER TREATMENT PLANT SLUDGE LAGOONS
DISCHARGE PIPELINE
13.8 KV FEEDER LINE
FUTURE SLUDGE LAGOONS
345 KV TRANSMISSION LINE
HEAVY HAUL RD.
ABANDONED RAILROAD SPUR
EXIST. CO. RD.
13.8 KV FEEDER LINE
INTAKE PIPELINE
PLANT NORTH
SCALE
500' 0' 500' 1000'
NOTES:
1.
2.
3. SEE DWG. 8600-X-88100 FOR DETAILS IN PLANT AREA.
U.E. PROPERTY
U.E. PROPERTY LINE
CONTOUR INTERVALS - 5 & 20 FEET
DRAINAGE AREA
OUTFALL SAMPLE POINT
DRAWN
CHKD.
SUPV.
APPR.
LOCATION
STORM WATER OUTFALLS 010-015
TOPOGRAPHICAL MAP &
DRAINAGE AREAS
CALLAWAY PLANT
UNION ELECTRIC COMPANY
ST. LOUIS, MO.
NPDES-002
REV. 1
D-3
CAD-0278D