HOSE RACK LOCATION

VALVE	HR NO.	LOCATION	FL. ELEV.	BUILDING
FS-201	HR-1	J-10 E-SIDE	335'-0"	TURBINE
FS-202	HR-2	J/K-10 E-SIDE	354'-0"	
FS-203	HR-3	H-10 E-SIDE	363'-6"	
FS-204	HR-4	K/L-10 E-SIDE	386'-0"	
FS-205	HR-5	F-10 E-SIDE	386'-0"	
FS-206	HR-6	D-10 E-SIDE	385'-0"	
FS-208	HR-8	C-10 E-SIDE	354'-0"	
FS-209	HR-9	D-10 E-SIDE	363'-6"	
FS-210	HR-10	B-10 E-SIDE	386'-0"	
FS-211	HR-11	E-6 W-SIDE	335'-0"	
FS-212	HR-12	G-5.9 W-SIDE	364'-0"	
FS-213	HR-13	C-6 W-SIDE	354'-0"	
FS-214	HR-14	D-6 W-SIDE	386'-0"	
FS-215	HR-15	C-6 W-SIDE	372'-0"	
FS-217	HR-17	F-6 W-SIDE	386'-0"	
FS-218	HR-18	J-6 W-SIDE	335'-0"	
FS-219	HR-19	K-6 W-SIDE	346'-0"	
FS-220	HR-20	K-5.9 W. SIDE	368'-0"	
FS-221	HR-21	K-6 W.SIDE	386'-0"	
FS-222	HR-22	J-5 BOILER RM WALL	354'-0"	AUXILIARY
FS-223	HR-23	G-4 ELECT. EQUIP'RM	368'-0"	
FS-224	HR-24	H/J-5.1 ELECT. PENN. RM	386'-0"	
FS-225	HR-25	G-5 FUEL POOL AREA	404'-0"	
FS-226	HR-26	D/E-4.5 ACCESS AREA	335'-0"	
FS-227	HR-27	C-5 COUNT RM.	386'-0"	
FS-228	HR-28	B-3 PIPE AREA 63	335'-0"	
FS-229	HR-29	C-3 CORRIDOR 67	354'-0"	
FS-230	HR-30	B-4.5 LOADING AREA	354'-0"	
FS-231	HR-31	C-3 CORRIDOR 92	373'-6"	
FS-232	HR-32	B-4 CORRIDOR 123	374'-0"	
FS-233	HR-33	B-3 HOT INST. SHOP	386'-0"	
FS-234	HR-34	C-5 VENT'L EQ. RM.	404'-0"	
FS-235	HR-35	B-3 CORRIDOR 89	404'-0"	
FS-236	HR-36	K-5.1 BOILER RM.	354'-0"	
FS-237	HR-37	C-8	448'-0"	TURB. ROOF
FS-238	HR-38	J-8	448'-0"	
FS-239	HR-39	N	335'-0"	RX
FS-240	HR-40	S	335'-0"	
FS-241	HR-41	N	367'-0"	
FS-242	HR-42	S	367'-0"	
FS-243	HR-43	S	376'-0"	
FS-244	HR-44	N	376'-0"	
FS-245	HR-45	S	401'-0"	
FS-246	HR-46	N	401'-0"	
FS-247	HR-47	S	422'-0"	
FS-248	HR-48	N	422'-0"	
FS-249	HR-49	B-3 ACCESS AREA	317'-0"	AUXILIARY
FS-258	HR-58	E-5.9 VENT'L EQ. RM.	422'-0"	
FS-134	HR-134	W HALLWAY	2ND FLOOR	TECH. SUPP.
FS-135	HR-135	S HALLWAY	1ST FLOOR	
FS-138	HR-138	S HALLWAY	2ND FLOOR	OLD ADMIN.
FS-139	HR-139	S HALLWAY	1ST FLOOR	
FS-140	HR-140	S AT ELEVATOR	1ST FLOOR	NEW ADMIN.
FS-141	HR-141	S AT ELEVATOR	2ND FLOOR	
FS-142	HR-142	S AT ELEVATOR	3RD FLOOR	
FS-143	HR-143	S AT ELEVATOR	4TH FLOOR	
FS-144	HR-144	S AT ELEVATOR	5TH FLOOR	
FS-145	HR-145	W EAST WHSE.	354'-0"	#4 WHSE.
FS-146	HR-146	E WEST WHSE.	354'-0"	
FS-155	HR-155	E	354'-0"	OLD APPL. WAREHOUSE
FS-156	HR-156	E	354'-0"	
FS-252	HR-67 SEE M-2219 SH.5	NEXT TO DOOR #172	354'-0"	UNIT ONE INTAKE
FS-163	HR-163	W EAST WHSE.	354'-0"	#4 WHSE.
FS-164	HR-164	E WEST WHSE.	354'-0"	#4 WHSE.
FS-165	HR-165	N EXTENSION	354'-0"	#4 WHSE.
FS-283	HR-83	B-6 N-SIDE	386'-8"	TURBINE BLDG.
FS-287	HR-87	B-6 N-SIDE	484'-8"	TURBINE BLDG.

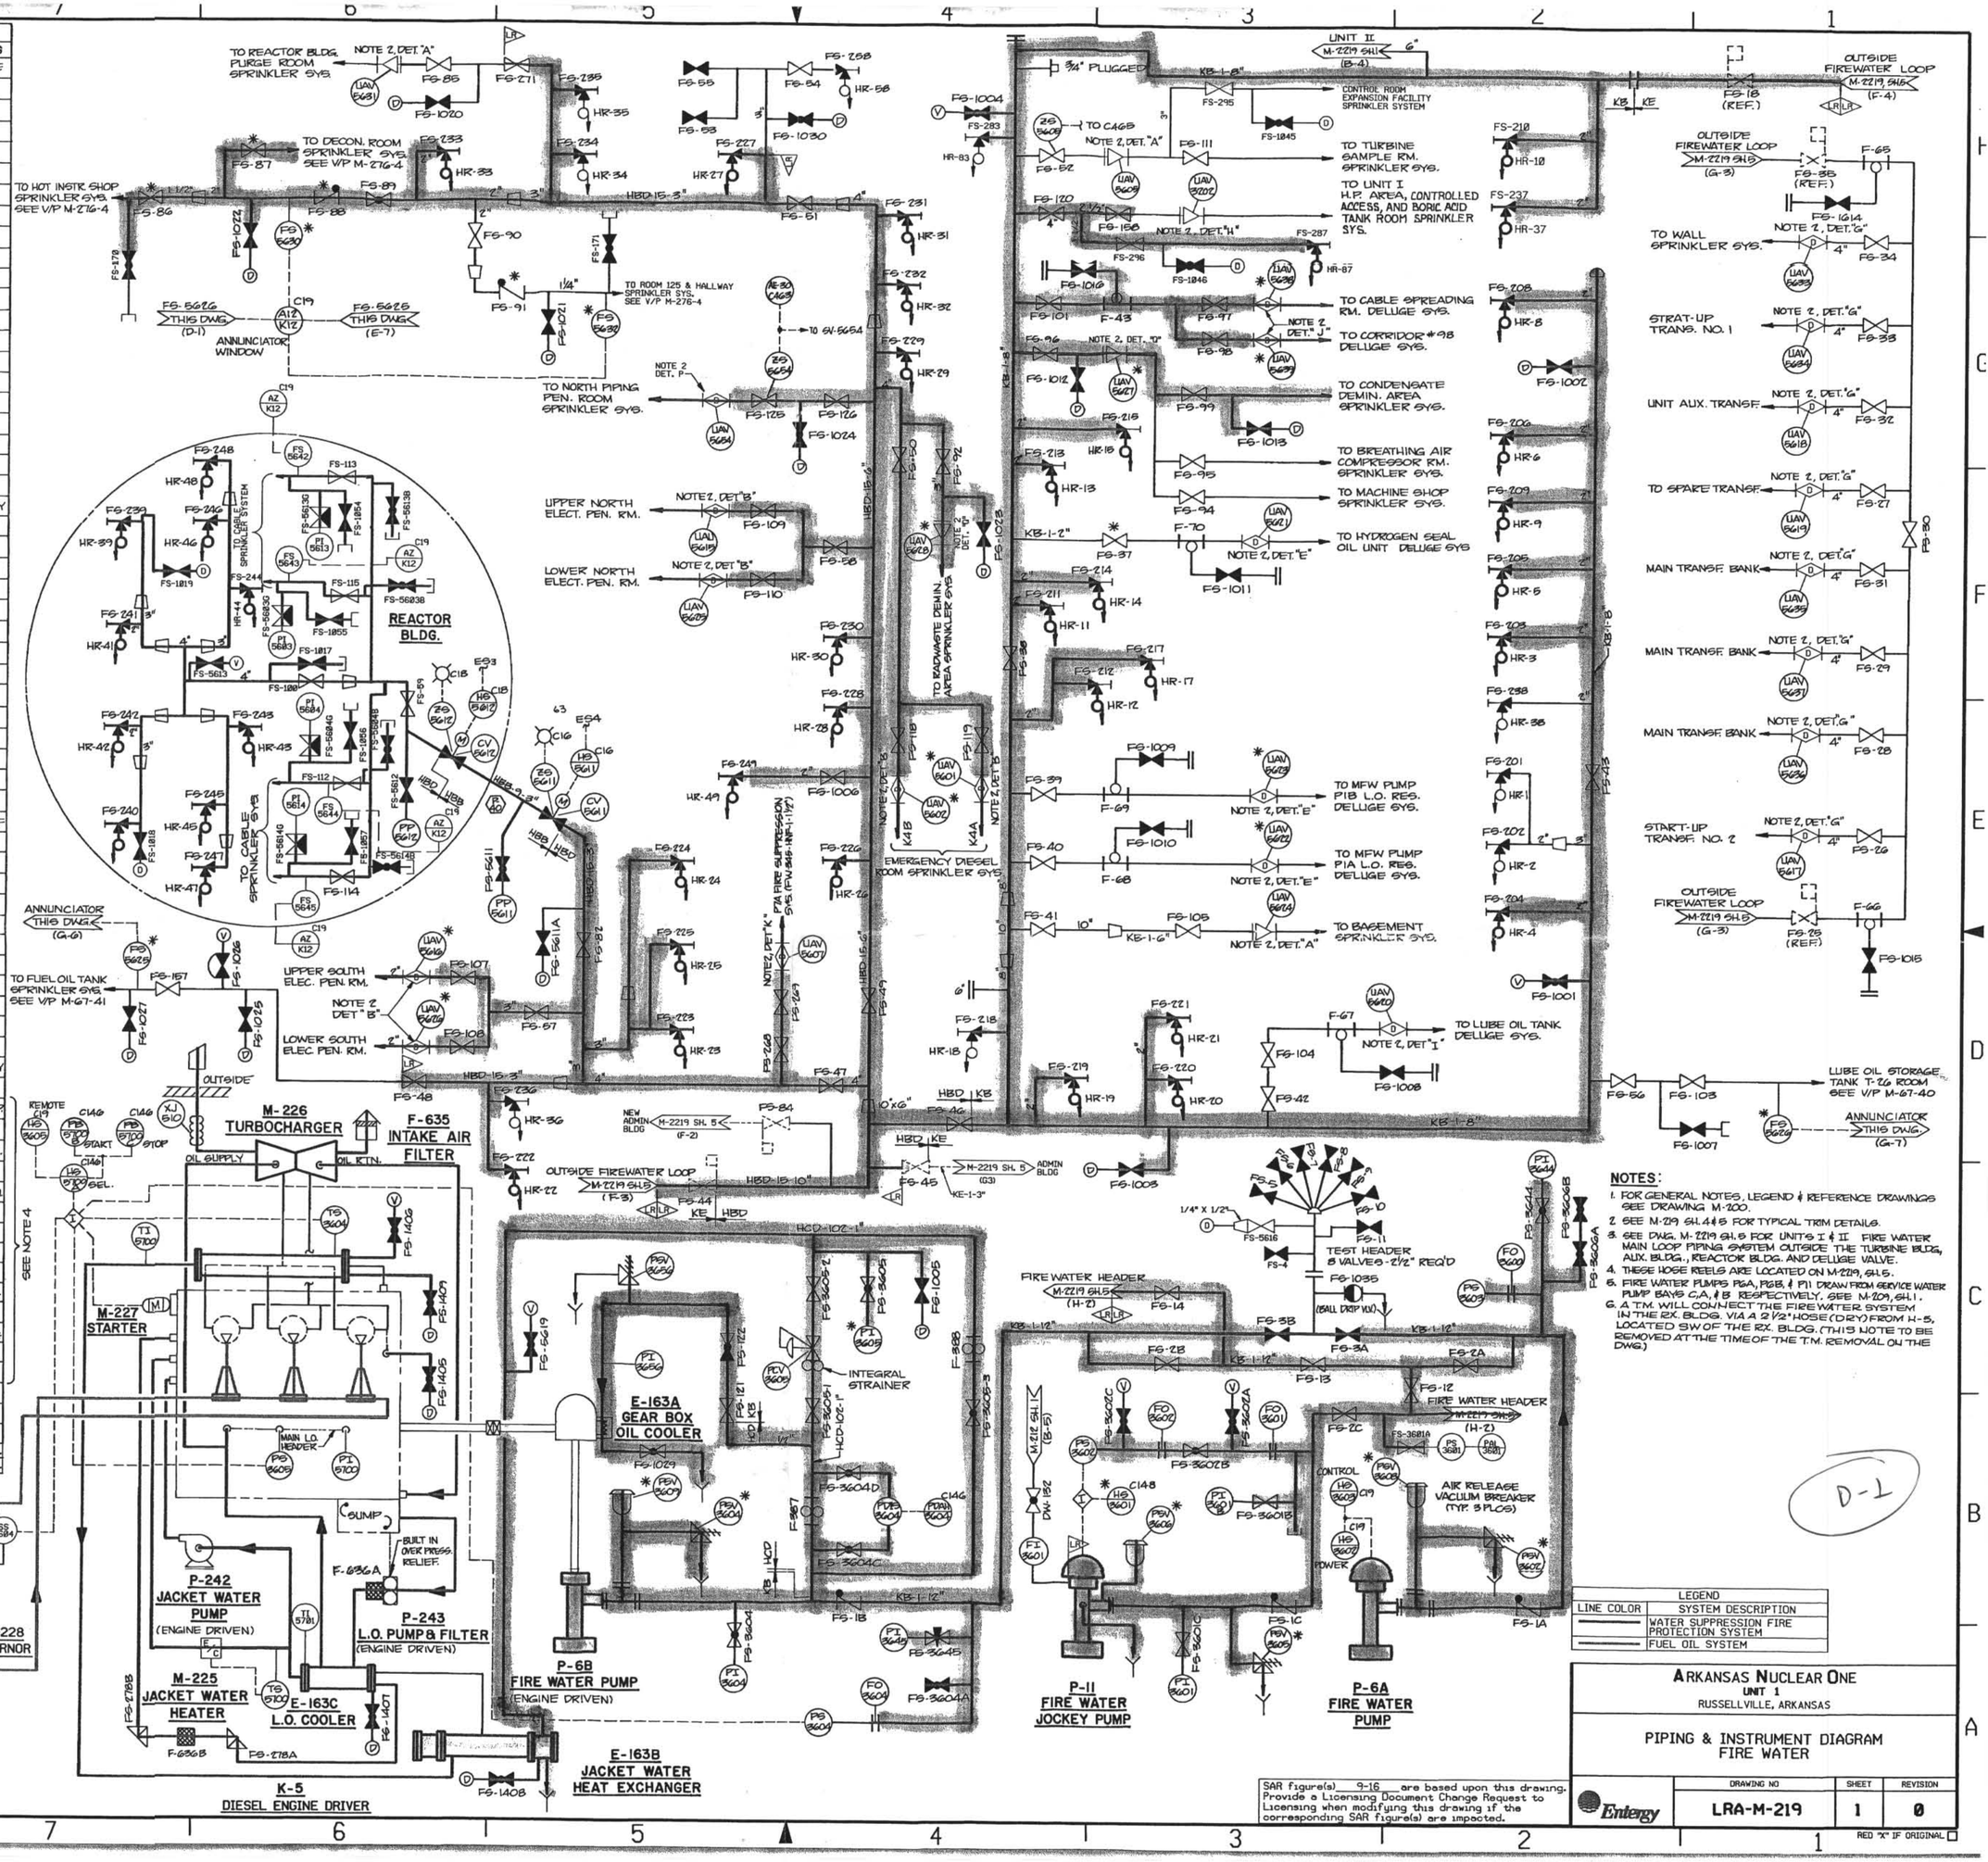

LEGEND	
LINE COLOR	SYSTEM DESCRIPTION
	WATER SUPPRESSION FIRE PROTECTION SYSTEM
	FUEL OIL SYSTEM

SAR figure(s) 9-16 are based upon this drawing. Provide a Licensing Document Change Request to Licensing when modifying this drawing if the corresponding SAR figure(s) are impacted.

ARKANSAS NUCLEAR ONE
UNIT 1
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
FIRE WATER

Entergy

DRAWING NO	SHEET	REVISION
LRA-M-219	1	0

RED "X" IF ORIGINAL