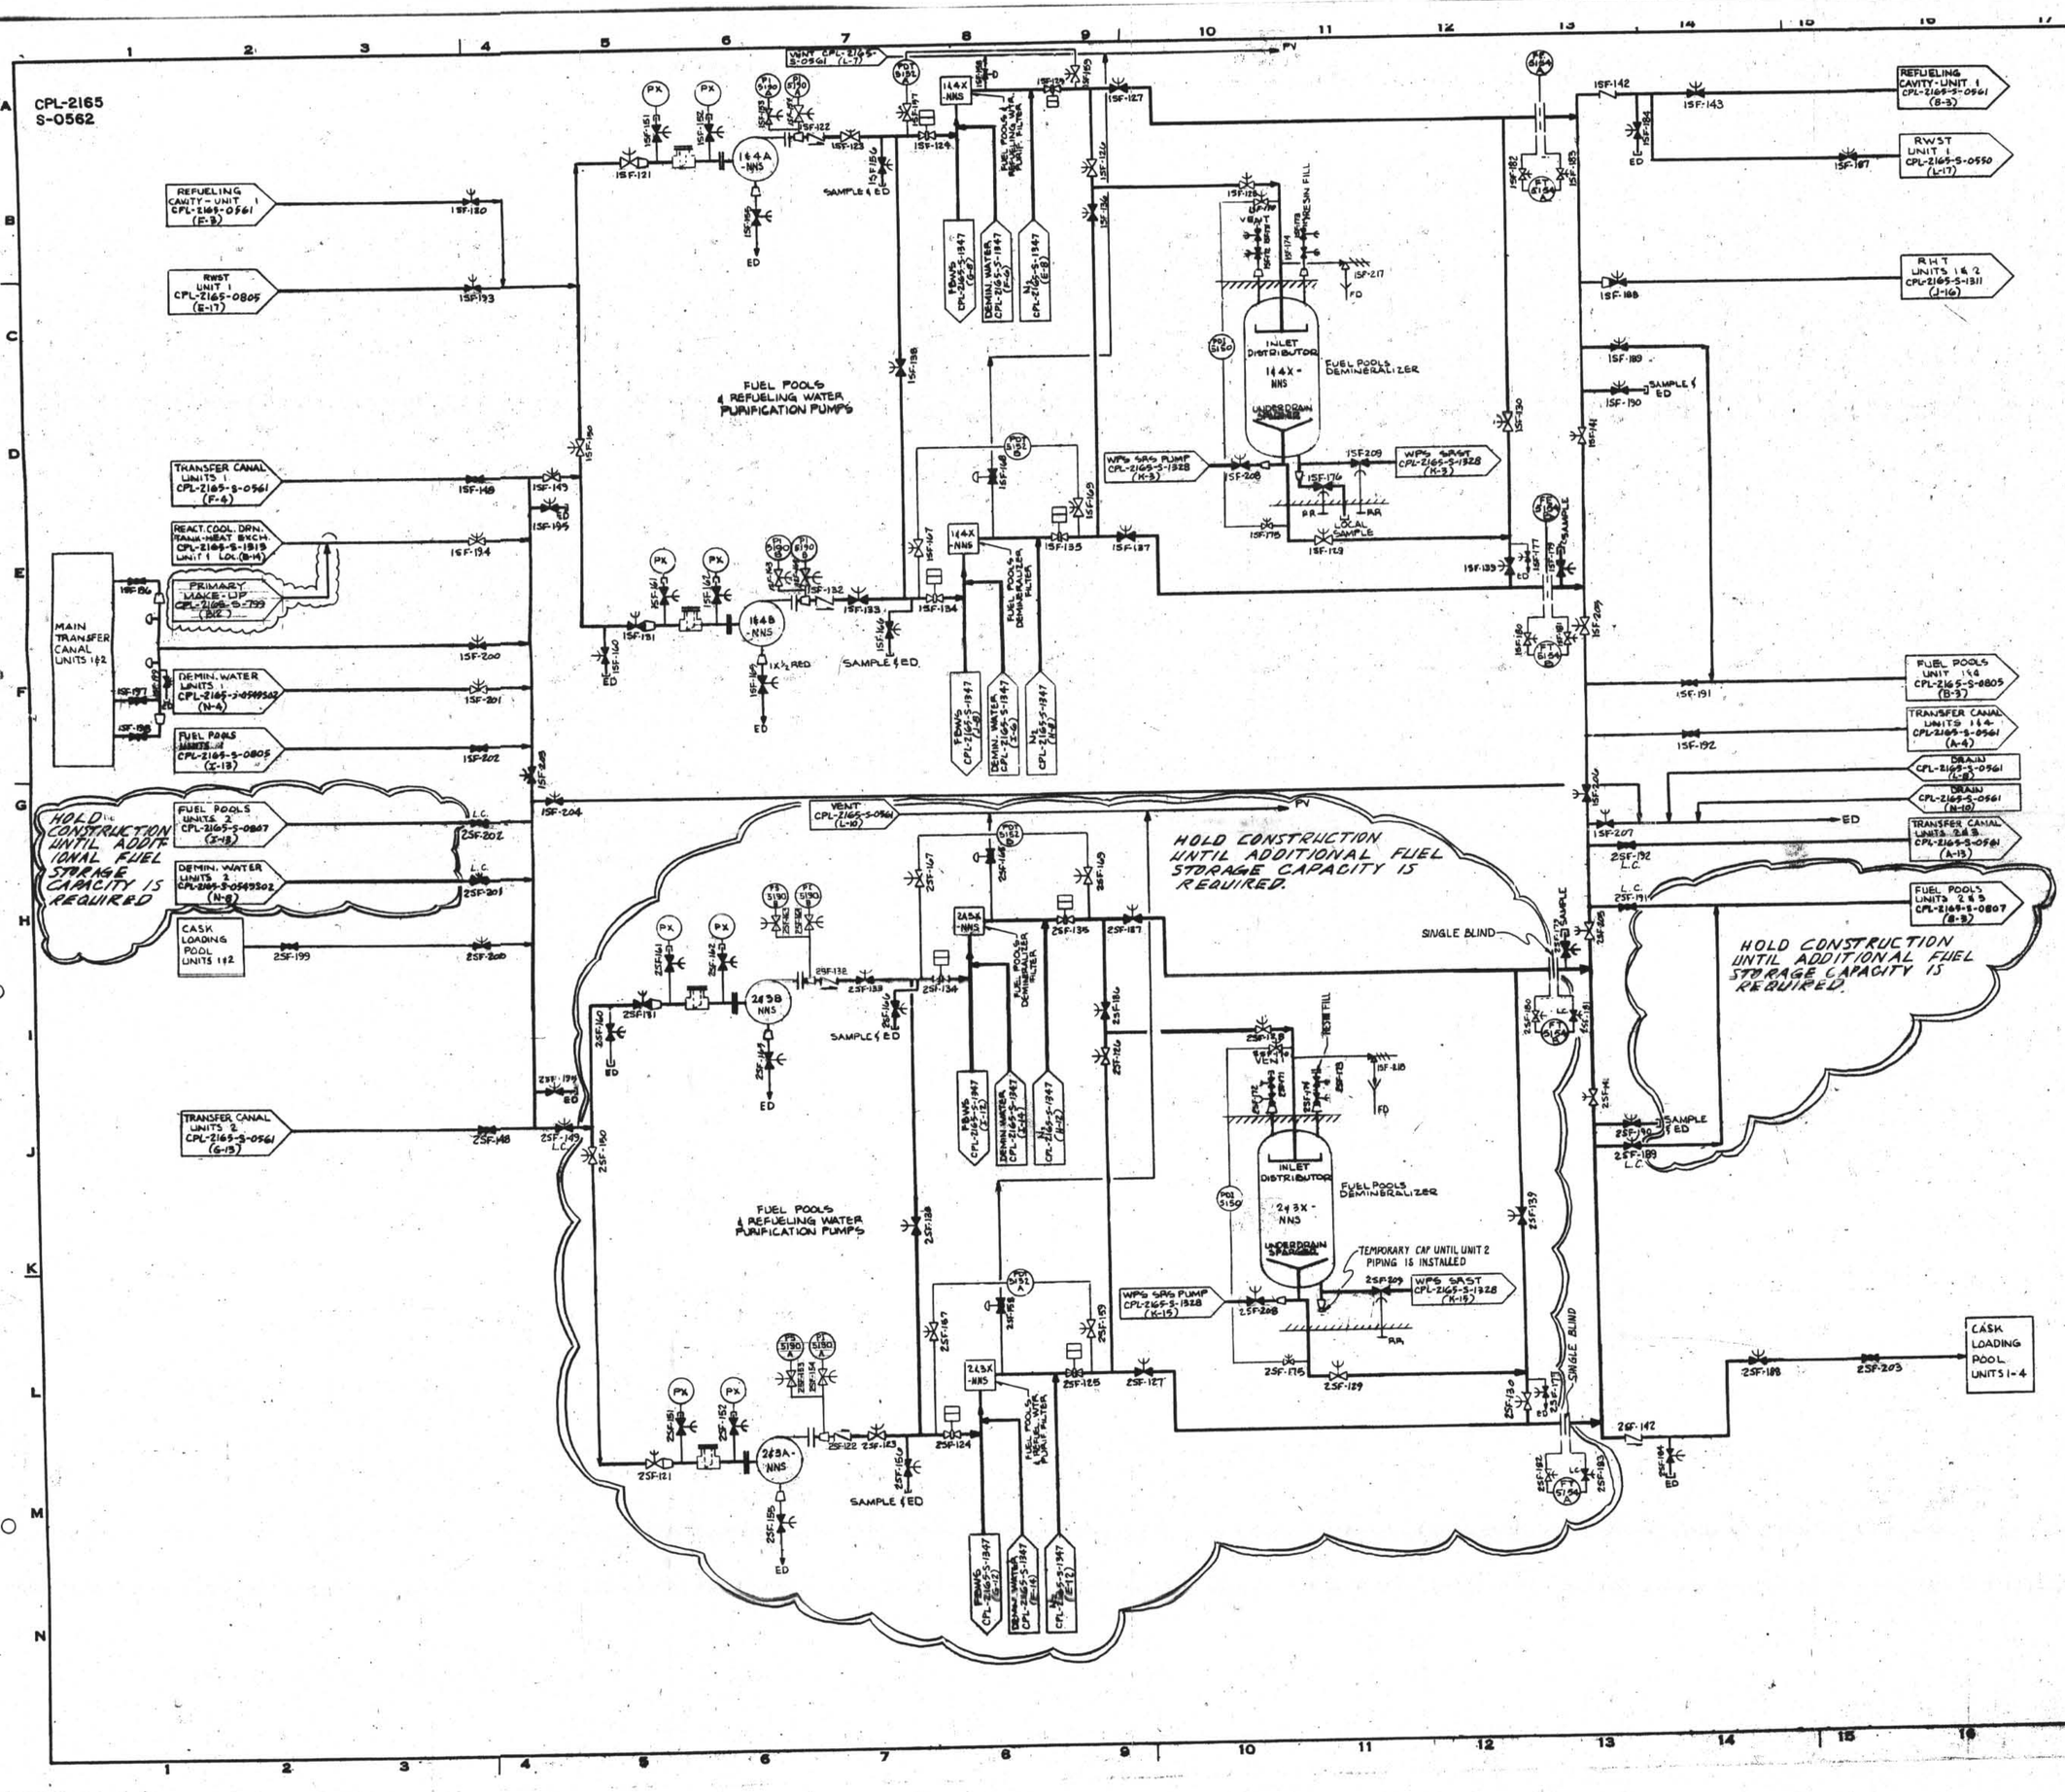

NO.	DATE	REVISION	BY	CHK	APPD
6	7/1/88	INCORPORATED: SDSE 90-0058 (D2, E1, E2)		4/88	
5	4/8/91	INCORPORATED IN THIS REV.: FCR-P-223 (H12)			
4	8/7/90	INCORPORATED IN THIS REVISION: FCR-5075 (F16)			
3	1/1/88	INCORPORATED IN THIS REVISION: FCR-P-3342R3 (A18, A19, A17)			
2	9-1-85	PLACED CONSTRUCTION OF PIPING AND EQUIPMENT ON THIS DRAWING ON HOLD UNTIL ADDITION FUEL STOR. CAP. IS REQUIRED. INCORPORATED: FCR-P-3052 R3 (C4, I5, I13, M13). SP-153827 (B11, B12, T11, T12) REVISED: TITLE BLOCK (W19). ADDED: "NNS" (A7, A8, C1, D8, E7, H7, H8, J1, L1, L7, L8). DELETED: DU, VA, S (A8, A9, F8, F9, E14, H8, H9, L8, L9)			
1	1/1/85	DOCUMENTS INCORP. IN REV. ADDED NO. PER N.O.D., DCA/SP-775 SUPERCEDED BY FCR-P-3052, FCR-P-3040 (A6, E6) FCR-P-3052 (G9, M9, J9, I2, I3, I9, K1 & L1 thru 4, M13, J13, J15, M15, K14 thru L14)	A. B.	J. K. H.	C. B. H.

CAROLINA POWER & LIGHT COMPANY
SHEARON HARRIS NUCLEAR POWER PLANT

SIMPLIFIED FLOW DIAGRAM
FUEL POOLS CLEAN-UP SYSTEMS
SHEET 2
UNIT 1

SCALE NONE | DESIGNED | DRAWN | CHECKED | APPROVED | DATE 12-5-8

CPL-2165
S-0562

D-1A