CPL-2165
S-0556

REPLACES DWG. SFD-198S-M-056

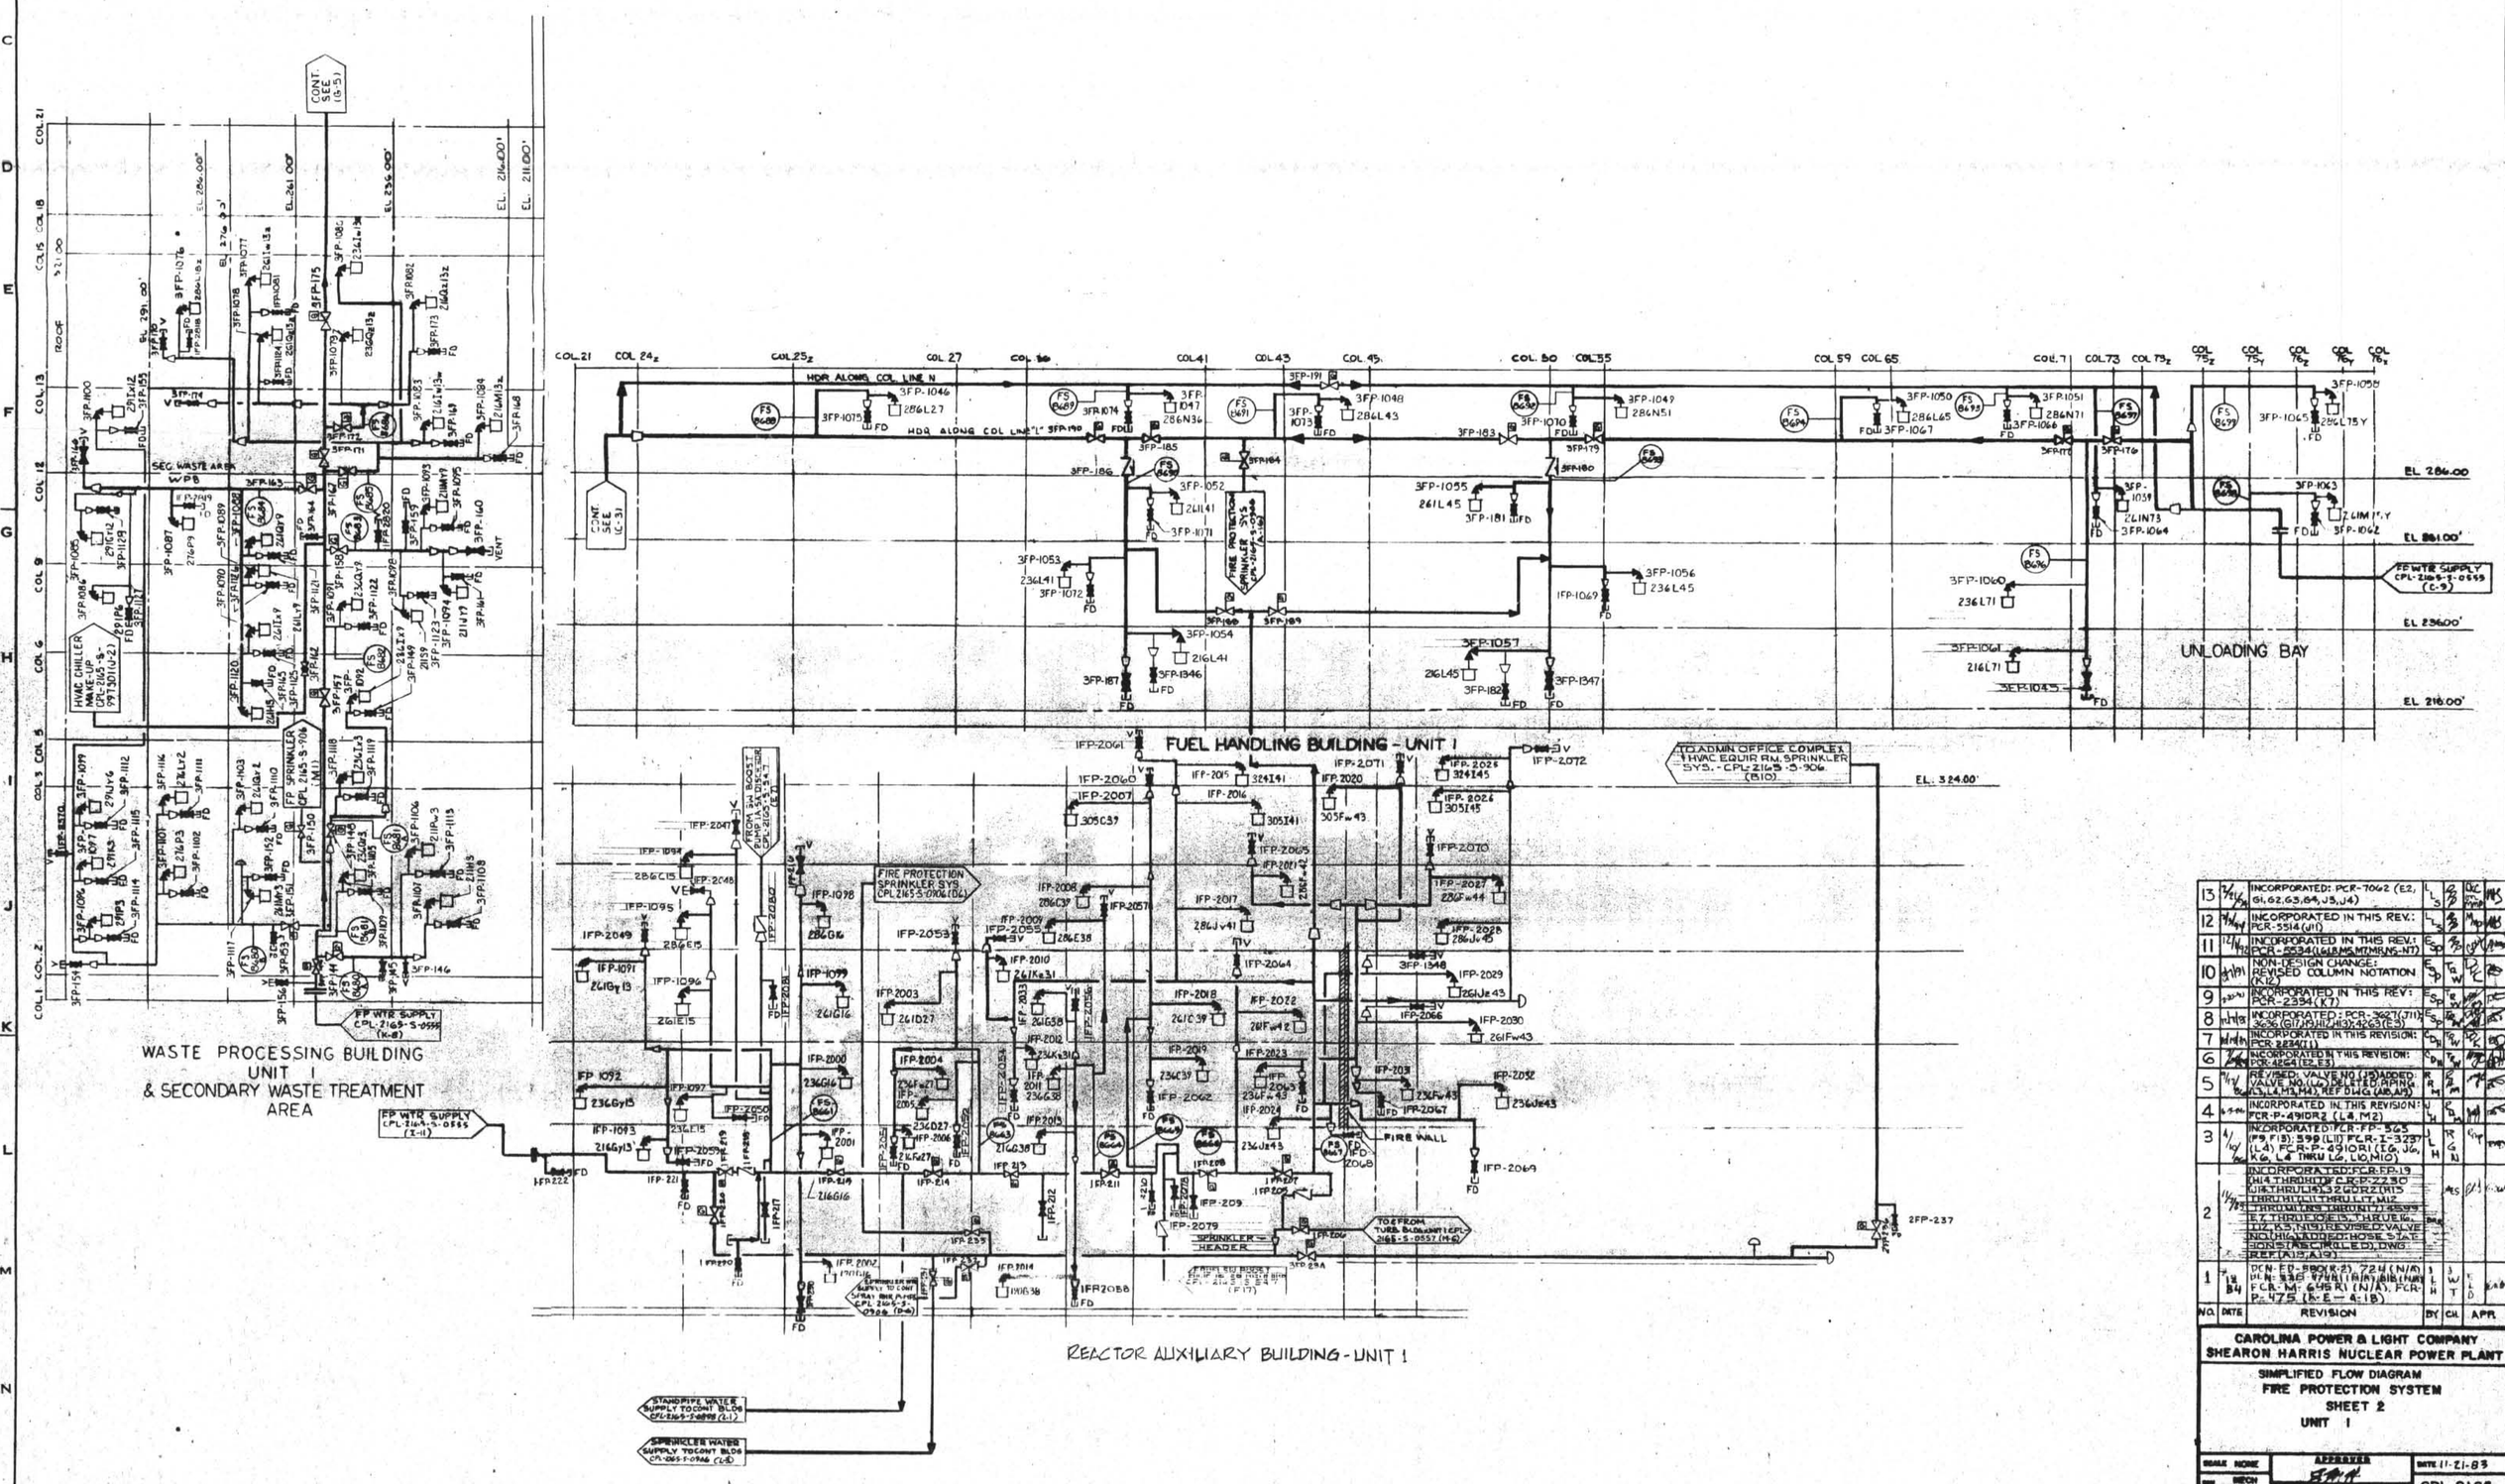

NO.	DATE	REVISION	BY	CH.	APR.
13	7/16/84	INCORPORATED: PCR-7062 (E2, G1, G2, G3, G4, J3, J4)	LS	SP	DC
12	4/4/84	INCORPORATED IN THIS REV.: PCR-5514 (J10)	LS	SP	DC
11	12/4/82	INCORPORATED IN THIS REV.: PCR-5534 (L6, L8, M5, M7, M8, N5-N7)	ES	SP	DC
10	8/19/81	NON-DESIGN CHANGE: REVISED COLUMN NOTATION (K-12)	ES	TG	DC
9	3/30/81	INCORPORATED IN THIS REV: PCR-2394 (K7)	ES	TG	DC
8	1/14/81	INCORPORATED: PCR-3627 (J11-J13, G11, J9, H12, H13, D2, G3, E3)	ES	TG	DC
7	10/14/80	INCORPORATED IN THIS REVISION: PCR 2234 (L11)	ES	TG	DC
6	7/8/80	INCORPORATED IN THIS REVISION: PCR 2124 (E2, E3)	ES	TG	DC
5	7/12/79	REVISED: VALVE NO. (J3) ADDED VALVE NO. (J10) DELETED; PIPING (L3, L4, M3, M4), REF DWG (A8, A9)	RM	TG	DC
4	4-5-79	INCORPORATED IN THIS REVISION: FCR-P-491DR2 (L4, M2)	LH	TG	DC
3	4/4/79	INCORPORATED: FCR-FP-525 (P9, F13); 599 (L11) FCR-I-3237 (L4); FCR-P-491DR1 (I6, J6, K6, L4 THRU L6, L10, M10)	LH	TG	DC
2	12/29/78	INCORPORATED: FCR-FP-19 (H4, H7 THRU H10); CRCP-2230 (J12, H13, J13, J2 THRU J8, K3, K2 THRU K7, L11 THRU L17, M12 THRU M15, M8 THRU M11); 5599 (E7, E8 THRU E13, E15 THRU E16, L12, K5, N15); REVISED: VALVE NO. (H3, H4, D2); DELETED: HOSE STATIONS (ABS. CHALLED), DWG: REF. (A13, A19)	RS	GS	DC
1	12/8/84	DCN-ED-8801(K-2) 724 (N/A) DCN-ED-8801(K-2) 724 (N/A) FCR-M-6495R1 (N/A), FCR-P-475 (K-E-4-18)	JWT	TGD	DC

CAROLINA POWER & LIGHT COMPANY
SHEARON HARRIS NUCLEAR POWER PLANT

SIMPLIFIED FLOW DIAGRAM
FIRE PROTECTION SYSTEM
SHEET 2
UNIT 1

SCALE NONE
DWN. MECH
DES. EPC/RA
CHK. JL
APPROVED
DATE 11-21-83
CPL-2165
S-0556

D-7A