

September 2, 1987

Posted
 Amdt. 123
 to DPR-26

Docket Nos. 50-03
 and 50-247

DISTRIBUTION

Docket File
 NRCPDR
 Local PDR
 PDI-1 Rdg.
 OGC
 S. Varga
 B. Boger
 OGC
 E. Butcher
 ARM/LFMB
 P. Erickson
 PNSNP Rdg.

C. Vogan
 M. Slosson
 D. Hagan
 E. Jordan
 J. Partlow
 T. Barnhart(8)
 ACRS(10)
 Wanda Jones
 GPA/PA
 P. Swetland, RI
 E. Hylton

Mr. Murray Selman
 Vice President, Nuclear Power
 Consolidated Edison Company
 of New York, Inc.
 Broadway and Bleakley Avenue
 Buchanan, New York 10511

Dear Mr. Selman:

The Commission has issued the enclosed Amendment No. 36 to Facility Operating License No. DPR-5 and Amendment No. 123 to Facility Operating License No. DPR-26 for the Indian Point Nuclear Generating Unit Nos. 1 and 2. The amendments consist of changes to the Technical Specifications in response to your application transmitted by letter dated November 26, 1986 (TAC 64162).

The amendments revise the Technical Specifications for Indian Point Unit Nos. 1 and 2 to incorporate changes to the Facility Organization. The amendments revise the organizational figures contained in the Technical Specifications and revise the affected titles of the members of the Station Nuclear Safety Committee.

A copy of the related Safety Evaluation is enclosed. A Notice of Issuance will be included in the Commission's next regular bi-weekly Federal Register notice.

Sincerely,

Marylee M. Slosson, Project Manager
 Project Directorate I-1
 Division of Reactor Projects, I/II

Enclosures:

1. Amendment No. 36 to DPR-5
2. Amendment No. 123 to DPR-26
3. Safety Evaluation

cc: w/enclosures
 See next page

* SEE PREVIOUS CONCURRENCE

PDI-1
 CVogan*
 8/18/87

PDI-1
 MSlosson*
 8/20/87

PDSNP ²⁷⁵²
 PErickson
 9/1/87

OGC
 MKarman*
 8/28/87

PDI-1
 RCapra
 9/2/87

Mr. Murray Selman
Consolidated Edison Company
of New York, Inc.

Indian Point Nuclear Generating
Station 1/2

cc:

Mayor, Village of Buchanan
236 Tate Avenue
Buchanan, New York 10511

Mr. Jay Dunkleberger
Office of Policy Analysis
and Planning
York State Energy Office
Building 2, Empire State Plaza
Albany, New York 12223

Robert L. Spring
Manager of Regulatory Affairs
Consolidated Edison Company
of New York, Inc.
Broadway and Bleakley Avenue
Buchanan, New York 10511

Senior Resident Inspector
U.S. Nuclear Regulatory Commission
Post Office Box 38
Buchanan, New York 10511

Brent L. Brandenburg
Assistant General Counsel
Consolidated Edison Company
of New York, Inc.
4 Irving Place - 1822
New York, New York 10003

Regional Administrator, Region I
U.S. Nuclear Regulatory Commission
631 Park Avenue
King of Prussia, Pennsylvania 19406

Carl R. D'Alvia, Esquire
Attorney for the Village of
Buchanan, New York
395 South Riverside Avenue
Croton-on-Hudson, New York 10520

Director, Technical Development
Programs
State of New York Energy Office
Agency Building 2
Empire State Plaza
Albany, New York 12223

Mr. Peter Kokolakis, Director
Nuclear Licensing
New York Power Authority
123 Main Street
White Plains, New York 10601

Mr. Walter Stein
Secretary - NFSC
Consolidated Edison Company
of New York, Inc.
4 Irving Place - 1822
New York, New York 10003

Ezra I. Bialik
Assistant Attorney General
Environmental Protection Bureau
New York State Department of Law
2 World Trade Center
New York, New York 10047



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

CONSOLIDATED EDISON COMPANY OF NEW YORK, INC.

DOCKET NO. 50-03

INDIAN POINT NUCLEAR GENERATING UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 36
License No. DPR-5

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Consolidated Edison Company of New York, Inc. (the licensee) dated November 26, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-5 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 36, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance to be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION

Robert A. Capra

Robert A. Capra, Acting Director
Project Directorate I-1
Division of Reactor Projects, I/II

Attachment:
Changes to the Technical
Specifications

Date of Issuance: September 2, 1987



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

ATTACHMENT TO LICENSE AMENDMENT
AMENDMENT NO. 36 TO FACILITY OPERATING LICENSE NO. DPR-5
DOCKET NO. 50-03

Revise Appendix A as follows:

<u>Remove Pages</u>	<u>Insert Pages</u>
3.1	3.1
3.2	3.2


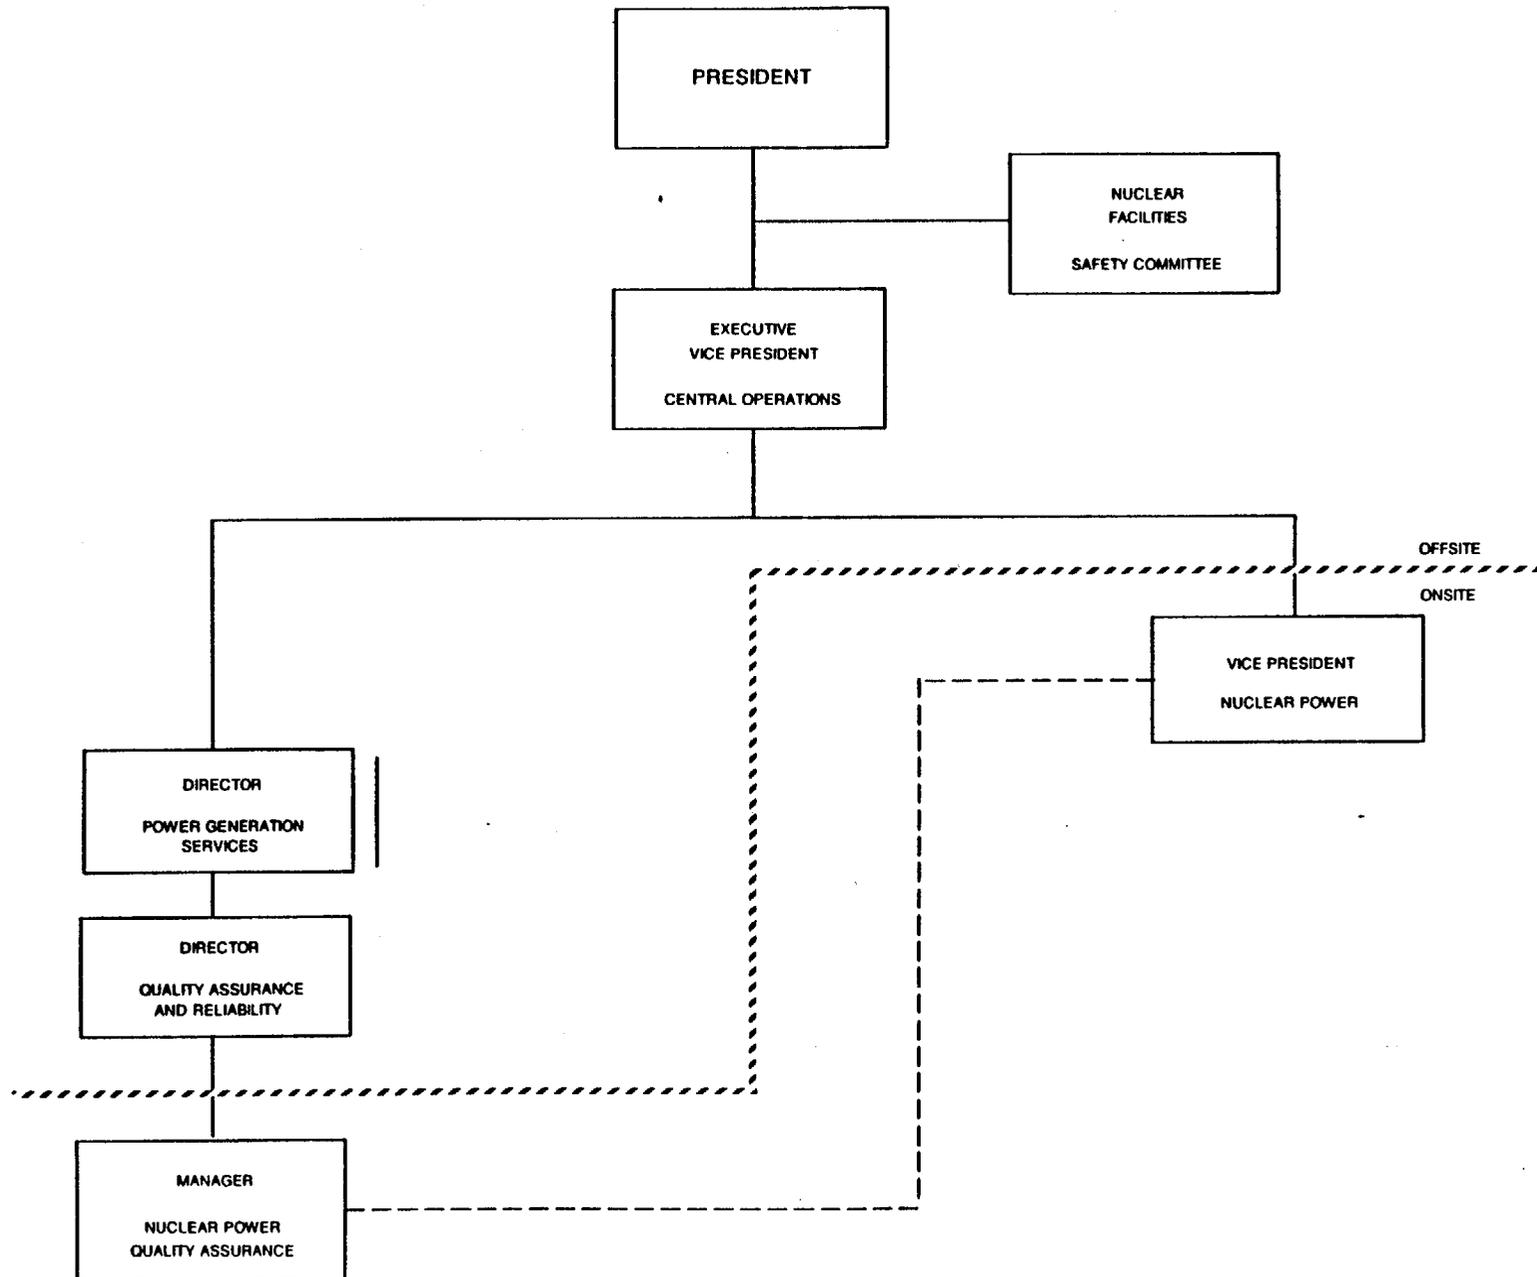


Figure 3.1 Independent Safety Review and Audit Organization

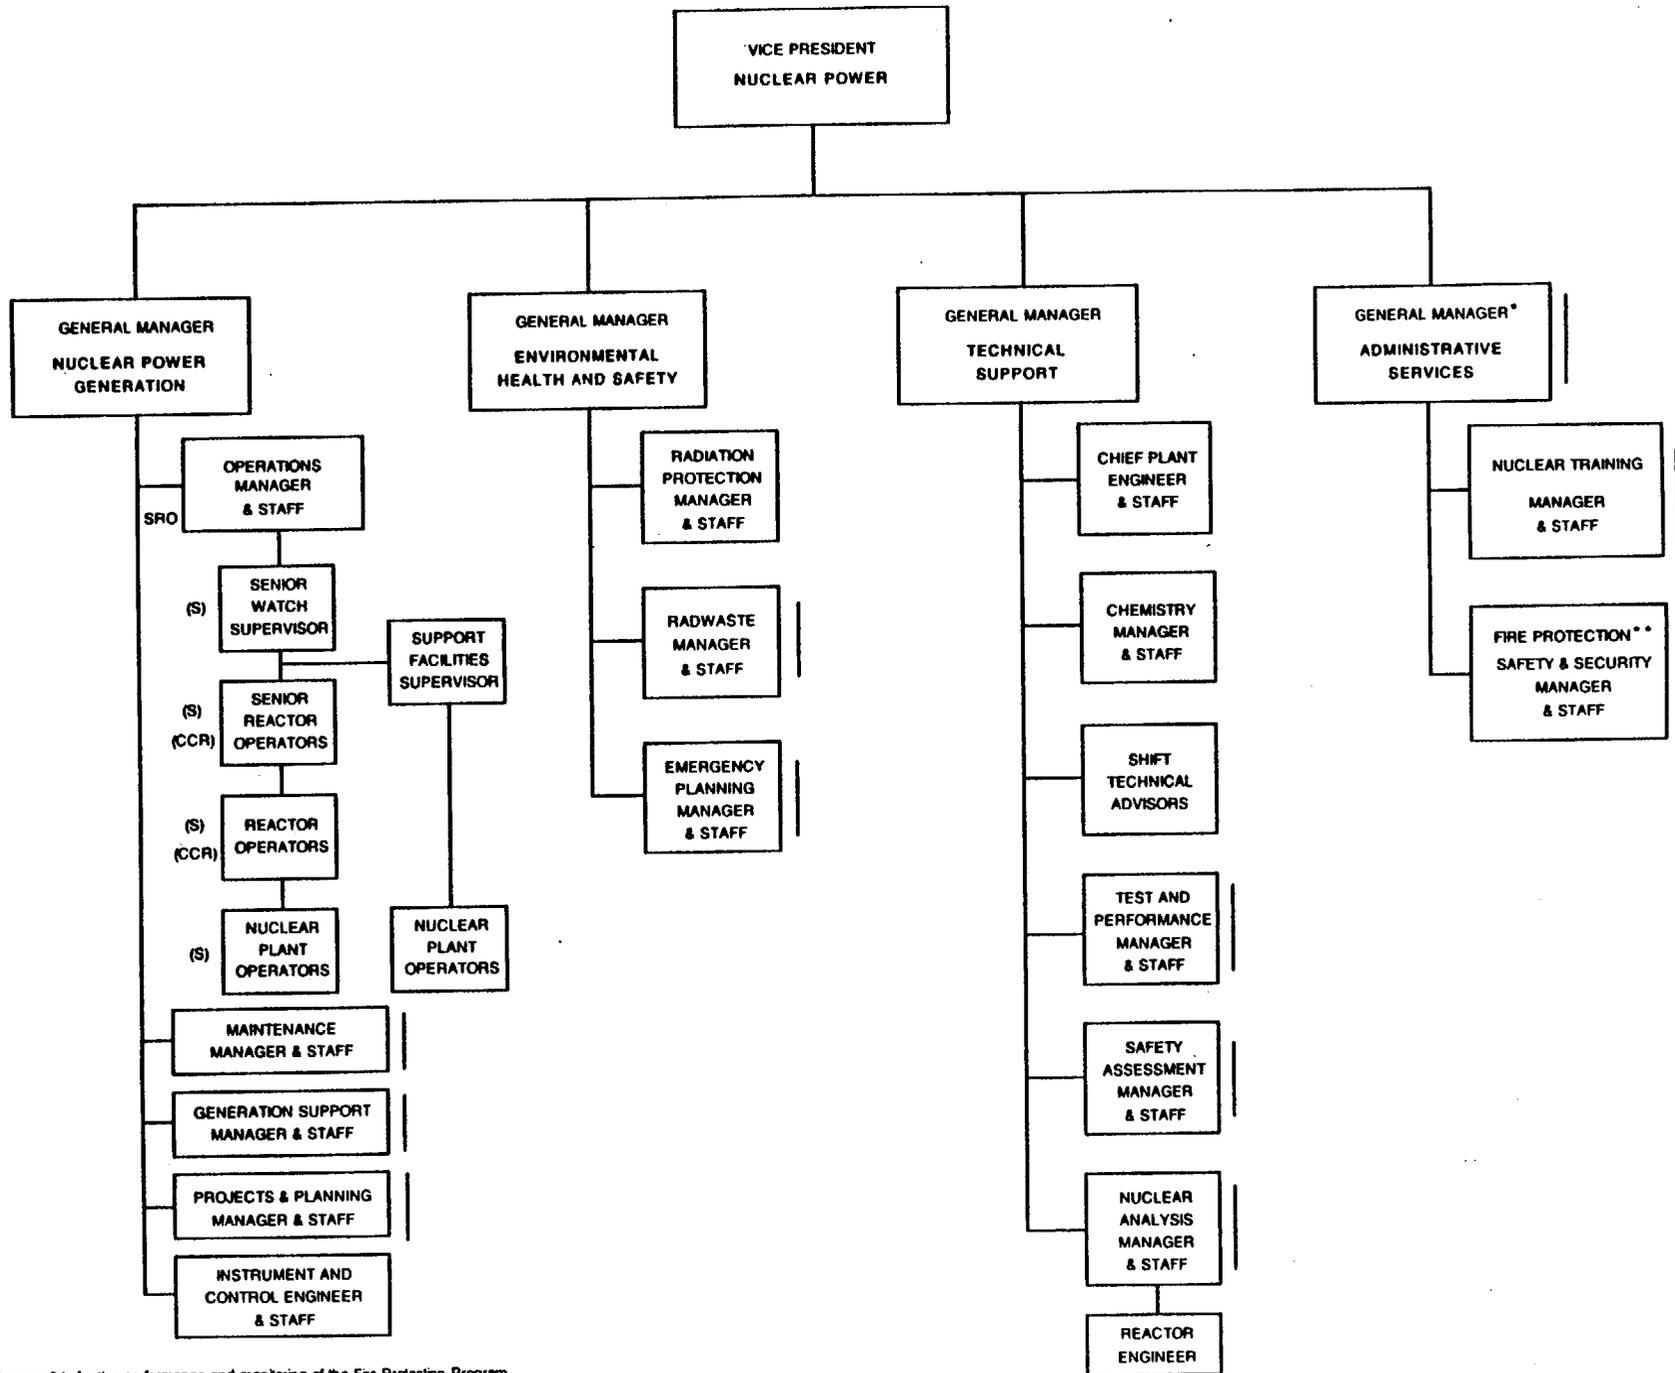

* Responsible for the performance and monitoring of the Fire Protection Program

** Responsible for the Fire Protection Program Activities

(CCR) - Central Control Room Position

(S) - Continuous Shift Coverage

Figure 3.2 Facility Organization



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

CONSOLIDATED EDISON COMPANY OF NEW YORK, INC.

DOCKET NO. 50-247

INDIAN POINT NUCLEAR GENERATING UNIT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 123
License No. DPR-26


1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Consolidated Edison Company of New York, Inc. (the licensee) dated November 26, 1986, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-26 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 123, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance to be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION



Robert A. Capra, Acting Director
Project Directorate I-1
Division of Reactor Projects, I/II

Attachment:
Changes to the Technical
Specifications

Date of Issuance: September 2, 1987



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 123 TO FACILITY OPERATING LICENSE NO. DPR-26

DOCKET NO. 50-247

Revise Appendix A as follows:

<u>Remove Pages</u>	<u>Insert Pages</u>
6.2.1	6.2.1
6.2.2	6.2.2
6-6	6-6


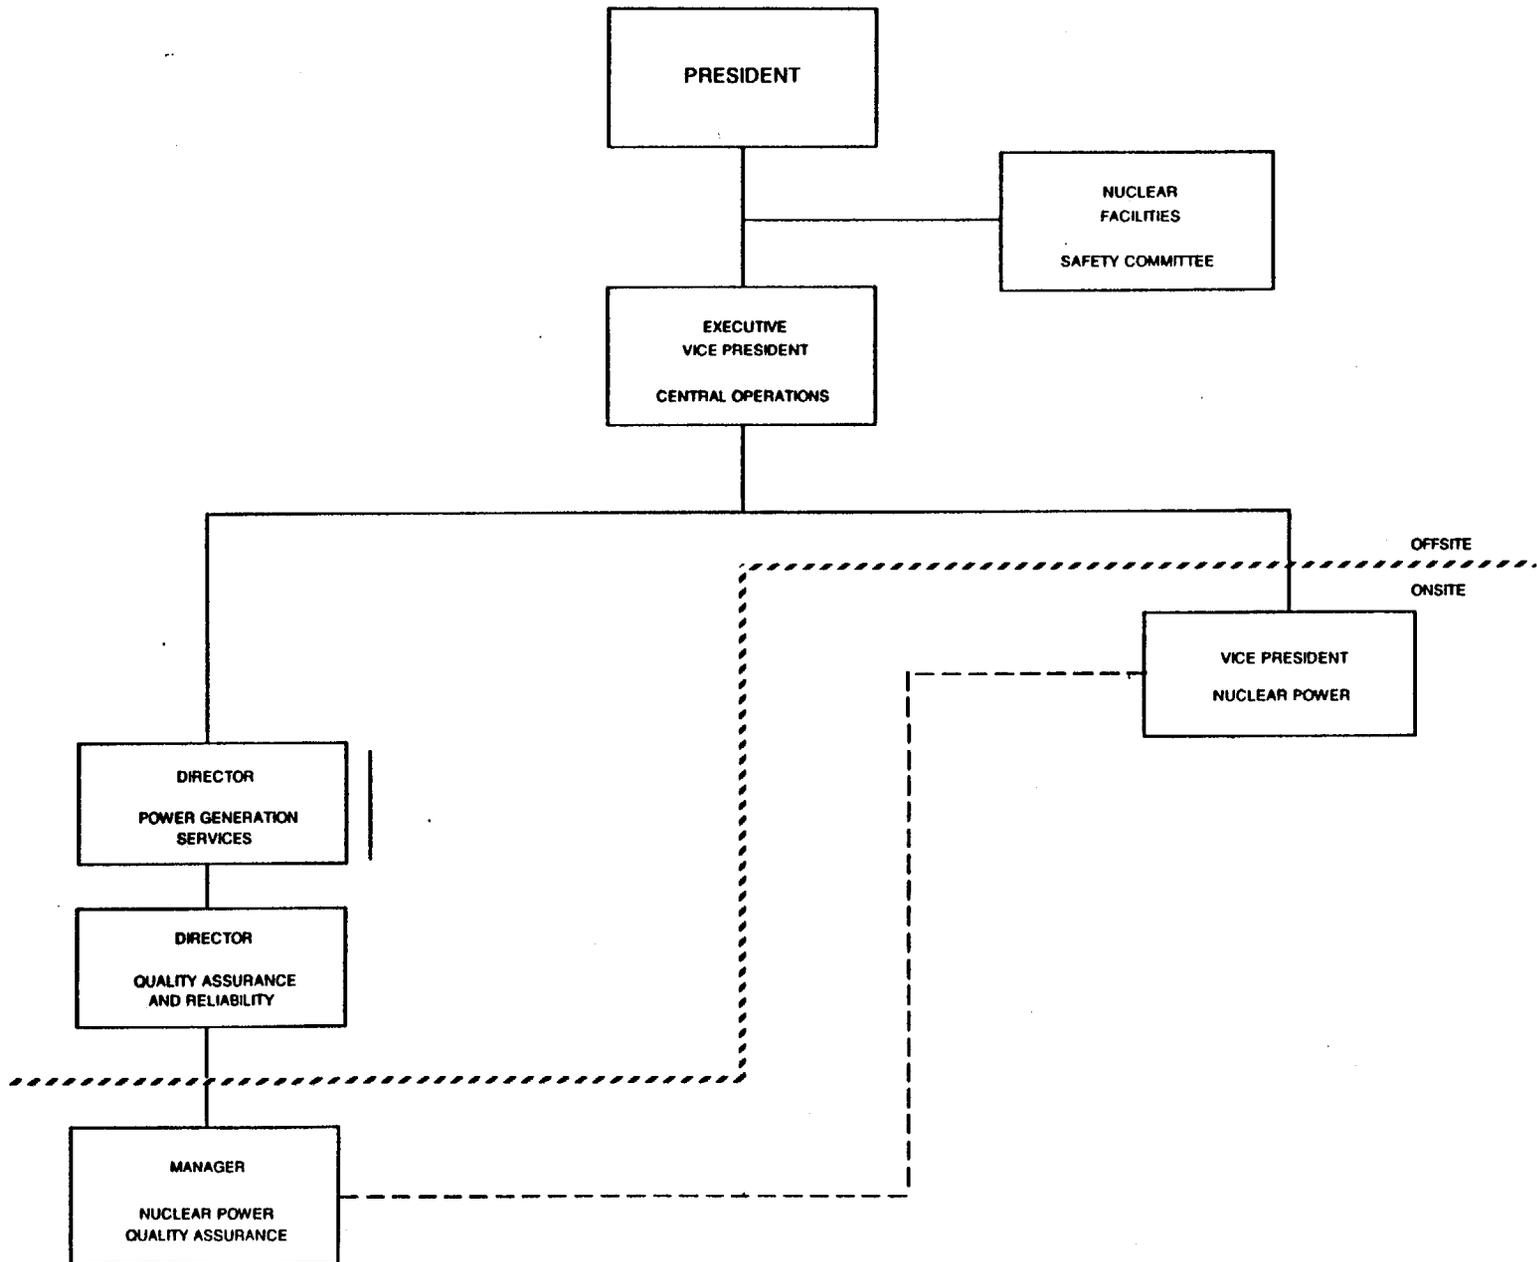


Figure 6.2.1 Independent Safety Review and Audit Organization

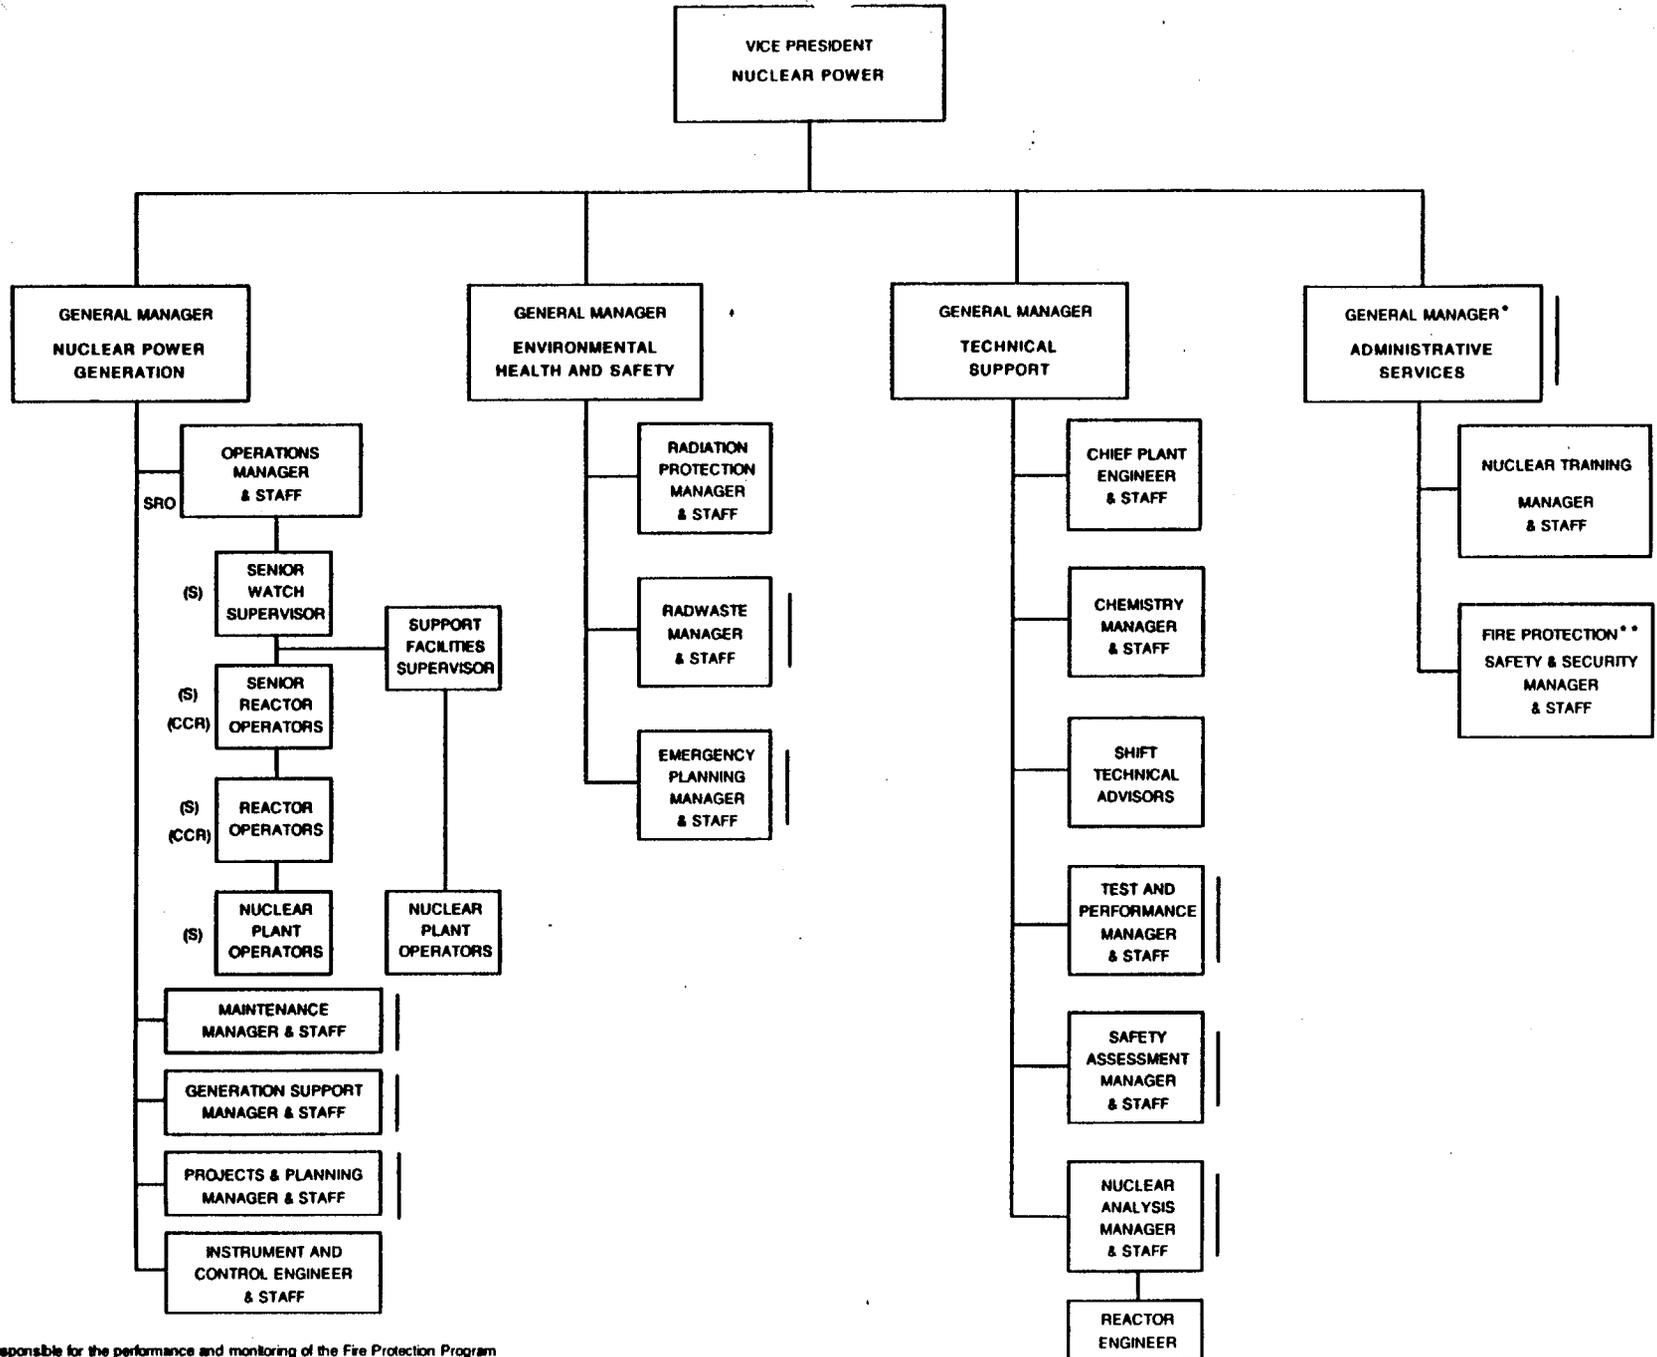

* Responsible for the performance and monitoring of the Fire Protection Program
 ** Responsible for the Fire Protection Program Activities
 (CCR) - Central Control Room Position
 (S) - Continuous Shift Coverage

Figure 6.2.2 Facility Organization

COMPOSITION

6.5.1.2 The Station Nuclear Safety Committee shall, as a minimum, be composed as follows:

Chairman:	General Manager-Technical Support
Member:	Chief Plant Engineer
Member:	Operations Manager
Member:	Maintenance Manager
Member:	Instrument and Control Engineer
Member:	Radiation Protection Manager
Member:	Reactor Engineer

6.5.1.2.1 In addition, other technically competent individuals may be appointed by the SNSC Chairman to serve as SNSC members.

ALTERNATES

6.5.1.3 Alternate members shall be appointed in writing by the SNSC Chairman to serve on a temporary basis, and must have qualifications similar to the member being replaced.

MEETING FREQUENCY

6.5.1.4 The SNSC shall meet at least once per calendar month and as convened by the SNSC Chairman or his designated alternate.

QUORUM

6.5.1.5 A quorum of the SNSC shall consist of the Chairman or his designated alternate and four members. No more than two alternates shall be included in the quorum.

RESPONSIBILITIES

6.5.1.6 The Station Nuclear Safety Committee shall be responsible for:

- a. Review of 1) all procedures required by Specification 6.8 and changes thereto, and 2) any other proposed procedures or changes thereto as determined by the General Manager-Technical Support to affect nuclear safety.
- b. Review of all proposed tests and experiments that affect nuclear safety.
- c. Review of all proposed changes to the Technical Specifications.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

SAFETY EVALUATION BY THE OFFICE OF NUCLEAR REACTOR REGULATION
RELATED TO AMENDMENT NO. 36 TO FACILITY OPERATING LICENSE NO. DPR-5
AND AMENDMENT NO. 123 TO FACILITY OPERATING LICENSE NO. DPR-26
CONSOLIDATED EDISON COMPANY OF NEW YORK, INC.
INDIAN POINT NUCLEAR GENERATING UNIT NOS. 1 AND 2
DOCKET NOS. 50-03 AND 50-247

INTRODUCTION

By letter dated November 26, 1986, Consolidated Edison Company requested a number of changes to the Administrative Controls for Indian Point Station, Units 1 and 2. Specifically, the changes would affect Figures 3.1 and 3.2 of the Indian Point 1 Technical Specifications; and Figures 6.2.1 and 6.2.2 and Section 6.5.1.2 of the Indian Point 2 Technical Specifications.

DISCUSSION AND EVALUATION

The proposed changes are as follows:

1. Figure 3.1 (IP-1)
Figure 6.2.1 (IP-2)
 - a. As a result of organizational restructuring, the offsite corporate support group, previously called the Technical Support Organization, is now called the Independent Safety Review and Audit Organization. The titles of Figures 3.1 and 6.2.1 would be changed accordingly. This is a title change only and is acceptable.
 - b. The existing Technical Specifications show a Vice President, Nuclear Engineering, Quality Assurance and Reliability in the offsite organization. This position has now been abolished and replaced by a new position of Director, Power Generation Services who retains responsibilities for Quality Assurance and Reliability. The Nuclear Engineering function has been moved onsite under the Vice President, Nuclear Power. The licensee states that this organizational split offsite and subsequent consolidation of the Nuclear Engineering function onsite permits the licensee to more effectively use its personnel. Additional engineering and technical resources of the licensee, not shown on the figures, are available through the Executive Vice President of Nuclear Operations. The resulting organization provides for the same level of technical support to the

station as was provided previously. However, the engineering function has been integrated with the onsite activities where it can be immediately responsive to the needs of the Vice President, Nuclear Power. The resulting organization has not diminished the support available to the station and it is consistent with Section 13.1.1 of the Standard Review Plan. It is, therefore, acceptable.

2. Figure 3.2 (IP-1)
Figure 6.2.2 (IP-2)

- a. A number of changes have been made to the onsite organization, including the following title changes:

<u>Old Title</u>	<u>New Title</u>
Chief Operations Engineer	Operations Manager
Maintenance Engineer	Maintenance Manager
Chief Technical Engineer	Chief Plant Engineer
Radwaste General Supervisor	Radwaste Manager
Test and Performance Engineer	Test and Performance Manager
Nuclear Training Director	Nuclear Training Manager
Emergency Planning Director	Emergency Planning Manager

These are title changes only and do not involve a change of function. They are, therefore, acceptable.

- b. Within the Nuclear Power Generation Department, the position of Operations Superintendent has been abolished. The Operations Manager will now directly manage the activities of the Senior Watch Supervisors, the Support Facilities Supervisors and the rotating shifts. The Operations Manager has personnel on his staff to assist in the day-to-day management of the plant operations activities. The position of Operations Superintendent is not required by the staff and abolition of this position is acceptable.
- c. The positions of Generation Support Manager and Projects and Planning Manager have been added to the Nuclear Power Generation Department. The Generation Support Manager and his staff provide additional administrative support to the department. The functions of the Projects and Planning Manager and his staff include those of the Major Projects Manager who previously was assigned to the Technical Support Department. The addition of the Generation Support Manager and the Projects and Planning Manager to the Nuclear Generation Department are intended to reduce the administrative burdens of both the Operations, Maintenance, and Instrumentation and Controls groups within Nuclear Power Generation, and the Chief Plant Engineer.
- d. The position of Nuclear Environmental Monitoring Engineer has been deleted from the Environmental Health and Safety Department and his function has been transferred to the Emergency Planning Manager.

- e. The Nuclear Engineering Department, previously located offsite, has been merged with the Technical Support Department onsite. This results in the addition of the Safety Assessment Manager and the Nuclear Analysis Manager to the staff of the General Manager Technical Support.
- f. The position of Security Administrator on the staff of the General Manager Administrative Services has been replaced by the Fire Protection, Safety and Security Manager. Responsibility for fire protection has been transferred from the Chief Technical Engineer in the previous organization to this new position.

Overall, the changes the licensee proposes to the onsite organization would result in a restructuring of functional responsibilities and a number of title changes. However, it would not delete any functions performed by the existing organization. In addition, the functions previously performed by the offsite Nuclear Engineering Department would now be performed onsite. The resulting organization is consistent with the guidance of Section 13.1.2 of the Standard Review Plan and is acceptable.

3. Section 6.5.1.2 (IP-2)

The titles of the members of the Station Nuclear Safety Committee would be changed to be consistent with the title changes mentioned above. Specifically, the Chief Technical Engineer would now be the Chief Plant Engineer, and the Maintenance Engineer would be the Maintenance Manager. These are title changes only and are acceptable.

ENVIRONMENTAL CONSIDERATION

This amendment involves only changes in administrative procedure and requirements. Accordingly, this amendment meets the eligibility criteria for categorical exclusion set forth in 10 CFR Section 51.22(c)(10). Pursuant to 10 CFR 51.22(b) no environmental impact statement or environmental assessment need be prepared in connection with the issuance of this amendment.

CONCLUSION

The staff has concluded, based on the considerations discussed above, that: (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner; and (2) such activities will be conducted in compliance with the Commission's regulations and the issuance of these amendments will not be inimical to the common defense and security or to the health and safety of the public.

PRINCIPAL CONTRIBUTOR:

L. Crocker

Dated: September 2, 1987