

REPORT: P187R40

50-346

DOCUMENTATION MANAGEMENT
DOCUMENT ON-LINE CONTROL SYSTEM
TRANSMITTAL / RECEIPT ACKNOWLEDGMENT

TRANSMITTAL NUMBER: 0101-00343
TRANSMITTAL DATE : 01/04/2001
TRANSMITTAL PAGE : 001
COPY NUMBER : 1665

pk

TO: DOC. CONTROL DESK,

USNRC
DIVISION OF EMERGENCY
PREPARDNESS
WASHINGTON, D.C. 20555

AS THE HOLDER OF THESE DOCUMENT COPIES, YOU ARE RESPONSIBLE FOR THEIR CONTROL AND MAINTENANCE IN ACCORDANCE WITH THE ACTIONS SPECIFIED BY THIS TRANSMITTAL. DOCUMENTS WHICH ARE NO LONGER CURRENT SHALL EITHER BE REMOVED AND DESTROYED OR MARKED TO REFLECT THAT THEY ARE SUPERSEDED OR VOIDED AND ARE NO LONGER CONSIDERED CONTROLLED.

***** ENSURE THAT DOCUMENTS ARE FILED IN TAB ORDER AS IDENTIFIED ON THE TABLE OF CONTENTS, AS APPLICABLE *****

IF YOU HAVE ANY QUESTIONS, PLEASE CONTACT DOCUMENT CONTROL, DAVIS-BESSE NUCLEAR POWER STATION, TELEPHONE (419) 321-7483.

THE ATTACHED DOCUMENT COPIES ARE DISTRIBUTION ONLY. NO RECEIPT ACKNOWLEDGMENT IS REQUIRED.

A045

REPORT: P187R40

DOCUMENTATION MANAGEMENT
DOCUMENT ON-LINE CONTROL SYSTEM
TRANSMITTAL / RECEIPT ACKNOWLEDGMENT

TRANSMITTAL NUMBER: 0101-00343
TRANSMITTAL DATE : 01/04/2001
TRANSMITTAL PAGE : 002

COPY NUMBER : 1665

	TYPE	DOCUMENT			STATUS
TOC	EPIA		SHT/SEC:		
REMOVE:	TOC	EPIA	SHT/SEC:	REV/SUB: 0017	REVISED
INSERT:	TOC	EPIA	SHT/SEC:	REV/SUB: 0018	APPROVED
MANUAL: EPIA			SHT/SEC:		
PROC RA-EP-01500			SHT/SEC:		
REMOVE:	PROC	RA-EP-01500	SHT/SEC:	REV/SUB: 0001	APPROVED
	PC	C95-1311			APPROVED
	PC	C96-1869			APPROVED
	PC	C98-0966			APPROVED
INSERT:	PROC	RA-EP-01500	SHT/SEC:	REV/SUB: 0001	APPROVED
	PC	C00-0352			APPROVED
	PC	C95-1311			APPROVED
	PC	C96-1869			APPROVED
	PC	C98-0966			APPROVED

END OF TRANSMITTAL

MANUAL TABLE OF CONTENTS
 DB EMERGENCY PLAN IMPLEMENTING PROCEDURES VOL A
 MANUAL: EPIA REVISION: 18

PAGE NO. 1
 DATE 01/04/01

TAB	PROCEDURE NUMBER	REV	ST	EFFECT DATE	ALTERATIONS	ALTERATION EFF DATE	TITLE
001	RA-EP-01500	01	CE	5/1/1995	C 951311 C 961869 C 980966 C 000352	10/6/1995 11/1/1996 5/8/1998 1/4/2001	EMERGENCY CLASSIFICATION
002	RA-EP-01600	00	CE	8/20/1996	C 991349	11/8/1999	UNUSUAL EVENT
003	RA-EP-01700	00	CE	8/20/1996	C 991352	11/8/1999	ALERT
004	RA-EP-01800	00	CE	8/20/1996	C 991351	11/8/1999	SITE AREA EMERGENCY
005	RA-EP-01900	00	CE	8/20/1996	C 991350	11/8/1999	GENERAL EMERGENCY

PROCEDURE DEVELOPMENT FORM
ED 7635-14

SHEET / OF / PROCEDURE ACTIVITY TRACKING NO. 00-0352

SECTION 1 - IDENTITY

PROCEDURE NO. / CURRENT REVISION RA-EP-01500 Rev. 01	PROPOSED REVISION NO. N/A	PROPOSED CHANGE NO. C-4	<input type="checkbox"/> NEW <input type="checkbox"/> REVISION <input checked="" type="checkbox"/> CHANGE <input type="checkbox"/> TEMPORARY APPROVAL	<input type="checkbox"/> CANCELLATION <input type="checkbox"/> INACTIVATION <input type="checkbox"/> REACTIVATION	<input type="checkbox"/> RESTRICTED ESTIMATED EXPIRATION (DATE / EVENT)
---	------------------------------	----------------------------	--	---	--

PROCEDURE TITLE
Emergency Classification

PROCEDURE CLASSIFICATION
 SR QR N-QR CHANGE TO? YES NO PAT / PCR NOS. CLOSED OUT
PCRs 96-2466, 98-1938. CONTINUED

ACTIVITY SUMMARY / PURPOSE Incorporate

(1) LAR 98-0005, Revise TS. 3/4.3.2.1 and Associated Bases. Change EAL 1.B.4 and 1.D.3 reference to SFAS "CTMT pressure 38.4 psia" to "CTMT High - High pressure" in EAL.

(2) Page 36, Add to step 2., "OR B. Valid alarm on a radiation detector monitoring the fuel handling area in Containment or the spent fuel area" and Change current step "B" to "C"

(3) Page 48 Correct ^{typo} type: Change "casing casing" to "...causing casing..."

(4) Page 58, F. Add "Control Room," so this procedure is the same as the Alert, SAE, and GE procedures CONTINUED

SECTION 2 - CONCURRENT EFFECTIVE DOCUMENTS CONTINUED

DOCUMENT NO. / REVISION	DOCUMENT TITLE	PAT NO. / CHANGE REQUEST
NONE		

SECTION 3 - REVIEW ORGANIZATIONS

REQUIRED				REQUESTED			
OPS	TRNG						
RP							

CONTINUED CONTINUED

PROCEDURE PREPARER Paul F. Timmerman *[Signature]* DATE 2/14/00 QUALIFIED REVIEWER D. J. Gordon *[Signature]* DATE 3/8/00

SECTION 4 - ATTACHMENTS

COMPLETED AND ATTACHED

YES N/A	YES N/A	YES N/A
<input type="checkbox"/> <input checked="" type="checkbox"/> VALIDATION CHECKLIST	<input checked="" type="checkbox"/> <input type="checkbox"/> SAFETY REVIEW	<input type="checkbox"/> <input checked="" type="checkbox"/> REVISED CROSS REFERENCES LIST
<input checked="" type="checkbox"/> <input type="checkbox"/> COMMITMENT VERIFICATION SUMMARY	<input checked="" type="checkbox"/> <input type="checkbox"/> DOCUMENT REVIEW SHEETS	<input checked="" type="checkbox"/> <input type="checkbox"/> PCRs
<input type="checkbox"/> <input checked="" type="checkbox"/> SAFETY EVALUATION NO.		<input type="checkbox"/> <input checked="" type="checkbox"/> OTHER

FINAL QUALIFIED REVIEWER CONCURRENCE *[Signature]* DATE 03/20/00

SECTION 5 - TEMPORARY APPROVAL

MANAGEMENT SRO N/A DATE N/A APPROVAL AUTHORITY N/A DATE N/A

SECTION 6 - CONCURRENCE / FINAL APPROVAL

PROCEDURE SPONSOR <i>[Signature]</i>	DATE 3/20/00	<input type="checkbox"/> MANAGER - BUSINESS SERVICES (BSA) N/A	DATE
<input type="checkbox"/> DIRECTOR - SUPPORT SERVICES (NA) N/A	DATE	<input type="checkbox"/> SRB <i>[Signature]</i>	DATE 3-29-00
<input type="checkbox"/> DIRECTOR - TECHNICAL SERVICES (E&S) N/A	DATE	<input type="checkbox"/> PLANT MANAGER <i>[Signature]</i>	DATE 3/30/00
<input type="checkbox"/> DIRECTOR - WORK MANAGEMENT (WMD) N/A	DATE	APPROVAL AUTHORITY <i>[Signature]</i>	DATE 1/1/01

SECTION 7 - TRAINING / PROCEDURE EFFECTIVITY

TRAINING COMPLETE YES N/A ALTERATION EFFECTIVE DATE 01/04/01 PROCEDURE SPONSOR *[Signature]* DATE 1-4-01

8/26/00
01/04/01

PROCEDURE DEVELOPMENT FORM
ED 7635-10

SHEET 1 OF 1 PROCEDURE ACTIVITY TRACKING NUMBER 95-1311

SECTION 1 - IDENTITY

PROCEDURE NO. RA-EP-01500 R1
 PROPOSED REVISION NO. -
 PROPOSED CHANGE NO. C-1
 NEW CANCELLATION NORMAL CHANGE LIMITED CHANGE
 REVISION INACTIVATION TEMPORARY APPROVAL
 LIMITED REVISION REACTIVATION RESTRICTED
 FROM _____ TO _____ (DATE/EVENT)

PROCEDURE TITLE EMERGENCY CLASSIFICATION

PROCEDURE CLASSIFICATION: R CR N-OR
 CHANGE NO? YES NO
 SAFETY REVIEW REQUIRED? YES NO
 PERFORMED IN CONJUNCTION WITH OTHER ACTIVITY
 CONTINUED

ACTIVITY SUMMARY/PURPOSE CHANGE EAL "HIGH RADIATION LEVELS WITHIN THE PLANTS" to "HIGH Radiation LEVELS WITHIN THE PROTECTED AREA." This will accomodate the addition of DRY FUEL STORAGE

PROCEDURE PAREP: [Signature] DATE: 6/21/95

SECTION 2 - QUALIFIED REVIEW

VALIDATION REQUIRED? YES NO METHOD OF VALIDATION: N/A ALARA REVIEW REQUIRED? YES NO

JUSTIFICATION: This change is so minor in nature as to not require validation

QUALIFIED REVIEWER: [Signature] DATE: 6/22/95

SECTION 3 - CROSS-DISCIPLINARY REVIEW/CONCURRENCE

DUE: 6-29-95

REQUIRED	REQUESTED	CONCURRENCE	ORG	CONCURRENCE /DATE	REQUIRED	REQUESTED	CONCURRENCE	ORG	CONCURRENCE /DATE
X	X	X	OPS	J. Delmonico					6/26/95
X	X	X	RP	B. Coard					6/29/95
X	X	X	SECU	L. Nannon					6/26/95
X	X	X	TRAN	[Signature]					6/24/95
	X	X	DFST	D. E. Hill					6/24/95

★ DRY FUEL STORAGE TEAM

SECTION 4 - ATTACHMENTS

COMPLETED AND ATTACHED

YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/>	DOCUMENT INTERFACE WORKSHEET	YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	VALIDATION CHECKLIST	YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	VENDOR MANUAL CONFIRMATION FORM
YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/>	COMMITMENT VERIFICATION SUMMARY	YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/>	SAFETY REVIEW	YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	DOCUMENT REVIEW SHEETS
YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	EDITORIAL VERIFICATION CHECKLIST	YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	SAFETY EVALUATION	YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	REVISED CROSS REFERENCES LIST
				YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/>	OTHER

QUALIFIED REVIEWER CONCURRENCE: [Signature] DATE: 6/29/95

SECTION 5 - TEMPORARY APPROVAL

MGMT SPO: N/A DATE:

SECTION 6 - CONCURRENCE/FINAL APPROVAL

PROCEDURE SPONSOR: [Signature] DATE: 7/27/95
 APPROVAL AUTHORITY: [Signature] DATE: 9/29/95
 SRB: [Signature] DATE: 9/29/95
 PLANT MANAGER: [Signature] DATE: 9/29/95

SECTION 7 - TRAINING/PROCEDURE EFFECTIVITY

TRAINING REQUIRED? YES NO
 JUSTIFICATION FOR NO TRAINING: The revision would change of this alternative do not require training
 CONTINUED
 TRAINING COMPLETION DATE: N/A
 SURVEILLANCE AND PERIODIC TEST PROGRAM CHANGE FORM SUBMITTED: YES NO
 PROCEDURE EFFECTIVE (DATE OR EVENT): 10/6/95
 PROCEDURE SPONSOR: [Signature]
 DATE: 10/3/95

PROCEDURE DEVELOPMENT FORM
ED 7635-12

SHEET 1 OF 1

PROCEDURE ACTIVITY TRACKING NO. 8-0966

SECTION 1 - IDENTITY

PROCEDURE NO. <u>RA-EP-01500 Rev 1</u>	PROPOSED REVISION NO.	PROPOSED CHANGE NO. <u>C-3</u>	<input type="checkbox"/> NEW <input type="checkbox"/> REVISION <input checked="" type="checkbox"/> CHANGE <input type="checkbox"/> TEMPORARY APPROVAL	<input type="checkbox"/> CANCELLATION <input type="checkbox"/> INACTIVATION <input type="checkbox"/> REACTIVATION	<input type="checkbox"/> RESTRICTED EXPIRES _____ (DATE/EVENT)
PROCEDURE TITLE <u>Emergency Classification</u>					
PROCEDURE CLASSIFICATION <input checked="" type="checkbox"/> SR <input type="checkbox"/> QR <input type="checkbox"/> N-QR CHANGE TO? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO			PAT/PCR NOS. CLOSED OUT <input type="checkbox"/> CONTINUED		

ACTIVITY SUMMARY / PURPOSE

Incorporate OTSG leakrate changes in accordance with Technical Specification Amendment No 220; update the commitment listing.

CONTINUED

SECTION 2 - CONCURRENT EFFECTIVE DOCUMENTS

CONTINUED

DOCUMENT NO. / REVISION	DOCUMENT TITLE	PAT NO. / CHANGE REQUEST

SECTION 3 - REVIEW ORGANIZATIONS

REQUIRED					REQUESTED				
<u>UPS</u>									

CONTINUED

CONTINUED

PROCEDURE PREPARER <i>[Signature]</i>	DATE <u>4/20/98</u>	QUALIFIED REVIEWER <i>[Signature]</i>	DATE <u>4/22/98</u>
--	------------------------	--	------------------------

SECTION 4 - ATTACHMENTS

COMPLETED AND ATTACHED

- | | | |
|--|---|--|
| YES <input checked="" type="checkbox"/> N/A <input checked="" type="checkbox"/> VALIDATION CHECKLIST | YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/> SAFETY REVIEW | YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/> REVISED CROSS REFERENCES LIST |
| YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/> COMMITMENT VERIFICATION SUMMARY | YES <input type="checkbox"/> N/A <input type="checkbox"/> DOCUMENT REVIEW SHEETS | YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/> PCRs |
| YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/> SAFETY EVALUATION NO. _____ | YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/> P COMMITMENT DOCUMENTATION | YES <input type="checkbox"/> N/A <input type="checkbox"/> OTHER _____ |

FINAL QUALIFIED REVIEWER CONCURRENCE <i>[Signature]</i>	DATE <u>4/24/98</u>
--	------------------------

SECTION 5 - TEMPORARY APPROVAL

MANAGEMENT SRO <u>N/A</u>	DATE	APPROVAL AUTHORITY <u>N/A</u>	DATE
------------------------------	------	----------------------------------	------

SECTION 6 - CONCURRENCE / FINAL APPROVAL

PROCEDURE SPONSOR <u>DAL / James P. Frueh</u>	DATE <u>4-22-98</u>	<input checked="" type="checkbox"/> SRB <i>[Signature]</i>	DATE <u>5-6-98</u>
<input type="checkbox"/> DIRECTOR - DA <u>N/A</u>	DATE	<input checked="" type="checkbox"/> PLANT MANAGER <i>[Signature]</i>	DATE <u>5/6/98</u>
<input type="checkbox"/> DIRECTOR - E&S <u>N/A</u>	DATE	APPROVAL AUTHORITY <i>[Signature]</i>	DATE <u>5/7/98</u>
<input type="checkbox"/> DIRECTOR - NSS <u>N/A</u>	DATE		

SECTION 7 - TRAINING / PROCEDURE EFFECTIVITY

TRAINING COMPLETE <input type="checkbox"/> YES <input checked="" type="checkbox"/> N/A	ALTERATION EFFECTIVE DATE <u>5-8-98</u>	PROCEDURE SPONSOR <u>James P. Frueh / DAL</u>	DATE <u>5-8-98</u>
---	--	--	-----------------------

PROCEDURE DEVELOPMENT FORM
FD 7635-11

SHEET 1 OF 1

PROCEDURE ACTIVITY TRACKING NO.
96-1869

SECTION 1 - IDENTITY

PROCEDURE NO. <u>RA-EP-01500 Rev.1</u>	PROPOSED REVISION NO.	PROPOSED CHANGE NO. <u>C-2</u>	<input type="checkbox"/> NEW <input type="checkbox"/> REVISION <input checked="" type="checkbox"/> CHANGE <input type="checkbox"/> TEMPORARY APPROVAL	<input type="checkbox"/> CANCELLATION <input type="checkbox"/> INACTIVATION <input type="checkbox"/> REACTIVATION	<input type="checkbox"/> RESTRICTED EXPIRES _____ (DATE/EVENT)
---	-----------------------	-----------------------------------	--	---	--

PROCEDURE TITLE
Emergency Classification

PROCEDURE CLASSIFICATION <input checked="" type="checkbox"/> SR <input type="checkbox"/> QR <input type="checkbox"/> N-QR CHANGE TO? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO	PAT/PCR NOS. CLOSED OUT <u>PCR 96-1680</u>	<input type="checkbox"/> CONTINUED
---	---	------------------------------------

ACTIVITY SUMMARY / PURPOSE
Add new definition, to define "CORE MELT SEQUENCE"

CONTINUED

SECTION 2 - CONCURRENT EFFECTIVE DOCUMENTS

CONTINUED

DOCUMENT NO. / REVISION	DOCUMENT TITLE	PAT NO. / CHANGE REQUEST
<u>NONE</u>		

SECTION 3 - REVIEW ORGANIZATIONS

DUE: 9/20/96

REQUIRED				REQUESTED	
<u>OPS</u>	<u>Sec</u>	_____	_____	_____	_____
<u>RP</u>	<u>TRAN</u>	_____	_____	_____	_____

CONTINUED

CONTINUED

PROCEDURE PREPARER <u>Paul Timmerman</u>	DATE <u>9/9/96</u>	QUALIFIED REVIEWER <u>Paul Timmerman</u>	DATE <u>9/9/96</u>
---	-----------------------	---	-----------------------

SECTION 4 - ATTACHMENTS

COMPLETED AND ATTACHED

- | | | |
|---|--|--|
| YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/> VALIDATION CHECKLIST | YES <input checked="" type="checkbox"/> N/A <input type="checkbox"/> SAFETY REVIEW | YES <input type="checkbox"/> N/A <input checked="" type="checkbox"/> REVISED CROSS REFERENCES LIST |
| <input checked="" type="checkbox"/> COMMITMENT VERIFICATION SUMMARY | <input checked="" type="checkbox"/> DOCUMENT REVIEW SHEETS | <input checked="" type="checkbox"/> PCRs |
| <input type="checkbox"/> SAFETY EVALUATION | | <input type="checkbox"/> OTHER <u>N/A</u> |

FINAL QUALIFIED REVIEWER CONCURRENCE <u>[Signature]</u>	DATE <u>9/24/96</u>
--	------------------------

SECTION 5 - TEMPORARY APPROVAL

MANAGEMENT SRC <u>N/A</u>	DATE <u>N/A</u>	APPROVAL AUTHORITY <u>N/A</u>	DATE <u>N/A</u>
------------------------------	--------------------	----------------------------------	--------------------

SECTION 6 - CONCURRENCE / FINAL APPROVAL

PROCEDURE SPONSOR <u>[Signature]</u>	DATE <u>10/1/96</u>	<input checked="" type="checkbox"/> SRB <u>[Signature]</u>	DATE <u>10/21/96</u>
<input type="checkbox"/> DIRECTOR - NA <u>N/A</u>	DATE	<input checked="" type="checkbox"/> PLANT MANAGER <u>[Signature]</u>	DATE <u>10/22/96</u>
<input type="checkbox"/> DIRECTOR - E&S <u>N/A</u>	DATE	APPROVAL AUTHORITY <u>[Signature]</u>	DATE <u>10/24/96</u>

SECTION 7 - TRAINING / PROCEDURE EFFECTIVITY

TRAINING COMPLETE <input type="checkbox"/> YES <input checked="" type="checkbox"/> N/A	ALTERATION EFFECTIVE DATE <u>11/1/96</u>	PROCEDURE SPONSOR <u>[Signature]</u>	DATE <u>10/28/96</u>
---	---	---	-------------------------

Davis-Besse Nuclear Power Station

EMERGENCY PLAN IMPLEMENTING PROCEDURE

RA-EP-01500

(Supersedes RA-EP-01500 R0 C3)

Emergency Classification

REVISION 01

Prepared by: *Paul Timmerman* 2/17/95
Date

Sponsor: *William Olson* 2-12-95
Manager - Regulatory Affairs Date

Approved by: *S. C. Jain / Ph. Michalis* 2/21/95
Director - Nuclear Services Date

Approved by: *MaDood* 2/24/95
Plant Manager Date

Effective Date: MAY - 1 1995

Procedure Classification:

- Safety Related
- Quality Related
- Non-Quality Related

EMERGENCY CLASSIFICATION

LIST OF EFFECTIVE PAGES

Page	Change No.
1	
2	C-4
3	
4	
5	
6	C-2
7	C-2
8	
9	
10	
11	
12	
13	
14	
15	C-4
16	
17	
18	
19	C-4
20	
21	
22	C-3

Page	Change No.
23	
24	
25	C-4
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	C-1
36	C-4
37	
38	
39	
40	
41	
42	
43	
44	

Page	Change No.
45	
46	
47	
48	C-4
49	
50	
51	
52	
53	
54	
55	
56	
57	
58	C-4
59	
60	
61	
62	C-3
63	C-3

TABLE OF CONTENTS

	<u>Page</u>
1.0 PURPOSE	4
2.0 REFERENCES	4
3.0 DEFINITIONS	6
4.0 RESPONSIBILITIES	7
5.0 INITIATING CONDITIONS	7
6.0 PROCEDURE	8
6.1 Classification of Emergency	8
6.2 Downgrading Emergency Classification	10
6.3 Terminating Emergency Classification	10
INDEX OF EMERGENCY ACTION LEVEL CONDITIONS	11
1. Primary System Events	13
2. Reactor Coolant System Leak Rate	22
3. Safety System Functions	25
4. Electrical Failures	29
5. Secondary System Events	32
6. Radiation Release Events	35
7. Hazards to Station Operations	42
8. Natural Events	52
9. Miscellaneous	56
10. Downgrading Guidelines	58
11. Terminating Guidelines	59
7.0 FINAL CONDITIONS	60
8.0 RECORDS	60
ATTACHMENT 1. Summary of Emergency Action Levels	61
COMMITMENTS	62

1.0 PURPOSE

This procedure provides guidelines for conditions at which specific emergency classifications must be declared.

2.0 REFERENCES

2.1 Developmental

- 2.1.1 NUREG-0654/FEMA REP-1, Rev. 1 Criteria for Preparation and Evaluation of Radiological Emergency Response Plans and Preparedness in Support of Nuclear Power Plants
- 2.1.2 Updated Safety Analysis Report, DBNPS
- 2.1.3 Davis-Besse Nuclear Power Station Emergency Plan
- 2.1.4 Technical Specifications, DBNPS Unit No. 1, Appendix A and B to License No. NPF3
- 2.1.5 NUMARC NESP-007, Methodology for Development of Emergency Action Levels, Revision 1
- 2.1.6 Davis-Besse Nuclear Power Station Offsite Dose Calculation Manual
- 2.1.7 NRC Branch Position on acceptable deviation to Appendix 1 to NUREG-0654/FEMA-REP-1 dated July 11, 1994.

2.2 Implementation

- 2.2.1 HS-EP-01600 (RA-EP-01600), Unusual Event
- 2.2.2 HS-EP-01700 (RA-EP-01700), Alert
- 2.2.3 HS-EP-01800 (RA-EP-01800), Site Area Emergency
- 2.2.4 HS-EP-01900 (RA-EP-01900), General Emergency
- 2.2.5 RA-EP-02710, Reentry
- 2.2.6 RA-EP-02720, Recovery Organization
- 2.2.7 HS-EP-02810 (RA-EP-02810), Tornado
- 2.2.8 HS-EP-02820 (RA-EP-02820), Earthquake
- 2.2.9 HS-EP-02830 (RA-EP-02830), Flooding
- 2.2.10 HS-EP-02840 (RA-EP-02840), Explosion
- 2.2.11 HS-EP-02850 (RA-EP-02850), Hazardous Chemical and Oil Spills

- 2.2.12 DB-OP-02000, RPS, SFAS, SFRCS Trip or SG Tube Rupture
- 2.2.13 DB-CH-01814, Steam Generator Tube Leak Rate Determination
- 2.2.14 Technical Specifications
- 2.2.15 Offsite Dose Calculation Manual

3.0 DEFINITIONS

- 3.1 ALERT - Event(s) are in progress or have occurred which involve an actual or potential substantial degradation of the level of safety of the DBNPS. Any releases are expected to be limited to small fractions of the EPA Protective Action Guidelines exposure levels.
- 3.2 CORE MELT SEQUENCE - A situation in which the core would be uncovered and there is no means for restoring cooling to the core. Without cooling, overheating and melting of the fuel will occur.
- 3.3 EMERGENCY ACTION LEVELS (EALs) - Radiological dose rates, specific contamination levels of airborne, waterborne, or surface-deposited concentrations of radioactive materials; or specific instrument readings and indications (including their rate of change) that may be used as thresholds for initiating such specific emergency measures as designating a particular classification of emergency, initiating a notification procedure, or initiating a particular protective action.
- 3.4 FUNCTIONAL - A system, subsystem, train, component or device though degraded in equipment condition or configuration, is FUNCTIONAL if it is capable of maintaining respective system parameters within acceptable design limits.
- 3.5 GENERAL EMERGENCY - Event(s) are in progress or have occurred which involve actual or imminent substantial core degradation or melting with the potential for loss of containment integrity. Releases can be reasonably expected to exceed EPA Protective Action Guideline exposure levels offsite for more than the immediate site area.
- 3.6 LOSS - A state of inoperability in which FUNCTIONAL AND OPERABLE status cannot be maintained. A system, subsystem, train, component or device is NOT LOST if its FUNCTIONALITY is assured.
- 3.7 OPERABLE - A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified functions(s). Implicit in this definition shall be the assumption that all necessary attendant instrumentation, controls, normal and emergency electrical power sources, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s), are also capable of performing their stated support function(s).
- 3.8 SITE AREA EMERGENCY - Event(s) are in progress or have occurred which involve actual or likely major failures of the DBNPS functions needed for the protection of the public. Any releases are not expected to exceed EPA Protective Action Guideline exposure levels except near the site boundary.
- 3.9 TRANSITORY EVENT - An event which is classifiable in accordance with RA-EP-01500, Emergency Classification, but becomes a lowerclassification or non-classifiable event before being declared.

3.10 UNUSUAL EVENT - Event(s) are in progress or have occurred which indicate a potential degradation of the level of safety of the DENPS. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occurs.

4.0 RESPONSIBILITIES

4.1 The Shift Supervisor shall be responsible for the initial implementation of this procedure.

4.2 The individual having formal control as Emergency Director is the final authority on upgrading or downgrading the emergency classification. This responsibility to classify an event may not be delegated.

5.0 INITIATING CONDITIONS

5.1 Station personnel report an abnormal or unusual situation to the operating shift crew, or they observe an off-normal event.

5.2 A supplementary action step in a plant procedure (e.g., the Emergency Operating Procedure, Alarm Procedure, Abnormal Procedures, etc.) refers to this procedure for classification of the indicated plant conditions.

6.0 PROCEDURE

6.1 Classification of Emergency:

- 6.1.1 When indications of abnormal occurrences are received by the Control Room staff, the Shift Supervisor shall:
- a. Verify the indications of the off-normal event or reported sighting.
 - b. Ensure that the immediate actions (e.g., use of the Emergency Operating Procedure and Abnormal Procedures) are taken for the safe and proper operation of the plant.
 - c. Compare the abnormal conditions with those listed in the Index of Emergency Action Levels.
 - d. Turn to the appropriate tab which corresponds to the condition picked from the EAL Index.

NOTE 6.1.1.e.

The specific emergency action levels described in this procedure are not all inclusive. The Emergency Director shall declare an appropriate emergency classification whenever, in his judgment, the station status warrants such a declaration. A "Miscellaneous" category is included to provide guidance in classifying events not specifically listed elsewhere.

CAUTION 6.1.1.e.

Many of the emergency action levels described in this procedure are not intended to be used during maintenance and/or testing situations where abnormal temperature, pressure, equipment status, etc. is expected. Each EAL contains information on the Mode(s) of Operation during which it is applicable.

- e. Assess the information available from valid indications or reports and classify the situation.
 1. When an event is classified, the Shift Supervisor shall become the Emergency Director during activation of the Davis-Besse Emergency Plan and shall be responsible for coordinating the actions of the emergency organization until relieved.

2. The Assistant Shift Supervisor may assume the Emergency Director duties only if the Shift Supervisor is not in the Control Room or is incapable of performing those duties.
3. The Shift Manager (Shift Technical Advisor) may assume the Emergency Director duties only if neither the Shift Supervisor nor the Assistant Shift Supervisor is in the Control Room and capable of performing those duties.
4. Upon arrival in the Control Room, the Emergency Assistant Plant Manager or Emergency Plant Manager may relieve the Emergency Director.
5. The Emergency Plant Manager may assume the Emergency Director duties from the Technical Support Center (TSC) if the TSC and Emergency Control Center (ECC) are activated.
6. The Emergency Director shall remain in the Control Room until the TSC and ECC have been activated.

CAUTION 6.1.1.f.

1. If it appears that several emergencies of different classes have occurred at the same time, the highest classification indicated should be declared.
2. If a Transitory Event has occurred notification of the offsite agencies is still required.

- f. Use the RA-EP-01600, Unusual Event; RA-EP-01700, Alert; RA-EP-01800, Site Area Emergency; or RA-EP-01900, General Emergency procedure to ensure that immediate notification requirements are met and the proper Emergency Plan response is taken.
- g. Continually evaluate the plant conditions to ensure the proper emergency classification is being utilized and the classification is upgraded as conditions dictate in accordance with Steps 6.1.1.c. through 6.1.1.e.
- h. Downgrade the emergency classification as conditions improve, utilizing Section 6.2 as a guide.

6.2 Downgrading Emergency Classification:

- 6.2.1 Compare the existing conditions with information contained in Tab 10, Downgrading Guidelines.
- 6.2.2 Downgrade emergency classification, if appropriate.
- 6.2.3 Continue to observe existing conditions.
- 6.2.4 Upon downgrading of the emergency classification refer to RA-EP-01600, Unusual Event; RA-EP-01700, Alert; RA-EP-01800, Site Area Emergency; or continue to Section 6.3, Terminating Emergency Classification.
- 6.2.5 Perform any necessary reentry actions per RA-EP-02710, Reentry.

6.3 Terminating Emergency Classification

- 6.3.1 Existing conditions have been compared with the Emergency Action Levels and judgment made that conditions have stabilized and termination is appropriate.
- 6.3.2 Compare the existing conditions with information contained in Tab 11, Termination Guidelines.
- 6.3.3 Terminate emergency classification.
- 6.3.4 Perform any necessary reentry actions per RA-EP-02710, Reentry.

NOTE 6.3.5

Recovery actions are required for all classifiable emergencies.

- 6.3.5 Perform any necessary recovery actions per RA-EP-02720, Recovery Organization.

<u>Tab</u>	<u>Condition</u>	<u>Page No(s).</u>
1.	<u>Primary System Events</u>	
	A. Failure of a primary relief valve	13
	B. Core fuel damage	14-16
	C. Loss of fission product barriers	17
	D. Abnormal CTMT atmosphere	18-21
2.	<u>Reactor Coolant System Leak Rate</u>	
	A. Abnormal RCS leak rate	22-24
3.	<u>Safety System Functions</u>	
	A. CRD, RPS	25
	B. SW, DH, CCW, MU, HPI, MFW, AFW	26-27
	C. Loss of CTRM alarms, Indication, or Communications	28
4.	<u>Electrical Failures</u>	
	A. AC	29-30
	B. DC	31
5.	<u>Secondary System Events</u>	
	A. Major steam leak	32-33
	B. Main steam safety valve failure	34
6.	<u>Radiation Release Event</u>	
	A. High radiation levels in plant	35
	B. Fuel handling accident	36
	C. Abnormal effluent release	37-38
	D. Abnormal radiation levels at site boundary	39-41

INDEX OF EMERGENCY ACTION LEVEL CONDITIONS

<u>Tab</u>	<u>Condition</u>	<u>Page No(s).</u>
7.	<u>Hazards to Station Operations</u>	
A.	Fire	42
B.	Aircraft crash	43
C.	Train derailment	44
D.	Explosion	45
E.	Toxic or flammable gas	46-47
F.	Turbine damage	48
G.	Missile impact	49
H.	Control room evacuation	50
I.	Security threat	51
8.	<u>Natural Events (Within Ottawa County)</u>	
A.	Earthquake	52
B.	Tornado	53
C.	Hurricane Force Winds	54
D.	Flooding, Low Water	55
9.	<u>Miscellaneous</u>	56-57
10.	<u>Downgrading Guidelines</u>	58
11.	<u>Termination Guidelines</u>	59

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSA. FAILURE OF A PRIMARY RELIEF VALVE

Condition	Indication(s)	Emergency Classification
1. Failure of safety related safety valve, or relief valve, to close following a pressure reduction	1. Indication of flow through Pressurizer Reliefs (as indicated on Panel C5798, C5799 and C5705) <u>AND</u> 2. RCS Pressure drop to <1600 psig	Unusual Event RA-EP-01600 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE

Condition	Indication(s)	Emergency Classification
1. High reactor coolant activity sample requiring plant shutdown per T.S. 3.4.8	1. Confirmed primary coolant activity sample results indicate > T.S. 3.4.8 <u>AND</u> 2. Plant shutdown required and in progress	Unusual Event RA-EP-01600 Modes 1 & 2
2. Very high coolant activity	Confirmed primary coolant sample results indicate >300 μ Ci/gram DOSE EQUIVALENT I-131	Alert RA-EP-01700 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
3. Core damage with inadequate core cooling determined	1. Confirmed primary coolant sample results indicate: A. DOSE EQUIVALENT I-131 >T.S. 3.4.8 <u>OR</u> - B. 100 / E μ Ci/gram specific activity, <u>AND</u> 2. The incore thermocouples indicate superheated conditions in the core	Site Area Emergency RA-EP-01800 All Modes
4. Core damage with other plant conditions making a release of large amounts of radioactivity possible	1. Confirmed primary coolant sample results indicate >300 μ Ci/gram DOSE EQUIVALENT I-131 <u>AND</u> 2. Incore thermocouple temperatures correspond to region 3 or 4 of DB-OP-02000 Figure 2 <u>AND</u> 3. A. Containment radiation level is > 10 ⁴ R/hr (RE 4596A/RE 4596B) <u>OR</u> B. SFAS level 4 trip (Containment high-high pressure)	General Emergency RA-EP-01900 All Modes

See Also: Loss of Fission Product Barriers (1-C-1)
Abnormal Containment Atmosphere (1-D-1 thru 3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE (Cont.)

Condition	Indication(s)	Emergency Classification
5. Core melt situations	1. Any sequence of events has occurred in which severe core damage (such as core melting) has taken place <u>AND</u> 2. A failure of containment is ready to take place (imminent)	General Emergency RA-EP-01900 All Modes

NOTE

Examples of some scenarios which could put the plant in this condition are:

1. Either a small or large LOCA occurs with a concurrent failure of the ECCS to perform, leading to severe core degradation or melting

OR

2. A transient is initiated by a loss of the main feedwater system followed by a failure of the auxiliary feedwater system for an extended period with core melting resulting

OR

3. A transient occurs requiring operation of shut-down systems with failure to trip which results in core damage, or additional failures of core cooling and makeup systems occur which lead to a core melt

OR

4. A failure of offsite and onsite power along with total loss of auxiliary feedwater makeup capability occurs for several hours which leads to a core melt

OR

5. A small LOCA occurs with initially successful ECCS, however a subsequent failure of RCS heat removal systems over a period of several hours leads to a core melt

See Also: Loss of Fission Product Barriers (1-C-1)
Abnormal Containment Atmosphere (1-D-1 thru 3)
Abnormal RCS Leak Rate (2-A-1 thru 4)

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSC. LOSS OF FISSION PRODUCT BARRIERS

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Loss of 2 of 3 fission product barriers with a potential loss of the 3rd barrier	<p><u>Any TWO of the following conditions exist and the third is ready to take place (imminent):</u></p> <ol style="list-style-type: none"> 1. Fuel clad rupture as indicated by confirmed primary coolant sample results indicating >300 $\mu\text{Ci/gm}$ DOSE EQUIVALENT I-131 2. A rupture of the RCS has been confirmed with the leak rate >50 gpm. (Makeup tank level decreasing at a rate greater than 2 inches per minute) 3. Containment integrity has been breached and cannot be restored. Refer to T.S. 3.6.1.3 and T.S. 3.6.3.1. 	<p>General Emergency RA-EP-01900 All Modes</p>

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Major Steam Leak (5-A-1 thru 3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSD. ABNORMAL CONTAINMENT ATMOSPHERE

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Abnormal containment radiation and temperature	<p><u>Both of the following:</u></p> <p>1. Containment radiation level corresponds to an Alert as determined from the Containment Radiation EAL Plot on pages 20 or 21</p> <p><u>AND</u></p> <p>2. Containment average air temperature indicates >170°F (TI1356, 1357, 1358)</p>	Alert RA-EP-01700 All Modes
2. High containment radiation, pressure and temperature	<p>1. Containment radiation levels correspond to a Site Area Emergency as determined from the Containment Radiation EAL Plot on pages 20 or 21</p> <p><u>AND</u></p> <p>2. A. Containment average air temperature indicates >200°F (TI1356, 1357, 1358)</p> <p><u>OR</u></p> <p>B. Safety Features Actuation System (SFAS) level 2 has activated</p>	Site Area Emergency RA-EP-01800 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Loss of Fission Product Barriers (1-C-1)
Core Fuel Damage (1-B-1 thru 5)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

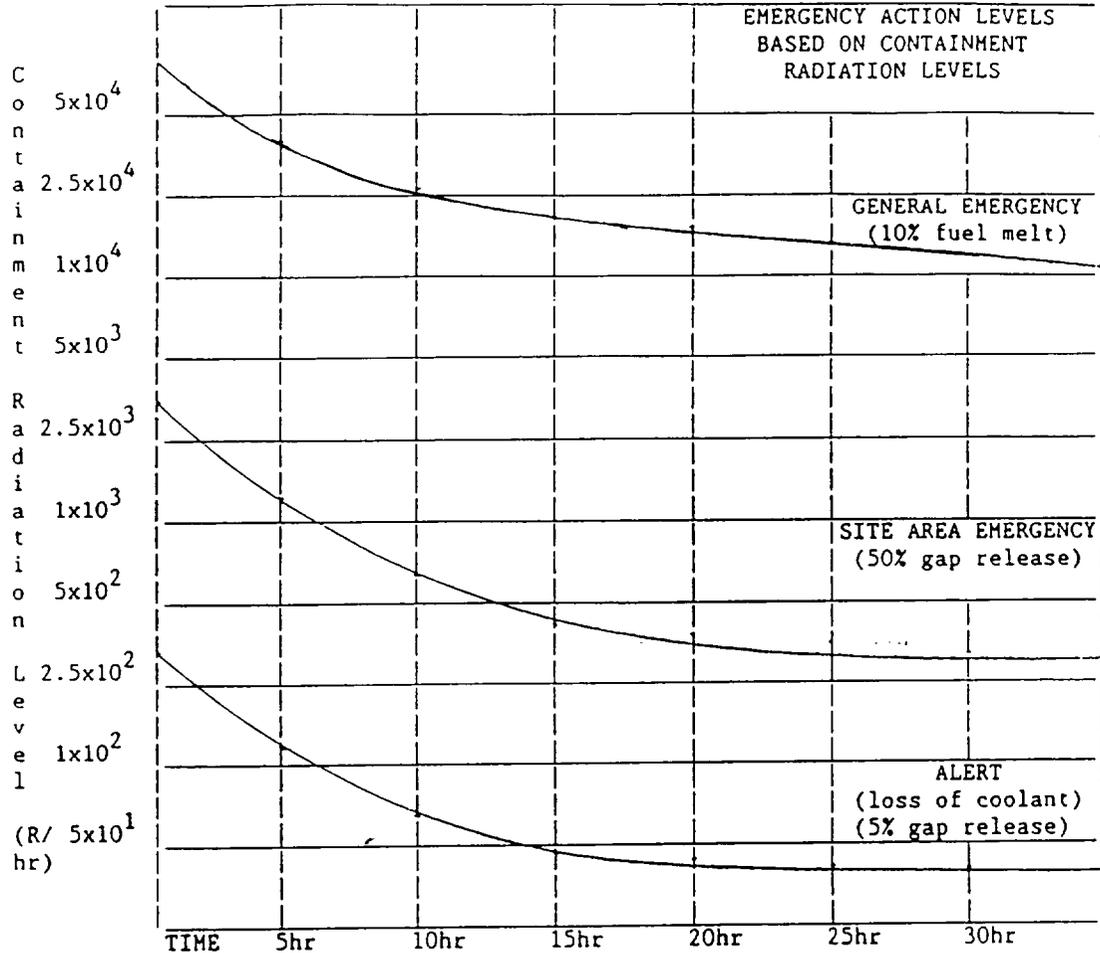
TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSD. ABNORMAL CONTAINMENT ATMOSPHERE (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
3. Very high containment radiation and pressure	1. Containment radiation level correlates to a General Emergency as determined from the Containment Radiation EAL Plot on pages 20 or 21 <u>AND</u> 2. SFAS level 4 actuation (Containment high-high pressure)	General Emergency RA-EP-01900 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Loss of Fission Product Barrier (1-C-1)
Core Fuel Damage (1-B-1 thru 5)

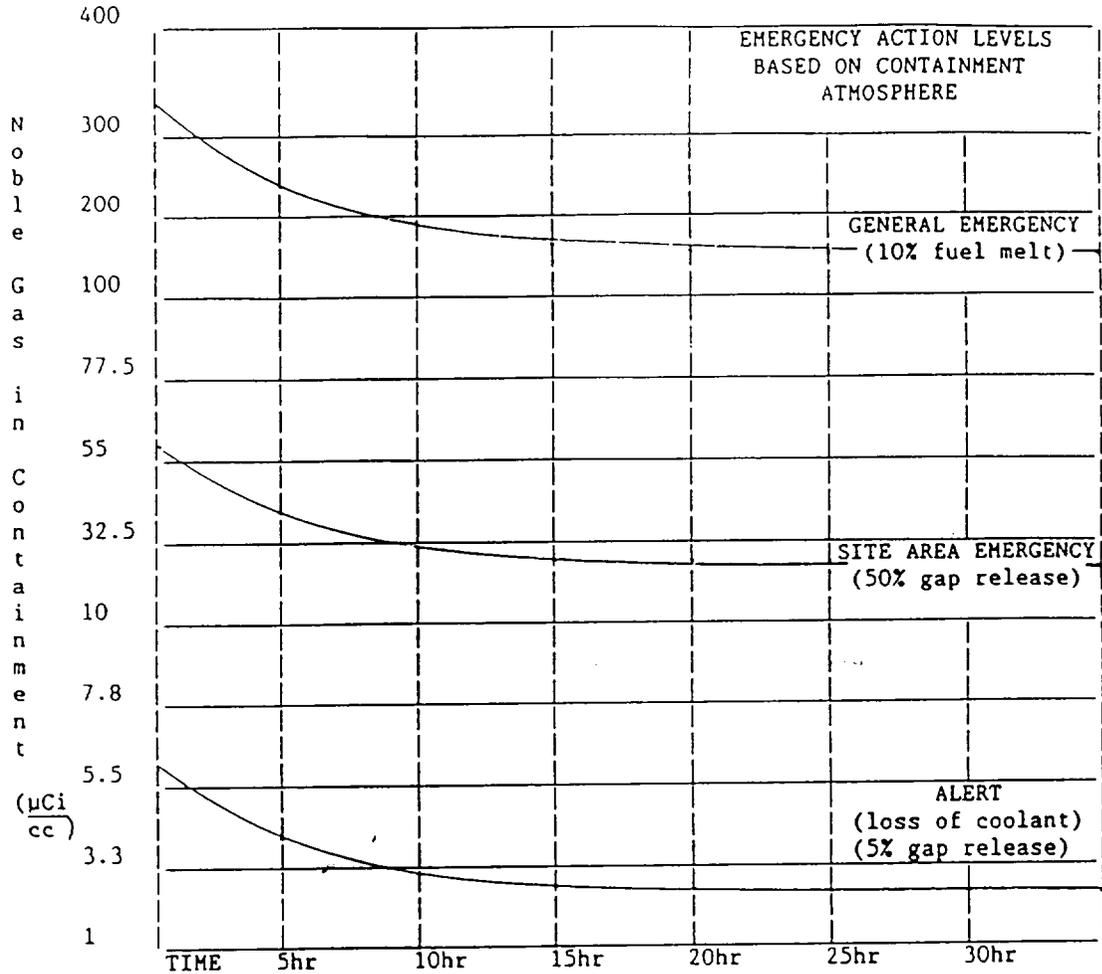
NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

CONTAINMENT RADIATION EAL PLOTCONTAINMENT RADIATION EAL PLOT INSTRUCTIONS

The curves represent readings for monitors RE 4596A or B, Containment High Range Radiation Detector. The procedure for their use is as follows:

1. Determine the time after reactor shutdown
2. Determine the RE 4596 Channel A or B radiation reading
3. Find the point on the figure where these two numbers intersect
4. Read the classification level of the line immediately below this point. This is the classification to use in correlation to the "Abnormal Containment Atmosphere" section of the Emergency Action Levels.

CONTAINMENT RADIATION EAL PLOTCONTAINMENT RADIATION EAL PLOT INSTRUCTIONS

The curves represent readings for monitors RE 4597AB or BB, Containment Atmosphere Radiation Detector. The procedure for their use is as follows:

1. Determine the time after reactor shutdown
2. Determine the RE 4597AB or BB Channel 1 or 2 radiation reading
3. Find the point on the figure where these two numbers intersect
4. Read the classification level of the line immediately below this point. This is the classification to use in correlation to the "Abnormal Containment Atmosphere" section of in the Emergency Action Levels.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE

Condition	Indication(s)	Emergency Classification
1. Reactor Coolant System leak requiring shutdown per T.S. 3.4.6.2 (includes primary leakage, and primary to secondary leakage)	1. A. Any leakage occurs from the pressure boundary <u>OR</u> B. RCS inventory balance indicates >1 GPM unidentified leakage <u>OR</u> C. Primary to Secondary leakage through the tubes of any one steam generator > 150 GPD <u>OR</u> D. RCS inventory balance indicates >10 GPM identified leakage <u>OR</u> E. Controlled leakage from Reactor Coolant Pump seals is > 10 GPM total <u>OR</u> F. Leakage from any RCS pressure isolation valve listed in T.S. Table 3.4-2 >5 GPM <u>AND</u> 2. Plant shutdown required and in progress	Unusual Event RA-EP-01600 Modes 1, 2, 3, & 4

See Also: Major Steam Leak (5-A-1 through 3)
 Loss of Fission Product Barriers (1-C-1)
 Abnormal Radiation Levels at Site Boundary (6-D-1 through 7)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE

Condition	Indication(s)	Emergency Classification
2. Reactor Coolant System leak rate >50 gpm, but within High Pressure Injection capacity (includes primary leakage, and primary to secondary leakage)	1. Makeup tank level decreasing at a rate greater than 2 inches per minute, while RCS temperature remains steady	Alert RA-EP-01700 All Modes
	<u>OR</u> 2. RCS inventory balance indicates >50 gpm total leakage	
3. Reactor Coolant System leak rate >50 gpm, but within High Pressure Injection Capacity (includes primary leakage, and primary to secondary leakage) <u>AND</u> loss of offsite power	1. A. Makeup tank level decreasing at a rate greater than 2 inches per minute; while RCS temperature remains steady	Site Area Emergency RA-EP-01800 All Modes
	<u>OR</u> B. RCS inventory balance indicates >50 gpm total leakage	
	<u>AND</u> 2. The 13.8 KV busses are de-energized	

See Also: Loss of Fission Product Barrier (1-C-1)
Electrical Failures (4-A-1 thru 5)
Safety/Relief Valve Failure (1-A-1)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
4. Loss of Coolant Accident > High Pressure Injection system capacity	1. High Pressure Injection system running <u>AND</u> 2. A. RCS pressure/pressurizer level continue to decrease OR B. RCS temperature/pressure reach saturation conditions	Site Area Emergency RA-EP-01800 All Modes

See Also: Loss of Fission Product Barrier (1-C-1)
Electrical Failures (4-A-1 thru 5)
Failure of a Primary Relief Valve (1-A-1)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSA. CRD, RPS

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. An uncontrolled control rod withdrawal from a subcritical reactor	1. Outward control rod motion is indicated without a command for such motion <u>AND</u> 2. The reactor is initially subcritical	Unusual Event RA-EP-01600 Modes 2, 3, 4, 5
2. Failure of Reactor Protection System (RPS) to initiate and complete a trip which brings the reactor subcritical.	1. Any time plant parameters meet conditions requiring a trip <u>AND</u> 2. RPS fails to initiate and complete a trip (either automatic or manual) which brings the reactor subcritical	Alert RA-EP-01700 Modes 1 & 2
3. Transient requiring operation of shutdown systems with failure to trip the reactor (continued power generation but no core damage immediately evident).	1. Any time plant parameters meet conditions requiring a trip <u>AND</u> 2. RPS fails to initiate and complete a trip (either automatic or manual) which brings the reactor subcritical <u>AND</u> 3. Power interruption from the Control Room fails to bring the reactor subcritical.	Site Area Emergency RA-EP-01800 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSB. SW, DH, CCW, MU, HPI, MFW, AFW

Condition	Indication(s)	Emergency Classification
1. Complete loss of any functions needed for plant cold shut-down	Loss of the Low Pressure Injection/Decay Heat System (BOTH TRAINS)	Alert RA-EP-01700 Modes 1, 2, 3 & 4
2. Inability to maintain plant in cold shutdown	1. Loss of any cooling system function needed to maintain cold shutdown (Decay Heat, Component Cooling Water, Service Water) (BOTH TRAINS). <u>AND</u> 2. a. An operational mode change due to temperature increase. <u>OR</u> b. A 30°F rise in RCS temperature. <u>OR</u> c. Core cooling by feed and bleed has been initiated.	Alert RA-EP-01700 Modes 5 & 6

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSB. SW, DH, CCW, MU, HPI, MFW, AFW (Continued)

Condition	Indication(s)	Emergency Classification
3. Complete loss of any function needed for plant hot shutdown	<u>Loss of any of the following systems:</u>	Site Area Emergency RA-EP-01800 Modes 1,2,3 & 4
	1. Service Water System (BOTH TRAINS)	
	<u>OR</u> 2. Component Cooling Water (BOTH TRAINS)	
	<u>OR</u> 3. A. Makeup System <u>AND</u> B. High Pressure Injection System (BOTH TRAINS)	
4. Loss of water level in the reactor vessel that has or will uncover fuel in the reactor vessel	<u>OR</u> 4. A. Main Feedwater System <u>AND</u> B. Auxiliary Feedwater-System <u>AND</u> C. Motor Driven Feed Pump	Site Area Emergency RA-EP-01800 Modes 5 & 6
	1. Loss of any cooling system function needed to maintain cold shutdown (Decay Heat, Component Cooling Water, Service Water) (BOTH TRAINS).	
	<u>AND</u> 2. Indication that the core is uncovered (e.g. incores indicate superheat, containment radiation levels increasing, source range detectors increasing, etc.).	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSC. LOSS OF CONTROL ROOM ALARMS, INDICATION, OR COMMUNICATIONS

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Communication capability lost to an extent requiring plant shutdown or other significant loss of assessment	Complete loss of the plant telephone system <u>AND</u> Gai-tronics system	Unusual Event RA-EP-01600 All Modes
2. Most or all alarms (annunciators) lost	Any simultaneous loss of all annunciator alarms <u>AND</u> the station computer	Alert RA-EP-01700 Modes 1 & 2
3. Most or all alarms (annunciators) lost and plant transient initiated or in progress	1. Complete loss of all annunciator alarms <u>AND</u> 2. Loss of the station computer <u>AND</u> 3. Plant transient in progress	Site Area Emergency RA-EP-01800 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESA. AC

Condition	Indication(s)	Emergency Classification
1. Loss of offsite power or loss of onsite AC power capability	1. Loss of power to A and B busses from the following transformers: a. Startup 01 <u>AND</u> b. Startup 02 <u>AND</u> c. Aux 11	Unusual Event RA-EP-01600 All Modes
	<u>OR</u> 2. a. Loss of power to C-1 <u>AND</u> D-1 busses from AC <u>AND</u> BD transformers. <u>AND</u> b. Onsite power capability has been degraded to either 4160 VAC vital bus C-1 or D-1 powered from a diesel generator.	
	<u>OR</u> 3. Loss of all diesel generators.	
2. AC power capability to vital busses reduced to a single power source for greater than 15 minutes such that any additional single failure would result in a station blackout.	1. Loss of power to C-1 <u>AND</u> D-1 busses from AC <u>AND</u> BD transformers for greater than 15 minutes.	Alert RA-EP-01900 Modes 1,2,3 & 4
	<u>AND</u> 2. Onsite power capability has been degraded to either 4160 VAC vital bus C-1 or D-1 powered from a diesel generator.	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESA. AC (Continued)

Condition	Indication(s)	Emergency Classification
3. Loss of offsite power and loss of all onsite AC power	4160 VAC vital busses C-1 AND D-1 de-energized longer than momentarily during transfers (see below for extended loss)	Alert RA-EP-01700 All Modes
4. Loss of offsite power and loss of onsite AC power for more than 15 minutes	4160 VAC vital busses C-1 AND D-1 de-energized more than 15 minutes	Site Area Emergency RA-EP-01800 All Modes
5. Prolonged loss of all offsite power and prolonged loss of all onsite AC power.	1. Loss of power to A and B busses from the following transformers: A. Startup 01. <u>AND</u> B. Startup 02 <u>AND</u> C. Aux 11 <u>AND</u> 2. 4160 VAC vital busses C-1 AND D1 are de-energized for more than 15 minutes. <u>AND</u> 3. A. Restoration of at least one vital bus within 4 hours is <u>NOT</u> likely. <u>OR</u> B. Indication of continuing degradation of core cooling based on fission product barrier monitoring.	General Emergency RA-EP-01900 Modes 1,2,3 & 4

See Also: Abnormal RCS Leak Rate With a Loss of Offsite Power (2-A-3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESB. DC

Condition	Indication(s)	Emergency Classification
1. Loss of all onsite DC power	All in plant DC busses de-energized (see below for extended loss)	Alert RA-EP-01700 All Modes
2. Loss of all vital onsite DC power for more than 15 minutes	All in plant DC busses de-energized for more than 15 minutes	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSA. MAJOR STEAM LEAK

Condition	Indication(s)	Emergency Classification
1. Rapid depressurization of secondary side	1. A. Increasing containment pressure (if leak is inside containment)	Unusual Event RA-EP-01600 Modes 1, 2, 3 & 4
	<u>OR</u> B. Unusually loud noise <u>OR</u> C. Visual sighting outside containment <u>AND</u> 2. Valid Steam and Feedwater Rupture Control System (SFRCS) automatic initiation on low main steam line pressure	
2. Steam line break with >10 gpm primary to secondary leak rate	1. Indication of a major steam leak (see 5.A.1)	Alert RA-EP-01700 Modes 1, 2, 3 & 4
	<u>AND</u> 2. Main steam line radiation monitor(s) indicate increased activity (RE 600/609)	
	<u>AND</u> 3. RCS leak rate >10 gpm as indicated by: A. Makeup tank decreasing >1/2 inch per minute <u>OR</u> B. RCS inventory balance indicates >10 gpm leak rate <u>OR</u> C. DB-CH-01814, Steam Generator Tube Leak Determination	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSA. MAJOR STEAM LEAK (Cont.)

Condition	Indication(s)	Emergency Classification
3. Steam line break with >50 gpm primary to secondary leakage <u>AND</u> indication of fuel damage	1. Indication of a major steam leak (see 5.A.1)	Site Area Emergency RA-EP-01800 Modes 1, 2, 3 & 4
	<u>AND</u> 2. Main steam line radiation Monitor(s) indicate increased activity (RE 600/ 609	
	<u>AND</u> 3. RCS leak rate >50 gpm as indicated by: A. Makeup tank decreasing >2 inches per minute <u>OR</u> B. RCS inventory balance indicates >50 gpm leak rate	
	<u>AND</u> 4. Confirmed primary coolant sample results indicate activity above acceptable limits of T.S. 3.4.8	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSB. MAIN STEAM SAFETY VALVE FAILURE

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Failure of safety related safety valves, or relief valves, to close following a pressure reduction	1. Rapid and continuing decrease in steam generator pressure to <500 psig <u>AND</u> 2. Visual or audible observation of a safety valve being open	Unusual Event RA-EP-01600 Modes 1,2,3 & 4

See Also: Major Steam Leak (5-A-1 through 5-A-3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSA. HIGH RADIATION LEVELS WITHINTHE PROTECTED AREA

Condition	Indication(s)	Emergency Classification
1. Radiation levels or air-borne contamination which indicates a severe degradation in the control of radioactive materials (such as an increase of a factor of 1000 in direct radiation readings)	1. A. An area radiation survey indicates radiation levels >1000 times normal	Alert RA-EP-01700 All Modes
	OR	
	B. Airborne radioactivity sample indicates activity levels >1000 times normal	
	OR	
	C. If an area of the plant is inaccessible, a radiation monitor reading indicating radiation levels >1000 times normal	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSB. FUEL HANDLING ACCIDENT

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Fuel handling accident which results in the release of radioactivity to containment or fuel handling area	Direct information from fuel handling personnel indicating that an irradiated fuel assembly has been damaged and radioactive gases are escaping	Alert RA-EP-01700 All Modes
2. Major damage to spent fuel in containment or fuel handling area (e.g., large object damages fuel or water loss below fuel level)	1. Indications of fuel handling accident which results in the release of radioactivity to containment or spent fuel pool area <u>AND</u> 2. A. SFAS Incident Level 1 actuation on radiation in Containment. <u>OR</u> B. Valid alarm on a radiation detector monitoring spent fuel in Containment or the fuel handling area. <u>OR</u> C. Isolation of ventilation in containment or spent fuel pool area based on radiation.	Site Area Emergency RA-EP-01800 All Modes

NOTE

The USAR analyzed fuel handling accident (Chapter 15) postulates the failure of 56 fuel pins from an assembly at maximum burnup, 62 hours after reactor shutdown.

Fuel repair activities involving the handling of an individual fuel pin are covered under the maintenance exception of Section 6.1.1.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSC. ABNORMAL EFFLUENT RELEASE

Condition	Indication(s)	Emergency Classification
1. Effluent release > limits allowed by the Offsite Dose Calculation Manual (ODCM): ODCM Section 2.3.1 ODCM Section 2.4.1 ODCM Section 3.3.1 ODCM Section 3.7.1 ODCM Section 3.8.1	<p><u>The following combination:</u></p> <p>1. Any confirmed effluent release exceeding the limits of the ODCM.</p> <p><u>OR</u></p> <p>2. A high alarm is received on any of the following Radiation Monitoring System monitors for greater than 15 minutes during a release (alarm setpoint established by the Chemistry Department)</p> <p>A. 1878A or B, Miscellaneous Waste Outlet</p> <p><u>OR</u></p> <p>B. 1770A or B, Clean Waste Outlet</p> <p><u>OR</u></p> <p>C. 1822A or B, Waste Gas Outlet</p> <p><u>AND</u></p> <p>3. The associated discharge valve fails to close (automatically <u>OR</u> manually)</p> <p><u>AND</u></p> <p>4. Chemistry Unit or Radiation Protection Section confirms that an ODCM limit has been exceeded.</p>	Unusual Event RA-EP-01600 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSC. ABNORMAL EFFLUENT RELEASE (Cont.)

Condition	Indication(s)	Emergency Classification
2. Effluent release >10 times limits allowed by the Offsite Dose Calculation Manual (ODCM): ODCM Section 2.3.1 ODCM Section 2.4.1 ODCM Section 3.3.1 ODCM Section 3.7.1 ODCM Section 3.8.1	<p><u>The following combination:</u></p> <p><u>1.</u> Any confirmed effluent release exceeding the ODCM Limits by >10 times the limits</p> <p><u>OR</u></p> <p><u>2.</u> A high alarm is received on any of the following Radiation Monitoring System monitors at 10 times setpoint (as established by the the Chemistry Department)</p> <p>A. 1878A or B, Miscellaneous Waste Outlet</p> <p><u>OR</u></p> <p>B. 1770A or B, Clean Waste Outlet</p> <p><u>OR</u></p> <p>C. 1822A or B, Waste Gas Outlet</p> <p><u>AND</u></p> <p><u>3.</u> The associated discharge valve fails to close (automatically <u>OR</u> manually)</p> <p><u>AND</u></p> <p><u>4.</u> Chemistry Unit or Radiation Protection Section confirms that an ODCM has been exceeded.</p>	Alert RA-EP-01700 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARYNOTE 6.D.1

RE 4598 indication is based on average meteorological conditions: stability class D, wind speed 10 mph.

Condition	Indication(s)	Emergency Classification
1. Projected or actual site boundary radiation levels that indicate a potential dose of about 1 mrem at the site boundary if continued over 2 hours.	1. Station Vent RE 4598 Channel 1 reading $\geq 3.6E-3$ $\mu\text{ci}/\text{cc}$ (Noble Gas) for 2 hours OR 2. 0.5 mrem/hr measured at the Site Boundary for 2 hours	Alert RA-EP-01700 All Modes

NOTE 6.D.2

RE 4598 indications are based on adverse meteorological conditions: stability class F, wind speed 2 mph.

Condition	Indication(s)	Emergency Classification
2. Projected or measured site boundary Total Effective Dose Equivalent (TEDE) rate ≥ 50 mrem/hr for $\frac{1}{2}$ hour.	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $1.6E-2$ $\mu\text{ci}/\text{cc}$ or greater for $\frac{1}{2}$ hour OR 2. 50 mrem/hr by direct measurement at the site boundary for $\frac{1}{2}$ hour	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARY (Cont.)NOTES 6.D.3, 6.D.4 and 6.D.5

RE 4598 indications are based on adverse meteorological conditions: stability class F, wind speed 2 mph.

3. Projected or measured site boundary TEDE rate ≥ 500 mrem/hr for 2 minutes	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $1.6E-1$ $\mu\text{ci/cc}$ or greater for 2 minutes	Site Area Emergency RA-EP-01800 All Modes
	<u>OR</u> 2. 500 mrem/hr by direct measurement at the site boundary for 2 minutes	
4. Projected or measured site boundary thyroid dose rate ≥ 250 mrem/hr for $\frac{1}{2}$ hour	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $3.7E-6$ $\mu\text{ci/cc}$ or greater for $\frac{1}{2}$ hour	Site Area Emergency RA-EP-01800 All Modes
	<u>OR</u> 2. Radioiodine of $7.9E-8$ $\mu\text{ci/cc}$ by direct measurement at the Site Boundary for $\frac{1}{2}$ hour	
5. Projected or measured site boundary thyroid dose rate ≥ 2500 mrem/hr for 2 minutes	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $3.7E-5$ $\mu\text{ci/cc}$ or greater for 2 minutes	Site Area Emergency RA-EP-01800 All Modes
	<u>OR</u> 2. Radioiodine of $7.8E-7$ $\mu\text{ci/cc}$ by direct measurement at the Site Boundary for 2 minutes	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARY (Cont.)NOTE 6.D.6 and 6.D.7

RE 4598 indications are based on adverse meteorological conditions: stability class D, wind speed 10 mph.

6. Projected or measured TEDE rate of 1 rem/hr or greater at the Site Boundary.	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $6.9E-1$ $\mu\text{ci}/\text{cc}$ or greater.	General Emergency RA-EP-01900 All Modes
	<u>OR</u> 2. 1 rem/hr by direct measurement at the Site Boundary.	
7. Projected or measured thyroid dose rate of 5 rem/hr or greater at the Site Boundary	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $1.8E-3$ $\mu\text{ci}/\text{cc}$ or greater.	General Emergency RA-EP-01900 All Modes
	<u>OR</u> 2. Radioiodine of $1.7E-6$ $\mu\text{ci}/\text{cc}$ by direct measurement at the Site Boundary.	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSA. FIRE

Condition	Indication(s)	Emergency Classification
1. Fire within the plant lasting more than 10 minutes	1. Any fire within the protected area lasting more than 10 minutes from the initiation of fire suppression (manually or automatically), <u>NO</u> safety systems affected OR 2. Any fire which requires offsite assistance	Unusual Event RA-EP-01600 All Modes
2. Fire potentially affecting safety systems	Any fire at the station that has the potential to damage or degrade a safety system	Alert RA-EP-01700 All Modes
3. Fire resulting in the loss of redundant trains of a safety system	Any fire that defeats the capability of both trains of a safety system	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSB. AIRCRAFT CRASH

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Aircraft crash onsite or unusual aircraft activity over facility	Control room informed by station personnel who have made a visual sighting	Unusual Event RA-EP-01600 All Modes
2. Aircraft crash affecting plant structures	Control room informed by station personnel who have made a visual sighting	Alert RA-EP-01700 All Modes
3. Aircraft crash damaging vital structures by impact or fire.	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. Instrumentation readings on vital systems indicate equipment problems	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSC. TRAIN DERAILMENT

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Train derailment onsite	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. A. Station structures have been damaged <u>OR</u> B. Danger to station personnel exists	Unusual Event RA-EP-01600 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSD. EXPLOSION

Condition	Indication(s)	Emergency Classification
1. Near or onsite explosion	Control room informed by station personnel who have made a visual sighting	Unusual Event RA-EP-01600 All Modes
2. Onsite explosion affecting plant operations	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. Instrumentation readings on plant systems indicate equipment problems	Alert RA-EP-01700 All Modes
3. Explosion causing severe damage to safe shutdown equipment	Explosion causing loss of: 1. Makeup system <u>AND</u> HPI system <u>OR</u> 2. Ability to supply feed water to the OTSG's	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02840, Explosion, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSE. TOXIC OR FLAMMABLE GAS

Condition	Indication(s)	Emergency Classification
1. Near or onsite toxic or flammable gas release	1. Report or detection of toxic or flammable gases that could enter within the Owner Controlled Area in amounts that can affect normal operation of the plant.	Unusual Event RA-EP-01600 All Modes
	<u>OR</u> 2. Report by local, county or State officials for potential evacuation of Owner Controlled Area personnel based on offsite events.	
2. Entry into facility environs of uncontrolled toxic or flammable gas	1. Report or detection of toxic or flammable gas within a Protected Area structure in concentrations that will be threatening to plant personnel.	Alert RA-EP-01700 All Modes
	<u>OR</u> 2. Report or detection of toxic or flammable gases within a Protected Area structure in concentrations that will affect the safe operation of the plant.	

NOTE

RA-EP-02850, Hazardous Chemical and Oil Spills, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSE. TOXIC OR FLAMMABLE GAS (Continued)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
3. Entry of uncontrolled flammable gases into vital areas. Entry of uncontrolled toxic gases into vital areas where lack of access to the area constitutes a safety problem. (Plant not in cold shutdown.)	1. Report or detection of toxic or flammable gases within Vital Areas where lack of access to the area prevents operation of BOTH TRAINS of a safety system.	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02850, Hazardous Chemical and Oil Spills, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSF. TURBINE DAMAGE

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Turbine rotating component failure causing rapid plant shutdown	1. High turbine vibration trip <u>AND</u> 2. Reactor trip	Unusual Event RA-EP-01600 Modes 1 & 2
2. Turbine failure causing casing penetration	Control room informed by Station personnel who have made a visual inspection of turbine casing	Alert RA-EP-01700 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSG. MISSILE IMPACT

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Missile impact from whatever source on the facility	Control room informed by Station personnel of any missile	Alert RA-EP-01700 All Modes
2. Missile impact causing severe damage to safe shutdown equipment	1. Control room informed by Station personnel of any missile impact on safe shutdown equipment <u>AND</u> 2. Instrumentation readings on safe shutdown equipment indicate equipment problems	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSH. CONTROL ROOM EVACUATION

Condition	Indication(s)	Emergency Classification
1. Evacuation of control room anticipated or required	Any evacuation of the control room anticipated or required with control of shutdown systems established from local stations within 15 minutes	Alert RA-EP-01700 All Modes
2. Evacuation of control room and control of shutdown systems <u>NOT</u> established from local stations in 15 minutes	Any evacuation of the control room with shutdown control <u>NOT</u> established locally within 15 minutes	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSI. SECURITY THREAT

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Security threat or attempted entry or attempted sabotage	Report by plant personnel of a security threat with a potential for industrial sabotage (i.e. attempted forcible entry into a vital area, armed entry into the protected area, discovery of suspected bombs or incendiary devices, etc.)	Unusual Event RA-EP-01600 All Modes
2. Ongoing security compromise	Report by a member of the security force that a security emergency is in progress	Alert RA-EP-01700 All Modes
3. Loss of physical control of the plant is ready to take place (imminent)	Physical attack on the plant involving imminent occupancy of the control room <u>OR</u> local shutdown stations that control vital equipment	Site Area Emergency RA-EP-01800 All Modes
4. Loss of physical control of the facility	1. Physical attack on the plant which has resulted in occupation of the control room <u>OR</u> 2. Unauthorized personnel in control of vital plant equipment	General Emergency RA-EP-01900 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)A. EARTHQUAKE

Condition	Indication(s)	Emergency Classification
1. Any earthquake felt in-plant or detected on station seismic instrumentation	Any earthquake felt in-plant <u>OR</u> detected by station seismic instrumentation	Unusual Event RA-EP-01600 All Modes
2. Earthquake > Operating Basis Earthquake (OBE) levels	1. Ground motion felt <u>AND</u> 2. OBE alarm on seismic alarm panel C5764A	Alert RA-EP-01700 All Modes
3. Earthquake >Safe Shutdown Earthquake (SSE) levels	1. Ground motion felt <u>AND</u> 2. SSE alarm on seismic alarm panel C5764A	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02820, Earthquake, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)B. TORNADO

Condition	Indication(s)	Emergency Classification
1. Any tornado onsite	Control room informed by station personnel who have made a visual sighting of a tornado crossing the site boundary	Unusual Event RA-EP-01600 All Modes
2. Any tornado striking facility	Control room informed by station personnel who have made a visual sighting of a tornado striking the facility	Alert RA-EP-01700 All Modes

NOTE

RA-EP-02810, Tornado, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)C. HURRICANE FORCE WINDS

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Hurricane force winds (greater than 74 mph)	Control room informed of hurricane force winds forecast for Ottawa County	Unusual Event RA-EP-01600 All Modes
2. Hurricane force winds near design basis levels (greater than 74 mph, but less than 90 mph)	1. Control Room informed of hurricane force winds occurring in Ottawa County <u>AND</u> 2. Two successive 15 minute averages from the station meteorological tower are of winds of 74 mph to 90 mph	Alert RA-EP-01700 All Modes
3. Hurricane force winds > design basis levels (greater than 90 mph)	1. Control room informed of hurricane force winds occurring in Ottawa County <u>AND</u> 2. Two successive 15 minute averages from the station meteorological tower are of winds above 90 mph	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)D. FLOODING, LOW WATER

Condition	Indication(s)	Emergency Classification
1. 50 year flood or low water, surge or seiche	Forebay level observed to be: 1. High (>580 feet IGLD) <u>OR</u> 2. Low (<562 feet IGLD)	Unusual Event RA-EP-01600 All Modes
2. Flood, low water, surge or seiche near design levels	Forebay level observed to be: 1. High (584 feet IGLD) <u>OR</u> 2. Low (<560 feet IGLD)	Alert RA-EP-01700 All Modes
3. Flood, low water, surge or seiche > design levels with plant not in cold shutdown	Forebay level observed to be: 1. High (>584 feet IGLD) <u>OR</u> 2. Low (<558 feet IGLD)	Site Area Emergency RA-EP-01800 Modes 1,2,3,&4

NOTE

RA-EP-02830, Flooding, contains further detailed information on high water situations.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS9. MISCELLANEOUS

Condition	Indication(s)	Emergency Classification
1. Inability to reach required shutdown within technical specification limits.	Plant is not brought to a required operating mode within a Technical Specification Limiting Condition for Operation (LCO) Action Statement Time.	Unusual Event RA-EP-01600 Modes 1,2,3,&4
2. Miscellaneous	Other plant conditions exist that warrant increased awareness on the part of the plant operations staff or State and/or local offsite authorities which are not covered under any other existing station procedures.	Unusual Event RA-EP-01600 All Modes
3. Miscellaneous	Other plant conditions exist that warrant precautionary activation of the Technical Support Center and Emergency Control Center and placing other key emergency personnel on standby.	Alert RA-EP-01700 All Modes
4. Miscellaneous	Other plant conditions exist that warrant activation of emergency centers and monitoring teams or a precautionary notification to the public near the site.	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS9. MISCELLANEOUS (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
5. Miscellaneous	Other plant conditions exist, from whatever source, that make release of large amounts of radioactivity in a short time period possible, e.g., any core melt situation.	General Emergency RA-EP-01900 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS10. DOWNGRADING GUIDELINES

- A. Existing conditions no longer meet the emergency criteria
AND
it appears unlikely that conditions will deteriorate further.
- B. Nonroutine releases of radioactive material to the environment are under control or terminated.
- C. Any fire, flood, earthquake, or similar emergency conditions are controlled or have ceased.
- D. All specified corrective actions have occurred
OR
the plant has been placed in the appropriate operational mode.
- E. All required notifications have been completed.
- F. Agreement between the Control Room, Technical Support Center and the Emergency Control Center that downgrading is appropriate (if they were activated).
- G. After issuance of offsite protective actions has occurred, State and County officials must concur with the downgrading.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS11. TERMINATING GUIDELINES

- A. The conditions which caused the emergency have stabilized, are under control, and are unlikely to deteriorate further.
- B. No surveillance relative to offsite protective actions is needed, except for the control of foodstuffs, water, and offsite contamination, or environmental assessment activities.
- C. Radiation levels in affected plant areas are acceptable, and/or are stable or decreasing.
- D. Releases of radioactive material to the environment greater than Offsite Dose Calculation Manual are under control or have ceased.
- E. The potential for an uncontrolled release of radioactive material is at an acceptable, low level.
- F. Containment pressure is within Technical Specification requirements related to the existing mode of operation.
- G. The reactor is in a stable, safe shutdown condition and long-term core cooling is available, as required.
- H. Any fire, flood, earthquake, or similar emergency conditions no longer exist.
- I. All offsite notifications are complete.
- J. Offsite conditions will not limit access of personnel and resources.
- K. Discussions have been held with those federal, state and local organizations that have mobilized in support of the emergency, and that are in direct communication with DBNPS.
- L. The Technical Support Center (TSC) staff, if activated, has evaluated plant status with respect to Technical Specifications and concurs with termination of the emergency.

7.0 FINAL CONDITIONS

Abnormal plant conditions have been terminated and an Emergency Director is no longer required.

8.0 RECORDS

8.1 The following quality assurance records are completed by this procedure and shall be listed on the Nuclear Records List, captured, and submitted to Nuclear Records Management in accordance with NG-NA-00106:

8.1.1 None

8.2 The following non-quality assurance records are completed by this procedure and may be captured and submitted to Nuclear Records Management in accordance with NG-NA-00106:

8.2.1 None

SUMMARY OF EMERGENCY ACTION LEVELS

GRP	UNUSUAL EVENT	ALERT	SITE AREA EMERGENCY	GENERAL EMERGENCY
1	A-1 Failure of safety related relief	B-2 Very high RCS activity	B-3 Core damage with inadequate core cooling	B-4 Core damage with large release of radioactivity possible B-5 Core melt situation C-1 Loss of 2 of 3 Fission product barriers
	B-1 High RCS activity requiring shutdown			
2	A-1 RCS leak rate requiring shutdown	A-2 RCS leak rate >50 GPM but < HPI capacity	A-3 RCS leak rate >50GPM but <HPI capacity and loss of site power A-4 LOCA > HPI	
3	A-1 Startup accident	A-2 Failure of Rx protect system (ATWS)	A-3 Failure of Rx protection system to complete a manual trip	
	C-1 Loss of communications	B-1 Loss of LPI B-2 Loss of DH, CCW, SW while shutdown C-2 Loss of annunciator and station computer	B-3 Loss of SW, CCW, MU, HPI or feedwater B-4 Loss of water level while drained down C-3 Loss of annunciator and computer during transient	
4	A-1 Loss of offsite power or onsite AC	A-2 Vital bus power reduced to a single source	A-4 Loss of offsite power and site AC >15 min	A-5 Prolonged station blackout
		A-3 Loss of offsite power and onsite AC B-1 Loss of all onsite DC	B-2 Loss of onsite DC >15 min	
5	A-1 Major Stm leak	A-2 Major Stm leak with >10 GPM primary to secondary leakage	A-3 Major Stm leak with > 50 GPM primary to secondary leakage and fuel damage indicated	
	B-1 Failure of Stm safety valve to close			

CAUTION:

THIS ATTACHMENT IS FOR INFORMATION ONLY - UTILIZE THE ACTUAL EAL TEXT WHEN CLASSIFYING.

GRP	UNUSUAL EVENT	ALERT	SITE AREA EMERGENCY	GENERAL EMERGENCY
6	C-1 Effluent release > Allowed Limits	A-1 Radiation level >1000 times normal	B-2 Fuel handling accident results in SFAS actuation or ventilation trip due to radiation	D-6 > Very high dose rates at site boundary D-7 >
		B-1 Fuel handling accident results in release		
7	A-1 Fire lasting more than 10 min.	A-2 Fire affecting safety system	A-3 Fire resulting in loss of safety system	
	B-1 Aircraft crash onsite or unusual aircraft activity	B-2 Aircraft crash affecting plant structures	B-3 Aircraft crash damaging vital system	
	C-1 Train derailment onsite	D-2 Onsite explosion affecting plant operations	D-3 Explosion damaging hot shutdown equip	
	D-1 Onsite explosion	E-2 Toxic or flammable gas release in plant	E-3 Toxic or flammable gas release in vital area	
	E-1 Toxic or flammable gas release near or onsite	F-2 Turbine failure with casing penetration	G-2 Missile impact damaging hot shutdown equipment	
	F-1 Turbine failure causing plant shutdown	G-1 Missile impact on plant structure	H-2 Evacuation of CTRM and local control not established in 15 min	
	I-1 Security threat	H-1 Evacuation of control room I-2 Ongoing security compromise	I-3 Loss of physical control imminent	
8	A-1 Any earthquake	A-2 Earthquake >OBE	A-3 Earthquake > SSE	
	B-1 Tomado onsite	B-2 Tomado striking facility		
	C-1 Hurricane force winds forecast	C-2 Winds >74 mph < 90 mph	C-3 Winds > 90 mph	
	D-1 50 year flood or low water	D-2 Flood or low water at design levels	D-3 Flood or low water > design levels	
9	Miscellaneous	Miscellaneous	Miscellaneous	Miscellaneous

CAUTION:

THIS ATTACHMENT IS FOR INFORMATION ONLY - UTILIZE THE ACTUAL EAL TEXT WHEN CLASSIFYING.

COMMITMENTS

<u>Section</u>	<u>Reference</u>	<u>Comments</u>
Table of EALs, throughout	TERMS O 05702	Reliable instrument readings where applicable
Table of EALs, EAL 7-A-2	TERMS O 13375	Fire at alert level needing offsite assistance
Table of EALs, EAL 3-C-3	TERMS O 13377	Deleted 15 minute time duration for loss of all annunciators at Site Area Emergency
Table of EALs, EAL 8-A-1	TERMS O 13380	Unusual Event declared if earthquake is felt but not detected by monitors
Table of EALs, EAL 7-F-1	TERMS O 13383	Add turbine failure Unusual Event
Table of EALs, EAL 4-A-3	TERMS O 13384	Alert EAL for loss of onsite and offsite power
Caution 6.1.1.e.	TERMS O 13477 TERMS O 13482	Reviewed/revised EAL applicability mode of plant operation
Table of EALs, EAL 2-A-2	TERMS O 13525	Clarify indications of > 50 gpm RCS leak
Table of EALs, EAL 7-A-1	TERMS O 13601	Make fire Unusual Event conform to NUREG 0654
Section 6.1.1.e.3.	TERMS O 13670	Specifies conditions under which the Shift Manager (STA) may assume Emergency Director duties
Table of EALs, EAL 8-A-2 and 8-A-3	TERMS O 13672	OBE and SSE Earthquakes
Table of EALs, throughout	TERMS O 14181	Highlighting of <u>AND</u> and <u>OR</u>
Table of EALs, EAL 1-B-1 thru 1-B-5	TERMS O 14855	Clarify fuel failure

COMMITMENTS (Continued)

<u>Section</u>	<u>Reference</u>	<u>Comments</u>
Table of EALs, EAL 3-A-3	TERMS O 14974	Ensure ATWS conditions are correctly classified.
Table of EALs throughout	TERMS O 14986	Cross reference to other EALs
Table of EALs, EAL 1-D-2	TERMS O 14988	High containment radia- tion, pressure and temperature indicated by any SFAS function activated
Table of EALs, EAL 1-C-1	TERMS O 15157	Clarify loss of fission product barriers
Section 3.2	TERMS O18734	Definition of a core melt Sequence
Table of EALs, EAL 1-C-1	TERMS Q 00052	EAL for loss of containment integrity
Entire Procedure	TERMS Q 03113	Procedure for Emergency Classification

END