



Gary R. Peterson  
Vice President

**Duke Power**  
Catawba Nuclear Station  
4800 Concord Road  
York, SC 29745  
(803) 831-4251 OFFICE  
(803) 831-3221 FAX

February 5, 2001


U.S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, D.C. 20555

Subject: Duke Energy Corporation  
Catawba Nuclear Station, Unit 1  
Docket Number 50-413  
Request for Relief Number 01-001  
Limited Weld Examinations in End-of-Cycle 12  
Refueling Outage

Pursuant to 10 CFR 50.55a(g)(5)(iii), please find attached Request for Relief 01-001. This request for relief is associated with limited weld examinations encountered during the Catawba Unit 1 End-of-Cycle 12 Refueling Outage. The components for which the weld examinations were limited are contained in the attachment to this letter.

The attachment to this letter contains all technical information necessary in support of this request for relief.

If you have any questions concerning this material, please call L.J. Rudy at (803) 831-3084.

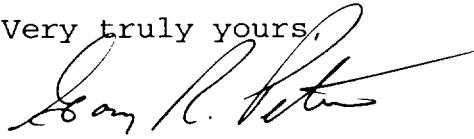Very truly yours,  


Gary R. Peterson

LJR/s

Attachment

A047

Document Control Desk  
Page 2  
February 5, 2001

xc (with attachment):

L.A. Reyes, Regional Administrator  
U.S. Nuclear Regulatory Commission, Region II  
Atlanta Federal Center  
61 Forsyth St., SW, Suite 23T85  
Atlanta, GA 30303

D.J. Roberts, Senior Resident Inspector  
U.S. Nuclear Regulatory Commission  
Catawba Nuclear Station

C.P. Patel, Senior Project Manager (addressee only)  
U.S. Nuclear Regulatory Commission  
Mail Stop 08-H12  
Washington, D.C. 20555-0001

## **DUKE ENERGY CORPORATION**

### **STATION: CATAWBA NUCLEAR STATION UNIT 1 10-YEAR INTERVAL REQUEST FOR RELIEF NO. 01-001**

Duke Energy Corporation has determined that conformance with certain ASME Section XI Code requirements is impractical. Therefore, pursuant to 10CFR50.55a(g)(5)(iii), Duke Energy requests relief from applicable portions of the code.

#### **I. System/Component(s) for Which Relief is Requested:**

ASME Section XI Code Class 1 Examination Category B-D Full Penetration Welds of Nozzles In Vessels; Examination Category B-F Pressure Retaining Dissimilar Metal Welds; Examination Category C-F-1 Pressure Retaining Welds In Austenitic Stainless Steel Or High Alloy Piping and ASME Section XI Code Class 2 Examination Category C-A Pressure Retaining Welds In Pressure Vessels

| <u>ID Number</u> | <u>Item Number</u> |
|------------------|--------------------|
| 1SGA-INLET       | B03.140.001        |
| 1SGA-OUTLET      | B03.140.002        |
| 1SGA-INLET-W5SE  | B05.070.001        |
| 1SGA-OUT-W6SE    | B05.070.002        |
| 1NS1-1           | C05.011.201        |
| 1NS1-2           | C05.011.202        |
| 1NS2-1           | C05.011.203        |
| 1CF34-3          | C05.011.251        |
| 1BSWINJF-SH-HD   | C01.020.018        |

#### **II. Code Requirement:**

- ASME Section XI 1989 Edition Examination Category B-D Full Penetration Welds of Nozzles In Vessels, Table IWB-2500-7 (d) , Item Number B03.140, examination volume M-N-O-P

- ASME Section XI 1989 Edition Examination Category B-F Pressure Retaining Dissimilar Metal Welds, Item Number B05.070. and Examination Category C-F-1 Pressure Retaining Welds in Austenitic Stainless Steel or High Alloy Piping (Dissimilar Metal Weld), Item Number C05.011. ASME Section XI, Appendix III, Paragraph III-4420, 1989 Edition with no addenda as modified by Code Case N-460. “The examination shall be performed using a sufficiently long examination beam path to provide coverage of the required examination volume in two-beam path directions. The examination shall be performed from two sides of the weld, where practicable, or from one side of the weld, as a minimum.”
  
- ASME Section XI 1989 Edition Examination Category C-F-1 Pressure Retaining Welds in Austenitic Stainless Steel or High Alloy Piping, Item Number C05.011. 10 CFR 50.55a(b)(2)(xv)(A) “When applying Supplements 2 and 3 of Appendix VIII, the following examination coverage criteria requirements must be used:
  - (1) Piping must be examined in two axial directions and when examination in the circumferential direction is required, the circumferential examination must be performed in two directions, provided access is available.
  
  - (2) Where examination from both sides is not possible, full coverage credit may be claimed from a single side for ferritic welds. Where examination from both sides is not possible on austenitic welds, full coverage credit from a single side may be claimed only after completing a successful single sided Appendix VIII demonstration using flaws on the opposite side of the weld.”10 CFR 50.55a(b)(2)(xvi)(B) “Examinations performed from one side of a ferritic or stainless steel pipe weld must be conducted with equipment, procedures, and personnel that have demonstrated proficiency with single sided examinations. To demonstrate equivalency to two sided examinations, the demonstration must be performed to the requirements of Appendix VIII as modified by this paragraph and 50.55a(b)(2)(xv)(A).”

- ASME Section XI 1989 Edition Examination Category C-A Pressure Retaining Welds in Pressure Vessels, Table IWC-2500-1, Item Number C01.020. ASME Section XI, Appendix III, Paragraph III-4420, 1989 Edition with no addenda as modified by Code Case N-460. “The examination shall be performed using a sufficiently long examination beam path to provide coverage of the required examination volume in two-beam path directions. The examination shall be performed from two sides of the weld, where practicable, or from one side of the weld, as a minimum.”

### **III. Code Requirement from which Relief is Requested:**

Relief is requested for the above-identified ID Numbers:

- Class 1 Steam Generator 1A Inlet and Outlet Nozzle Inside Radius Section:  
Relief is being sought from the requirement to examine 100% of the volume M-N-O-P shown in IWB-2500-7 (d).

- Class 1 Steam Generator 1A Inlet and Outlet Nozzle-to-Safe End Welds:  
Relief is being sought from the requirement to provide coverage of the required examination volume in two-beam path directions.

- Class 2 Containment Spray Pump 1A-to-Reducer Weld, Containment Spray Reducer-to-Flange Weld, and Containment Spray Valve 1NS018A-to-Pipe Welds:

Relief is being sought from the requirement to perform examinations from one side of stainless steel welds using equipment, procedures, and personnel that have demonstrated proficiency with single sided examinations in accordance with 50.55a(b)(2)(xv)(A).

- Class 2 Feedwater Pipe-to-Valve 1CF042 Weld:

Relief is being sought from the requirement to provide coverage of the required examination volume in two-beam path directions.

- Class 2 Seal Water Injection Filter 1B Shell-to-Head Weld:

Relief is being sought from the requirement to provide coverage of the required examination volume in two-beam path directions.

#### **IV. Basis for Relief:**

- During the ultrasonic examination of the Steam Generator 1A Inlet and Outlet Nozzle Inside Radius Sections, 1SGA-INLET and 1SGA-OUTLET (Item Numbers B03.140.001 and B03.140.002 respectively) shown in Attachments 2 and 3, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 83.24%. Limitations are caused by the ratio of the nozzle O.D. to the vessel thickness. When the nozzle O.D. is small in relation to the vessel thickness, more coverage can be obtained when scanning from the vessel side. Conducting examinations from nozzle boss and OD blend radius using compound angles; determining which angles to use; metal paths to calibrate and area of coverage are not accurate with manual calculations. Duke Energy is investigating the use of computer modeling to solve the limitation problems. Radiography is not practical because of the geometry of the component, which prevents placement of the film and exposure source. Nozzle inner radius sections were examined with the ultrasonic method to the maximum extent practical from the vessel wall. Calibration blocks and procedures were in accordance with ASME Section V, Article 4, Paragraph T-441.3.2.1. The volume was scanned using 60° and 70° beam angles in clock-wise and counter-clockwise directions.
- During the ultrasonic examination of the Steam Generator 1A Inlet and Outlet Nozzle-to-Safe End, 1SGA-INLET-W5SE, 1SGA-OUT-W6SE (Item Numbers B05.070.001, B05.070.002) shown in Attachments 4 and 5 respectively, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 75.00%. Austenitic weld metal characteristics and single sided access caused by the component geometry prevents two-beam path direction coverage of the examination volume. Obtaining coverage greater than 90% of the weld volume as defined in Code Case N-460, which is utilized by Duke Energy is not possible.

The most effective ultrasonic technique for the examination of dissimilar metal welds uses refracted longitudinal waves. The longitudinal wave is preferred as the austenitic weld metal and buttering create highly attenuative barriers to shear wave ultrasound. The longitudinal wave is less affected by these difficulties. However, the longitudinal wave is affected by mode conversion when it strikes the inside surface of the safe end or pipe at any angle other than a right angle to the surface.

The calculations below show that a 45<sup>0</sup> refracted longitudinal wave striking the inside surface of a pipe will produce a 22.9<sup>0</sup> refracted shear wave in addition to the normally expected 45<sup>0</sup> reflected longitudinal wave.

$$\sin^{-1} = (\sin 45^{\circ} \times V_s) \div V_L$$

$$= (0.707 \times 0.123) \div 0.223$$

Where;  $\sin^{-1}$  is the shear wave angle


$V_s$  is the shear wave velocity of the stainless steel safe end/pipe material in inches / msec.

$V_L$  is the longitudinal wave velocity of the stainless steel safe/pipe end material in inches/msec.

As shown in the graph below, the mode conversion process creates two sound beams of differing intensities reflecting off the inside surface<sup>1</sup>. At incident angles greater than 30 degrees, the shear wave will predominate. However, the shear wave is attenuated and scattered by the austenitic weld metal and the layer of buttering. The examination sensitivity is degraded to such an extent that any examination using the second sound path leg is meaningless. Therefore, the two-beam path direction coverage requirement is impractical.

In order to obtain the required two-beam path direction coverage, welds would have to be re-designed to allow scanning from both sides.

<sup>1</sup>Firestone, F.A.: Tricks with the Supersonic Reflectoscope, J. Soc. Nondestructive Testing, vol. 7, no. 2 Fall 1948.

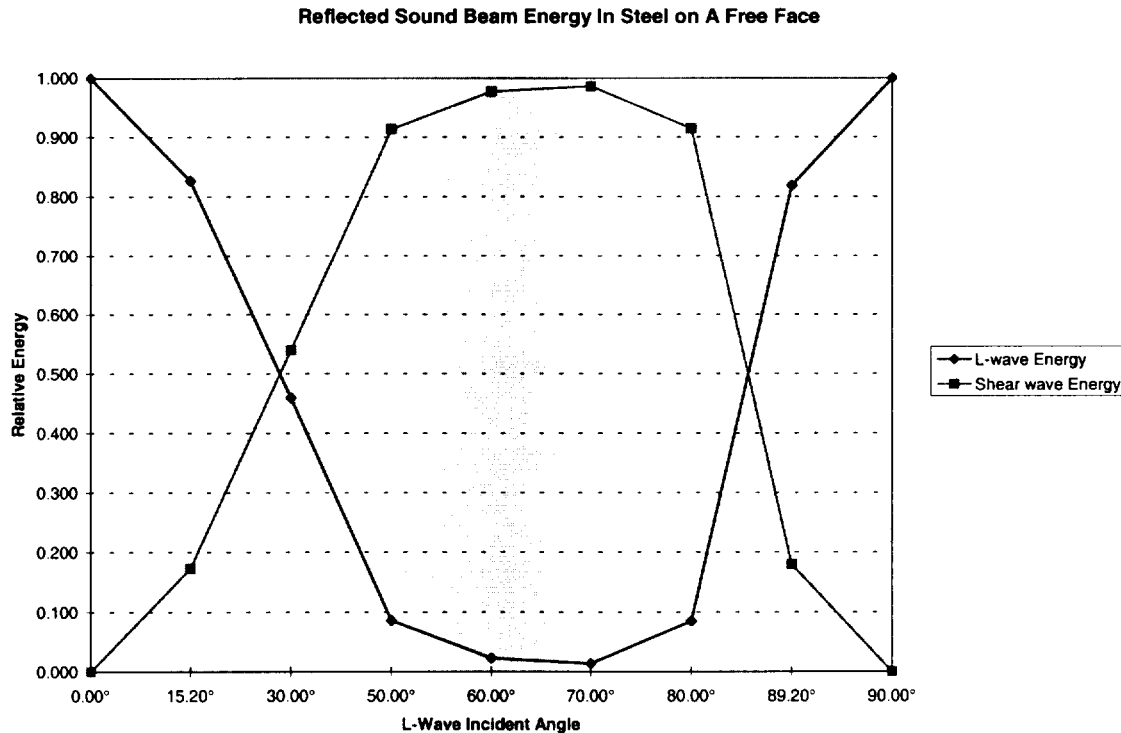

- During the ultrasonic examination of the Containment Spray Pump 1A-to-Reducer Weld, 1NS1-1 (Item Number C05.011.201) shown in Attachment 6, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 60% of the required examination volume. This is a pump to reducer weld where access is limited to the pump side of the weld only.
- During the ultrasonic examination of the Containment Spray System Reducer-to-Flange Weld 1NS1-2 (Item Number C05.011.202) shown in Attachment 7, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 59.06% of the required examination volume. This is a reducer to flange weld where access is limited to the reducer side of the weld only.
- During the ultrasonic examination of the Containment Spray Valve 1NS018A-to-Pipe Weld 1NS2-1 (Item Number C05.011.203) shown in Attachment 8, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 58.15% of the required examination volume. This is a pipe to valve weld where access is limited to the pipe side of the weld only.
- During the ultrasonic examination of the Feedwater Pipe-to-Valve 1CF042, Weld 1CF34-3 (Item Number C05.011.251) shown in Attachment 9, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 75% of the required examination volume. This is a dissimilar metal weld joining a stainless steel pipe to a carbon steel valve. Access is limited to the pipe side only because of the as-cast surface condition of the valve.

Austenitic weld metal characteristics and single sided access caused by the component geometry prevents two-beam path direction coverage of the examination volume.

In order to obtain the required two-beam path direction coverage, the weld would have to be re-designed to allow scanning from both sides of the weld over the required examination volume.

- During the ultrasonic examination of the Seal Water Injection Filter 1B Shell-to-Head Weld, 1BSWINJF-SH-HD (Item Number C01.020.018) shown in



Attachment 10, greater than 90% coverage of the required examination volume could not be obtained. The examination coverage was limited to 59.33% of the required examination volume.

Austenitic weld metal characteristics and single sided access caused by the component geometry prevents two-beam path direction coverage of the examination volume.

In order to obtain the required two-beam path direction coverage, the weld would have to be re-designed to allow scanning from both sides of the weld over the required examination volume.

## **V. Alternate Examinations or Testing:**

No additional examinations are planned during the current interval for ID Numbers 1SGA-INLET, 1SGA-OUTLET, 1SGA-INLET-W5SE, 1SGA-OUT-W6SE, 1NS1-1, 1NS1-2, 1NS2-1, 1CF34-3 and 1BSWINJF-SH-HD. Duke Energy Corporation will continue to use the most current ultrasonic techniques available to obtain maximum coverage for future examinations of these ID Numbers.

## **VI. Justification for the Granting of Relief:**

These welds were rigorously inspected by radiography and liquid penetrant examination during construction and verified to be free from unacceptable fabrication defects.

### Steam Generator 1A Inlet and Outlet Nozzle Inner Radius

Although the examination volume requirements as defined in ASME Section XI 1989 Edition with no addenda Figure IWB-2500-7, Examination Volume M-N-O-P for ID Numbers 1SGA-INLET and 1SGA-OUTLET (Item Numbers B03.140.001 and B03.140.002) could not be met, the amount of coverage obtained for these examinations provides an acceptable level of quality and integrity. For results of the examinations, reference Attachments 2 and 3.

Steam Generator 1A Inlet and Outlet Nozzle Inner Radii are located inside containment and are part of the reactor coolant system pressure boundary. General Design Criterion 30, "Quality of Reactor Coolant Pressure Boundary," of Appendix A to 10 CFR Part 50, "General Design Criteria for Nuclear Power Plants," mandates that means be provided for detecting and, to the extent practical, identifying the location of the source of reactor coolant leakage. If a leak

were to develop at these weld locations discussed in this relief request, the instrumentation available to the operators for detection and monitoring of leakage would provide a prompt and qualitative information necessary to permit them to take immediate corrective action. If a leak should develop in these aforementioned locations, the only corrective action would be shutdown and depressurize the reactor coolant system, since the welds are non-isolable.

Plant Technical Specifications dictate that a reactor coolant system water inventory balance be performed on a regular basis. A normal operating practice is to perform this computer based mass balance on a daily frequency and/or whenever the operators suspect any abnormal changes to other leakage detection systems. Plant Technical Specification requires that if the leak rate cannot be reduced below 1 gpm unidentified that the plant be put in hot standby within 6 hours and in cold shutdown within the following 30 hours. Leakage as a result of a failed weld discussed in this section would show up as unidentified leakage and subject to the 1 gpm limit.

Other leakage detection systems available to the operator and dictated per plant technical specifications are:

- Containment Atmosphere Gaseous and Particulate Radioactivity Monitoring System (EMF monitors 38 & 39) which would detect airborne radiological activity;
- Containment Floor and Equipment Sump Level and Flow Monitoring Subsystem where unidentified accumulated water on the containment floor would be monitored and evaluated as sump level changes;
- Containment Ventilation Unit Condensate Drain Tank Level Monitoring Subsystem which collects and measures as unidentified leakage the moisture removed from the containment atmosphere.

Additionally, other indicators are also available to the operator that a leak exists or may be developing:

- Containment Atmosphere Iodine Monitor (EMF 40)
- Charging / Letdown system mismatches;
- Containment humidity indications;
- Pre-Cycle walkdowns performed each outage while system is at operating temperature and pressure prior to criticality;
- Post-Cycle walkdowns performed at operating temperature and pressure performed during unit shutdown.

Steam Generator 1A Inlet and Outlet Nozzle-to-Safe End Welds

Although the examination volume requirements as defined in ASME Section XI 1989 Edition with no addenda, Appendix III, Paragraph III-4420, for ID Numbers 1SGA-INLET-W5SE, 1SGA-OUT-W6SE, (Item Numbers B05.070.001 and B05.070.002) could not be met, the amount of coverage obtained for these examinations provides an acceptable level of quality and integrity. For results of the examinations, reference Attachments 4 and 5.

Steam Generator 1A Inlet and Outlet Nozzle-to-Safe End Welds are located inside containment and are part of the reactor coolant system pressure boundary. General Design Criterion 30, "Quality of Reactor Coolant Pressure Boundary," of Appendix A to 10 CFR Part 50, "General Design Criteria for Nuclear Power Plants," mandates that means be provided for detecting and, to the extent practical, identifying the location of the source of reactor coolant leakage. If a leak were to develop at these weld locations discussed in this relief request, the instrumentation available to the operators for detection and monitoring of leakage would provide a prompt and qualitative information necessary to permit them to take immediate corrective action. If a leak should develop in these aforementioned locations, the only corrective action would be shutdown and depressurize the reactor coolant system, since the welds are non-isolable.

Plant Technical Specifications dictate that a reactor coolant system water inventory balance be performed on a regular basis. A normal operating practice is to perform this computer based mass balance on a daily frequency and/or whenever the operators suspect any abnormal changes to other leakage detection systems. Plant Technical Specification requires that if the leak rate cannot be reduced below 1 gpm unidentified that the plant be put in hot standby within 6 hours and in cold shutdown within the following 30 hours. Leakage as a result of a failed weld discussed in this section would show up as unidentified leakage and subject to the 1 gpm limit.

Other leakage detection systems available to the operator and dictated per plant technical specifications are:

- Containment Atmosphere Gaseous and Particulate Radioactivity Monitoring System (EMF monitors 38 & 39) which would detect airborne radiological activity;
- Containment Floor and Equipment Sump Level and Flow Monitoring Subsystem where unidentified accumulated water on the containment floor would be monitored and evaluated as sump level changes;
- Containment Ventilation Unit Condensate Drain Tank Level Monitoring Subsystem which collects and measures as unidentified leakage the moisture removed from the containment atmosphere.

Additionally, other indicators are also available to the operator that a leak exists or may be developing:

- Containment Atmosphere Iodine Monitor (EMF 40)
- Charging / Letdown system mismatches;
- Containment humidity indications;
- Pre-Cycle walkdowns performed each outage while system is at operating temperature and pressure prior to criticality;
- Post-Cycle walkdowns performed at operating temperature and pressure performed during unit shutdown.

Containment Spray Pump 1A-to-Reducer Weld, Containment Spray Reducer-to-Flange Weld, Containment Spray Valve 1NS018A-to-Pipe Weld

Although the examination requirements as defined in 10 CFR 50.55a (b) (2) (xv) (A) could not be met for ID Numbers 1NS1-1, 1NS1-2, 1NS2-1 (Item Numbers C05.011.201, C05.011.202, and C05.011.203 respectively), the examinations conducted provide an acceptable level of quality and integrity. For results of the examinations, reference Attachments 6, 7, and 8.

Feedwater Pipe-to-Valve 1CF042

Although the examination volume requirements as defined in ASME Section XI 1989 Edition with no addenda, Appendix III, Paragraph III-4420, for ID Number 1CF34-3 (Item Number C05.011.251) could not be met, the amount of coverage obtained for this examination provides an acceptable level of quality and integrity. For results of the examinations, reference Attachment 9.

Containment Spray Pump 1A-to-Reducer Weld

Containment Spray Pump (NS) 1A is used to control pressure inside Reactor Building Containment during an engineered safeguards actuation. This pump is not used for normal operation of the plant.

This area that contains the pump to reducer weld is surveyed twice a day by Operations during their routine rounds. One of the items that must be checked off is for general condition of the room containing the pump. It is reasonable for the operator making these rounds to detect any external leaks from this weld.

This same area is also surveyed once a week by a periodic test that is used to specifically look for radioactive leaks outside containment. This area must be surveyed and signed off. If a leak were encountered, it would be written up in a work request and Problem Investigation Process form filled out. The Fluid Leak Management Process then examines the leak. The leak is either repaired or set up for periodic monitoring. A leak in the NS system would also have to be entered

into the Emergency Core Cooling System Leakage Program managed by Technical Specification 5.5.3.

#### Containment Spray Reducer-to-Flange Weld

Containment Spray Pump (NS) 1A is used to control pressure inside the containment vessel during a Safety Injection. This pump is not used for normal operation of the plant.

This area that contains the reducer weld (large end of the reducer to the pump suction) is surveyed twice a day by Operations during their routine rounds. One of the items that must be checked off is for general condition of the room containing the reducer. It is reasonable for the operator making these rounds to detect any external leaks from this weld.

This same area is also surveyed once a week by a periodic test that is used to specifically look for radioactive leaks outside containment. This area must be surveyed and signed off. If a leak were encountered, it would be written up in a work request and Problem Investigation Process form filled out. The Fluid Leak Management Process then examines the leak. The leak is either repaired or set up for periodic monitoring. A leak in the NS system would also have to be entered into the Emergency Core Cooling System Leakage Program managed by Technical Specification 5.5.3.

#### Containment Spray Valve 1NS018A-to-Pipe Weld

1NS-18A provides a suction source to Containment Spray Pump (NS) 1A, which is used to control pressure inside the containment vessel during a Safety Injection. This pump is not used for normal operation of the plant.

This area that contains the weld (NS side of 1NS-18A) is surveyed twice a day by Operations during their routine rounds. One of the items that must be checked off is for general condition of the room containing the valve. It is reasonable for the operator making these rounds to detect any external leaks from this weld.

This same area is also surveyed once a week by a periodic test that is used to specifically look for radioactive leaks outside containment. This area must be surveyed and signed off. If a leak were encountered, it would be written up in a work request and Problem Investigation Process form filled out. The Fluid Leak Management Process then examines the leak. The leak is either repaired or set up for periodic monitoring. A leak in the NS system would also have to be entered into the Emergency Core Cooling System Leakage Program managed by Technical Specification 5.5.3.

### Feedwater Pipe-to-Valve ICF042

ICF042 is a Feedwater Isolation Valve to a Steam Generator. It has a safety function to close when a Safety Injection or Feedwater Isolation signal is received. This valve is normally open during power operations.

This weld is located on the upstream side of ICF042. ICF042 is located in the doghouse of Unit 1. Routine operator rounds inside the doghouse would detect a leak in this area. In the event that the leak was large enough, there are level detectors inside the doghouse to initiate closure of this valve in the event that the water level got high enough. Since the weld is on the upstream side of the valve, it does not effect the safety related auxiliary water supply (CA) that makes up the heat sink for the reactor coolant system.

### Seal Water Injection Filter 1B Shell-to-Head Weld

Although the examination volume requirements as defined in ASME Section XI 1989 Edition with no addenda, Appendix III, Paragraph III-4420, for ID Number 1BSWINJF-SH-HD (Item Number C01.020.018) could not be met, the amount of coverage obtained for this examination provides an acceptable level of quality and integrity. For results of the examination, reference Attachment 10.

The Seal Water Injection Filter 1B is used in power operations. The Seal Water Injection Filter 1B is located in the Auxiliary Building in a filter pit. During power operations and unit refueling outages, the Seal Water Injection Filter 1B is accessible for visual inspections by pulling a concrete plug out of the Auxiliary Building Floor on the 577' elevation.

If a leak were to occur at the weld in question (shell to head weld), there are several periodic tests and evaluations that are performed by established procedures that should identify the leakage for prompt OPS/ENG evaluation:

- During power operation, any leakage from the Seal Water Injection Filter 1B would be identified as a mass loss in the reactor coolant system water inventory balance. As described above, a normal operating practice is to perform this computer based mass balance on a daily frequency and/or whenever the operators suspect any abnormal changes to other leakage detection systems. Plant Technical Specification requires that if the leak rate cannot be reduced below 1 gpm unidentified that the plant be put in hot standby within 6 hours and in cold shutdown within the following 30 hours. Leakage as a result of a failed weld discussed in this section would show up as unidentified leakage and subject to the 1 gpm limit.
- If a leak were to occur at the subject weld, the water would spill on the floor in the Seal Water Injection Filter 1B room and flow to the floor drain and then to

the Floor Drain Tank. Our Chemistry department periodically monitors the tank level and evaluates unidentified leakage for correction.

Finally, for all of the welds covered by this Request for Relief, in the event that a through-wall leak were discovered, the affected component would be subjected to an operability determination as required by existing plant processes. Should the affected component be determined to be inoperable, the applicable Technical Specification remedial actions would be followed.

**VII. Implementation Schedule:**

These examinations will continue to be scheduled in accordance with the requirements of ASME Section XI for future Inspection Intervals at Catawba Nuclear Station, Unit 1.

The following individuals contributed to the development of this RFR:

Jim McArdle (NDE Level III) provided Sections 2-5

David Goforth (System Engineer) provided Section 6

Andy Hogge (Sponsor) compiled the remaining sections

Sponsored By:

Andrew J. Hogge, Jr.

Date

2/1/2001

Approved By:

R. Kevin Rhyne

Date

2/1/2001

|               |                                 |
|---------------|---------------------------------|
| Attachment 1  | Description Table               |
| Attachment 2  | UT Examination Data B03.140.001 |
| Attachment 3  | UT Examination Data B03.140.002 |
| Attachment 4  | UT Examination Data B05.070.001 |
| Attachment 5  | UT Examination Data B05.070.002 |
| Attachment 6  | UT Examination Data C05.011.201 |
| Attachment 7  | UT Examination Data C05.011.202 |
| Attachment 8  | UT Examination Data C05.011.203 |
| Attachment 9  | UT Examination Data C05.011.251 |
| Attachment 10 | UT Examination Data C01.020.018 |



ASME Class 1 & 2 Inservice Inspection Request For Relief No. 01-001  
 For Catawba Unit 1 Based on ASME Section XI - 1989 Code

| Item No.    | Exam Category/<br>Figure No.                     | System Or<br>Component | Area To Be<br>Examined                                     | Reason For Request  | Licensee<br>Proposed<br>Alternate<br>Examination |
|-------------|--|------------------------|--|---|--|
| B03.140.001 | B-D<br>IWB-2500-7<br>(d)                         | Steam<br>Generator     | Steam<br>Generator<br>1A Inlet<br>Nozzle Inside<br>Radius  | Limited scan due to the ratio of the nozzle<br>OD to the vessel thickness. Actual<br>coverage obtained = 83.24%<br>(See Attachment 2) | None   |
| B03.140.002 | B-D<br>IWB-2500-7<br>(d)                         | Steam<br>Generator     | Steam<br>Generator<br>1A Outlet<br>Nozzle Inside<br>Radius | Limited scan due to the ratio of the nozzle<br>OD to the vessel thickness. Actual<br>coverage obtained = 83.24%<br>(See Attachment 3) | None   |
| B05.070.001 | B-F<br>Appendix<br>III,<br>Paragraph<br>III-4420 | Steam<br>Generator     | Steam<br>Generator<br>1A Inlet<br>Nozzle-to-<br>Safe-End   | Limited scan due to material<br>characteristics and single-sided access.<br>Actual coverage obtained = 75%<br>(See Attachment 4)      | None   |

ASME Class 1 & 2 Inservice Inspection Request For Relief No. 01-001  
 For Catawba Unit 1 Based on ASME Section XI - 1989 Code

| Item No.    | Exam Category /Figure No.                                      | System Or Component       | Area To Be Examined                          | Reason For Request  | Licensee Proposed Alternate Examination |
|-------------|--|---------------------------|--|---|---|
| B05.070.002 | B-F<br>Appendix III,<br>Paragraph III-4420                     | Steam Generator           | Steam Generator 1A Outlet Nozzle-to-Safe End | Limited scan due to material characteristics and single-sided access. Actual coverage obtained = 75% (See Attachment 5) | None                                    |
| C05.011.201 | C-F-1<br>10CFR50.55a(b)(2)(xv)(A)<br>10CFR50.55a(b)(2)(xvi)(B) | Containment Spray Pump 1A | Containment Spray Pump 1A-to-Reducer Weld    | Limited scan due single-sided access. Actual coverage obtained = 60% (See Attachment 6)                                 | None                                    |
| C05.011.202 | C-F-1<br>10CFR50.55a(b)(2)(xv)(A)<br>10CFR50.55a(b)(2)(xvi)(B) | Containment Spray System  | Containment Spray Reducer-to-Flange Weld     | Limited scan due single-sided access. Actual coverage obtained = 59.06% (See Attachment 7)                              | None                                    |
| C05.011.203 | C-F-1<br>10CFR50.55a(b)(2)(xv)(A)<br>10CFR50.55a(b)(2)(xvi)(B) | Containment Spray System  | Containment Spray Valve 1NS018A-to-Pipe Weld | Limited scan due single-sided access. Actual coverage obtained = 58.15% (See Attachment 8)                              | None                                    |

ASME Class 1 & 2 Inservice Inspection Request For Relief No. 01-001  
 For Catawba Unit 1 Based on ASME Section XI - 1989 Code

| Item No.    | Exam Category /Figure No.                    | System Or Component         | Area To Be Examined                               | Reason For Request   | Licensee Proposed Alternate Examination |
|-------------|--|-----------------------------|---|--|---|
| C05.011.251 | C-F-1<br>Appendix III,<br>Paragraph III-4420 | Feedwater System            | Feedwater Pipe-to-Valve 1CF042 Weld               | Limited scan due to: Access is limited to the pipe side only because of the as-cast surface condition of the valve. Actual coverage obtained = 75%<br>(See Attachment 9) | None                                    |
| C01.020.018 | C-A<br>Appendix III,<br>Paragraph III-4420   | Seal Water Injection Filter | Seal Water Injection Filter 1B shell-to-Head Weld | Limited Scan due to singled sided access. Actual coverage obtained = 59.33%<br>(See Attachment 10)   | None                                    |

|  |                              |  |                                    |  |   |                |
|--|------------------------------|--|------------------------------------|--|---|----------------|
| <b>DUKE POWER COMPANY</b>                                      |                              |  |                                    |  | Exam Start: 1138                          | Form NDE-UT-2A |
| <b>ULTRASONIC EXAMINATION DATA SHEET FOR PLANAR REFLECTORS</b> |                              |  |                                    |  | Exam Finish: 1205                         | Revision 4     |
| Station: Catawba   | Unit: 1                      | Component/Weld ID: 1SGA-INLET  |                                    |  | Date: 11/1/00                             |                |
| Weld Length (in.): 122.5                                       | Surface Condition: AS GROUND |  | Lo: 9.2.3                          |  | Surface Temperature: <u>77</u> ° <u>F</u> |                |
| Examiner: David Zimmerman <i>David Zimmerman</i>               | Level: II                    | Scans:<br>45 <input type="checkbox"/> _____ dB    70 <input checked="" type="checkbox"/> <u>73.5</u> dB<br>45T <input type="checkbox"/> _____ dB    70T <input type="checkbox"/> _____ dB<br>60 <input checked="" type="checkbox"/> <u>59</u> dB<br>60T <input type="checkbox"/> _____ dB<br>Other: _____ dB |                                    |  | Pyrometer S/N: <u>MCNDE 27010</u>         |                |
| Examiner: James L. Panel <i>James L. Panel</i>                 | Level: II                    |  |                                    |  | Cal Due: <u>3/27/01</u>                   |                |
| Procedure: NDE-680   | Rev: 2                       | FC: N/A  | Configuration: <u>INNER RADIUS</u> |  |   |                |
| Calibration Sheet No:<br>0001050, 0001051                      |                              |  | S1 _____ Flow _____ S2 _____       |  | VESSEL to NOZZLE                          |                |
|  |                              |  | Scan Surface: OD                   |  |   |                |
|  |                              |  | Applies to NDE-680 only            |  |   |                |
|  |                              |  | Skew Angle: 23.0, 23.5             |  |   |                |

| IND # | 4   | Max % Ref                         | Mp Max | W Max | L Max | L1         | L2         | W1         | Mp1        | W2         | Mp2        | Beam Dir. | Exam Surf.                        | Scan | Damps |  |
|-------|-----|-----------------------------------|--------|-------|-------|------------|------------|------------|------------|------------|------------|-----------|-----------------------------------|------|-------|--|
|       |     | <b>DO NOT WRITE IN THIS SPACE</b> |        |       |       | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA |           | <b>DO NOT WRITE IN THIS SPACE</b> |      |       |  |
|       |     |                                   |        |       |       | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     |           |                                   |      |       |  |
|       |     |                                   |        |       |       | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    |           |                                   |      |       |  |
| NRI   | 60° |                                   |        |       |       |            |            |            |            |            |            |           |                                   |      |       |  |
| NRI   | 70° |                                   |        |       |       |            |            |            |            |            |            |           |                                   |      |       |  |

|   |                   |                      |  |                            |
|---|-------------------|----------------------|--|----------------------------|
| Remarks:  |                   |                      |  |                            |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |                   |                      |  | Sheet <u>1</u> of <u>4</u> |
| Reviewed By: <i>Larry Mauldin</i>   | Level: <u>III</u> | Date: <u>11-2-00</u> | Authorized Inspector: <i>Robert McNeil</i> | Date: <u>11-13-00</u>      |
|   |                   |                      | Item No: B03.140.001                       |                            |

*REQUEST FOR RELIEF # 01-001 ATTACHMENT 2*

*AH 11/21/00*

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

|   |   |          |
|---|---|----------|
| Component/Weld ID: 1SGA-INLET   | Item No: B03.140.001  | Remarks: |
| <input type="checkbox"/> NO SCAN<br><input checked="" type="checkbox"/> LIMITED SCAN<br>SURFACE <input checked="" type="checkbox"/> 1 <input type="checkbox"/> 2<br>BEAM DIRECTION <input type="checkbox"/> 1 <input checked="" type="checkbox"/> 2 <input checked="" type="checkbox"/> cw <input type="checkbox"/> ccw<br>FROM L <u>22.0</u> to L <u>42.5</u> INCHES FROM WO <u>N/A</u> to <u>N/A</u><br>ANGLE: <input type="checkbox"/> 0 <input type="checkbox"/> 45 <input checked="" type="checkbox"/> 60 <input type="checkbox"/> Other <u>70°</u> FROM <u>N/A</u> DEG to <u>N/A</u> DEG                      | SUPPORT CORNER IS 1.0" FROM C/L OF NOZZLE RADIUS            |          |
| <input type="checkbox"/> NO SCAN<br><input checked="" type="checkbox"/> LIMITED SCAN<br>SURFACE <input checked="" type="checkbox"/> 1 <input type="checkbox"/> 2<br>BEAM DIRECTION <input type="checkbox"/> 1 <input checked="" type="checkbox"/> 2 <input checked="" type="checkbox"/> cw <input checked="" type="checkbox"/> ccw<br>FROM L _____ to L _____ INCHES FROM WO _____ to _____<br>ANGLE: <input type="checkbox"/> 0 <input type="checkbox"/> 45 <input type="checkbox"/> 60 <input type="checkbox"/> Other _____ FROM _____ DEG to _____ DEG   | SENSOR PLATE IS 4.5" TI 10.5" FROM C/L OF NOZZLE OD RADIUS. |          |
| <input checked="" type="checkbox"/> NO SCAN<br><input type="checkbox"/> LIMITED SCAN<br>SURFACE <input type="checkbox"/> 1 <input checked="" type="checkbox"/> 2<br>BEAM DIRECTION <input checked="" type="checkbox"/> 1 <input type="checkbox"/> 2 <input checked="" type="checkbox"/> cw <input checked="" type="checkbox"/> ccw<br>FROM L <u>N/A</u> to L <u>N/A</u> INCHES FROM WO <u>C/L</u> to <u>BEYOND</u><br>ANGLE: <input type="checkbox"/> 0 <input type="checkbox"/> 45 <input checked="" type="checkbox"/> 60 <input checked="" type="checkbox"/> Other <u>70°</u> FROM <u>0</u> DEG to <u>360</u> DEG | LIMITED ON NOZZLE C/L OF BLEND RADIUS                       |          |
| <input type="checkbox"/> NO SCAN<br><input type="checkbox"/> LIMITED SCAN<br>SURFACE <input type="checkbox"/> 1 <input type="checkbox"/> 2<br>BEAM DIRECTION <input type="checkbox"/> 1 <input type="checkbox"/> 2 <input type="checkbox"/> cw <input type="checkbox"/> ccw<br>FROM L _____ to L _____ INCHES FROM WO _____ to _____<br>ANGLE: <input type="checkbox"/> 0 <input type="checkbox"/> 45 <input type="checkbox"/> 60 <input type="checkbox"/> Other _____ FROM _____ DEG to _____ DEG  |   |          |

|                                    |                      |  |  |                            |
|------------------------------------|----------------------|--|--|----------------------------|
| Prepared By: <u>David K. Z</u>     | Level: <u>II</u>     | Date: <u>11/1/00</u>                       | Sketch(s) attached <input type="checkbox"/> yes <input checked="" type="checkbox"/> no | Sheet <u>2</u> of <u>4</u> |
| Reviewed By: <u>Larry Traubler</u> | Date: <u>11-2-00</u> | Authorized Inspector: <u>Robert Mettel</u> | Date: <u>11-13-00</u>  |                            |

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

3 of 4

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

5 IN. SQ. x PI - 4.5 IN. SQ. / 4 + .5 / 2 x (3.2 + 3.1) =  
 5.31 SQ. IN.

Volume Calculation

5.31 SQ. IN x 36.625 IN. = 194.48 CU. IN.

**Coverage Calculations**

| Scan # | Angle  | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|--------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 60/70° | CW             | 4.42                   | 36.625                | 161.88                   | 194.48                   | 83.24            |
| 2      | 60/70° | CCW            | 4.42                   | 36.625                | 161.88                   | 194.48                   | 83.24            |
|        |        |                |                        |                       | 323.76                   | 388.96                   | 83.24            |

Item No: B03.140.001

Prepared By: *David K. B.*

Level: II

Date: 11/1/00

Reviewed By: *Larry Mauldin*

Level: III

Date: 11-2-00

# STEAM GENERATOR INLET-OUTLET NOZZLE

I.D. # 156A - TALLEY  
 ITEM# 303,140.001  
 BY: Daniel Z... LEVEL II  
 DATE: 11/1/00

## AREA OF INSPECTION

ABCD + CDGH

$$\frac{5'' R^2 \times \pi - 4.5'' R^2}{4} + \frac{.5''}{2} (3.2' + 3.1') = 5.31 \text{ sq. in.}$$

## AREA LOSS


$$EFGH \quad \frac{.5''}{2} (1.8'' + 1.75'') = .89 \text{ sq. in.}$$

60° & 70° INSPECTED AREA

$$(\text{TOTAL AREA}) 5.31 \text{ sq. in.} - (\text{AREA LOSS}) .89 \text{ sq. in.} = 4.42 \text{ sq. in.}$$

## PERCENT OF COVERAGE

$$\frac{4.42 \text{ sq. in.}}{5.31 \text{ sq. in.}} \times 100 = \underline{\underline{83.2\%}}$$

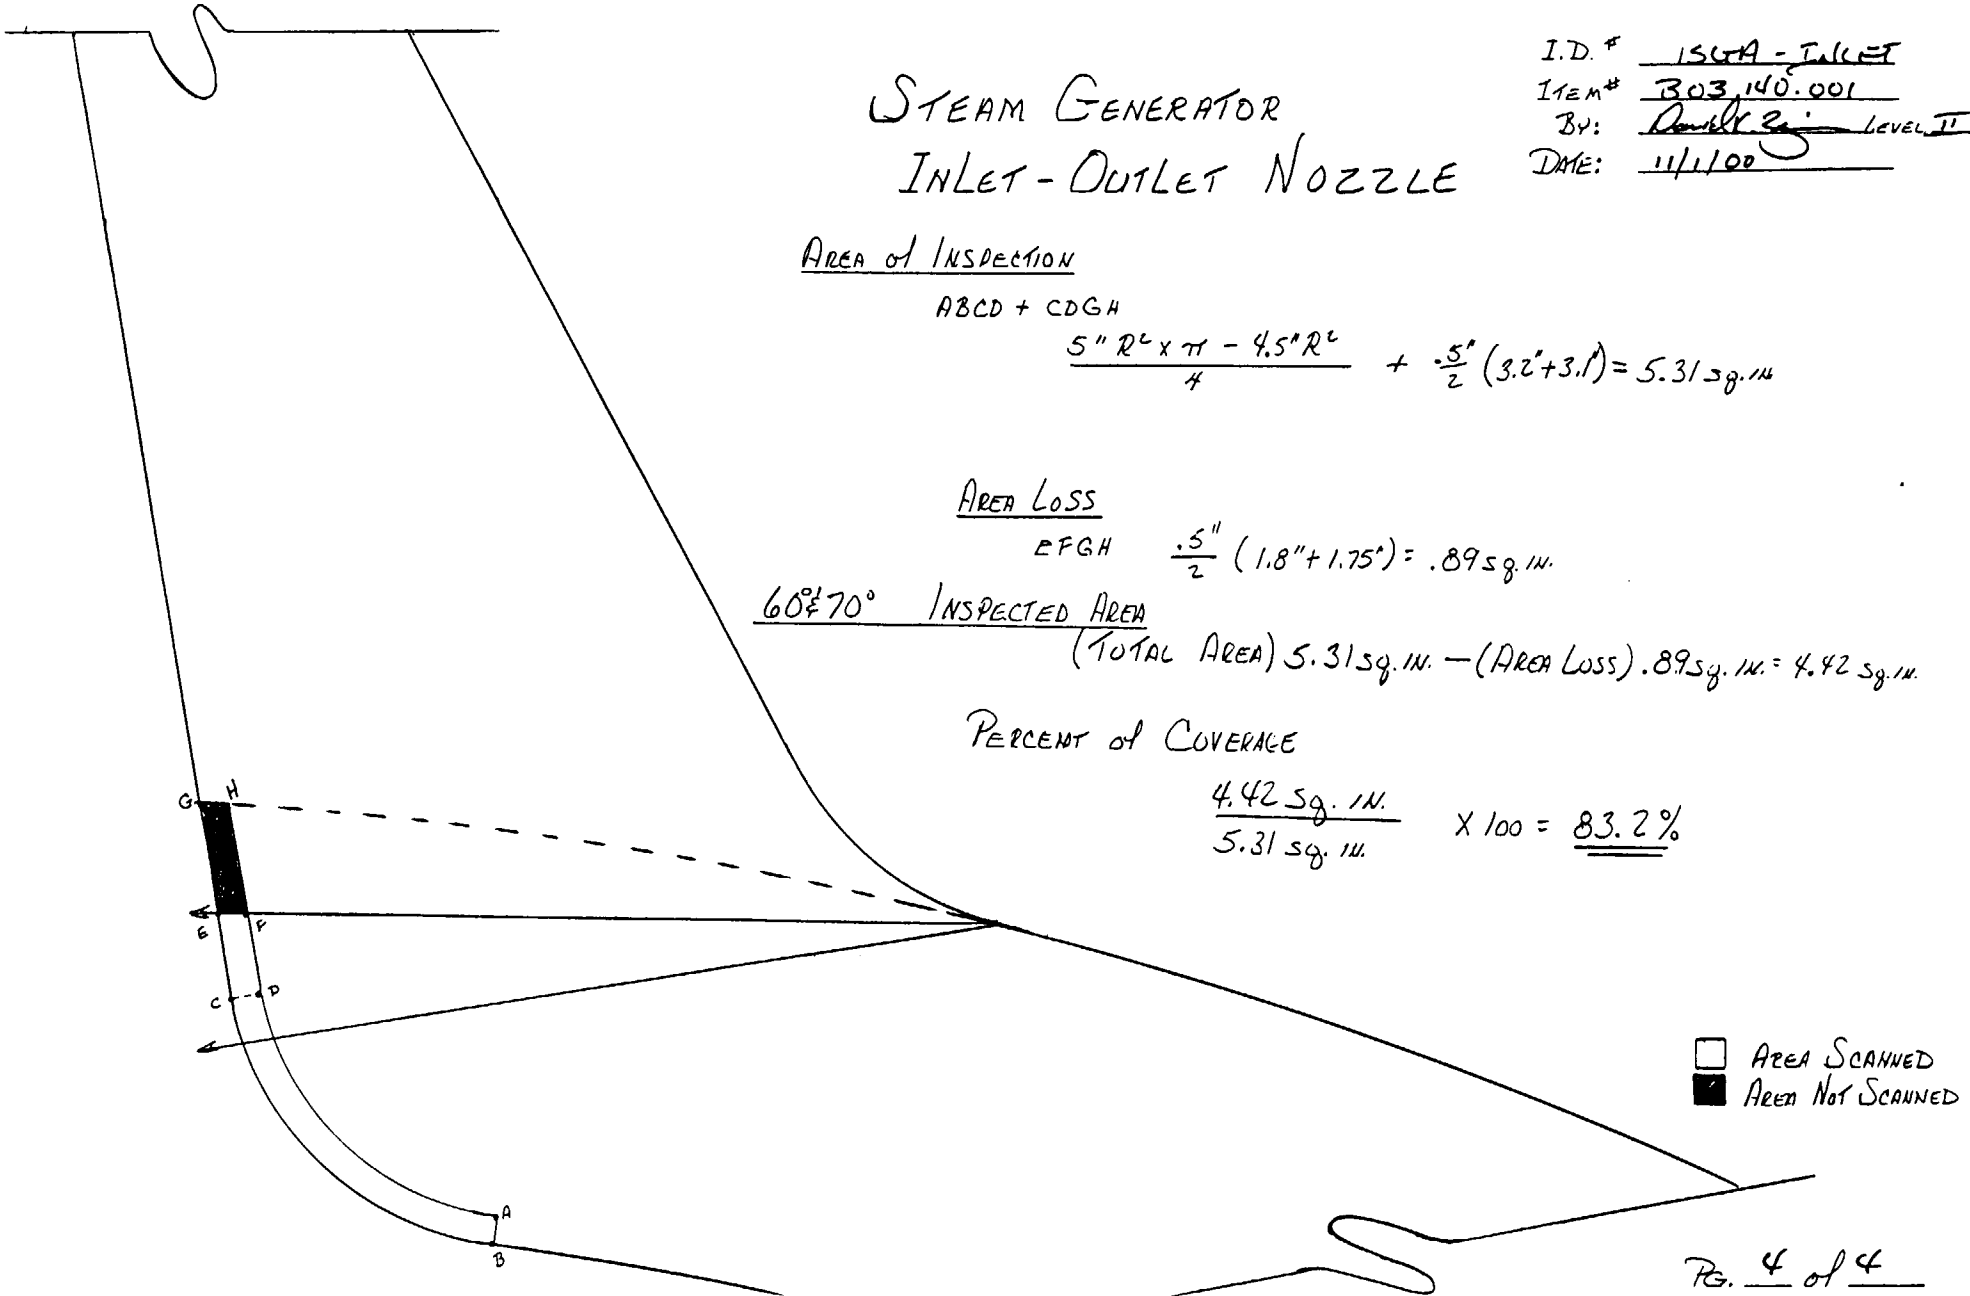

|  |                              |   |   |  |                |
|--|------------------------------|---|---|--|----------------|
| <b>DUKE POWER COMPANY</b>                        |                              |   |   | Exam Start: 1103   | Form NDE-UT-2A |
|  |                              |   |   | <b>ULTRASONIC EXAMINATION DATA SHEET FOR PLANAR REFLECTORS</b> |                |
| Station: Catawba                                 | Unit: 1                      | Component/Weld ID: 1SGA-OUTLET                      |   |  | Date: 11/1/00  |
| Weld Length (in.): 122.5                         | Surface Condition: AS GROUND | Lo: 9.2.3   | Surface Temperature: <u>77</u> ° <u>F</u>             |  |                |
| Examiner: David Zimmerman <i>David Zimmerman</i> | Level: II                    | Scans:  |   | Pyrometer S/N: <u>MCNDE 27010</u>                              |                |
| Examiner: James L. Panel <i>James L. Panel</i>   | Level: II                    | 45 <input type="checkbox"/> _____ dB                | 70 <input checked="" type="checkbox"/> <u>73.5</u> dB | Cal Due: <u>3/27/01</u>  |                |
| Procedure: NDE-680                               | Rev: 2                       | 45T <input type="checkbox"/> _____ dB               | 70T <input type="checkbox"/> _____ dB                 | Configuration: <u>INNER RADIUS</u>                             |                |
|  | FC: N/A                      | 60 <input checked="" type="checkbox"/> <u>59</u> dB |   | <u>S1</u> Flow <u>S2</u>                                       |                |
| Calibration Sheet No:<br>0001050, 0001051        |                              | 60T <input type="checkbox"/> _____ dB               |   | <u>VESSEL</u> to <u>NOZZLE</u>                                 |                |
|  |                              | Other: _____ dB                                     |   | Scan Surface: <u>OD</u>  |                |
|  |                              |   |   | Applies to NDE-680 only  |                |
|  |                              |   |   | Skew Angle: <u>23.0, 23.5</u>                                  |                |

| IND # | Max % Ref | Mp Max | W Max | L Max | L1         | L2         | W1         | Mp1        | W2         | Mp2        | Beam Dir. | Exam Surf. | Scan | Damps |
|-------|-----------|--------|-------|-------|------------|------------|------------|------------|------------|------------|-----------|------------|------|-------|
|       |           |        |       |       | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA |           |            |      |       |
|       |           |        |       |       | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     |           |            |      |       |
|       |           |        |       |       | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    |           |            |      |       |
| NRI   | 60°       |        |       |       |            |            |            |            |            |            |           |            |      |       |
| NRI   | 70°       |        |       |       |            |            |            |            |            |            |           |            |      |       |

|   |                   |                      |   |
|---|-------------------|----------------------|---|
| Remarks:  |                   |                      |   |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |                   |                      | Sheet <u>1</u> of <u>4</u>                      |
| Reviewed By: <i>Larry Mauldin III</i>   | Level: <u>III</u> | Date: <u>11-2-00</u> | Authorized Inspector: <i>Robert M. Sullivan</i> |
|   |                   |                      | Date: <u>11-13-00</u>                           |
|   |                   |                      | Item No: <u>B03.140.002</u>                     |

REQUEST FOR RELIEF # 01-001 ATTACHMENT 3

*AJH 11/21/00*



**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1SGA-OUTLET

Item No: B03.140.002

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L 22.0 to L 42.5 INCHES FROM WO N/A to N/A  
 ANGLE:  0  45  60  Other 70° FROM N/A DEG to N/A DEG

SUPPORT CORNER IS 1.0" FROM C/L OF NOZZLE RADIUS

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

SENSOR PLATE IS 4.5" TI 10.5" FROM C/L OF NOZZLE OD RADIUS.

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L N/A to L N/A INCHES FROM WO C/L to BEYOND  
 ANGLE:  0  45  60  Other 70° FROM 0 DEG to 360 DEG

LIMITED ON NOZZLE C/L OF BLEND RADIUS

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: *David K...*

Level: II

Date: 11/1/00

Sketch(s) attached  yes  no

Sheet 2 of 4

Reviewed By: *Larry ...*

Date: 11-2-00

Authorized Inspector: *Robert McNeil*

Date: 11-13-00

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

3074

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

5 IN. SQ. x PI - 4.5 IN. SQ. / 4 + .5 / 2 x (3.2 + 3.1) =  
 5.31 SQ. IN.

Volume Calculation

5.31 SQ. IN. x 36.625 IN. = 194.48 CU. IN.

**Coverage Calculations**

| Scan # | Angle  | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|--------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 60/70° | CW             | 4.42                   | 36.625                | 161.88                   | 194.48                   | 83.24            |
| 2      | 60/70° | CCW            | 4.42                   | 36.625                | 161.88                   | 194.48                   | 83.24            |
|        |        |                |                        |                       | 323.76                   | 388.96                   | 83.24            |

Item No: B03.140.002

Prepared By: *David K. B.*

Level: *II*

Date: *11/1/00*

Reviewed By: *Larry Mauldin*

Level: *III*

Date: *11.2.00*

STEAM GENERATOR  
INLET - OUTLET NOZZLE

I.D. # 1567A - OUTLET  
 I.E.M.# 303.140.002  
 BY: Douglas J. Leves II  
 DATE: 11/1/02

Area of Inspection

$$ABCD + CDGH = \frac{5'' R^2 \times \pi - 4.5'' R^2}{4} + \frac{5''}{2} (3.2^2 + 3.1^2) = 5.31 \text{ sq. in.}$$

Area Loss


$$EFGH = \frac{.5''}{2} (1.8'' + 1.75'') = .895 \text{ sq. in.}$$

60° ± 70° Inspected Area

$$\text{(Total Area) } 5.31 \text{ sq. in.} - \text{(Area Loss) } .895 \text{ sq. in.} = 4.42 \text{ sq. in.}$$

Percent of Coverage

$$\frac{4.42 \text{ sq. in.}}{5.31 \text{ sq. in.}} \times 100 = \underline{\underline{83.2\%}}$$

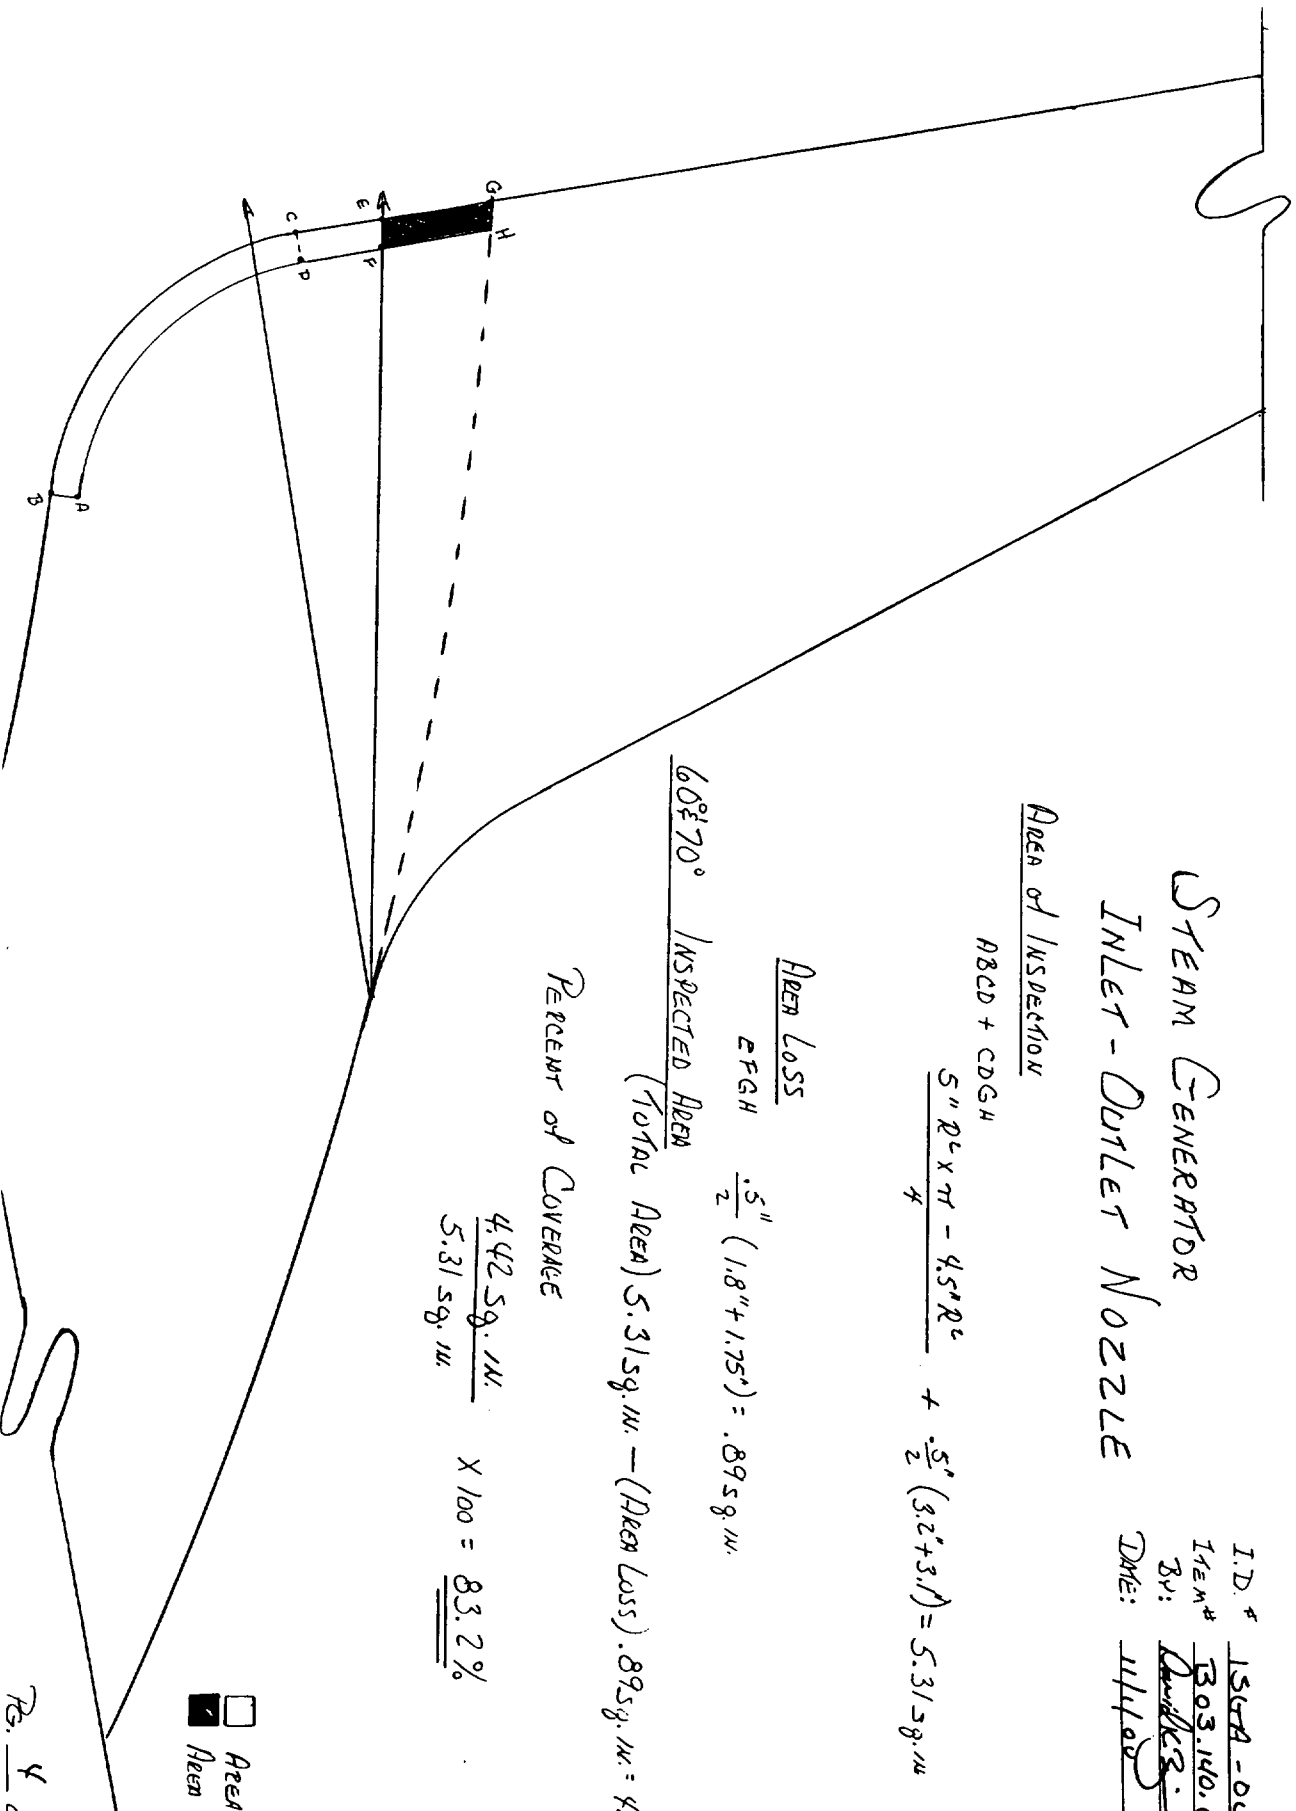

Area Scanned  
 Area Not Scanned

|  |  |                                       |                                    |  |   |                                   |  |
|--|--|---------------------------------------|------------------------------------|--|---|-----------------------------------|--|
| <b>DUKE POWER COMPANY</b>                                |  |                                       |                                    | Exam Start: 1125                                       | Form NDE-UT-2A                            |                                   |  |
|  |  |                                       |                                    | Exam Finish: 1148                                      | Revision 4                                |                                   |  |
| Station: Catawba   |  | Unit: 1                               | Component/Weld ID: 1SGA-INLET-W5SE |  | Date: 10/31/00                            |                                   |  |
| Weld Length (in.): 121.0                                 |  | Surface Condition: AS MACHINED        |                                    | Lo: 9.1.1.1  | Surface Temperature: <u>78</u> ° <u>F</u> |                                   |  |
| Examiner: David Zimmerman <i>David K. Z</i> Level: II    |  | FC: N/A                               |                                    | Scans:   |   |                                   |  |
| Examiner: James L. Panel <i>James L. Panel</i> Level: II |  |                                       |                                    | 45 <input type="checkbox"/> _____ dB                   | 70 <input type="checkbox"/> _____ dB      | Pyrometer S/N: <u>MCNDE 27010</u> |  |
| Procedure: NDE-930 Rev: 1                                |  |                                       |                                    | 45T <input checked="" type="checkbox"/> <u>65.5</u> dB | 70T <input type="checkbox"/> _____ dB     | Cal Due: <u>3/27/01</u>           |  |
| Calibration Sheet No:<br>0001044, 0001045                |  | 60 <input type="checkbox"/> _____ dB  |                                    | Configuration: <u>CIRC.</u>                            |   |                                   |  |
|  |  | 60T <input type="checkbox"/> _____ dB |                                    | <u>S2</u> Flow <u>S1</u>                               |   |                                   |  |
|  |  | Other: <u>33L - 59</u> dB             |                                    | Safe End to Nozzle                                     |   |                                   |  |
|  |  |                                       |                                    | Scan Surface: OD                                       |   |                                   |  |
|  |  |                                       |                                    | Applies to NDE-680 only                                |   |                                   |  |
|  |  |                                       |                                    | Skew Angle: _____                                      |   |                                   |  |

| IND # | Max % Ref                  | Mp Max | W Max | L Max | L1         | L2         | W1         | Mp1        | W2         | Mp2        | Beam Dir | Exam Surf                  | Scan | Damps |
|-------|----------------------------|--------|-------|-------|------------|------------|------------|------------|------------|------------|----------|----------------------------|------|-------|
|       | DO NOT WRITE IN THIS SPACE |        |       |       | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA |          | DO NOT WRITE IN THIS SPACE |      |       |
|       |                            |        |       |       | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     |          |                            |      |       |
|       |                            |        |       |       | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    |          |                            |      |       |
| NRI   | 33°L                       |        |       |       |            |            |            |            |            |            |          |                            |      |       |
| NRI   | 45°L                       |        |       |       |            |            |            |            |            |            |          |                            |      |       |

|   |                   |                       |  |                            |
|---|-------------------|-----------------------|--|----------------------------|
| Remarks:  |                   |                       |  |                            |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |                   |                       |  | Sheet <u>1</u> of <u>4</u> |
| Reviewed By: <i>Larry Traubler</i>  | Level: <u>III</u> | Date: <u>11-14-00</u> | Authorized Inspector: <i>Robert McNeil</i> | Date: <u>11-14-00</u>      |
|   |                   |                       | Item No: <u>B05.070.001</u>                |                            |

*REQUEST FOR RELIEF #01-001 ATTACHMENT 4*

*ASH 11/21/00*

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

**FORM NDE-UT-4**

**Revision 1**

Component/Weld ID: 1SGA-INLET-W5SE

Item No: B05.070.001

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ 0 \_\_\_\_\_ to \_\_\_\_\_ BEYOND \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_ FROM \_\_\_\_\_ 0 \_\_\_\_\_ DEG to \_\_\_\_\_ 360 \_\_\_\_\_ DEG

NOZZLE TO SAFE END CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: *David K. [Signature]*                      Level: *II*                      Date: *11/1/00*

Sketch(s) attached    yes    no                      Sheet 2 of 4

Reviewed By: *Larry Thaulder*                      Date: *11-14-00*

Authorized Inspector: *Robert M. [Signature]*                      Date: *11/14/00*

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

3 of 4

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

1.17 IN. x 2.55 IN. = 2.98 SQ. IN.

Volume Calculation

2.98 SQ. IN. x 119.4 IN. = 355.81 CU. IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 33    | 1              | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
| 2      | 45    | 2              | 0                      | 119.4                 | 0                        | 355.81                   | 0.00             |
| 3      | 45    | CW             | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
| 4      | 45    | CCW            | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
|        |       |                |                        |                       | 1067.43                  | 1423.24                  | 75.00            |

Item No: B05.070.001

Prepared By: *David K. [Signature]*

Level: *II*

Date: *11/1/00*

Reviewed By: *Randy Mauldin*

Level: *III*

Date: *11-14-00*


Subject SAFE END TO NOZZLE

By David K. [Signature] Date 10/31/00  
Checked by Ray Madden Date 11-14-00

Prob No. BOS 070.001

S1

S2

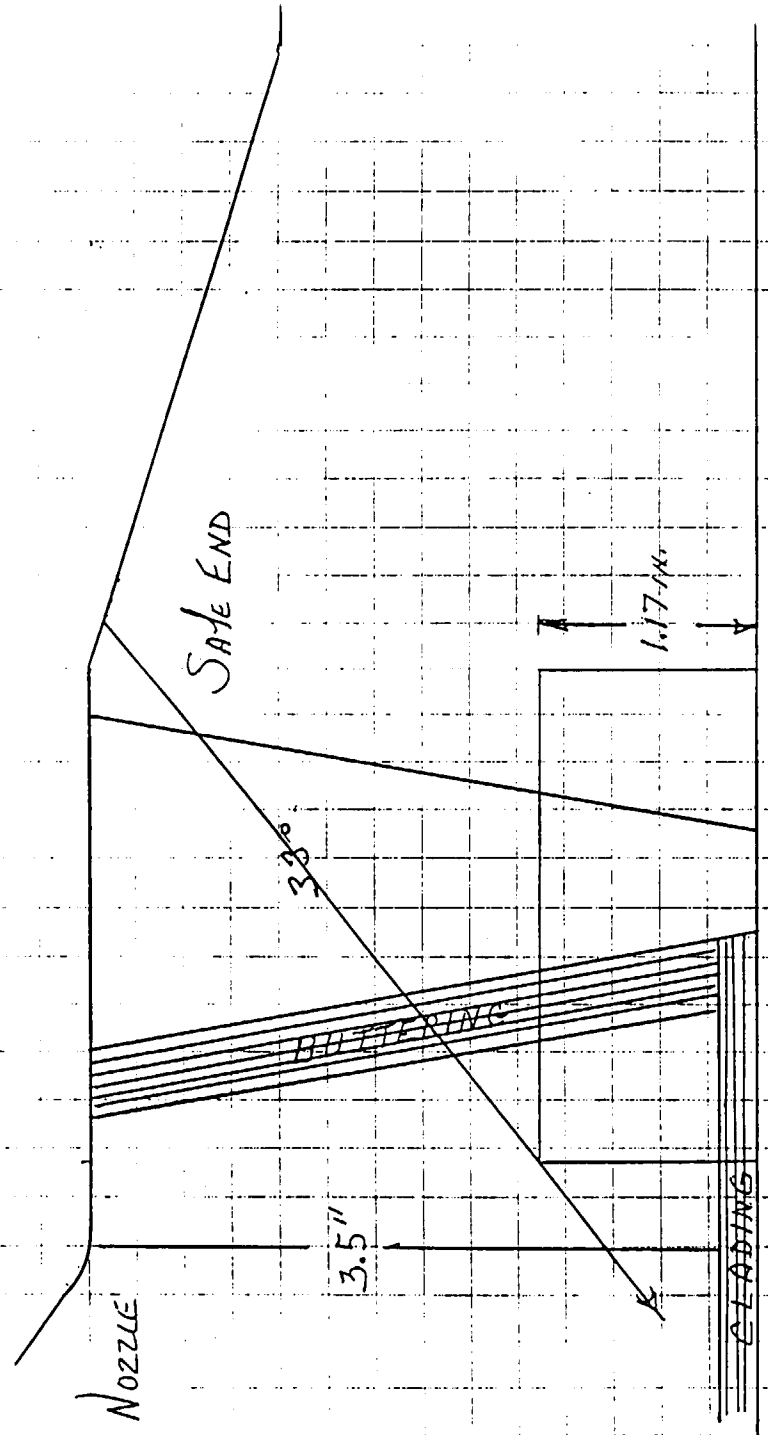

EXAM AREA:

$$1.17 \text{ IN.} \times 2.55 \text{ IN.} = 2.98 \text{ SQ. IN.}$$

|  |                                |  |                                       |                                   |   |                   |                |
|--|--------------------------------|--|---------------------------------------|-----------------------------------|---|-------------------|----------------|
| <b>DUKE POWER COMPANY</b>                                      |                                |  |                                       |                                   |   | Exam Start: 1236  | Form NDE-UT-2A |
| <b>ULTRASONIC EXAMINATION DATA SHEET FOR PLANAR REFLECTORS</b> |                                |  |                                       |                                   |   | Exam Finish: 1259 | Revision 4     |
| Station: Catawba   | Unit: 1                        | Component/Weld ID: 1SGA-OUT-W6SE                       |                                       |                                   |   | Date: 10/31/00    |                |
| Weld Length (in.): 121.0                                       | Surface Condition: AS MACHINED |  | Lo: 9.1.1.1                           |                                   | Surface Temperature: <u>78</u> ° <u>F</u> |                   |                |
| Examiner: David Zimmerman <i>David K Z</i>                     | Level: II                      | Scans:   |                                       | Pyrometer S/N: <u>MCNDE 27010</u> |   |                   |                |
| Examiner: James L. Panel <i>James L Panel</i>                  | Level: II                      | 45 <input type="checkbox"/> _____ dB                   | 70 <input type="checkbox"/> _____ dB  | Cal Due: <u>3/27/01</u>           |   |                   |                |
| Procedure: NDE-930 Rev: 1                                      | FC: N/A                        | 45T <input checked="" type="checkbox"/> <u>65.5</u> dB | 70T <input type="checkbox"/> _____ dB | Configuration: <u>CIRC.</u>       |   |                   |                |
| Calibration Sheet No:<br>0001044, 0001045                      |                                | 60 <input type="checkbox"/> _____ dB                   |                                       | <u>S2</u> Flow <u>S1</u>          |   |                   |                |
|  |                                | 60T <input type="checkbox"/> _____ dB                  |                                       | <u>Nozzle</u> to <u>Safe End</u>  |   |                   |                |
|  |                                | Other: <u>33L - 59</u> dB                              |                                       | Scan Surface: <u>OD</u>           |   |                   |                |
|  |                                |  |                                       | Applies to NDE-680 only           |   |                   |                |
|  |                                |  |                                       | Skew Angle: _____                 |   |                   |                |

| IND # | Max % Ref | Mp Max | W Max | L Max | L1            | L2            | W1            | Mp1           | W2            | Mp2           | Beam Dir | Exam Surf | Scan | Damps |
|-------|-----------|--------|-------|-------|---------------|---------------|---------------|---------------|---------------|---------------|----------|-----------|------|-------|
|       |           |        |       |       | 20%dac<br>HMA | 20%dac<br>HMA | 20%dac<br>HMA | 20%dac<br>HMA | 20%dac<br>HMA | 20%dac<br>HMA |          |           |      |       |
|       |           |        |       |       | 50%dac        | 50%dac        | 50%dac        | 50%dac        | 50%dac        | 50%dac        |          |           |      |       |
|       |           |        |       |       | 100%dac       | 100%dac       | 100%dac       | 100%dac       | 100%dac       | 100%dac       |          |           |      |       |
| NRI   | 33°L      |        |       |       |               |               |               |               |               |               |          |           |      |       |
| NRI   | 45°L      |        |       |       |               |               |               |               |               |               |          |           |      |       |

|   |                   |                       |  |
|---|-------------------|-----------------------|--|
| Remarks:  |                   |                       |  |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |                   |                       | Sheet <u>1</u> of <u>4</u>                                       |
| Reviewed By: <i>Larry Mauldin</i>   | Level: <u>III</u> | Date: <u>11-14-00</u> | Authorized Inspector: <i>Robert McMill</i> Date: <u>11-14-00</u> |
|   |                   |                       | Item No: B05.070.002   |

*REQUEST FOR RELIEF # 01-001 ATTACHMENT 5*



**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1SGA-OUT-W6SE

Item No: B05.070.002

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ 0 \_\_\_\_\_ to \_\_\_\_\_ BEYOND \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ 0 \_\_\_\_\_ DEG to \_\_\_\_\_ 360 \_\_\_\_\_ DEG

NOZZLE TO SAFE-END CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: David K. 3                      Level: II                      Date: 11/1/00

Sketch(s) attached  yes  no                      Sheet 2 of 4

Reviewed By: Larry Mauldin                      Date: 11-14-00

Authorized Inspector: Robert McNeil                      Date: 11.14.00

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

3 of 4

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

1.17 IN. x 2.55 IN. = 2.98 SQ. IN.

Volume Calculation

2.98 SQ. IN. x 119.4 IN. = 255.81 CU. IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 33    | 2              | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
| 2      | 45    | 1              | 0                      | 119.4                 | 0                        | 355.81                   | 0.00             |
| 3      | 45    | CW             | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
| 4      | 45    | CCW            | 2.98                   | 119.4                 | 355.81                   | 355.81                   | 100.00           |
|        |       |                |                        |                       | 1067.43                  | 1423.24                  | 75.00            |

Item No: B05.070.002

Prepared By: *David K. B.*

Level: *II*


Date: *11/1/00*

Reviewed By: *Larry Mauldin*

Level: *III*

Date: *11-14-00*

Prob No. B05.070.002 By David K. B. Date 10/31/00  
Checked by Rory Truitt Date 11-14-00

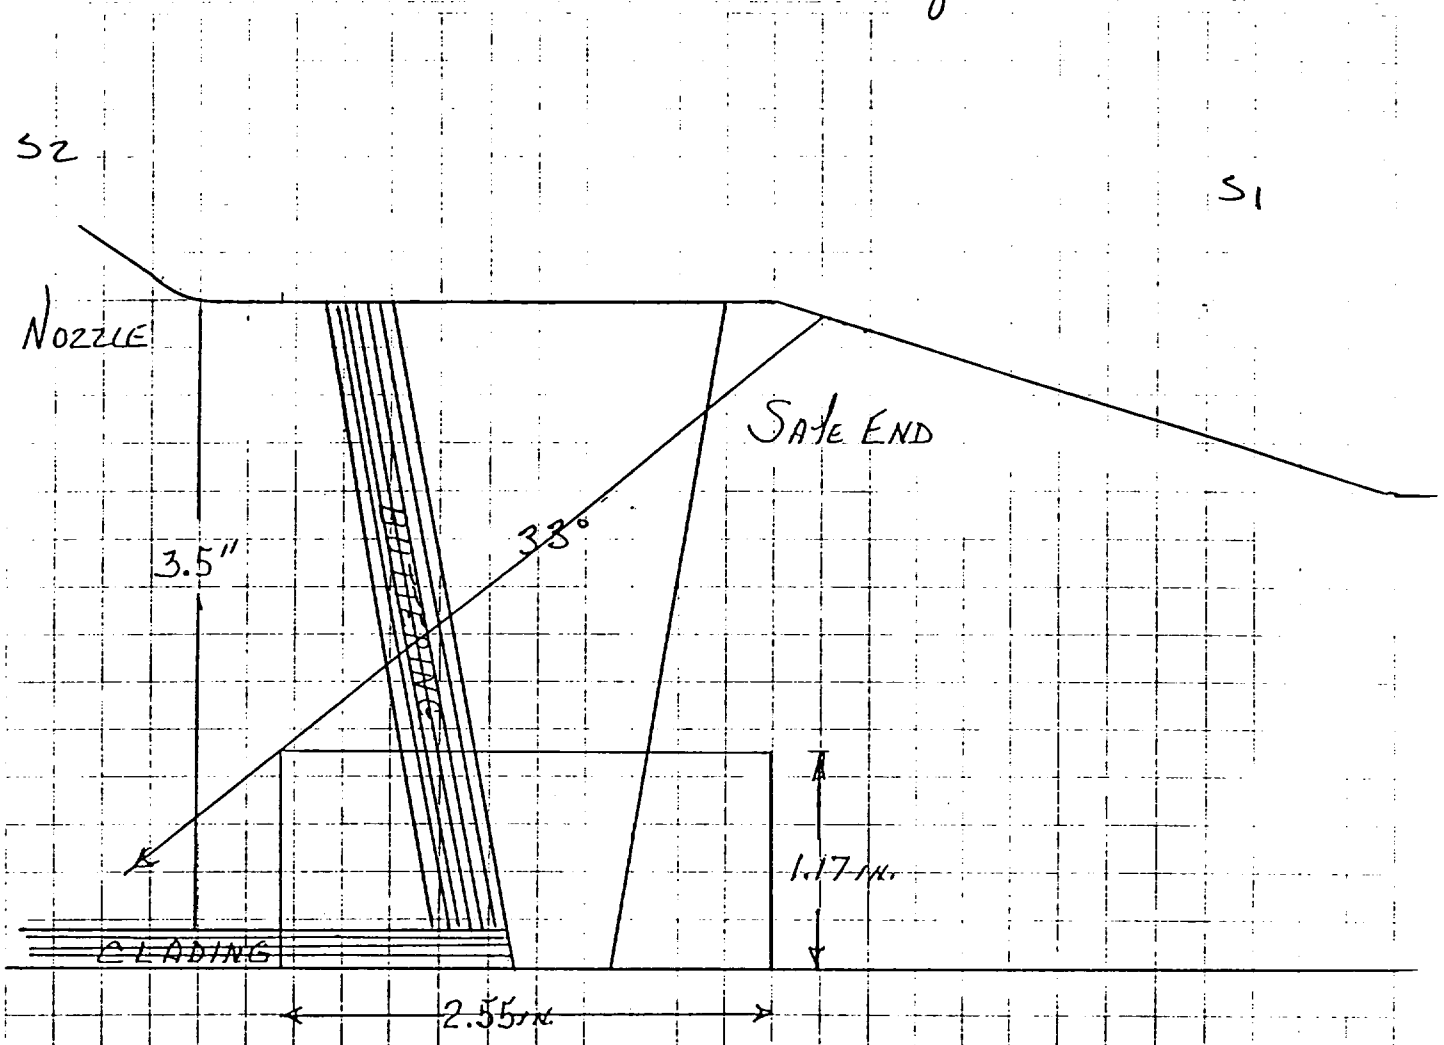

EXAM AREA:

$$1.17 \text{ IN.} \times 2.55 \text{ IN.} = 2.98 \text{ SQ. IN.}$$

| DUKE POWER COMPANY                                       |                            |                          |                          |                               |                           |                           |                          |  |                           | Exam Start: 1219         |                           | NDE-UT-3A     |       |  |
|--|----------------------------|--------------------------|--------------------------|-------------------------------|---------------------------|---------------------------|--------------------------|--|---------------------------|--------------------------|---------------------------|---------------|-------|--|
| ULTRASONIC EXAMINATION DATA SHEET FOR LAMINAR REFLECTORS |                            |                          |                          |                               |                           |                           |                          |  |                           | Exam Finish: 1221        |                           | Revision 2    |       |  |
| Station: Catawba   |                            |                          | Unit: 1                  |                               | Component/Weld ID: 1NS1-1 |                           |                          |  |                           | Date: 10/25/00           |                           |               |       |  |
| Nominal Material Thickness (in): 0.5                     |                            |                          |                          | Weld Length (in.): 33.8       |                           |                           |                          | Surface Temperature: 82° Deg F                             |                           |                          |                           |               |       |  |
| Measured Material Thickness (in): .462                   |                            |                          |                          | Lo: 9.1.1.4                   |                           |                           |                          | Pyrometer S/N: MCNDE 27205                                 |                           |                          |                           |               |       |  |
| Surface Condition: AS GROUND                             |                            |                          |                          | Calibration Sheet No: 0001031 |                           |                           |                          | Cal Due: 1/17/01   |                           |                          |                           |               |       |  |
| Examiner: David Zimmerman <i>David K. Z</i> Level: II    |                            |                          |                          |                               |                           |                           |                          | Configuration: CIRC. WELD<br>S2 Flow S1<br>Reducer to Pipe |                           |                          |                           |               |       |  |
| Examiner: Gary J. Moss <i>Gary J. Moss</i> Level: II     |                            |                          |                          |                               |                           |                           |                          |  |                           |                          |                           |               |       |  |
| Procedure: NDE-640 Rev: 1 FC: *                          |                            |                          |                          |                               |                           |                           |                          |  |                           |                          |                           |               |       |  |
| IND NO.  | Ampl<br>≥ rem<br>BW<br>LOB | L1<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB | Mp1<br>≥ rem<br>BW<br>LOB     | W2<br>≥ rem<br>BW<br>LOB  | Mp2<br>≥ rem<br>BW<br>LOB | L2<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB                                   | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB | Mp2<br>≥ rem<br>BW<br>LOB | Exam<br>Surf. | Damps |  |
| NRI  | 0°                         |                          |                          |                               |                           |                           |                          |  |                           |                          |                           |               |       |  |

|                                   |  |  |                   |  |  |  |                       |  |  |                             |  |                      |  |
|-----------------------------------|--|--|-------------------|--|--|--|-----------------------|--|--|-----------------------------|--|----------------------|--|
| Remarks: *FC 95-18, 95-19         |  |  |                   |  |  |  |                       |  |  |                             |  |                      |  |
|                                   |  |  |                   |  | Limitations: see NDE-UT-4 <input type="checkbox"/> None: <input checked="" type="checkbox"/> |  |                       |  |  | Sheet <u>1</u> of <u>35</u> |  |                      |  |
| Reviewed By: <i>Larry Mauldin</i> |  |  | Level: <i>III</i> |  | Date: <i>11-1-00</i>   |  | Authorized Inspector: |  |  | Date:                       |  | Item No: C05.011.201 |  |


REQUEST FOR RELIEF #01-001 ATTACHMENT 6

*ASH 11/29/00*

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

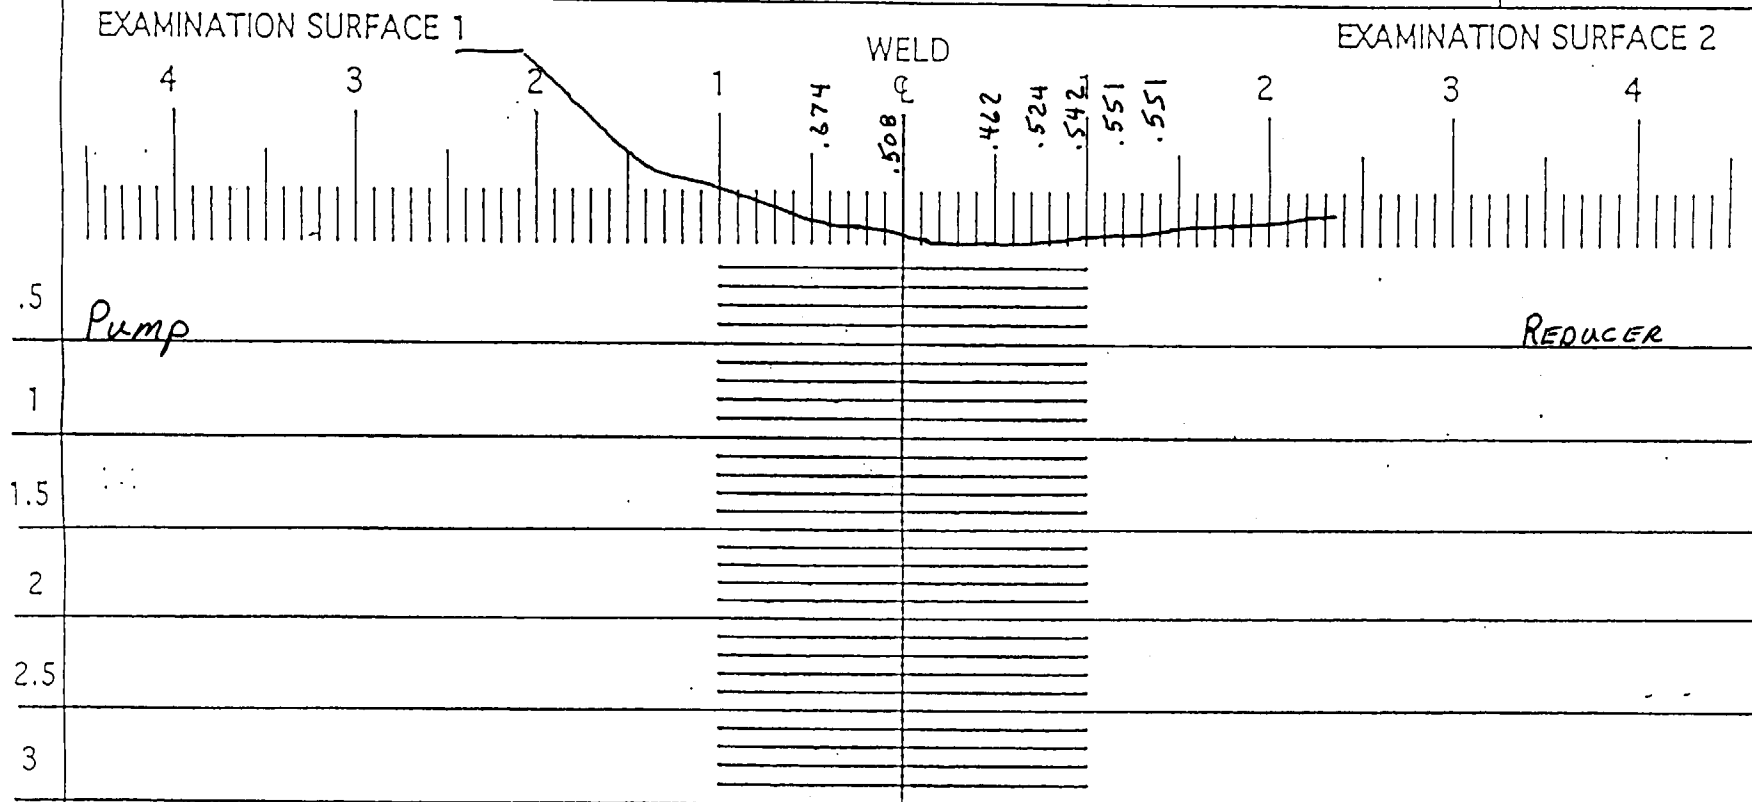

Component ID/Weld No. 1NS1-1

Remarks:

Examiner: Gary Bloss

Reviewed By: Larry Thauler


Authorized Inspector:

Item No: C05.011.201

Level: II Date: 10-26-00

Level: III Date: 11-1-00

Date:

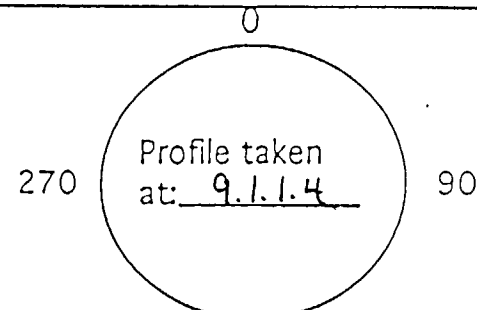

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1NS1-1

Item No: C05.011.201

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L   N/A   to L   N/A                        INCHES FROM WO   0   to   BEYOND    
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM   0   DEG to   360   DEG

DUE TO PUMP CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: Gay Moss                      Level: II                      Date: 10-25-00                      Sketch(s) attached  yes  no                      Sheet 3 of 5

Reviewed By: Randy Maulder                      Date: 11-1-00                      Authorized Inspector: Robert McCall                      Date: 11-13-00

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

4/15

**Examination Volume/Area Defined**

Base Metal       Weld       Near Surface       Bolting       Inner Radius

Area Calculation

1.0 IN. x .167 IN. = .167 SQ. IN.

Volume Calculation

.167 SQ. IN. x 33.8 IN. = 5.65 CU. IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 45°   | CW             | .167                   | 33.8                  | 5.65                     | 5.65                     | 100.00           |
| 2      | 45°   | CCW            | .167                   | 33.8                  | 5.65                     | 5.65                     | 100.00           |
| 3      | 60°   | S1             | .067                   | 33.8                  | 2.26                     | 5.65                     | 40.00            |
| 4      | 60°   | S2             | 0                      | 33.8                  | 0                        | 5.65                     | 0.00             |
|        | SHEAR | WAVE           | AGGREGATE              | COVERAGE              | 13.56                    | 22.6                     | 60.00            |
| 3      | 60RL  | S1             | 0.10                   | 33.8                  | 3.38                     | 5.65                     | 59.82            |

RL WAVE COVERAGE 59.8% x 25% (1 SCAN) = 14.95 = 15%

Item No: C05.011.201

Prepared By: *Daryl K. Z...* Level: II Date: 10/25/00

Reviewed By: *Larry Mauldin* Level: III Date: 11-1-00

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET


NDE-UT-5

Revision 1

EXAMINATION SURFACE 1

EXAMINATION SURFACE 2

WELD

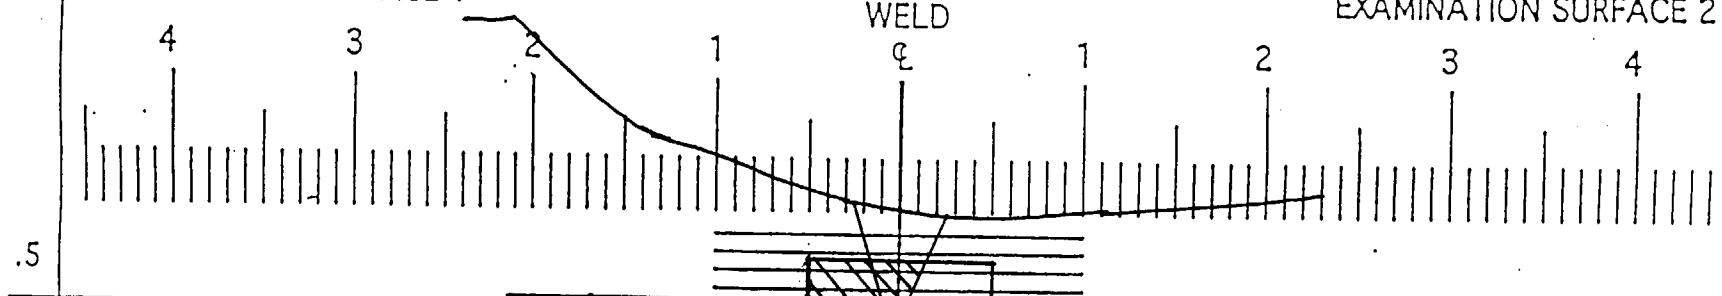

1 TOTAL AREA OF INTEREST

$$1.0 \text{ in} \times .167 \text{ in} = .167 \text{ in}^2$$

1.5

2 AREA INSPECTED - 60° SHEAR

$$2.5 \left( \frac{.35 \text{ in} + .45 \text{ in}}{2} \right) .167 \text{ in} = 0.067 \text{ in}^2$$

SUPPLEMENTAL COVERAGE - 60° RL

$$\left( \frac{.65 \text{ in} + .55 \text{ in}}{2} \right) .167 \text{ in} = 0.100 \text{ in}^2$$

3

Component ID/Weld No.

WS1-1

Remarks: LIMITED CALCULATION

Item No: C05.011.201

Examiner: David L. Z...

Level: II

Date: 10/25/00


Reviewed By: Larry Mauldin

Level: III

Date: 11-1-00

Authorized Inspector Robert McMill

Date: 11-13-00

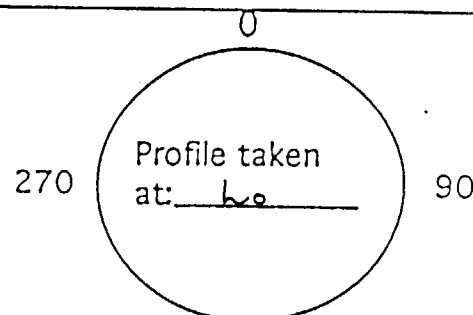

180 Sheet 5 of 5



| DUKE POWER COMPANY   |                            |                          |  |                               |                           |                           |                                |                          |                           | Exam Start: 1216         |                           | NDE-UT-3A  |       |  |
|--|----------------------------|--------------------------|--|-------------------------------|---------------------------|---------------------------|--------------------------------|--------------------------|---------------------------|--------------------------|---------------------------|------------|-------|--|
| ULTRASONIC EXAMINATION DATA SHEET FOR LAMINAR REFLECTORS   |                            |                          |  |                               |                           |                           |                                |                          |                           | Exam Finish: 1219        |                           | Revision 2 |       |  |
| Station: Catawba   |                            |                          | Unit: 1  |                               | Component/Weld ID: 1NS1-2 |                           |                                |                          |                           | Date: 10/25/00           |                           |            |       |  |
| Nominal Material Thickness (in): 0.5                       |                            |                          |  | Weld Length (in.): 40.0       |                           |                           | Surface Temperature: 82° Deg F |                          |                           |                          |                           |            |       |  |
| Measured Material Thickness (in): .458                     |                            |                          |  | Lo: 9.1.1.4                   |                           |                           | Pyrometer S/N: MCNDE 27205     |                          |                           |                          |                           |            |       |  |
| Surface Condition: AS GROUND                               |                            |                          |  | Calibration Sheet No: 0001032 |                           |                           | Cal Due: 1/17/01               |                          |                           |                          |                           |            |       |  |
| Examiner: David Zimmerman <i>David Zimmerman</i> Level: II |                            |                          | Configuration: CIRC. WELD<br>S2 Flow S1<br><u>FLANGE</u> to <u>REDUCER</u> |                               |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| Examiner: Gary J. Moss <i>Gary J. Moss</i> Level: II       |                            |                          |  |                               |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| Procedure: NDE-640 Rev: 1 FC: *                            |                            |                          |  |                               |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| IND NO.  | Ampl<br>≥ rem<br>BW<br>LOB | L1<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB   | Mp1<br>≥ rem<br>BW<br>LOB     | W2<br>≥ rem<br>BW<br>LOB  | Mp2<br>≥ rem<br>BW<br>LOB | L2<br>≥ rem<br>BW<br>LOB       | W1<br>≥ rem<br>BW<br>LOB | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB | Mp2<br>≥ rem<br>BW<br>LOB | Exam Surf. | Damps |  |
| NRI  | 0°                         |                          |  |                               |                           |                           |                                |                          |                           |                          |                           |            |       |  |

|                                   |  |  |                  |  |  |  |                       |  |  |                            |  |                      |  |  |
|-----------------------------------|--|--|------------------|--|--|--|-----------------------|--|--|----------------------------|--|----------------------|--|--|
| Remarks: *FC 95-18, 95-19         |  |  |                  |  |  |  |                       |  |  |                            |  |                      |  |  |
|                                   |  |  |                  |  | Limitations: see NDE-UT-4 <input type="checkbox"/> None: <input checked="" type="checkbox"/> |  |                       |  |  | Sheet <u>1</u> of <u>5</u> |  |                      |  |  |
| Reviewed By: <i>Randy Maulder</i> |  |  | Level: <i>II</i> |  | Date: <i>11-1-00</i>   |  | Authorized Inspector: |  |  | Date:                      |  | Item No: C05.011.202 |  |  |

*REQUEST FOR RELIEF #01-001 ATTACHMENT 7*

*AJH 11/29/00*

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET


NDE-UT-5

Revision 1

EXAMINATION SURFACE 1

WELD

EXAMINATION SURFACE 2

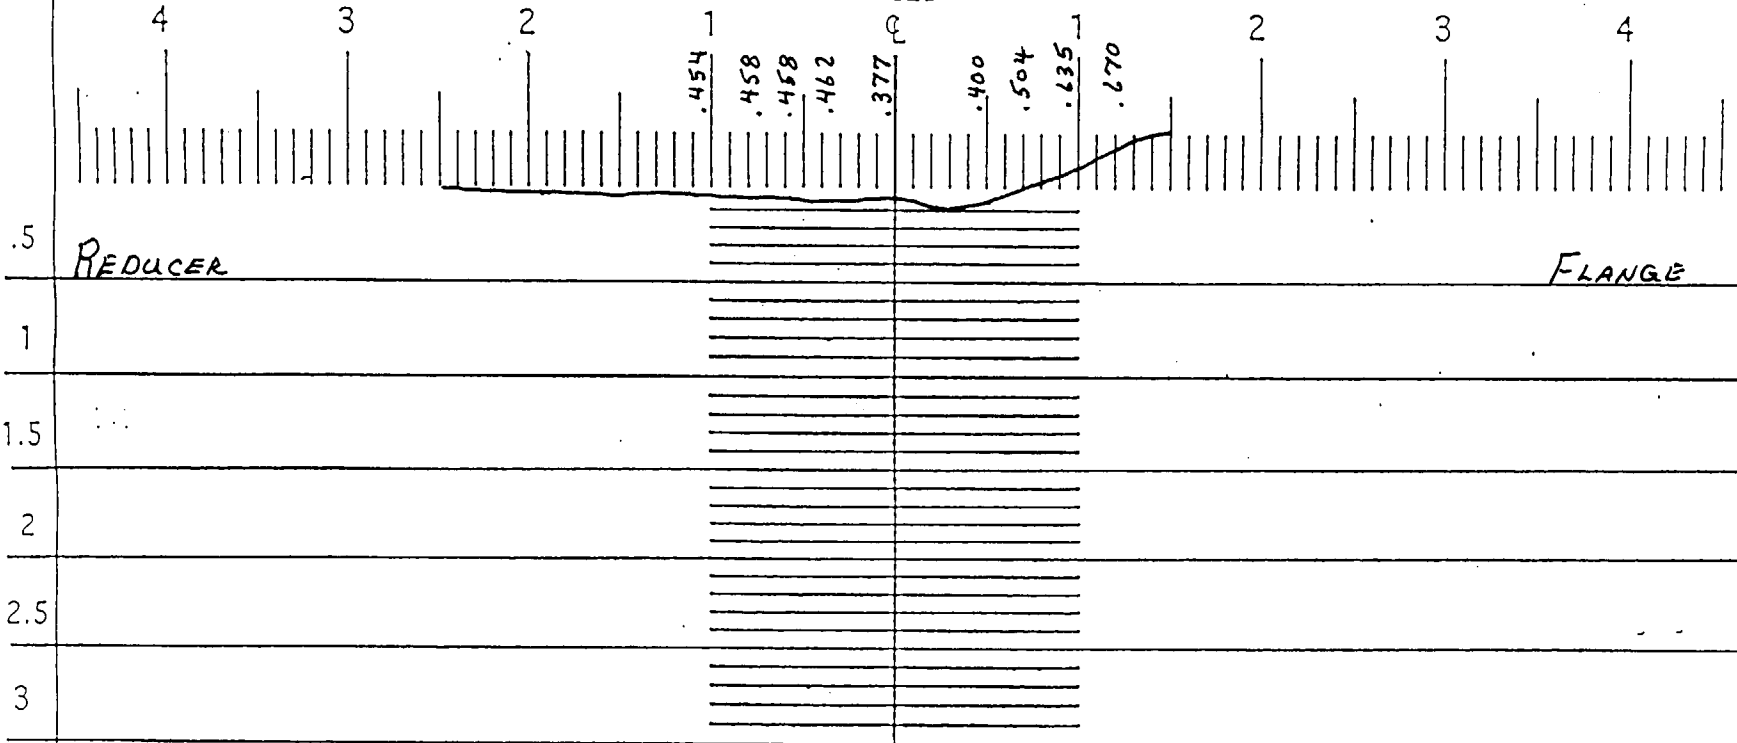

Component ID/Weld No. INS1-2


: Remarks:

Item No: C05.011.202

Examiner: Gary Moss Level: II Date: 10-25-00

Reviewed By: Larry Mauldin Level: III Date: 11-1-00

Authorized Inspector: \_\_\_\_\_ Date: \_\_\_\_\_

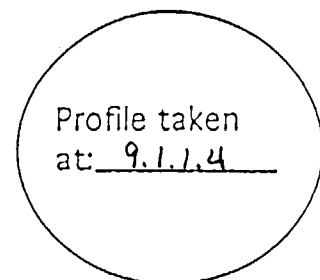

180 Sheet 2 of 5

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1NS1-2

Item No: C05.011.202

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L   N/A   to L   N/A   INCHES FROM WO   0   to   BEYOND    
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM   0   DEG to   360   DEG

DUE TO FLANGE CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_ INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_ FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: Gay Moss                      Level: II                      Date: 10-25-00                      Sketch(s) attached  yes  no                      Sheet 3 of 5

Reviewed By: Randy Haubler                      Date: 11-1-00                      Authorized Inspector: Robert McMillin                      Date: 11-13-00

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

4/9/5

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

.9 x .153 = .138 SQ. IN

Volume Calculation

.138 SQ. IN. x 40 IN. = 5.52 CU. IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 45    | CW             | .138                   | 40                    | 5.52                     | 5.52                     | 100.00           |
| 2      | 45    | CCW            | .138                   | 40                    | 5.52                     | 5.52                     | 100.00           |
| 3      | 60    | S2             | .050                   | 40                    | 2                        | 5.52                     | 36.23            |
| 4      | 60    | S1             | 0                      | 40                    | 0                        | 5.52                     | 0.00             |
|        | SHEAR | WAVE           | AGGREGATE              | COVERAGE              | 13.04                    | 22.08                    | 59.06            |
| 3      | 60RL  | S1             | .088                   | 40                    | 3.52                     | 5.52                     | 63.77            |

RL WAVE COVERAGE 64% x 25% (1 SCAN) = 16% OF TOTAL WELD.

Item No: C05.011.202

Prepared By: *Mary Moss*

Level: *IB*

Date: *10-25-00*

Reviewed By: *Larry Mauldin*


Level: *III*

Date: *11-1-00*

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

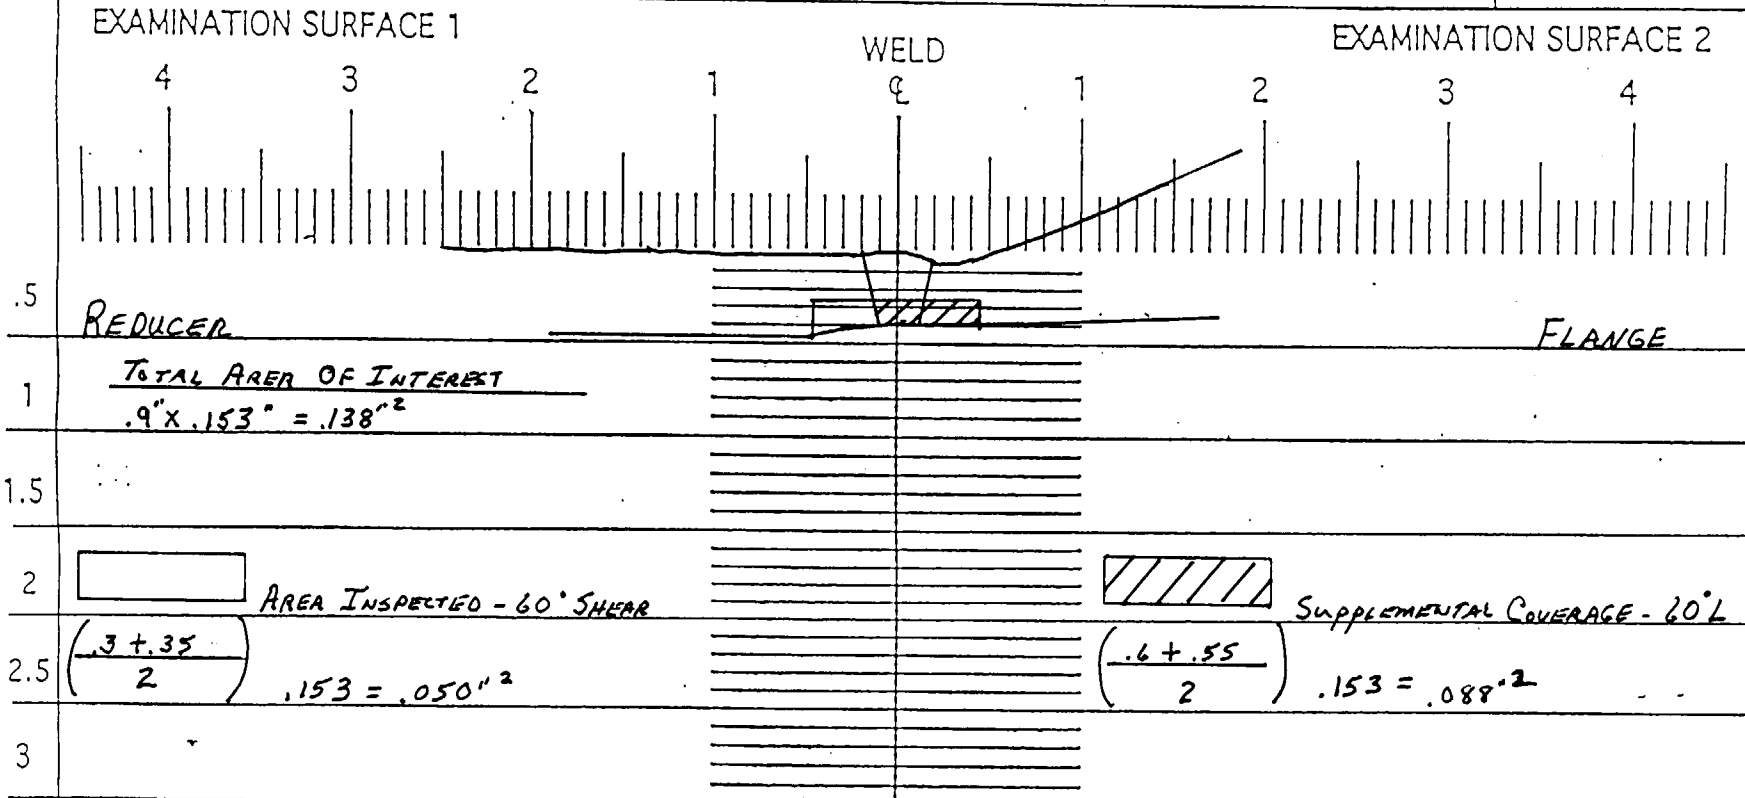

Component ID/Weld No. 1N51-2

: Remarks:


\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

Item No: C05.011.202

|  |                   |                       |
|--|-------------------|-----------------------|
| Examiner: <u>David G. B.</u>               | Level: <u>II</u>  | Date: <u>10/25/00</u> |
| Reviewed By: <u>Larry Mauldin</u>          | Level: <u>III</u> | Date: <u>11-1-00</u>  |
| Authorized Inspector: <u>Robert McMill</u> |                   | Date: <u>11-13-00</u> |

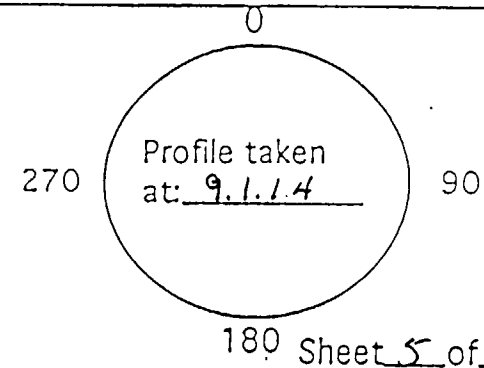

| DUKE POWER COMPANY   |                            |                          |   |                                  |                           |                           |                                |                          |                           | Exam Start: 1123         |                           | NDE-UT-3A  |       |  |
|--|----------------------------|--------------------------|---|----------------------------------|---------------------------|---------------------------|--------------------------------|--------------------------|---------------------------|--------------------------|---------------------------|------------|-------|--|
| ULTRASONIC EXAMINATION DATA SHEET FOR LAMINAR REFLECTORS   |                            |                          |   |                                  |                           |                           |                                |                          |                           | Exam Finish: 1128        |                           | Revision 2 |       |  |
| Station: Catawba   |                            |                          | Unit: 1   |                                  | Component/Weld ID: 1NS2-1 |                           |                                |                          |                           | Date: 10/25/00           |                           |            |       |  |
| Nominal Material Thickness (in): 0.375                     |                            |                          |   | Weld Length (in.): 40.0          |                           |                           | Surface Temperature: 82° Deg F |                          |                           |                          |                           |            |       |  |
| Measured Material Thickness (in): .377                     |                            |                          |   | Lo: 9.1.1.1                      |                           |                           | Pyrometer S/N: MCNDE 27205     |                          |                           |                          |                           |            |       |  |
| Surface Condition: AS GROUND                               |                            |                          |   | Calibration Sheet No:<br>0001033 |                           |                           | Cal Due: 1/17/01               |                          |                           |                          |                           |            |       |  |
| Examiner: David Zimmerman <i>David Zimmerman</i> Level: II |                            |                          | Configuration: <u>CIRC. WELD</u><br><u>S2</u> Flow <u>S1</u><br><u>VALVE</u> to <u>PIPE</u> |                                  |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| Examiner: Gary J. Moss <i>Gary J. Moss</i> Level: II       |                            |                          |   |                                  |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| Procedure: NDE-640 Rev: 1 FC: *                            |                            |                          |   |                                  |                           |                           |                                |                          |                           |                          |                           |            |       |  |
| IND NO.  | Ampl<br>≥ rem<br>BW<br>LOB | L1<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB  | Mp1<br>≥ rem<br>BW<br>LOB        | W2<br>≥ rem<br>BW<br>LOB  | Mp2<br>≥ rem<br>BW<br>LOB | L2<br>≥ rem<br>BW<br>LOB       | W1<br>≥ rem<br>BW<br>LOB | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB | Mp2<br>≥ rem<br>BW<br>LOB | Exam Surf. | Damps |  |
| NRI  | 0°                         |                          |   |                                  |                           |                           |                                |                          |                           |                          |                           |            |       |  |

|                                   |  |  |                   |  |                      |  |                       |  |  |  |  |                            |  |
|-----------------------------------|--|--|-------------------|--|----------------------|--|-----------------------|--|--|--|--|----------------------------|--|
| Remarks: *FC 95-18, 95-19         |  |  |                   |  |                      |  |                       |  |  |  |  |                            |  |
|                                   |  |  |                   |  |                      |  |                       |  |  | Limitations: see NDE-UT-4 <input checked="" type="checkbox"/> None: <input type="checkbox"/> |  | Sheet <u>1</u> of <u>5</u> |  |
| Reviewed By: <i>Larry Mauldin</i> |  |  | Level: <u>III</u> |  | Date: <u>11-1-00</u> |  | Authorized Inspector: |  |  | Date:  |  | Item No:<br>C05.011.203    |  |

REQUEST FOR RELIEF #01-001 ATTACHMENT 8

ASH  
11/29/00

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET


NDE-UT-5

Revision 1

EXAMINATION SURFACE 1

WELD

EXAMINATION SURFACE 2

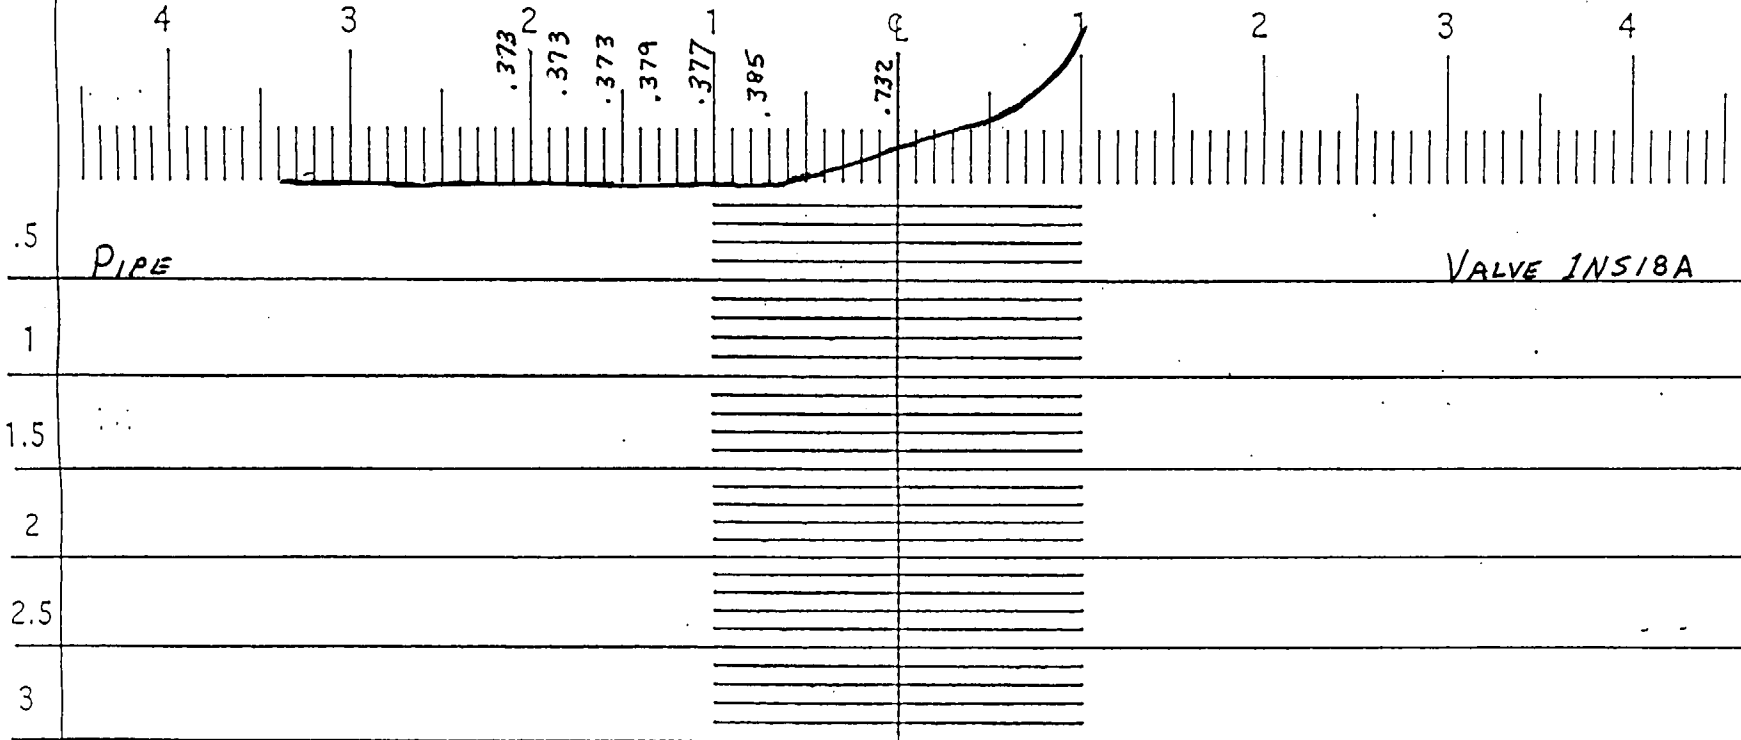

Component ID/Weld No. 1N52-1

: Remarks:

Item No: C05.011.203

Examiner: Sam Moss

Level: II

Date: 10-25-00


Reviewed By: Sam Mauldin

Level: III

Date: 11-1-00

Authorized Inspector: o

Date:

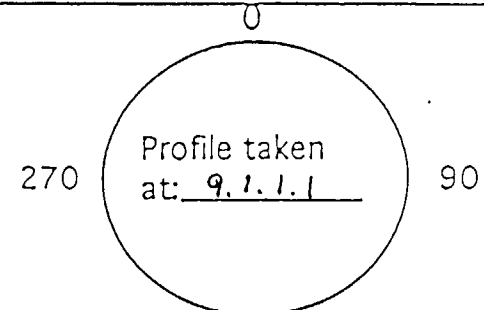

180 Sheet 2 of 5

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

**FORM NDE-UT-4**

**Revision 1**

Component/Weld ID: 1NS2-1

Item No: C05.011.203

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L   N/A   to L   N/A                        INCHES FROM WO   0   to   BEYOND    
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM   0   DEG to   360   DEG

DUE TO VALVE CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: Gay Moss                      Level: B                      Date: 10-25-00

Sketch(s) attached  yes  no                      Sheet 3 of 5

Reviewed By: Ray Mauldin                      Date: 11-1-00

Authorized Inspector: Robert M. [Signature]                      Date: 11-13-00



**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

40/5

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

$.60 \times .10 / 2 + .2 \times .1 = .230 \text{ SQ. IN.}$

Volume Calculation

$.230 \text{ SQ. IN.} \times 40.0 \text{ IN.} = 9.2 \text{ CU. IN.}$

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 45    | CW             | .23                    | 40                    | 9.2                      | 9.2                      | 100.00           |
| 2      | 45    | CCW            | .23                    | 40                    | 9.2                      | 9.2                      | 100.00           |
| 3      | 60    | S1             | 0                      | 40                    | 0                        | 9.2                      | 0.00             |
| 4      | 60    | S2             | .075                   | 40                    | 3                        | 9.2                      | 32.61            |
|        | SHEAR | WAVE           | AGGREGATE              | COVERAGE              | 21.4                     | 36.8                     | 58.15            |
| 4      | 60RL  | S2             | .155                   | 40                    | 6.2                      | 9.2                      | 67.39            |

RL WAVE COVERAGE 67.4% x 25% (1 SCAN) = 16.85% OF TOTAL WELD.

Item No: C05.011.203

Prepared By:

*David K. [Signature]*

Level: II

Date:

10/25/00

Reviewed By:

*Larry [Signature]*


Level: III

Date: 11-1-00

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

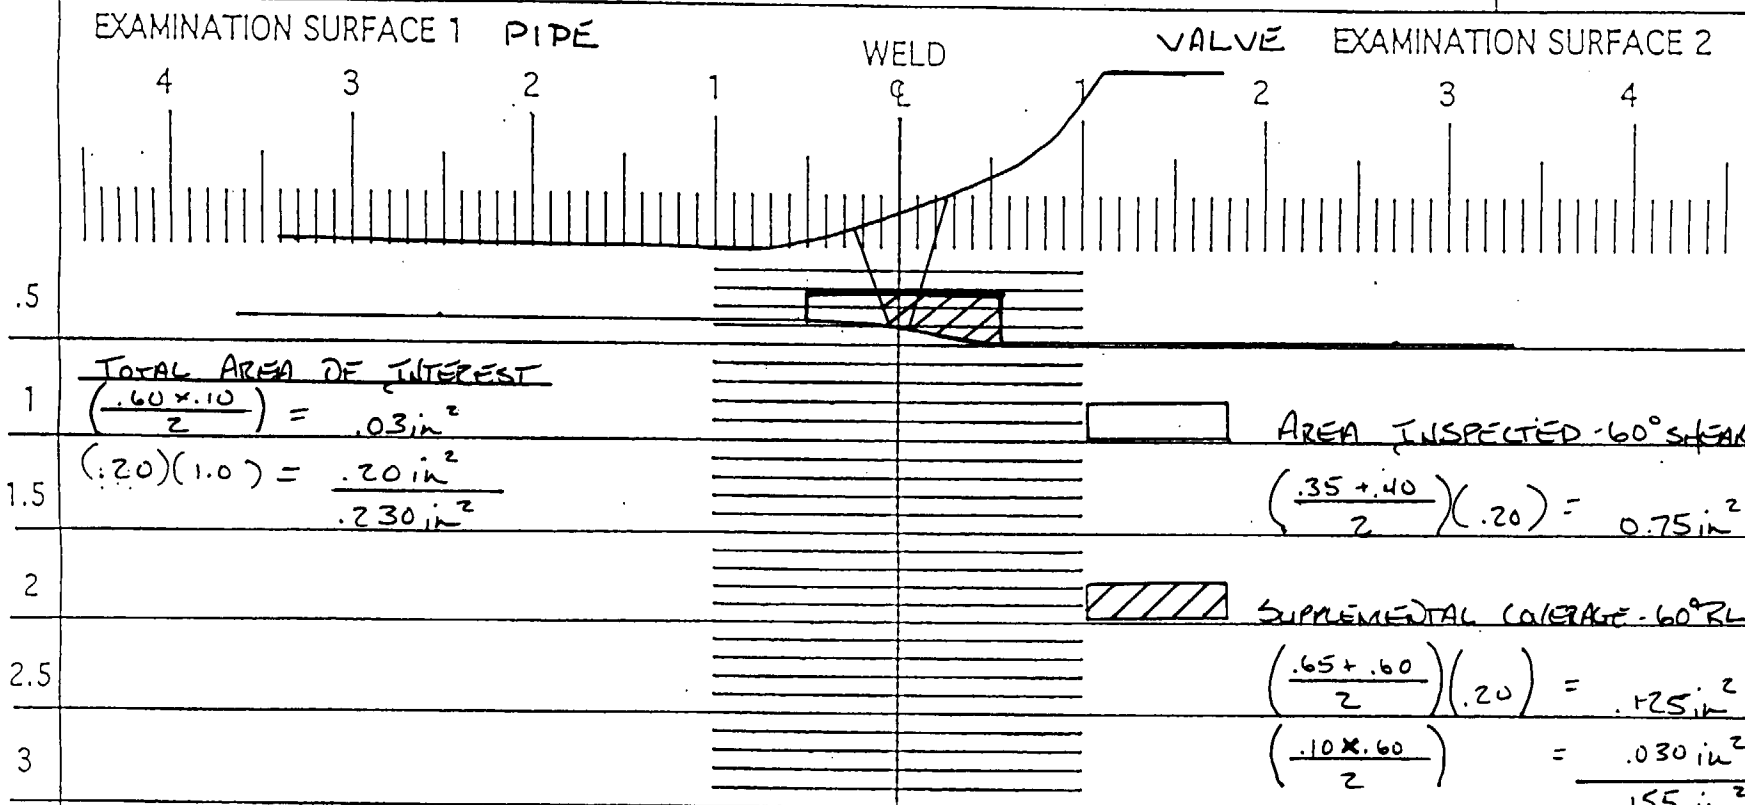

Component ID/Weld No. 1052-1


Remarks: LIMITED CALCULATION

Item No: 005.011.203

Examiner: David K 3 Level: II Date: 10/26/00

Reviewed By: Tom Mauldin Level: II Date: 11-1-00

Authorized Inspector: Robert McCall Date: 11-13-00

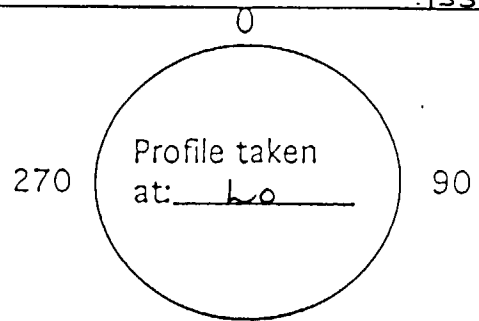

| DUKE POWER COMPANY                                       |                            |                          |                               |                           |                            |                                |                          |                                       |                           | Exam Start: 1030         |                           | NDE-UT-3A  |       |
|--|----------------------------|--------------------------|-------------------------------|---------------------------|----------------------------|--------------------------------|--------------------------|---------------------------------------|---------------------------|--------------------------|---------------------------|------------|-------|
| ULTRASONIC EXAMINATION DATA SHEET FOR LAMINAR REFLECTORS |                            |                          |                               |                           |                            |                                |                          |                                       |                           | Exam Finish: 1040        |                           | Revision 2 |       |
| Station: Catawba   |                            |                          | Unit: 1                       |                           | Component/Weld ID: 1CF34-3 |                                |                          |                                       |                           | Date: 10/19/00           |                           |            |       |
| Nominal Material Thickness (in): 0.938                   |                            |                          | Weld Length (in.): 56.5       |                           |                            | Surface Temperature: 78° Deg F |                          |                                       |                           |                          |                           |            |       |
| Measured Material Thickness (in): 0.963                  |                            |                          | Lo: 9.1.1.1                   |                           |                            | Pyrometer S/N: MCNDE 27205     |                          |                                       |                           |                          |                           |            |       |
| Surface Condition: AS GROUND                             |                            |                          | Calibration Sheet No: 0001008 |                           |                            |                                |                          | Cal Due: 1/17/01                      |                           |                          |                           |            |       |
| Examiner: James L. Panel <i>James L. Panel</i> Level: II |                            |                          |                               |                           |                            |                                |                          | Configuration: Pipe to Valve (1CF042) |                           |                          |                           |            |       |
| Examiner: Gary J. Moss <i>Gary J. Moss</i> Level: II     |                            |                          |                               |                           |                            |                                |                          | S2 Flow S1                            |                           |                          |                           |            |       |
| Procedure: NDE-640 Rev: 1 FC: *                          |                            |                          |                               |                           |                            |                                |                          | VALVE to PIPE                         |                           |                          |                           |            |       |
| IND NO.  | Ampl<br>≥ rem<br>BW<br>LOB | L1<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB      | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB   | Mp2<br>≥ rem<br>BW<br>LOB      | L2<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB              | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB | Mp2<br>≥ rem<br>BW<br>LOB | Exam Surf. | Damps |
| 0  | NRI                        |                          |                               |                           |                            |                                |                          |                                       |                           |                          |                           |            |       |

|                                   |  |  |                   |  |  |  |  |  |  |                            |  |                      |  |  |
|-----------------------------------|--|--|-------------------|--|--|--|--|--|--|----------------------------|--|----------------------|--|--|
| Remarks: * FC 95-18 & 95-19       |  |  |                   |  |  |  |  |  |  |                            |  |                      |  |  |
|                                   |  |  |                   |  | Limitations: see NDE-UT-4 <input type="checkbox"/> None: <input checked="" type="checkbox"/> |  |  |  |  | Sheet <u>1</u> of <u>7</u> |  |                      |  |  |
| Reviewed By: <i>Larry Mauldin</i> |  |  | Level: <u>III</u> |  | Date: <u>10-20-00</u>  |  | Authorized Inspector: <i>Robert McCall</i> |  |  | Date: <u>10-29-00</u>      |  | Item No: C05.011.251 |  |  |

REQUEST FOR RELIEF #01-001 ATTACHMENT 9

A/H  
11/29/00

|  |                              |                            |  |  |   |  |                |
|--|------------------------------|----------------------------|--|--|---|--|----------------|
| <b>DUKE POWER COMPANY</b>                                      |                              |                            |  |  |   | Exam Start: 1050                             | Form NDE-UT-2A |
| <b>ULTRASONIC EXAMINATION DATA SHEET FOR PLANAR REFLECTORS</b> |                              |                            |  |  |   | Exam Finish: 1112                            | Revision 4     |
| Station: Catawba   | Unit: 1                      | Component/Weld ID: 1CF34-3 |  |  |   | Date: 10/19/00                               |                |
| Weld Length (in.): 56.5"                                       | Surface Condition: AS GROUND |                            | Lo: 9.1.1.1  |  | Surface Temperature: <u>78</u> ° <u>F</u> |  |                |
| Examiner: James L. Panel <i>James L. Panel</i>                 | Level: II                    |                            | Scans:   |  |   | Pyrometer S/N: <u>MCNDE 27205</u>            |                |
| Examiner: Gary J. Moss <i>Gary J. Moss</i>                     | Level: II                    |                            | 45 <input checked="" type="checkbox"/> <u>41.5</u> dB 70 <input type="checkbox"/> _____ dB |  |   | Cal Due: <u>1/17/01</u>                      |                |
| Procedure: NDE-610   | Rev: 4                       | FC: *                      | 45T <input type="checkbox"/> _____ dB 70T <input type="checkbox"/> _____ dB                |  |   | Configuration: <u>Pipe to Valve (1CF042)</u> |                |
| Calibration Sheet No:<br>0001009, 0001010                      |                              |                            | 60 <input type="checkbox"/> _____ dB   |  |   | <u>PIPE</u> Flow <u>VALVE</u>                |                |
|  |                              |                            | 60T <input type="checkbox"/> _____ dB  |  |   | <u>S1</u> to <u>S2</u>                       |                |
|  |                              |                            | Other: <u>45 RL@64.5</u> dB  |  |   | Scan Surface: <u>OD</u>                      |                |
|  |                              |                            |  |  |   | <b>Applies to NDE-680 only</b>               |                |
|  |                              |                            |  |  |   | Skew Angle: <u>N/A</u>                       |                |

| IND # | <del>4</del> | Max % Ref | Mp Max | W Max | L Max | L1         | L2         | W1         | Mp1        | W2         | Mp2        | Beam Dir. | Exam Surf.                        | Scan                              | Damps |
|-------|--------------|-----------|--------|-------|-------|------------|------------|------------|------------|------------|------------|-----------|-----------------------------------|-----------------------------------|-------|
|       |              |           |        |       |       | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA | 20%dac HMA |           | <b>DO NOT WRITE IN THIS SPACE</b> | <b>DO NOT WRITE IN THIS SPACE</b> |       |
|       |              |           |        |       |       | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     | 50%dac     |           |                                   |                                   |       |
|       |              |           |        |       |       | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    | 100%dac    |           |                                   |                                   |       |
| 1     | 45           | 40%       | 1.39"  | 1.0"  | 10.0" | 360°       | INT.       | IND.       |            |            |            | 2         | 1                                 | AX                                | NO    |

|   |                   |                       |  |
|---|-------------------|-----------------------|--|
| Remarks: * 97-01 & 98-02  |                   |                       |  |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |                   |                       | Sheet <u>2</u> of <u>7</u>                                       |
| Reviewed By: <i>Larry Mauldin</i>   | Level: <u>III</u> | Date: <u>10-20-00</u> | Authorized Inspector: <i>Robert McNeil</i> Date: <u>10-29-00</u> |
|   |                   |                       | Item No: C05.011.251   |


DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

EXAMINATION SURFACE 1

EXAMINATION SURFACE 2

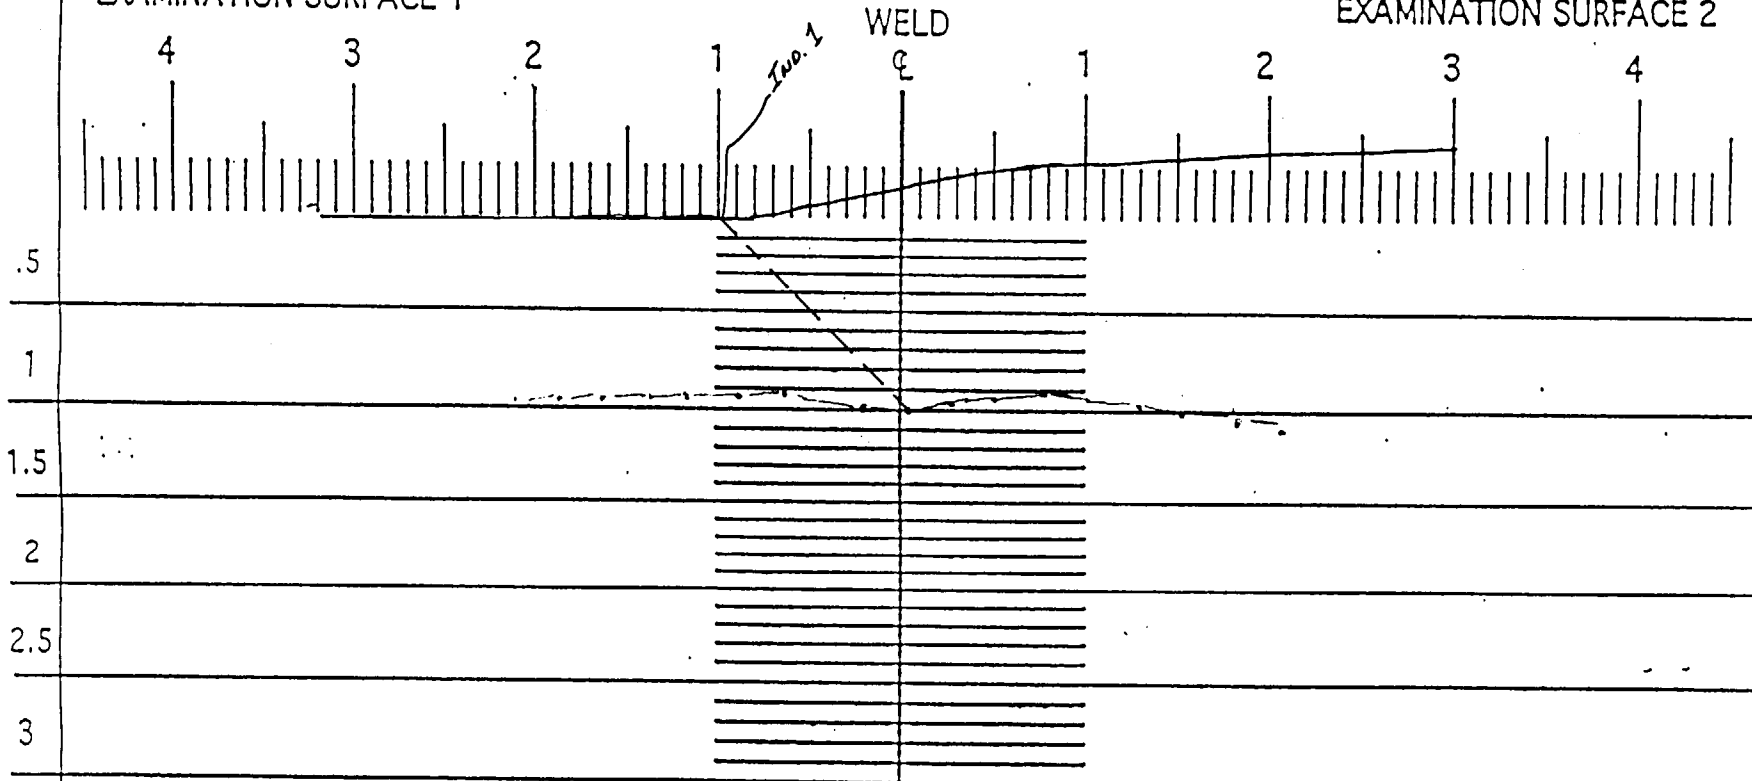


Component ID/Weld No. 1CF34-3

Remarks:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Item No: C05.011.251

|  |                   |                       |
|--|-------------------|-----------------------|
| Examiner: <u>Jerry R. Lane</u>             | Level: <u>II</u>  | Date: <u>10/19/00</u> |
| Reviewed By: <u>Larry Mauldin</u>          | Level: <u>III</u> | Date: <u>10-20-00</u> |
| Authorized Inspector: <u>Robert Miller</u> |                   | Date: <u>10-29-00</u> |

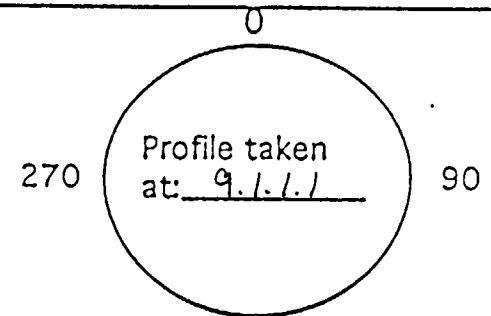

180 Sheet 3 of 7

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1CF34-3

Item No: C05.011.251

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L   N/A   to L   N/A                        INCHES FROM WO   .5"   to   BEYOND    
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM   0   DEG to   360   DEG

DUE TO VALVE CONFIGURATION

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1  2                       1  2  cw  ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0  45  60  Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: *James o Panel*                      Level: *II*                      Date: *10/19/00*                      Sketch(s) attached  yes  no                      Sheet 4 of 7

Reviewed By: *Larry Mauldin*                      Date: *III 10-20-00*                      Authorized Inspector: *Robert m. Giv*                      Date: *10-29-00*

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

5087

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

.32 IN. X 2.0 IN. = 0.64 SQ.IN.

Volume Calculation

0.64 SQ.IN. X 56.5 IN. = 36.16 CU.IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 45S   | CW             | .64                    | 56.5                  | 36.16                    | 36.16                    | 100.00           |
| 2      | 45S   | CCW            | .64                    | 56.5                  | 36.16                    | 36.16                    | 100.00           |
| 3      | 45L   | 2              | .64                    | 56.5                  | 36.16                    | 36.16                    | 100.00           |
| 4      | 45L   | 1              | 0                      | 56.5                  | 0                        | 36.16                    | 0.00             |
|        |       |                |                        |                       | 108.48                   | 144.64                   | 75.00            |

AGGREGATE COVERAGE = 75%

Item No: C05.011.251

Prepared By: GARY MOSS

*Gary Moss*

Level: II

Date: 10/20/00

Reviewed By:

*Larry Mauldin*

Level: III

Date: 10-20-00


DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

EXAMINATION SURFACE 1

EXAMINATION SURFACE 2

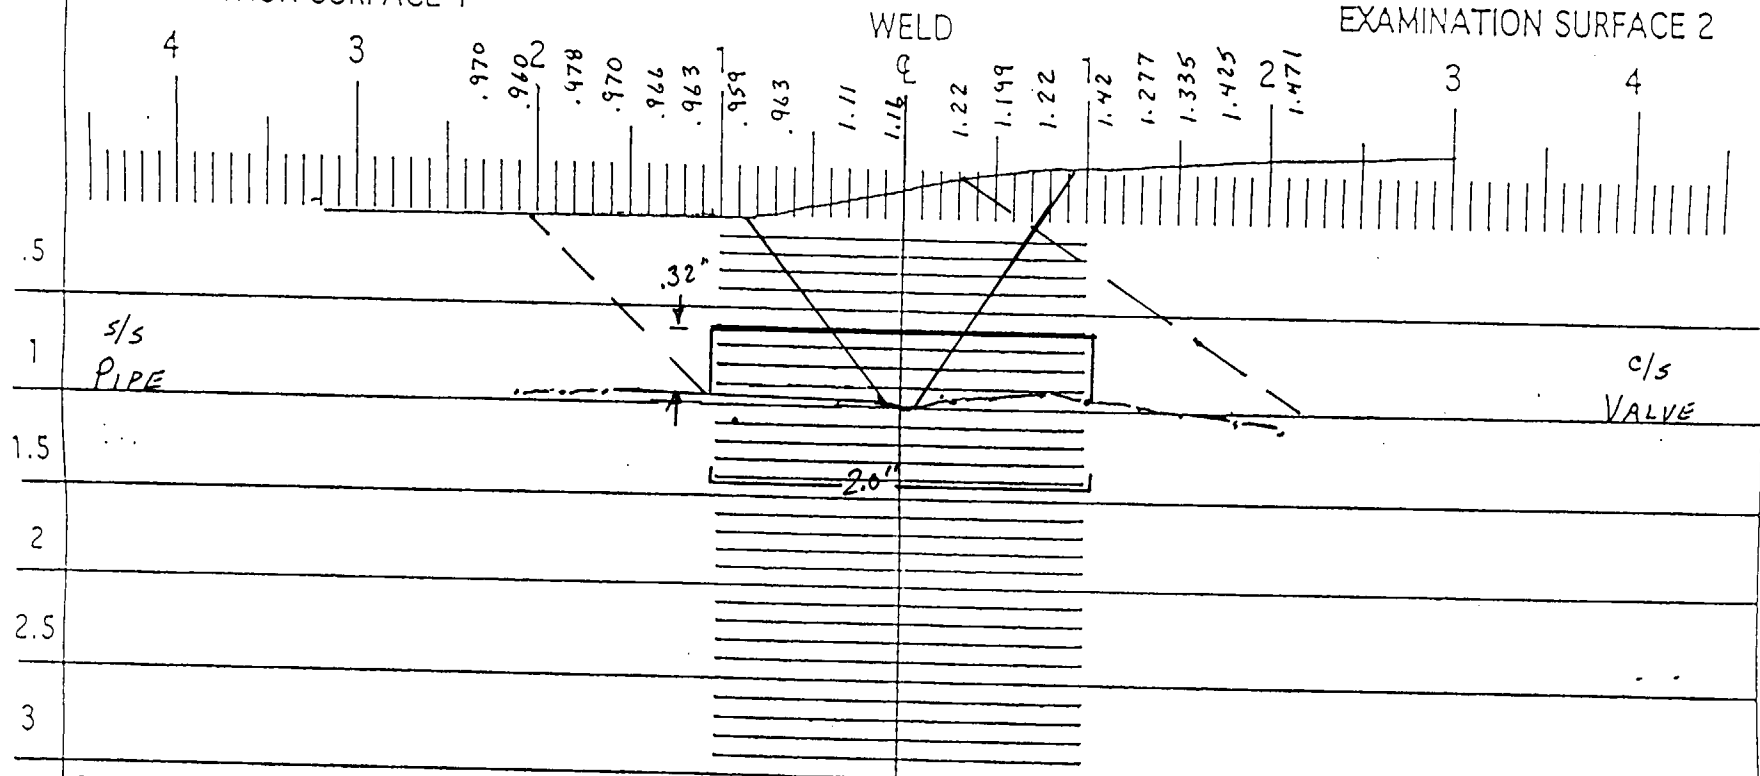

Component ID/Weld No. 1CF34-3

Remarks: 100% SCAN IN AXIAL DIRECTION FROM S1 TOWARD S2. NO SCAN FROM S-2 TOWARD S1.

Item No: C05.011.251

Examiner: Nancy Moss


Level: II Date: 10-19-00

Reviewed By: Randy Mauldin

Level: III Date: 10-20-00

Authorized Inspector: Robert McNeil

Date: 10-29-00

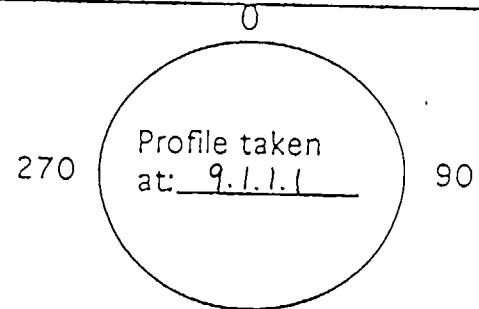

180 Sheet 6 of 7



**DUKE POWER COMPANY**  
**ULTRASONIC INDICATION RESOLUTION SHEET**

Form NDE-UT-8

Revision 1

Acceptance Standard:

IND. #1 WAS DETERMINED TO A GEOMETRIC REFLECTOR DUE TO ID WELD ROOT GEOMETRY. THE SIGNAL WOULD NOT HOLD UP TO SKEWING. THIS WAS CONFIRMED WITH THE RESPONSE OF A 70° SHEAR WAVE TRANSDUCER ( LESS THAN 50% OF THE L-WAVE SIGNAL). ALSO BY THE USE OF A WSY-70 TRANSDUCER AND THE REVIEW OF THE RADIOGRAPHIC FILM.

Item No: C05.011.251

Acceptable Indications: #1

Rejectable Indications:

These indications have been compared with previous ultrasonic data     Yes     No previous data available

Examiner: Gary J. Moss    Level: II    Date: 10/19/00

Sheet 7 of 7

Reviewer: Larry Mauldin    Level: III    Date: 10.20.00

Authorized Inspector: Robert M. Lewis    Date: 10.29.00

| DUKE POWER COMPANY   |                            |                          |   |                           |                                   |                                |                          |                          |                           | Exam Start: 0830         |                           |            |       | NDE-UT-3A  |  |
|--|----------------------------|--------------------------|---|---------------------------|-----------------------------------|--------------------------------|--------------------------|--------------------------|---------------------------|--------------------------|---------------------------|------------|-------|------------|--|
| ULTRASONIC EXAMINATION DATA SHEET FOR LAMINAR REFLECTORS   |                            |                          |   |                           |                                   |                                |                          |                          |                           | Exam Finish: 0841        |                           |            |       | Revision 2 |  |
| Station: Catawba   |                            |                          | Unit: 1   |                           | Component/Weld ID: 1BSWINJF-SH-HD |                                |                          |                          |                           |                          | Date: 9/15/00             |            |       |            |  |
| Nominal Material Thickness (in): 0                         |                            |                          | Weld Length (in.): 14.1                                     |                           |                                   | Surface Temperature: 87° Deg F |                          |                          |                           |                          |                           |            |       |            |  |
| Measured Material Thickness (in): 0.398                    |                            |                          | Lo: 8.1.4   |                           |                                   | Pyrometer S/N: MCNDE 27017     |                          |                          |                           |                          |                           |            |       |            |  |
| Surface Condition: AS GROUND                               |                            |                          | Calibration Sheet No: 0001001                               |                           |                                   |                                |                          |                          | Cal Due: 12/13/00         |                          |                           |            |       |            |  |
| Examiner: David Zimmerman <i>David Zimmerman</i> Level: II |                            |                          | Configuration: Shell to Head<br>S1 Flow S2<br>HEAD to SHELL |                           |                                   |                                |                          |                          | Exam Surf.                |                          |                           | Damps      |       |            |  |
| Examiner: _____ Level: _____                               |                            |                          |   |                           |                                   |                                |                          |                          |                           |                          |                           |            |       |            |  |
| Procedure: NDE-640 Rev: 1 FC: *                            |                            |                          |   |                           |                                   |                                |                          |                          |                           |                          |                           |            |       |            |  |
| IND NO.  | Ampl<br>≥ rem<br>BW<br>LOB | L1<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB                                    | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB          | Mp2<br>≥ rem<br>BW<br>LOB      | L2<br>≥ rem<br>BW<br>LOB | W1<br>≥ rem<br>BW<br>LOB | Mp1<br>≥ rem<br>BW<br>LOB | W2<br>≥ rem<br>BW<br>LOB | Mp2<br>≥ rem<br>BW<br>LOB | Exam Surf. | Damps |            |  |
| 4  |                            |                          |   |                           |                                   |                                |                          |                          |                           |                          |                           |            |       |            |  |
| NRI  | 0°                         |                          |   |                           |                                   |                                |                          |                          |                           |                          |                           |            |       |            |  |

Remarks: \*FC 95-18 & 95-19 \*\*\* I.D. TAPER IN SHELL B.M. RANGES 0.398 TO 0.708. TAPER ALSO SHOWN ON ISO.

Reviewed By: *Lawrence Mauldin* Level: *III* Date: *10-19-00*

Limitations: see NDE-UT-4  None:

Authorized Inspector: *Robert Mettel* Date: *11-13-00*

Sheet 1 of 6

Item No: C01.020.018


*REQUEST FOR RELIEF #01-001 ATTACHMENT 10*

*AJA 11/29/00*

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

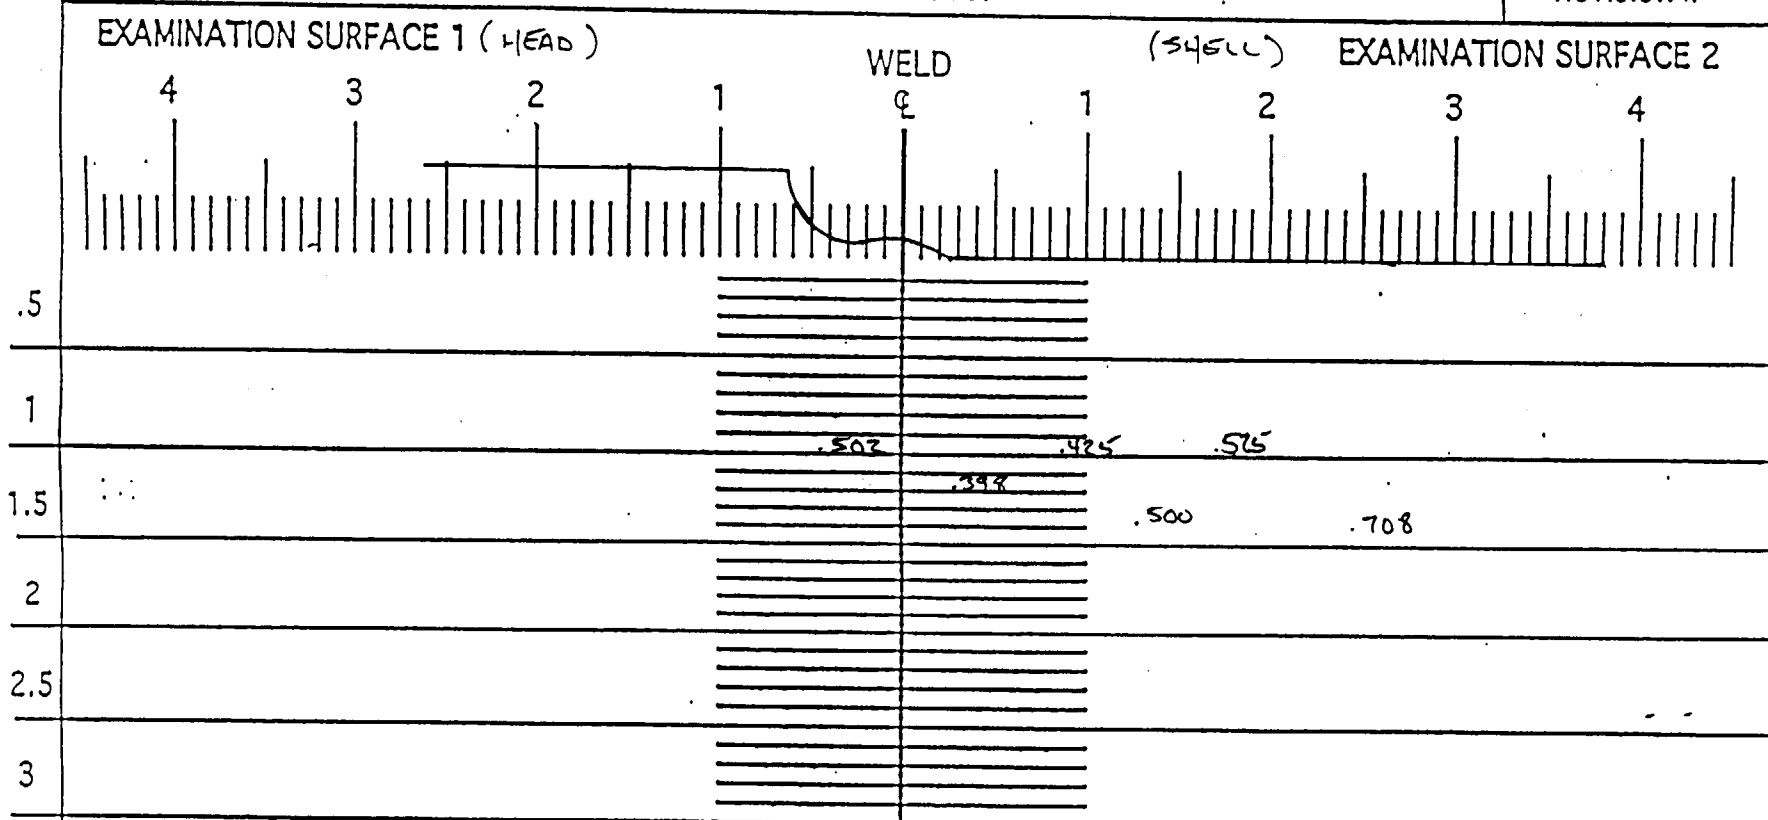

Component ID/Weld No. <sup>022</sup> 1A SW (IN) IF-SH-7D


Remarks: 3

Item No: C01020.018

Examiner: *David K...*      Level: II      Date: 9/15/00

Reviewed By: *Louis Mauldin*      Level: III      Date: 10-19-00

Authorized Inspector: *Robert M...*      Date: 11-13-00

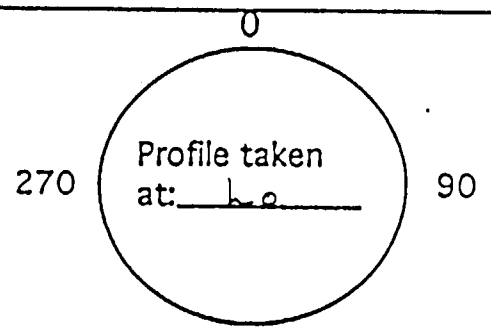

| <b>DUKE POWER COMPANY</b>                                      |                                     |                                   |                              |       |  |            |            |   |            | Exam Start: 0842  | Form NDE-UT-2A   |           |            |                                   |       |  |
|--|-------------------------------------|-----------------------------------|------------------------------|-------|--|------------|------------|---|------------|-------------------|--|-----------|------------|-----------------------------------|-------|--|
| <b>ULTRASONIC EXAMINATION DATA SHEET FOR PLANAR REFLECTORS</b> |                                     |                                   |                              |       |  |            |            |   |            | Exam Finish: 0908 | Revision 4   |           |            |                                   |       |  |
| Station: Catawba   |                                     |                                   | Unit: 1                      |       | Component/Weld ID: 1BSWINJF-SH-HD  |            |            |   |            |                   | Date: 9/15/00  |           |            |                                   |       |  |
| Weld Length (in.): 14.1  |                                     |                                   | Surface Condition: AS GROUND |       |  | Lo: 8.1.4  |            | Surface Temperature: <u>87</u> ° <u>F</u> |            |                   |  |           |            |                                   |       |  |
| Examiner: David Zimmerman <i>David Zimmerman</i>               |                                     |                                   | Level: II                    |       | Scans:<br>45 <input checked="" type="checkbox"/> <u>47.0</u> dB    70 <input type="checkbox"/> _____ dB<br>45T <input checked="" type="checkbox"/> <u>55.5</u> dB    70T <input type="checkbox"/> _____ dB<br>60 <input type="checkbox"/> _____ dB<br>60T <input type="checkbox"/> _____ dB<br>Other: <u>45 RL@62.5</u> dB |            |            |   |            |                   | Pyrometer S/N: <u>MCNDE 27017</u>  |           |            |                                   |       |  |
| Examiner:  |                                     |                                   | Level:                       |       |  |            |            |   |            |                   | Cal Due: <u>12/13/00</u>   |           |            |                                   |       |  |
| Procedure: _____ Rev: 2  |                                     |                                   | FC: _____                    |       |  |            |            |   |            |                   | Configuration: <u>Shell to Head</u>  |           |            |                                   |       |  |
| Calibration Sheet No:<br>0001002, 0001003, 0001004             |                                     |                                   | 99-02                        |       |  |            |            |   |            |                   | HEAD _____ Flow _____ SHELL _____<br>S1 _____ to _____ S2 _____<br>Scan Surface: OD<br><b>Applies to NDE-680 only</b><br>Skew Angle: _____ |           |            |                                   |       |  |
| IND #  | <input checked="" type="checkbox"/> | Max % Ref                         | Mp Max                       | W Max | L Max  | L1         | L2         | W1  | Mp1        | W2                | Mp2  | Beam Dir. | Exam Surf. | Scan                              | Damps |  |
|  |                                     | <b>DO NOT WRITE IN THIS SPACE</b> |                              |       |  | 20%dac HMA | 20%dac HMA | 20%dac HMA                                | 20%dac HMA | 20%dac HMA        | 20%dac HMA   |           |            | <b>DO NOT WRITE IN THIS SPACE</b> |       |  |
|  |                                     |                                   |                              |       |  | 50%dac     | 50%dac     | 50%dac                                    | 50%dac     | 50%dac            | 50%dac   |           |            |                                   |       |  |
|  |                                     |                                   |                              |       |  | 100%dac    | 100%dac    | 100%dac                                   | 100%dac    | 100%dac           | 100%dac  |           |            |                                   |       |  |
| NRI  | 45°                                 |                                   |                              |       |  |            |            |   |            |                   |  |           |            |                                   |       |  |

|   |  |  |                  |  |                       |  |   |  |  |                            |  |                      |  |  |
|---|--|--|------------------|--|-----------------------|--|---|--|--|----------------------------|--|----------------------|--|--|
| Remarks:  |  |  |                  |  |                       |  |   |  |  |                            |  |                      |  |  |
| Limitations: (see NDE-UT-4) <input checked="" type="checkbox"/> 90% or greater coverage obtained: yes <input type="checkbox"/> no <input checked="" type="checkbox"/> |  |  |                  |  |                       |  |   |  |  | Sheet <u>3</u> of <u>4</u> |  |                      |  |  |
| Reviewed By: <i>Larry Mauldin</i>   |  |  | Level: <u>II</u> |  | Date: <u>10-19-00</u> |  | Authorized Inspector: <i>Robert Mader</i> |  |  | Date: <u>11-13-00</u>      |  | Item No: C01.020.018 |  |  |

**DUKE POWER COMPANY  
ISI LIMITATION REPORT**

FORM NDE-UT-4

Revision 1

Component/Weld ID: 1BSWINJF-SH-HD

Item No: C01.020.018

Remarks:

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L   N/A   to L   N/A                        INCHES FROM WO   .3"   to   BEYOND    
 ANGLE:  0    45    60    Other \_\_\_\_\_                      FROM   0   DEG to   360   DEG

HEAD CONFIGURATION (S1) ALLOWS 0% SCAN IN AXIAL DIRECTION TOWARDS S2.

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

NO SCAN                      SURFACE                      BEAM DIRECTION  
 LIMITED SCAN                       1    2                       1    2    cw    ccw  
 FROM L \_\_\_\_\_ to L \_\_\_\_\_                      INCHES FROM WO \_\_\_\_\_ to \_\_\_\_\_  
 ANGLE:  0    45    60    Other \_\_\_\_\_                      FROM \_\_\_\_\_ DEG to \_\_\_\_\_ DEG

Prepared By: *Daniel K. Z...*                      Level:   II                        Date:   9/15/00                        Sketch(s) attached    yes    no                      Sheet   4   of   6    
 Reviewed By: *Larry Maulder*                      Date:   10-19-00                        Authorized Inspector: *Robert McMillin*                      Date:   11/13/00

**DUKE POWER COMPANY**  
**Limited Examination Coverage Worksheet**

NDE-91-1

Revision 0

**Examination Volume/Area Defined**

Base Metal     Weld     Near Surface     Bolting     Inner Radius

Area Calculation

0.134" X 1.0" = 0.134 SQ. IN.

Volume Calculation

0.134 IN. X 14.1 IN. = 1.89 CU. IN.

**Coverage Calculations**

| Scan # | Angle | Beam Direction | Area Examined (sq.in.) | Length Examined (in.) | Volume Examined (cu.in.) | Volume Required (cu.in.) | Percent Coverage |
|--------|-------|----------------|------------------------|-----------------------|--------------------------|--------------------------|------------------|
| 1      | 45    | 2              | 0                      | 14.1                  | 0                        | 1.89                     | 0.00             |
| 2      | 45    | 1              | .050                   | 14.1                  | 0.705                    | 1.89                     | 37.30            |
| 3      | 45    | CW             | .134                   | 14.1                  | 1.89                     | 1.89                     | 100.00           |
| 4      | 45    | CCW            | .134                   | 14.1                  | 1.89                     | 1.89                     | 100.00           |
|        | SHEAR | WAVE           | AGGREGATE              | COVERAGE              | 4.485                    | 7.56                     | 59.33            |
| RL     | WAVE  | COVERAGE       |                        |                       |                          |                          | 0.00             |
| 2      | 45RL  | 1              | .084                   | 14.1                  | 1.184                    | 1.89                     | 62.65            |

62.6 X 25% (1 SCAN) = 15.7 % OF TOTAL WELD

5 of 5

Item No: C01.020.018

Prepared By: *David K. Z...*

Level: *II*

Date: *10/10/00*

Reviewed By: *Larry Maulder*

Level: *IV*


Date: *10-19-00*

DUKE POWER COMPANY  
UT PROFILE/PLOT SHEET

NDE-UT-5

Revision 1

EXAMINATION SURFACE 1 HEAD WELD S HELL EXAMINATION SURFACE 2

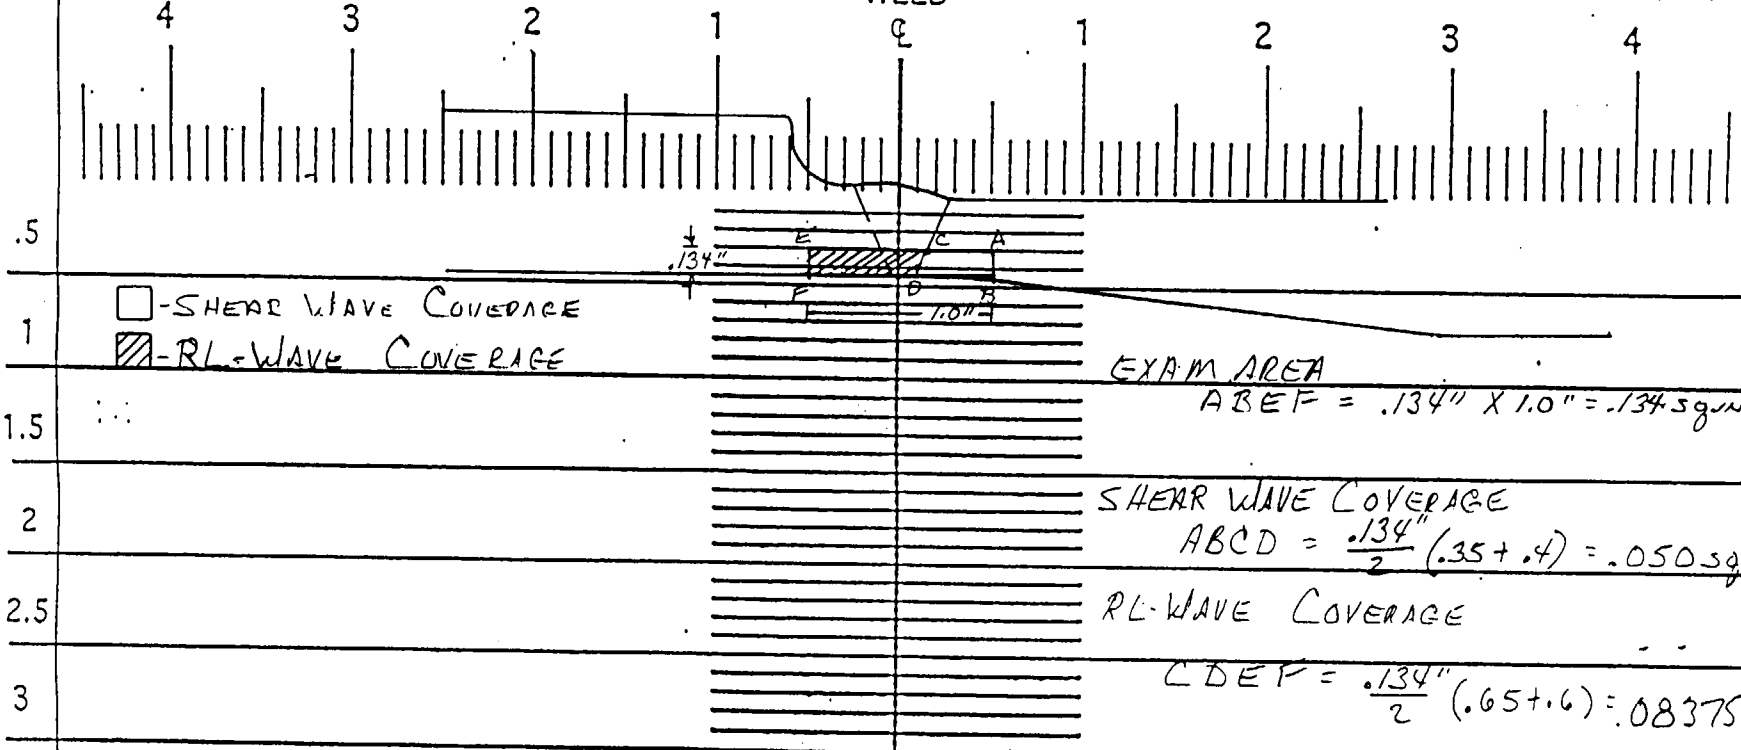

Component ID/Weld No. <sup>DLZ</sup> 1A5WINJF-SH-HD

Remarks: B

Item No: C01.020.018  
 Examiner: David A. Z... Level: II Date: 10/10/00  
 Reviewed By: Gary Mauldin Level: III Date: 10-19-00  
 Authorized Inspector: Robert M... Date: 11-13-00

