67 M 2-47E807-2-ISI

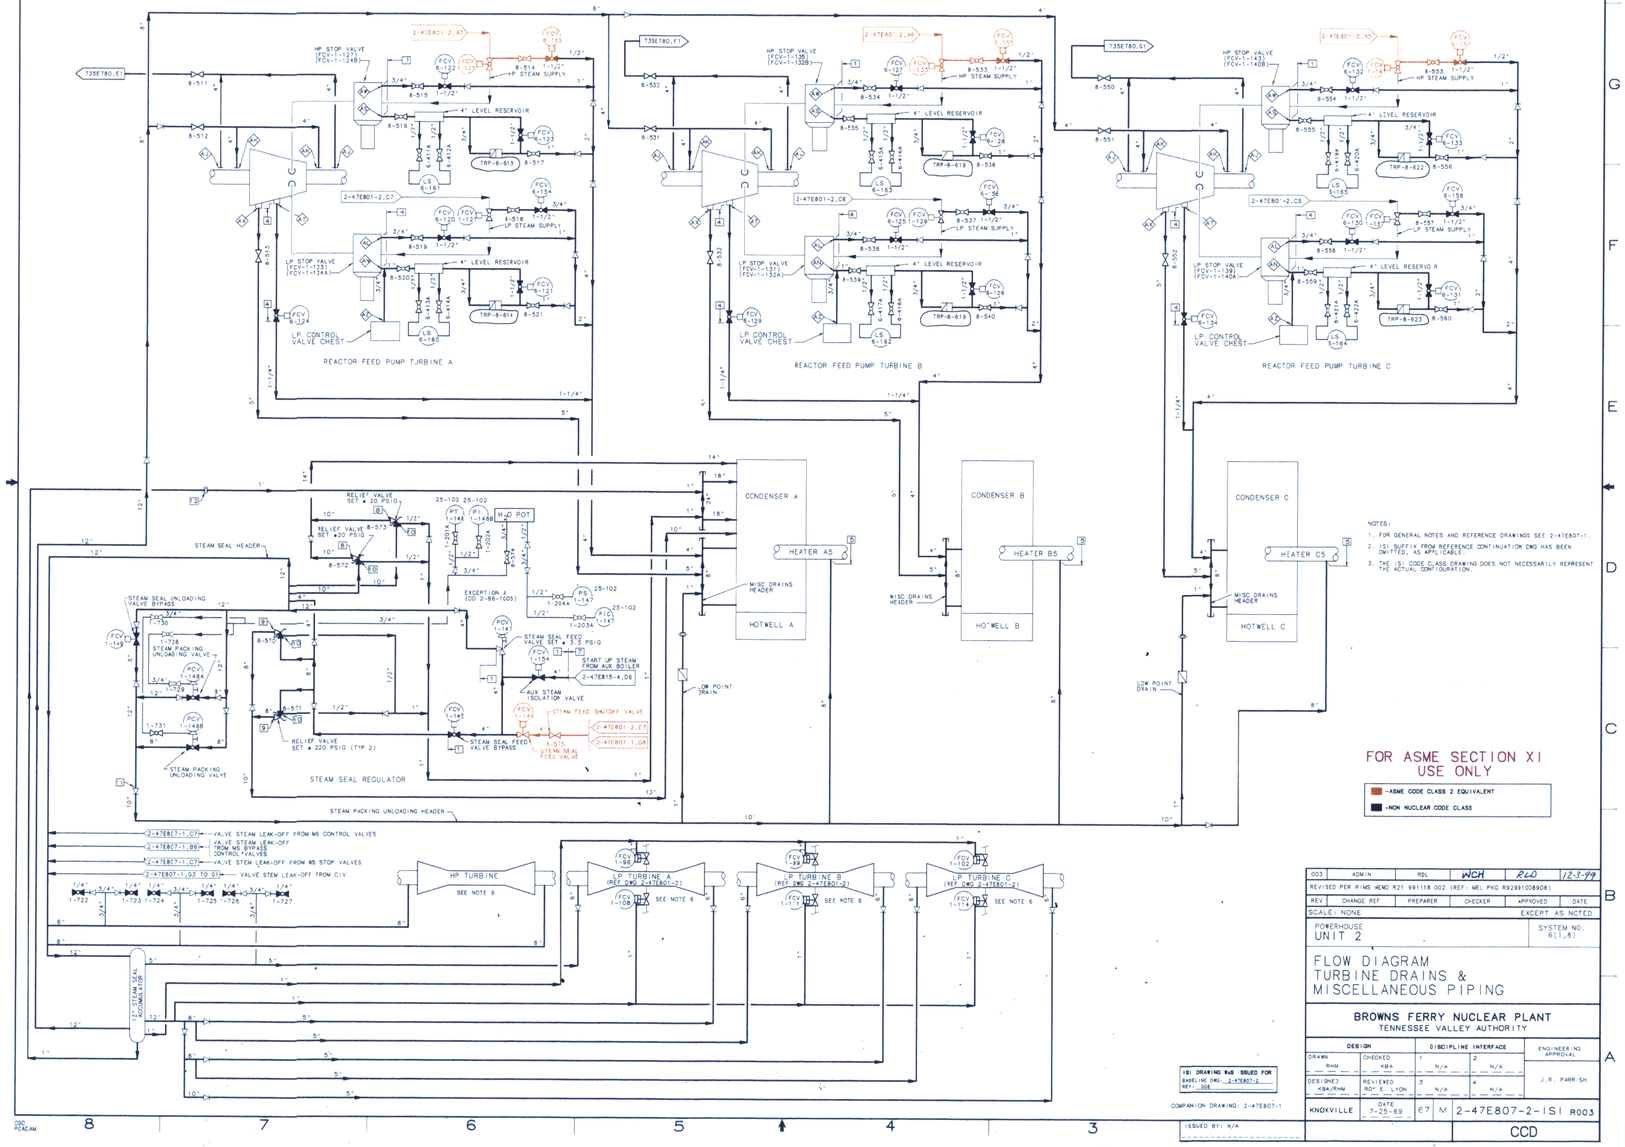

NOTES:

1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE 2-47E807-1.
2. ISI SUFFIX FROM REFERENCE CONTINUATION DWG HAS BEEN OMITTED, AS APPLICABLE.
3. THE ISI CODE CLASS DRAWING DOES NOT NECESSARILY REPRESENT THE ACTUAL CONFIGURATION.

FOR ASME SECTION XI USE ONLY

- ASME CODE CLASS 2 EQUIVALENT
- NON NUCLEAR CODE CLASS

003	ADMIN	RDL	WCH	RLD	12-3-99
REVISED PER RIMS MEMO R21 991118 002 (REF: MEL PKG R9299108908)					
REV	CHANGE REF	PREPARER	CHECKER	APPROVED	DATE

SCALE: NONE — EXCEPT AS NOTED

POWERHOUSE UNIT 2 — SYSTEM NO. 6(1,8)

FLOW DIAGRAM
TURBINE DRAINS &
MISCELLANEOUS PIPING

BROWNS FERRY NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY

DESIGN		DISCIPLINE INTERFACE		ENGINEERING APPROVAL
DRAWN RHM	CHECKED KBA	1 N/A	2 N/A	J.R. PARRISH
DESIGNED KBA/RHM	REVIEWED RDY E. LYON	3 N/A	4 N/A	
KNOXVILLE	DATE 7-25-69	E7 M	2-47E807-2-ISI R003	
			CCD	

ISI DRAWING WAS ISSUED FOR BASELINE IMO: 2-47E807-2 REV: 003

COMPANION DRAWING: 2-47E807-1

ISSUED BY: N/A

D-16