

September 13, 1988

Docket No. 50-220

Mr. Charles V. Mangan
Senior Vice President
Niagara Mohawk Power Corporation
301 Plainfield Road
Syracuse, New York 13212

DISTRIBUTION

Docket File	EJordan
NRC PDR	JPartlow
Local PDR	WJones
PDI-1 Rdg.	DHagan
SVarga	ACRS(10)
BBoger	TBarnhart(4)
CVogan	OGC
MHaughey	JJohson,RI
RBenedict	GPA/PA
ARM/LFMB	EButcher
THuang	

Dear Mr. Mangan:

By letter dated April 19, 1988, the Commission issued Amendment No. 97 to the Facility Operating License No. DPR-63 for the Nine Mile Point Nuclear Station Unit 1. The amendment consisted of changes to certain of the Technical Specifications (TS), including Figure 2.1.1 on TS page 8. In the process of correcting a spelling error on that page, the Rod Block line in the figure was mislocated, but this latter error was not detected prior to issuance of the license amendment.

Your letter of May 12, 1988 included a correct copy of Figure 2.1.1 and noted that the Rod Block line was not intended to be revised and had not been identified to be changed in your amendment application of December 18, 1987. The corrected copy, which is enclosed, is in accordance with the amendment application and with the staff's safety evaluation that accompanied License Amendment No. 97. The enclosed Figure 2.1.1 therefore, should replace Figure 2.1.1 transmitted with Amendment No. 97 dated April 19, 1988 as the effective Figure 2.1.1 in the TS for Nine Mile Point Nuclear Station Unit 1.

Sincerely,

Mary F. Haughey, Project Manager
Project Directorate I-1
Division of Reactor Projects, I/II

Enclosure:
TS Figure 2.1.1

cc: See next page

PDI-1
CVogan
9/14/88

RB
PDI-1
RBenedict
9/12/88

M. Haughey
PDI-1
MHaughey:dlg:vr
9/13/88

Rca
PDI-1
RCapra
9/13/88

DF01
11

Mr. C. V. Mangan
Niagara Mohawk Power Corporation

Nine Mile Point Nuclear Station,
Unit No. 1

cc:

Mr. Troy B. Conner, Jr., Esquire
Conner & Wetterhahn
Suite 1050
1747 Pennsylvania Avenue, N. W.
Washington, D. C. 20006

Kim Dahlberg
Unit 1 Station Superintendent
Nine Mile Point Nuclear Station
Post Office Box 32
Lycoming, New York 13093

Mr. Frank R. Church, Supervisor
Town of Scriba
R. D. #2
Oswego, New York 13126

Mr. Peter E. Francisco, Licensing
Niagara Mohawk Power Corporation
301 Plainfield Road
Syracuse, New York 13212

Mr. James L. Willis
General Supt.-Nuclear Generation
Niagara Mohawk Power Corporation
Nine Mile Point Nuclear Station
Post Office Box 32
Lycoming, New York 13093

Charlie Donaldson, Esquire
Assistant Attorney General
New York Department of Law
120 Broadway
New York, New York 10271


Resident Inspector
U. S. Nuclear Regulatory Commission
Post Office Box 126
Lycoming, New York 13093

Mr. Gary D. Wilson, Esquire
Niagara Mohawk Power Corporation
300 Erie Boulevard West
Syracuse, New York 13202

Regional Administrator, Region I
U. S. Nuclear Regulatory Commission
475 Allendale Road
King of Prussia, Pennsylvania 19406

Ms. Donna Ross
New York State Energy Office
2 Empire State Plaza
16th Floor
Albany, New York 12223

FIGURE 2.1.1 FLOW BIASED SCRAM AND APRM ROD BLOCK

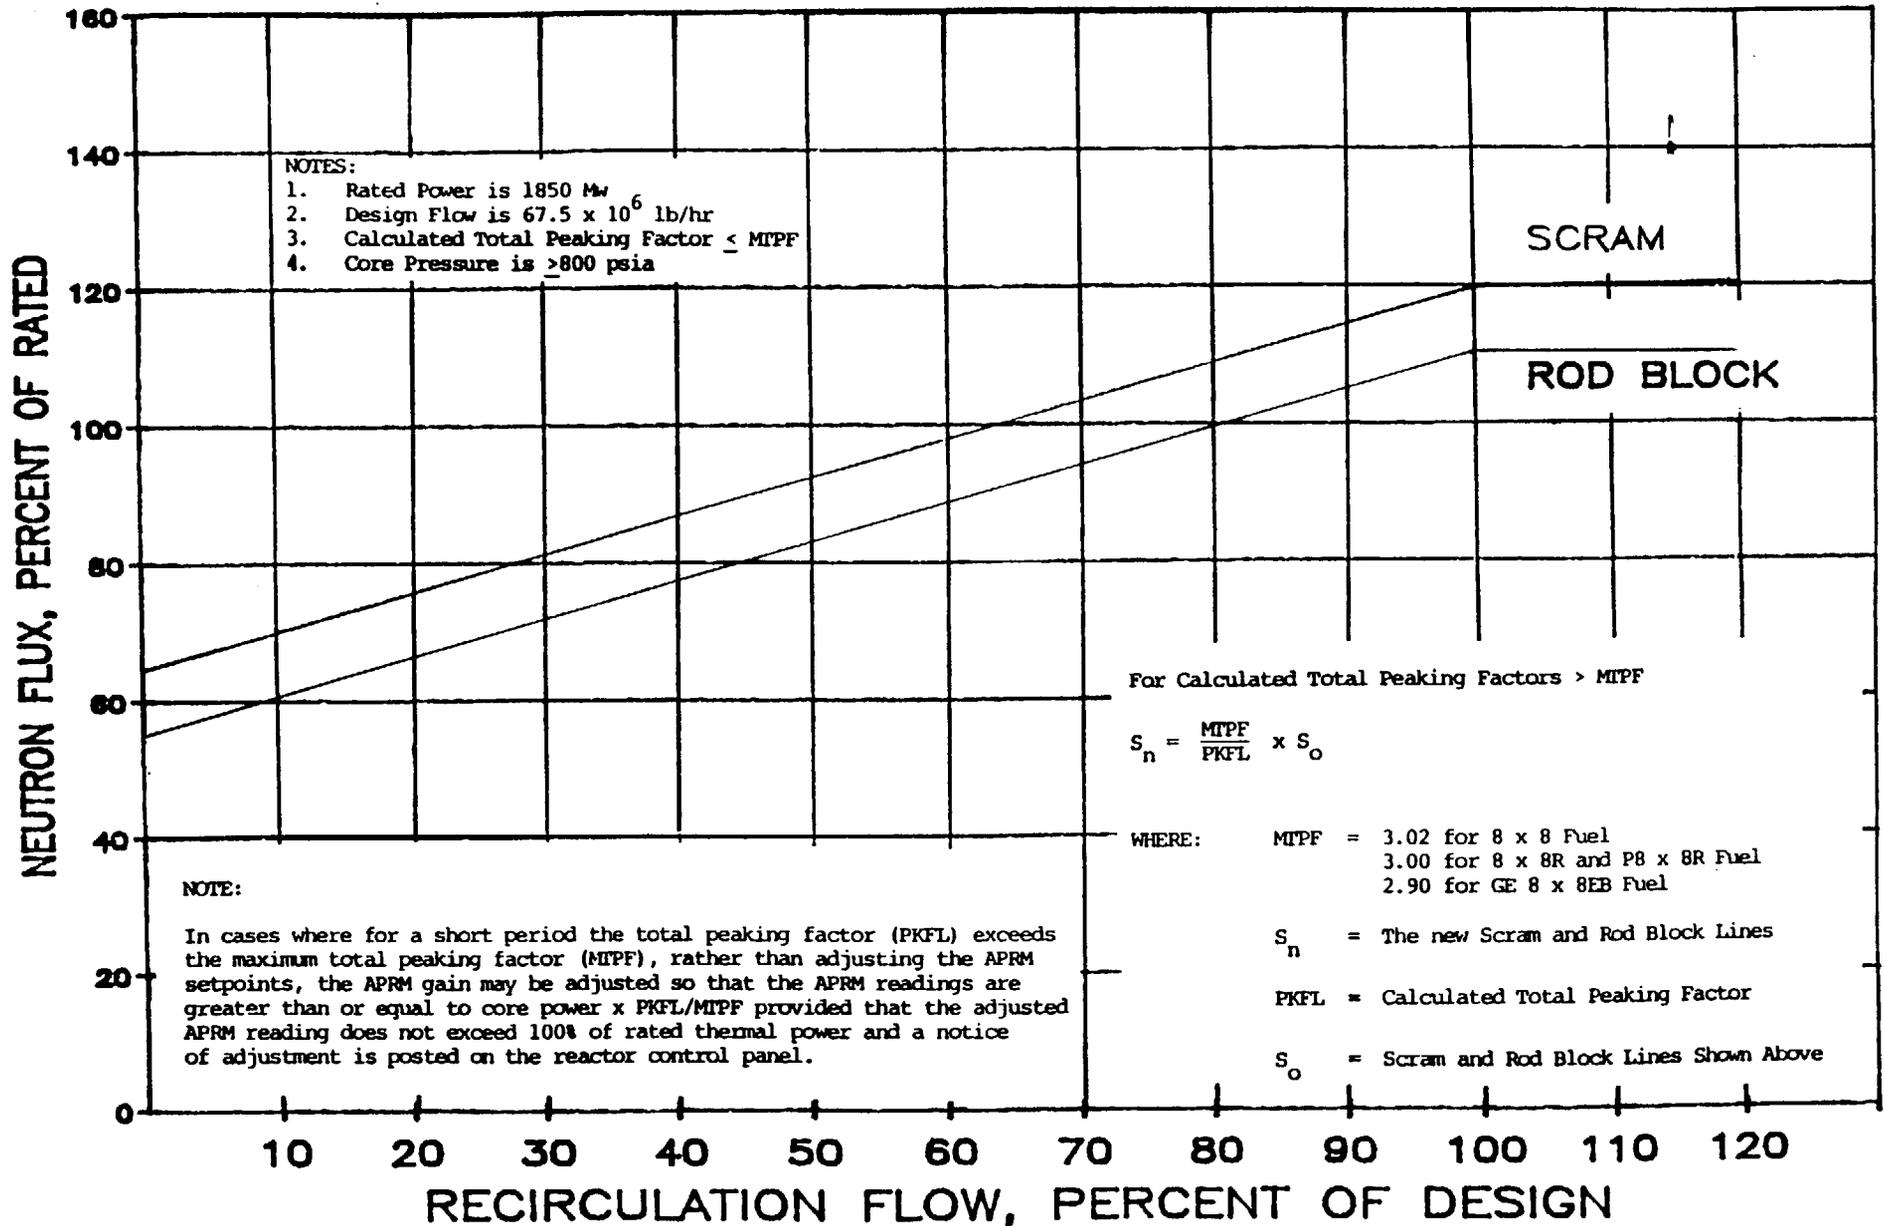

8809160150 880913
 PDR ADDCK 05000220
 P DIC