


JANUARY 9 1981

Docket No. 50-219

Mr. I. R. Finrock, Jr.  
Vice President  
Oyster Creek Nuclear Generating Station  
Post Office Box 388  
Forked River, New Jersey 08731

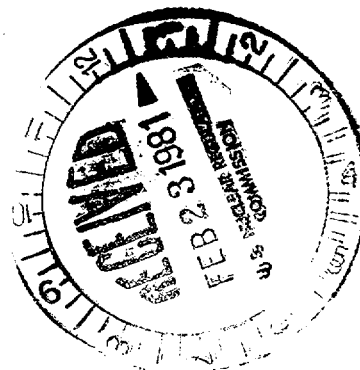

Dear Mr. Finrock:

SUBJECT: ORDER FOR MODIFICATION OF LICENSE CONCERNING BWR SCRAM  
DISCHARGE SYSTEMS

This letter transmits an Order for Modification of License which requires prompt implementation of certain actions to assure the safe operation of BWR's with inadequate Scram Discharge Volume - Instrument Volume (SDV-IV) hydraulic coupling. The licensee should, to the extent practical, design the Automatic Dump System to be independent of the air pressure instrumentation for manual scram. A copy of the Order is being filed with the Office of the Federal Register for publication.

Sincerely,

Original signed by

Dennis M. Crutchfield, Chief  
Operating Reactors Branch #5  
Division of Licensing

Enclosure:  
Order

cc w/encl:  
See next page

8103040558

G

OFFICE	DL ORB 2						
SURNAME	HANNON	H.S. Smith	D. Crutchfield				
DATE	1/9/81	1/9/81	1/9/81				



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

JANUARY 9 1981

Docket No. 50-219


Mr. I. R. Finfrock, Jr.  
Vice President  
Oyster Creek Nuclear Generating Station  
Post Office Box 388  
Forked River, New Jersey 08731

Dear Mr. Finfrock:

SUBJECT: ORDER FOR MODIFICATION OF LICENSE CONCERNING BWR SCRAM  
DISCHARGE SYSTEMS

This letter transmits an Order for Modification of License which requires prompt implementation of certain actions to assure the safe operation of BWR's with inadequate Scram Discharge Volume - Instrument Volume (SDV-IV) hydraulic coupling. The licensee should, to the extent practical, design the Automatic Dump System to be independent of the air pressure instrumentation for manual scram. A copy of the Order is being filed with the Office of the Federal Register for publication.

Sincerely,

  
Dennis M. Crutchfield, Chief  
Operating Reactors Branch #5  
Division of Licensing

Enclosure:  
Order

cc w/encl:  
See next page

Mr. I. R. Finfrock, Jr.

cc

G. F. Trowbridge, Esquire  
Shaw, Pittman, Potts and Trowbridge  
1800 M Street, N. W.  
Washington, D. C. 20036

GPU Service Corporation  
ATTN: Mr. E. G. Wallace  
Licensing Manager  
260 Cherry Hill Road  
Parsippany, New Jersey 07054

Natural Resources Defense Council  
917 15th Street, N. W.  
Washington, D. C. 20006

Steven P. Russo, Esquire  
248 Washington Street  
P. O. Box 1060  
Toms River, New Jersey 08753

Joseph W. Ferraro, Jr., Esquire  
Deputy Attorney General  
State of New Jersey  
Department of Law and Public Safety  
1100 Raymond Boulevard  
Newark, New Jersey 07012

Ocean County Library  
Brick Township Branch  
401 Chambers Bridge Road  
Brick Town, New Jersey 08723

Mayor  
Lacey Township  
P. O. Box 475  
Forked River, New Jersey 08731

Commissioner  
Department of Public Utilities  
State of New Jersey  
101 Commerce Street  
Newark, New Jersey 07102

Gene Fisher  
Bureau Chief  
Bureau of Radiation Protection  
380 Scotts Road  
Trenton, New Jersey 08628

Commissioner  
New Jersey Department of Energy  
101 Commerce Street  
Newark, New Jersey 07102

Plant Superintendent  
Oyster Creek Nuclear Generating  
Station  
P. O. Box 388  
Forked River, New Jersey 08731

Resident Inspector  
c/o U. S. NRC  
P. O. Box 445  
Forked River, New Jersey 08731

Director, Criteria and Standards  
Division  
Office of Radiation Programs  
(ANR-460)  
U. S. Environmental Protection  
Agency  
Washington, D. C. 20460

U. S. Environmental Protection  
Agency  
Region II Office  
ATTN: EIS COORDINATOR  
26 Federal Plaza  
New York, New York 10007

UNITED STATES OF AMERICA  
NUCLEAR REGULATORY COMMISSION

In the Matter of )  
JERSEY CENTRAL POWER & LIGHT CO. ) Docket No. 50-219  
(Oyster Creek Nuclear Generating )  
Station) )

ORDER FOR MODIFICATION OF LICENSE

I.

The Jersey Central Power and Light Company (licensee) is the holder of Provisional Operating License No. DPR-16 which authorizes the operation of the Oyster Creek Nuclear Generating Station at steady state reactor power levels not in excess of 1930 megawatts thermal (rated power). The facility consists of a boiling water reactor located at the licensee's site in Ocean County, New Jersey.

II.

During a routine shutdown of Browns Ferry Unit No. 3 on June 28, 1980, 76 of 185 control rods failed to fully insert in response to a manual scram from approximately 30% power. All rods were subsequently inserted within 15 minutes and no reactor damage or hazard to the public occurred. However, the event did cause an in-depth review of the current BWR Control Rod Drive Systems which indentified design deficiencies requiring both short and long-term corrective measures. These measures are set forth in the Generic Safety Evaluation Report - BWR SCRAM DISCHARGE SYSTEM, dated December 1, 1980, preped by the NRC staff. One of the deficiencies identified was a failure mode of the control air system, which can conceivable cause an inability to scram

the control rods. Sustained low pressure in the control air system could result in complete or partial opening of multiple scram outlet valves before opening of the scram inlet valves, causing the Scram Discharge Volume (SDV) to fill rapidly, thus leaving a relatively short time for the operator to take corrective action before scram capability is lost. It appears that an event of this general type (but with no adverse consequences) actually occurred at the Quad Cities Unit 1 reactor on January 3, 1977.

IE Bulletin 80-17 (Supplement 3) requires an immediate manual scram when low pressure occurs in the Control Rod Drive (CRD) air system or when other indications occur, such as multiple rod drift alarms or a marked change in the number of control rods that are at high temperature. Beginning on December 1, 1980, protection was also provided by continuous monitoring of the SDV as required by IE Bulletin 80-17 (Supplement 1). However, since only a short time could be available for the operator to successfully initiate a reactor scram, a question remains as to the adequacy of equipment and procedures. This continuous monitoring system and operator response provide important protection against water accumulation in the SDV headers under slow fill conditions; however it does not address completely all the potential loss of air events. In addition, a human factors evaluation determined that reliance on the operator to successfully carry out a manual scram within a limited time frame may not be assured. Therefore, in the short term in order to provide prompt added protection for credible degraded air conditions in BWR control air supply systems, it is necessary that an automatic system be operable to initiate control rod insertion by rapidly dumping the control air system header if the air pressure decreases below a prescribed value.

The NRC staff is developing revised design and safety criteria for a long term solution to this problem.

## III.

The Generic Safety Evaluation Report (SER) of December 1, 1980, recommended that this automatic air header dump system be installed within two months. As a result of questions as to whether a reliable system could be installed within two months, the staff continued to review this requirement. We have performed a more detailed risk assessment which has shown a lower probability for the loss of scram capability due to a loss of air than our original estimate. We have also reevaluated the human factors involved in carrying out the requirements of IE Bulletin 80-17 (Supplement 3) which requires a manual scram of the reactor on alarms related to the loss of air pressure in the air system. These alarms provide some added assurance that the operator can trip the reactor before the scram discharge volume fills.

As a result of these analyses I have determined that the public health, safety and interest require that the automatic air dump system be in operation within 90 days of the date of this Order and that operation during this period does not present an undue risk to the public health and safety.

I have further determined based on staff evaluations of installed air systems, and on staff discussions with industry representatives that a 90-day period will allow adequate time for design, procurement, fabrication, installation, and testing for an automatic air dump system of the type prescribed in this Order.

As discussed above, although (1) the failure of the control air system is a low probability event, (2) the actions already required provide a significant measure of assurance that such an event will not occur and (3) the criteria for a long term fix are currently being developed, I have determined that the public health and safety require the additional measures prescribed by this Order and their implementation on this short time schedule. However, in view of the immediacy of the need for this system, the system being mandated by this Order is not being made subject to the requirements of Appendices A and B to 10 CFR Part 50.

IV.

Accordingly, pursuant to the Atomic Energy Act of 1954, as amended, including Sections 103 and 161i, and the Commission's rules and regulations in 10 CFR Parts 2 and 50, IT IS ORDERED THAT EFFECTIVE IMMEDIATELY, Provisional Operating License No. DPR-16 is hereby amended to add the following provisions:

- (1) An automatic system shall be operable to initiate control rod insertion on low pressure in the control air header, which meets the following criteria:
  - (a) The system shall automatically initiate control rod insertion at 10 psi or greater above scram outlet valve opening pressure;
  - (b) The system shall not degrade the existing safety systems (e.g., reactor protection system);
  - (c) The system shall allow for scram reset;
  - (d) The design shall consider the potential for inadvertent or unnecessary scrams;

- (e) Any required power supply should not be subject to any failure mode which could also initiate the degraded-air conditions, unless it can be demonstrated that an automatic scram will occur promptly because of the failure mode of the power supply;
  - (f) The system is not subject to the requirements of Appendices A and B of 10 CFR 50;
  - (g) There shall be a documented independent design review of the system;
  - (h) Before the system is declared operable, a documented pre-operational test of the system will be successfully completed; and
  - (i) The system shall be functionally tested at each Unit shutdown, but need not be tested more than once each 90 days.
- (2) After April 9, 1981, the Automatic Dump System as described above shall be operable in all modes other than shutdown and refueling or the unit shall be placed in a cold shutdown condition within 72 hours unless system operability is restored.



V.

The licensee or any person whose interests may be affected by this Order may request a hearing within 20 days of the date of publication of this Order in the Federal Register. Any request for a hearing will not stay the effective date of this Order. Any request for a hearing shall be addressed to the Director, Office of Nuclear Reactor Regulation, U. S. Nuclear Regulatory Commission, Washington, D. C. 20555. A copy of the request should also be sent to the Executive Legal Director, U. S. Nuclear Regulatory Commission, Washington, D. C. 20555. If a person other than the licensee requests a hearing, that person shall set forth with particularity the nature of their interest and the manner in which such interest may be affected by this Order.


VI.

If a hearing is held concerning this Order, the issue to be considered at the hearing shall be:

Whether the licensee should be required to have the automatic system required by Section IV to be operable by April 9, 1981.

Operation of the facility on terms consistent with this Order is not stayed by the pendency of any proceedings on the Order.

FOR THE NUCLEAR REGULATORY COMMISSION

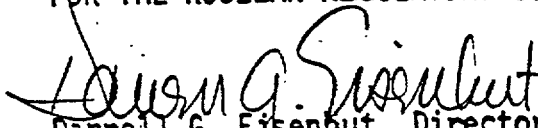  
Darrell G. Eisenhut, Director  
Division of Licensing  
Office of Nuclear Reactor Regulation

Dated: JANUARY 9 1981  
Bethesda, Maryland