

MAY 01 2001



LRN-01-0145

United States Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555

Gentlemen:

**2000 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT
SALEM AND HOPE CREEK GENERATING STATIONS
DOCKET NOS. 50-272, 50-311 AND 50-354**

As required by Section 6.9.1.7 of Appendix A to Facility Operating Licenses DPR-70 and DPR-75 for Salem Generating Station, Unit Nos. 1 and 2, and Section 6.9.1.6 of Appendix A to Facility Operating License NPF-57 for Hope Creek Generating Station, PSEG Nuclear hereby transmits one copy of the 2000 Annual Radiological Environmental Operating Report. This report summarizes the results of the radiological environmental surveillance program for 2000 in the vicinity of the Salem and Hope Creek Generating Stations. The result of this program for 2000 was specifically compared to the result of the pre-operational program.

If you have any questions or comments on this transmittal, please contact Robin Ritzman at (856) 339-1445.

Sincerely,

A handwritten signature in black ink, appearing to read "Gabor Salamon" with a stylized flourish at the end.

Gabor Salamon
Nuclear Safety and Licensing Manager

Attachment

Handwritten initials in black ink, possibly "IRB" or "IRB" with a vertical line through them.

MAY 01 2001

C Mr. H. Miller, Administrator - Region I
U. S. Nuclear Regulatory Commission
475 Allendale Road
King of Prussia, PA 19406

USNRC Salem Senior Resident Inspector (X24)

USNRC Hope Creek Senior Resident Inspector (X24)

Mr. R. Ennis, Licensing Project Manager
U. S. Nuclear Regulatory Commission
One White Flint North
11555 Rockville Pike
Mail Stop 8B1
Rockville, MD 20852

Mr. R. Fretz, Licensing Project Manager
U. S. Nuclear Regulatory Commission
One White Flint North
11555 Rockville Pike
Mail Stop 8B1
Rockville, MD 20852

Mr. K. Tosch, Manager IV
Bureau of Nuclear Engineering
33 Arctic Parkway - CN415
Trenton, NJ 08625

Mr. K. Kille
Delaware Emergency Management Agency
P.O. Box 527
Delaware City, DE 19706



PSEG

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

For

Salem Generating Station, Unit 1: Docket No. 50-272


Salem Generating Station, Unit 2: Docket No. 50-311

Hope Creek Generating Station : Docket No. 50-354

2000 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT JANUARY 1 TO DECEMBER 31, 2000

**Prepared By
PSEG MAPLEWOOD TESTING SERVICES
APRIL 2001**

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

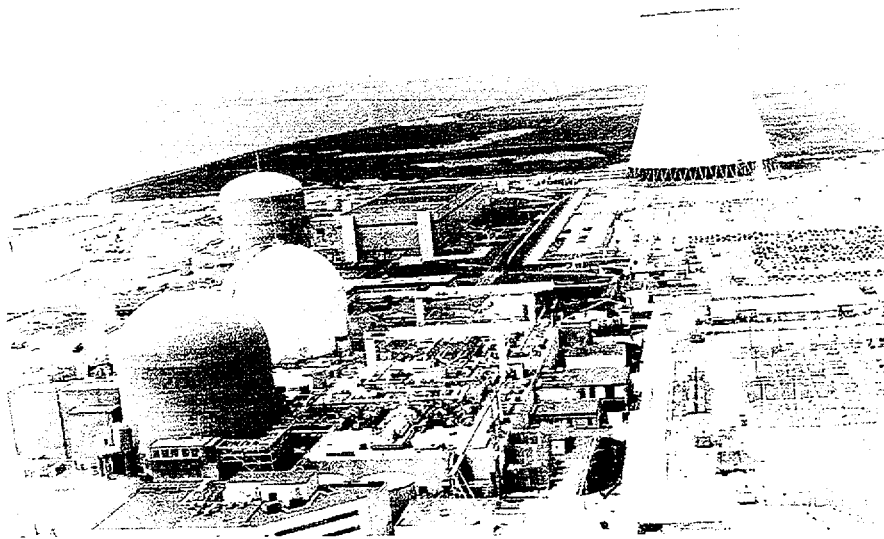

SALEM & HOPE CREEK GENERATING STATIONS

2000 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

JANUARY 1 TO DECEMBER 31, 2000

TABLE OF CONTENTS

	<u>PAGE</u>
SUMMARY.....	1
THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....	3
Objectives.....	4
Data Interpretation.....	5
Quality Assurance Program.....	5
Results and Discussion.....	6
Atmospheric.....	6
Direct Radiation.....	7
Terrestrial.....	8
Aquatic.....	12
Program Deviations.....	17
Conclusions.....	17
REFERENCES.....	28
APPENDIX A - PROGRAM SUMMARY.....	31
APPENDIX B - SAMPLE DESIGNATION AND LOCATIONS.....	39
APPENDIX C - DATA TABLES.....	47
APPENDIX D - SUMMARY OF RESULTS FROM ANALYTICS & ENVIRONMENTAL RESOURCE ASSOCIATES INTERLABORATORY COMPARISON PROGRAMS.....	77
APPENDIX E - SYNOPSIS OF LAND USE CENSUS.....	85

LIST OF TABLES

<u>TABLE NUMBER</u>	<u>TABLE DESCRIPTION</u>	<u>PAGE</u>
1.	Salem and Hope Creek Generating Stations' Radiological Environmental Monitoring Program (Program Overview)	18

LIST OF FIGURES

<u>FIGURE NUMBER</u>	<u>FIGURE DESCRIPTION</u>	<u>PAGE</u>
1.	Gross Beta Activity in Air Particulate 1980 through 2000 (Quarterly).....	21
2.	Ambient Radiation - Off-site vs Control Station 1980 through 2000 (Quarterly).....	22
3.	Iodine-131 Activity in Milk 1980 through 2000 (Quarterly).....	23
4.	Gross Beta Activity in Surface Water 1980 through 2000 (Quarterly).....	24
5.	Tritium Activity in Surface Water 1980 through 2000 (Quarterly).....	25
6A.	Cesium-137 Activity in Aquatic Sediment 1980 through 2000 (Semi-Annual).....	26
6B.	Cobalt-60 Activity in Aquatic Sediment 1980 through 2000 (Semi-Annual).....	27

SUMMARY

During normal operations of a nuclear power generating station there are releases of small amounts of radioactive material to the environment. To monitor and determine the effects of these releases a Radiological Environmental Monitoring Program (REMP) has been established for the environment around Artificial Island where the Salem Generating Stations (SGS) and Hope Creek Generating Station (HCGS) are located. The results of the REMP are published annually, providing a summary and interpretation of the data collected.

PSEG's Maplewood Testing Services (MTS) has been responsible for the collection and analysis of environmental samples during the period of January 1, 2000, through December 31, 2000, and the results are discussed in this report. The REMP for SGS/HCGS was conducted in accordance with the SGS and HCGS Technical Specifications/Offsite Dose Calculation Manual. The Lower Limit of Detection (LLD) values required by the Technical Specifications/ODCM were achieved for this reporting period. The objectives of the program were also met during this period. The data collected assists in demonstrating that SGS and HCGS were operated in compliance with Technical Specifications/ODCM.

Most of the radioactive materials noted in this report are normally present in the environment, either naturally, such as potassium-40, or as a result of non-nuclear generating station activity, such as nuclear bomb testing. Measurements made in the vicinity of SGS/HCGS were compared to background or control measurements and the preoperational REMP study performed before Salem Unit 1 became operational. Samples of air particulates, air iodine, milk, surface, ground and drinking water, vegetables, game, fodder crops, fish, crabs, and sediment were collected and analyzed. External radiation dose measurements were also made in the vicinity of SGS/HCGS using thermoluminescent dosimeters.

From the results obtained, it can be concluded that the levels and fluctuations of radioactivity in environmental samples were as expected for an estuarine environment. No unusual radiological characteristics were observed in the environs of SGS/HCGS during this reporting period. Since these results were comparable to the results obtained during the preoperational phase of the program, and with historical results collected since commercial operation, we can conclude that the operation of SGS and HCGS had no significant impact on the radiological characteristics of the environs of these stations.

To demonstrate compliance with Technical Specifications/ODCM (Sections 3/4.12.1 & 6.8.4.h -1,2,3), samples were analyzed for one or more of the following: gamma emitting isotopes, tritium (H-3), iodine-131 (I-131), gross beta and gross alpha. The results of these analyses were used to assess the environmental impact of SGS and HCGS operations,

thereby demonstrating compliance with Technical Specifications/ODCM (Section 3/4.11) and applicable Federal and State regulations, and to verify the adequacy of radioactive effluent control systems. The results provided in this report are summarized below:

- There were a total of 1177 analyses on 904 environmental samples during 2000. Direct radiation dose measurements were also made using 194 thermoluminescent dosimeters (TLDs).
- In addition to the detection of naturally-occurring isotopes (i. e. Be-7, K-40, Ra-226 and Th-232) trace levels of Cs-134 and Cs-137 were also detected. The concentrations of these nuclides were well below the Technical Specification reporting limit.
- Dose measurements made with quarterly TLDs at 31 offsite locations around the SGS/HCGS site, averaged 49 millirems for the year 2000. The average dose measurements at the control locations (background) was 53 millirems for the year. This was comparable to the preoperational phase of the program which had an average of 55 millirems per year for 1973 to 1976.

THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

Lower Alloways Creek Township, Salem County, New Jersey is the site of Salem (SGS) and Hope Creek (HCGS) Generating Stations. SGS consists of two operating pressurized water nuclear power reactors. Salem Unit One has a net rating of 1115 megawatt electric (MWe) and Salem Unit Two has a net rating of 1139 MWe. The licensed core power for both units is 3411 megawatt thermal (MWt). HCGS is a boiling water nuclear power reactor which has a net rating of 1067 MWe (3293 MWt).

SGS/HCGS are located on a man-made peninsula on the east bank of the Delaware River. It was created by the deposition of hydraulic fill from dredging operations. The environment surrounding SGS/HCGS is characterized mainly by the Delaware River and Bay, extensive tidal marshlands, and low-lying meadowlands. These land types make up approximately 85% of the land area within five miles of the site. Most of the remaining land is used for agriculture [1,2]. More specific information on the demography, hydrology, meteorology, and land use of the area may be found in the Environmental Reports [1,2], Environmental Statements [3,4], and the Updated Final Safety Analysis Reports for SGS and HCGS [5,6].

Since 1968, a radiological environmental monitoring program (REMP) has been conducted at the SGS/HCGS Site. Starting in December, 1972, more extensive radiological monitoring programs were initiated. The operational REMP was initiated in December, 1976, when Salem Unit 1 achieved criticality. PSEG's Maplewood Testing Services (MTS) has been involved in the REMP since its inception. MTS is responsible for the collection of all radiological environmental samples and, from 1973 through June, 1983, conducted a quality assurance program in which duplicates of a portion of those samples analyzed by the primary laboratory were also analyzed by MTS.

From January, 1973, through June, 1983, Radiation Management Corporation (RMC) had primary responsibility for the analysis of all samples under the SGS/HCGS REMP and annual reporting of results. RMC reports for the preoperational and operational phase of the program are referenced in this report [7-9]. On July 1, 1983, MTS assumed primary responsibility for the analysis of all samples (except TLDs) and the reporting of results. Teledyne Brown Engineering Environmental Services (TBE), assumed responsibility for third-party QA analyses and TLDs. An additional vendor, Controls for Environmental Pollution Inc. (CEP), was retained to provide third-party QA analyses and certain non-routine analyses from May, 1988, until June 1, 1992. Currently, Duke Engineering and Services Environmental Laboratory (DE&SEL) is the third party QA vendor and the laboratory which performs the TLD analyses. MTS reports for the operational phase from 1983 to 1999 are referenced in this report [10].

An overview of the 2000 Program is provided in Table 1. Radioanalytical data from samples collected under this program were compared with results from the preoperational phase. Differences between these periods were examined statistically to determine the effects of station operations. This report presents the results from January 1 through December 31, 2000, for the SGS/HCGS REMP.

OBJECTIVES

The objectives of the Operational REMP are:

- To fulfill the requirements of the Radiological Surveillance sections of the Technical Specifications/ODCM for SGS/HCGS.
- To determine whether any significant increase occurred in the concentration of radionuclides in critical pathways.
- To determine if SGS or HCGS has caused an increase in the radioactive inventory of long-lived radionuclides.
- To detect any change in ambient gamma radiation levels.
- To verify that SGS and HCGS operations have no detrimental effects on the health and safety of the public or on the environment.

This report, as required by Section 6.9.1.7 of the Salem Technical Specifications/ODCM and Section 6.9.1.6 of the Hope Creek Technical Specifications/ODCM, summarizes the findings of the 2000 REMP. Results of the four-year preoperational program have been summarized for comparison with subsequent operational reports [8].

In order to meet the objectives, an operational REMP was developed. Samples of various media were selected for monitoring due to the radiological dose impact to human and other organisms. The selection of samples was based on: (1), established critical pathways for the transfer of radionuclides through the environment to man, and, (2), experience gained during the preoperational phase. Sampling locations were determined based on site meteorology, Delaware estuarine hydrology, local demography, and land uses.

Sampling locations were divided into two classes, indicator and control. Indicator stations are those which are expected to manifest station effects. Control samples are collected at locations which are believed to be unaffected by station operations, usually at 15 to 30 kilometers distance. Fluctuations in the levels of radionuclides and direct radiation at indicator stations are evaluated with respect to analogous fluctuations at control stations. Indicator and control station data are also evaluated relative to preoperational data. Appendix A describes and summarizes, in accordance with Section 6.9.1.7 of the Salem TS and Section 6.9.1.6 of the Hope Creek TS, the operational program as performed in 2000.

Appendix B describes the coding system which identifies sample type and location. Table B-1 lists the sampling stations and the types of samples collected at each station. These sampling stations are indicated on Maps B-1 and B-2.

DATA INTERPRETATION

Results of analyses are grouped according to sample type and presented in Appendix C. All results above the Lower Limit of Detection (LLD) are at a confidence level of 2 sigma. This represents the range of values into which 95% of repeated analyses of the same sample should fall. As defined in Regulatory Guide 4.8, LLD is the smallest concentration of radioactive material in a sample that will yield a net count (above system background) that will be detected with 95% probability, with only 5% probability of falsely concluding that a blank observation represents a "real signal". LLD is normally calculated as 4.66 times the standard deviation of the background counting rate, or of the blank sample count, as appropriate, divided by counting efficiency, sample size, 2.22 (dpm per picocurie), the radiochemical yield when applicable, the radioactive decay constant and the elapsed time between sample collection and time of counting. The Minimum Detectable Concentration (MDC) is defined as the smallest concentration of radioactive material that can be detected at a given confidence level. The MDC differs from the LLD in that the MDC takes into consideration the interference caused by the presence of other nuclides while the LLD does not.

The grouped data were averaged and standard deviations calculated in accordance with Appendix B of Reference 16. Thus, the 2 sigma deviations of the averaged data represent sample and not analytical variability. For reporting and calculation of averages, any result occurring at or below the LLD is considered to be at that level. When a group of data was composed of 50% or more LLD values, averages were not calculated.

Grab sampling is a useful and acceptable procedure for taking environmental samples of a medium in which the concentration of radionuclides is expected to vary slowly with time or where intermittent sampling is deemed sufficient to establish the radiological characteristics of the medium. This method, however, is only representative of the sampled medium for that specific location and instant of time. As a result, variation in the radionuclide concentrations of the samples will normally occur. Since these variations will tend to counterbalance one another, averages based upon repetitive grab samples is considered valid.

QUALITY ASSURANCE PROGRAM

MTS has a quality assurance program designed to ensure confidence in the analytical program. Approximately 20% of the total analytical effort is spent on quality control, including process quality control, instrument quality control, interlaboratory cross-check analyses, and data review.

The quality of the results obtained by MTS is ensured by the implementation of the Quality Assurance Program as described in the Maplewood Testing Services Quality Assurance Plan [11] and the Environmental and Chemical Division Procedures Manual. The internal quality control activity of MTS includes the quality control of instrumentation, equipment and reagents; the use of reference standards in calibration, documentation of established procedures and computer programs, and analysis of duplicate and spiked samples. The external quality control activity is implemented through participation in both the Analytics and the Environmental Resource Associates Interlaboratory Comparison Programs. The results of these Interlaboratory Comparison Programs are listed in Tables D-1 through D-4 in Appendix D.

RESULTS AND DISCUSSION

The analytical results of the 2000 REMP samples are divided into categories based on exposure pathways: atmospheric, direct, terrestrial, and aquatic. The analytical results for the 2000 REMP are summarized in Appendix A. The data for individual samples are presented in Appendix C. The data collected demonstrates that the SGS and HCGS REMP was conducted in compliance with the Technical Specifications/ODCM.

The REMP for the SGS/HCGS Site has historically included samples and analyses not specifically required by these Stations' Technical Specifications/ODCM. MTS continues to collect and analyze some of these samples in order to maintain personnel proficiency in performing these non-routine analyses. These analyses are referenced throughout the report as Management Audit samples. The summary tables in this report include these additional samples and analyses.

ATMOSPHERIC

Air particulates were collected on Schleicher-Schuell No. 25 glass fiber filters with low-volume air samplers. Iodine was collected from the air by adsorption on triethylenediamine (TEDA) impregnated charcoal cartridges connected in series after the air particulate filters. Air sample volumes were measured with calibrated dry-gas meters and were corrected to standard temperature and pressure.

Air Particulates (Tables C-1, C-2)

Air particulate samples were collected at 6 locations. Each of the 311 weekly samples collected were analyzed for gross beta. Quarterly composites of the weekly samples from each station were analyzed for specific gamma emitters. Total data recovery for the 6 sampling stations in 2000 was 99.92 percent.

- Gross beta activity was detected in 259 of the indicator station samples at concentrations ranging from 5.1×10^{-3} to

48×10^{-3} pCi/m³ and in 52 of the control station samples from 7.2×10^{-3} to 48×10^{-3} pCi/m³. The averages for the indicator and control station samples were 21 and 22×10^{-3} pCi/m³, respectively. The maximum preoperational level detected was 920×10^{-3} pCi/m³, with an average of 74×10^{-3} pCi/m³. Results from 1980 to current year are plotted on Figure 1 as quarterly averages. Included along with this plot, for purposes of comparison, is an inset depicting a continuation of this plot from the current year all the way back to 1973.

■ Gamma spectroscopy, performed on each of the 24 quarterly composite samples analyzed, indicated the presence of the naturally-occurring radionuclides Be-7 and K-40. All other gamma emitters searched for were below the LLD.

○ Beryllium-7, attributed to cosmic ray activity in the atmosphere, was detected in all 20 indicator station composites that were analyzed, at concentrations ranging from 42×10^{-3} to 79×10^{-3} pCi/m³, with an average of 57×10^{-3} pCi/m³. It was detected in the 4 control station composites ranging from 47×10^{-3} to 71×10^{-3} pCi/m³, with an average of 60×10^{-3} pCi/m³. The maximum preoperational level detected was 330×10^{-3} pCi/m³, with an average of 109×10^{-3} pCi/m³.

○ Potassium-40 activity was detected in all 20 of the indicator station samples, with concentrations ranging from 6.7×10^{-3} to 16×10^{-3} pCi/m³, with an average of 12×10^{-3} pCi/m³. K-40 was also detected in the 4 control station samples, with concentrations ranging from 14×10^{-3} to 17×10^{-3} pCi/m³. No preoperational data is available for comparison.

Air Iodine (Table C-3)

Iodine in filtered air samples was collected at 6 locations. Each of the 312 weekly samples collected was analyzed for I-131.

Iodine-131 was not detected in any of the weekly samples analyzed. LLD sensitivities for all the stations, both indicator and control, ranged from $<1 \times 10^{-3}$ to $<10 \times 10^{-3}$ pCi/m³. The maximum preoperational level detected was 42×10^{-3} pCi/m³.

DIRECT RADIATION

Ambient radiation levels in the environs were measured with energy-compensated CaSO₄ (Tl) thermoluminescent dosimeters (TLDs) supplied and read by DE&SEL. Packets containing TLD's for quarterly exposure were placed in the owner controlled area and around the Site at various distances.

Direct Radiation (Table C-4)

A total of 49 locations were monitored for direct radiation during 2000, including 12 on-site locations, 31 off-site locations within the 10 mile zone, and 6 control locations beyond 10 miles. Effort was made to locate TLD's at schools and population centers in the area.

Five readings for each TLD (ie; 5 elements) at each location were taken in order to obtain a more statistically valid result. For these measurements, the rad is considered equivalent to the rem, in accordance with 10CFR20.1004.

The average dose rate for the 31 quarterly off-site indicator TLDs was 4.1 millirads per standard month, and the average control rate was 4.4 millirads per standard month. The preoperational average for the quarterly TLD readings was 4.4 millirads per standard month.

In Figure 2, the quarterly average radiation levels of the off-site indicator stations versus the control stations, are plotted for the period 1980 through 2000, with an inset graph depicting the current year back to 1973.

TERRESTRIAL

Milk samples were taken semi-monthly when cows were on pasture and monthly when cows were not grazing on open pasture. Animals are considered on pasture from April to November of each year. Samples were collected in new polyethylene containers and transported in ice chests with no preservatives added.

A well water sample was collected monthly. Separate raw and treated potable water samples were composited daily at the City of Salem water treatment plant. All samples were collected in new polyethylene containers.

Locally grown vegetable and fodder crops were collected at the time of harvest. Such samples were weighed and packed in plastic bags.

Game (muskrat) has been collected annually (time of year dependent on weather conditions, which affect pelt thickness) from local farms after being trapped, stripped of their pelts and gutted. The carcasses were packed in plastic bags and kept chilled in ice chests during transport.

Milk (Table C-5)

Milk samples were collected at 4 local dairy farms (2 farms in NJ and 2 in Delaware). Each sample was analyzed for I-131 and gamma emitters.

- Iodine-131 was not detected in any of the 80 samples analyzed.

LLD sensitivities for both the indicator and the control station samples ranged from <0.1 to <0.5 pCi/L. The maximum preoperational level detected was 65 pCi/L which occurred following a period of atmospheric nuclear weapons tests. Results from 1980 to 2000 are plotted on Figure 3, with an inset graph depicting the current year back to 1973.

- Gamma spectroscopy performed on each of the 80 samples indicated the presence of the naturally-occurring radionuclide K-40. All other gamma emitters searched for were below the LLD.
- Potassium-40 was detected in all 80 samples. Concentrations for the 60 indicator station samples ranged from 1210 to 1450 pCi/L, with an average of 1340 pCi/L. The 20 control station sample concentrations ranged from 1190 to 1450 pCi/L, with an average of 1300 pCi/L. The maximum preoperational level detected was 2000 pCi/L, with an average of 1437 pCi/L.

Well Water (Ground Water) (Tables C-6, C-7)

Although wells in the vicinity of SGS/HCGS are not directly affected by plant operations, water samples were collected monthly from one farm's well during January through December of the year. Each sample was analyzed for gross alpha, gross beta, tritium, and gamma emitters.

- Gross alpha activity was detected in 11 of the well water samples at concentrations ranging from 1.2 to 3.3 pCi/L and an average of 2 pCi/L. The maximum preoperational level detected was 9.6 pCi/L. There was no preoperational average determined for this analysis.
- Gross beta activity was detected in all 12 well water samples. Concentrations for the samples ranged from 9.5 to 11 pCi/L, with an average of 10 pCi/L. The 2000 gross beta results are comparable with the preoperational results which ranged from <2.1 to 38 pCi/L, with an average value of 9 pCi/L.
- Tritium activity was not detected in any of the well water samples. The LLD sensitivities ranged from <120 to <170 pCi/L. The maximum preoperational level detected was 380 pCi/L.
- Gamma spectroscopy performed on each of the 12 well water samples indicated the presence of the naturally-occurring radionuclides K-40 and Radium. All other gamma emitters searched for were below the LLD.
- Radium was detected in all 12 of the well water samples at concentrations ranging from 84 to 233 pCi/L with an average of 140 pCi/L. The maximum preoperational level detected was 2.0 pCi/L.

These values are similar to those found in the past ten years. However, as with the 1989 through 1999 results, they are higher than those found in the preoperational program. The results are most likely due to a procedural change for sample preparation. The change results in less removal of radon (and its daughter products) from the sample. It is reasonable to conclude that values currently observed are typical for this region.

- Potassium-40 was detected in 7 of the samples at concentrations ranging from 58 to 79 pCi/L and an average of 49 pCi/L. The maximum preoperational level detected was 30 pCi/L.

Potable Water (Drinking Water) (Tables C-8, C-9)

Both raw and treated potable water samples were collected and composited by Salem water treatment plant personnel. Each sample consisted of daily aliquots composited into a monthly sample. The raw water source for this plant is Laurel Lake and adjacent wells. Each of the 24 individual samples was analyzed for gross alpha, gross beta, tritium, iodine-131 and gamma emitters.

- Gross alpha activity was detected in 11 raw water samples at concentrations of 0.5 to 1.1 pCi/L and in 4 treated water samples ranging from 0.5 to 1.3 pCi/L. The averages for both raw and treated water samples was 0.8 pCi/L. The maximum preoperational level detected was 2.7 pCi/L.
- Gross beta activity was detected in all 24 samples at concentrations ranging from 2.0 to 3.6 pCi/L for both the raw and treated water. The average concentration for both raw and treated was 2.7 pCi/L. The maximum preoperational level detected was 9.0 pCi/L, with an average of 4.2 pCi/L.
- Tritium activity was not detected in any of the raw and treated water samples. LLD sensitivities ranged from <120 to <160 pCi/L. The maximum preoperational level detected was 350 pCi/L, with an average of 179 pCi/L.
- Iodine-131 measurements to a sensitivity of 1.0 pCi/L were performed. Since the receiving water body (Delaware River) is brackish, the water is not used for human consumption. Drinking water supplies are not affected by discharges from the site. Iodine-131 measurements for all 24 samples were below the LLD sensitivities. The LLD sensitivities ranged from <0.1 to <0.4 pCi/L.
- Gamma spectroscopy performed on each of the 24 monthly water samples indicated the presence of the naturally-occurring radionuclides K-40 and Radium. All other gamma emitters searched for were below the LLD.

- The radionuclide K-40 was detected in 17 of the raw and treated potable waters at concentrations ranging from 27 to 76 pCi/L. The combined average for both raw and treated samples was 38 pCi/L. There was no preoperational data available for comparison.
- Radium was not detected in any potable raw samples and in only 1 of the treated samples at a concentration of 4.2 pCi/L. LLD sensitivities for both raw and treated waters ranged from <1.4 to <3.4 pCi/L. The maximum preoperational level detected was 1.4 pCi/L. The higher results in the two measurable samples are most likely due to the procedural change for sample preparation, as discussed in the Well Water section.

Vegetables (Table C-10)

Although vegetables in the region are not irrigated with water into which liquid plant effluents have been discharged, a variety of food products grown in the area for human consumption were sampled at 5 indicator stations (16 samples) and 3 control stations (11 samples). The vegetables collected as management audit samples were analyzed for gamma emitters and included asparagus, cabbage, collard greens, sweet corn, peppers and tomatoes.

Gamma spectroscopy performed on each of the 27 samples indicated the presence of the naturally occurring radionuclides K-40 and Radium. All other gamma emitters searched for were below the LLD.

Potassium-40 was detected in all 27 samples. Concentrations for the 16 indicator station samples ranged from 1430 to 3100 pCi/kg-wet and averaged 2280 pCi/kg-wet. Concentrations for the 11 control station samples ranged from 1460 to 2650 pCi/kg-wet, and averaged 2180 pCi/kg-wet. The average concentration detected for all samples, both indicator and control, was 2230 pCi/kg-wet. The maximum preoperational level detected was 4800 pCi/kg-wet, with an average of 2140 pCi/kg-wet.

Radium was detected in 2 indicator samples (corn and tomato) at concentrations of 16 and 20 pCi/kg-wet. It was not detected in any of the control station samples. No preoperational data is available for comparison.

Game (Table C-11)

Although not required by the SGS or HCGS Technical Specifications/ODCM, samples of muskrats, inhabiting the marshlands surrounding the site, are collected. This game is consumed by local residents. The samples, when available, are collected from 2 locations once a year as management audit samples and analyzed for gamma emitters.

Gamma spectroscopy performed on the flesh indicated the presence of the naturally-occurring radionuclide K-40. All other gamma emitters searched for were below the LLD.

Potassium-40 was detected in the indicator station sample at a concentration of 3240 pCi/kg-wet and the control station sample at 2550 pCi/kg-wet. The average for both muskrat samples was 2900 pCi/kg-wet. The maximum preoperational level detected was 27000 pCi/kg-wet, with an average of 4400 pCi/kg-wet.

Fodder Crops (Table C-12)

Although not required by the SGS or HCGS Technical Specifications/ODCM, seven samples of crops normally used as cattle feed (silage and soybeans) were collected from three indicator stations (5 samples) and one control station (2 samples). It was determined that these products may be a significant element in the food-chain pathway. Fodder crops are collected as management audit samples and analyzed for gamma emitters. All of the locations from which samples were collected this year are milk sampling stations.

Gamma spectroscopy performed on each of the 7 samples indicated the presence of the naturally-occurring radionuclides Be-7 and K-40. All other gamma emitters searched for were below the LLD.

Beryllium-7, attributed to cosmic ray activity in the atmosphere, was detected in all 3 of the indicator silage samples at concentrations of 490 to 840 pCi/kg-wet. It was detected in the control station silage sample at 690 pCi/kg-wet. The average for all the silage samples was 710 pCi/kg-wet. The maximum preoperational level detected for silage was 4700 pCi/kg-wet, with an average of 2000 pCi/kg-wet. Be-7 was not detected in any of the soybean samples. LLD sensitivities for the soybean samples ranged from <30 to <40 pCi/kg-wet. The maximum preoperational level detected for soybean samples was 9300 pCi/kg-dry.

Potassium-40 was detected in all 7 samples. Concentrations for the 5 indicator station samples ranged from 3100 to 15600 pCi/kg-wet and for the 2 control station samples at 3860 and 14100 pCi/kg-wet. The average concentration detected for the silage samples (both indicator and control) was 3930 pCi/kg-wet. Preoperational results averaged 7000 pCi/kg-wet. Results for the soybean samples (both indicator and control) averaged 14500 pCi/kg-wet which is comparable to preoperational studies when the average wet/dry factor of 1.2 is used. Preoperational soybean results averaged 22000 pCi/kg-dry.

AQUATIC

All aquatic samples were collected by Environmental Consulting Services, Inc. Surface water samples were collected in new polyethylene containers that were rinsed twice with the sample medium prior to collection.

Edible fish and crabs are taken by net and then processed. In processing, the flesh is separated from the bone and shell and placed in sealed polyethylene containers and frozen before being transported in ice chests.

Sediment samples were taken with a bottom grab sampler and frozen in sealed polyethylene containers before being transported in ice chests.

Surface Water (Tables C-13, C-14, C-15)

Surface water samples were collected monthly at 4 indicator stations and 1 control station in the Delaware estuary.

One location is at the outfall area (which is the area where liquid radioactive effluents from the Salem Station are allowed to be discharged into the Delaware River), another is downstream from the outfall area, and another is directly west of the outfall area at the mouth of the Appoquinimink River. Two upstream locations are in the Delaware River and at the mouth of the Chesapeake and Delaware Canal, the latter being sampled when the flow is from the Canal into the river. Station 12C1, at the mouth of the Appoquinimink River, serves as the operational control. All surface water samples were analyzed monthly for gross beta and gamma emitters. Quarterly composites were analyzed for tritium.

- Gross beta activity was detected in all 48 of the indicator station samples ranging from 5.7 to 191 pCi/L, with an average of 59 pCi/L. Beta activity was detected in all 12 of the control station samples with concentrations ranging from 20 to 123 pCi/L, with an average of 50 pCi/L. The maximum preoperational level detected was 110 pCi/L, with an average of 32 pCi/L. Quarterly results for all locations are plotted on Figure 4, for the years 1980 to 2000, with an inset graph depicting the current year back to 1973.
- Tritium activity was detected in 1 of the indicator station composites at an average concentration of 240 pCi/L. Tritium was not detected in any of the control station composites. LLD sensitivities for the remaining composites, both indicator and control, ranged from <150 to <170 pCi/L. The maximum preoperational level detected was 600 pCi/L, with an average of 210 pCi/L. Positive results from 1980 to 2000 are plotted on Figure 5, with an inset graph depicting the current year back to 1973.
- Gamma spectroscopy performed on each of the 48 indicator station and 12 control station surface water samples indicated the presence of the naturally-occurring radionuclides K-40 and Radium. All other gamma emitters searched for were below the LLD.

- Potassium-40 was detected in 46 samples from the indicator stations at concentrations ranging from 39 to 208 pCi/L and in all of the control station samples ranging from 21 to 111 pCi/L. The average for the indicator station locations was 91 pCi/L, while the average for the control station locations was 72 pCi/L. The maximum preoperational level detected was 200 pCi/L, with an average of 48 pCi/L.
- Radium was not detected in any of the 48 indicator station samples and in one of the 12 control station samples at a concentration of 5 pCi/L. LLD values for the remaining samples, both the indicator and control locations, ranged from <1.5 to <6.3 pCi/L. The maximum preoperational level detected was 4.0 pCi/L.

Fish (Table C-17)

Edible species of fish were collected semi-annually at 3 locations and analyzed for gamma emitters (flesh), and for Sr-89 and Sr-90 (bones & flesh) in one location (11A1). This location was chosen since it is the outfall area for the Salem Station. Samples included catfish, weakfish, white perch and striped bass.

- Gamma spectroscopy performed on each of the 4 indicator station samples and 2 control station samples indicated the presence of the naturally-occurring radionuclide K-40. All other gamma emitters searched for were below the LLD.
- Potassium-40 was detected in all 4 samples from the indicator stations at concentrations ranging from 3190 to 3830 pCi/kg-wet for an average of 3520 pCi/kg-wet. K-40 was detected in both samples from the control location at 3350 and 3600 pCi/kg-wet. The average for the control samples was 3475 pCi/kg-wet. The maximum preoperational level detected was 13000 pCi/kg-wet, with an average of 2900 pCi/kg-wet.
- Strontium-89 and strontium-90 analyses were performed by DE&SEL on one sample of the first semi-annual sample collection (location 11A1), and reported as MDC. These are management audit analyses which are performed in recognition of the high bioaccumulation factor of strontium in bone.
- Strontium-89 was not detected in the bone sample. The MDC value for the sample was <130 pCi/kg-dry. The maximum preoperational level detected was 100 pCi/kg-dry.
- Strontium-90 was not detected in the bone sample. The MDC value for the sample was <120 pCi/kg-dry. The maximum preoperational level detected was 940 pCi/kg-dry, with an average of 335 pCi/kg-dry.
- Strontium-89 was not detected in the flesh sample. The MDC value for the sample was <35 pCi/kg-wet. The pre-operational level ranged from <4.1 to <100 pCi/kg-wet.

- Strontium-90 was not detected in the flesh sample. The MDC value for the sample was <18 pCi/kg-wet. The maximum preoperational level detected was 67 pCi/kg-wet.

Blue Crab (Table C-18)

Blue crab samples were collected semi-annually at 2 locations, 1 indicator and 1 control, and the edible portions were analyzed for gamma emitters.

Gamma spectroscopy performed on the flesh of each of the 2 indicator station samples and 2 control station samples indicated the presence of the naturally-occurring radionuclides K-40 and Radium. All other gamma emitters searched for were below the LLD.

Potassium-40 was detected in both indicator station samples at concentrations of 2440 and 2500 pCi/kg-wet and in both of the control station samples at 2090 and 2300 pCi/kg-wet. The average for both the indicator and control station samples was 2280 pCi/kg-wet. The maximum preoperational level detected was 12000 pCi/kg-wet, with an average of 2835 pCi/kg-wet.

Sediment (Table C-19)

Sediment samples were collected semi-annually from 7 locations, 6 indicator stations and 1 control station. Each of the 14 samples was analyzed for gamma emitters. Although trace levels of man-made nuclides were detected in some sediment samples, these levels were expected and well within the acceptable levels specified in section 3/4.12.1 of the Technical Specifications/ODCM.

Gamma spectroscopy was performed on each of the 12 indicator station samples and 2 control station samples. In addition to the detection of the naturally-occurring radionuclides Radium, K-40, Be-7 and Th-232, low levels of Cs-134 and Cs-137 were also detected. All other gamma emitters searched for were below the LLD.

Cesium-134 was detected in 1 of the 12 indicator station samples at a concentration of 25 pCi/kg-dry. It was not detected in either control station samples. LLD sensitivities for the remaining station samples, both indicator and control ranged from <2.1 to <9 pCi/kg-dry. No pre-operational data is available for comparison.

Cesium-137 was detected in 8 indicator station samples at concentrations ranging from 32 to 168 pCi/kg-dry and an average of 78 pCi/kg-dry. It was detected in 1 control station sample at a concentration of 47 pCi/kg-dry. The maximum preoperational level detected was 400 pCi/kg-dry with an average of 150 pCi/kg-dry. Results from 1980 to 2000 are plotted on Figure 6A, with an inset graph depicting the current year back to 1973.

Cobalt-60 was not detected in any of the sediment samples. LLD sensitivities for these 14 samples, indicator and control, ranged from <3.2 to <19 pCi/kg-dry. Results of all the positive values from 1980 to 2000 are plotted on Figure 6B, with an inset graph depicting the current year back to 1973.

Potassium-40 was detected in all 12 indicator station samples at concentrations ranging from 1330 to 16600 pCi/kg-dry, with an average of 11340 pCi/kg-dry. Concentrations detected in both of the control station samples were at 13400 and 14000 pCi/kg-dry. The average for both the indicator and control station samples was 11700 pCi/kg-dry. The maximum preoperational level detected was 21000 pCi/kg-dry, with an average of 15000 pCi/kg-dry.

Radium was detected in all 12 indicator station samples at concentrations ranging from 140 to 860 pCi/kg-dry, with an average of 550 pCi/kg-dry. Concentrations detected in both of the control station samples were at 710 and 800 pCi/kg-dry, with an average of 760 pCi/kg-dry. The grand average for both the indicator and control station samples was 580 pCi/kg-dry. The maximum pre-operational level detected was 1200 pCi/kg-dry, with an average of 760 pCi/kg-dry.

Thorium-232 was detected in all 12 indicator station samples at concentrations ranging from 150 to 1200 pCi/kg-dry, with an average of 780 pCi/kg-dry. Concentrations detected in both of the control station samples were at 860 and 920 pCi/kg-dry, with an average of 890 pCi/kg-dry. The grand average for both the indicator and control station samples was 910 pCi/kg-dry. The maximum pre-operational level detected was 1300 pCi/kg-dry, with an average of 840 pCi/kg-dry.

Beryllium-7 was detected in 2 of the 12 indicator station samples at a concentration of 660 and 890 pCi/kg-dry, and in 1 of the control station samples at a concentration of 250 pCi/kg-dry. The LLD sensitivities for the remaining samples, both indicator and control, ranged from <40 to <120 pCi/kg-dry. The maximum preoperational level detected was 2300 pCi/kg-dry.

PROGRAM DEVIATIONS

An air particulate sample was not available for the week of 6/05-12/00 at location 16E1. The filter was vandalized by having a hole poked through it, rendering the result invalid. Since our filter/iodine cartridges are located 10 feet off the ground and difficult to reach without a ladder, this was considered an isolated incident with no modifications to be made at this time. The total availability of all the air sampling equipment for the year 2000 was 99.92%.

The TLD result for the 2nd quarter from location 5F1 was not reported by DE&SEL. Some of the TLDs used in the program were changed out by different groups and sent to DE&SEL at different times, creating a holding period in which the samples were left in a tray on a shelf before being read. MTS personnel are now responsible for all routine TLD changeout in the field and shipment of all the samples to DE&SEL for analysis.

The TLD from location 7F2 was lost during the 3rd quarter, 2000. The utility pole the TLD had been stapled to had been replaced. A search of the marsh area around the pole did not turn up the package. A supervisor of the line crew at Conective was contacted and reported to us the pole had been replaced after it fell during a recent storm. He told us their personnel did not find anything on the pole. We inquired if we could put a name of a Conective supervisor on the TLD package that has our MTS name and phone number in the event that this happens again. We were told that since their personnel change jobs often this was not a good idea. We agreed that in the event they should find one of our TLD packets on one of their utility poles that they may need to remove, they will contact MTS.

CONCLUSIONS

The Radiological Environmental Monitoring Program for Salem and Hope Creek Generating Stations was conducted during 2000 in accordance with the SGS and HCGS Technical Specifications/ODCM. The LLD values required by the Technical Specifications/ODCM were achieved for this reporting period. The objectives of the program were also met during this period. The data collected assists in demonstrating that SGS and HCGS were operated in compliance with Technical Specifications/ODCM.

From the results obtained, it can be concluded that the levels and fluctuations of radioactivity in environmental samples were as expected for an estuarine environment. No unusual radiological characteristics were observed in the environs of SGS/HCGS during this reporting period. Since these results were comparable to the results obtained during the preoperational phase of the program, which ran from 1973 to 1976, and with historical results collected since commercial operation, we can conclude that the operation of the Salem and Hope Creek Stations had no significant impact on the radiological characteristics of the environs of that area.

TABLE 1

SALEM AND HOPE CREEK GENERATING STATIONS
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
(PROGRAM OVERVIEW)

MEDIUM	STATION CODE		COLLECTION FREQUENCY	TYPE/FREQUENCY* OF ANALYSIS
	INDICATOR	CONTROL		
<u>I. ATMOSPHERIC ENVIRONMENT</u>				
a. Air Particulate	5S1 5D1 16E1 1F1 2F6	14G1	Weekly	Gross beta/weekly Gamma scan/quarterly
b. Air Iodine	5S1 5D1 16E1 1F1 2F6	14G1	Weekly	Iodine-131/weekly
<u>II. DIRECT RADIATION</u>				
a. Thermoluminescent Dosimeters	1S1 2S4 3S1 4S1 3G1 2S2 5D1 2E1 1F1 1G3 5S1 10D1 3E1 2F2 10G1 6S2 14D1 13E1 2F6 16G1 7S1 15S1 16S1 4F2 14G1 10S1 16E1 5F1 6F1 3H1 11S1 7F2 11F1 13F4 4D2 9E1 2F5 3F2 11E2 15D1 12E1 3F3 16F2 10F2 12F1 13F2 13F3 14F2 15F3		Quarterly	Gamma dose/ quarterly
<u>III. Terrestrial Environment</u>				
a. Milk	2F9 11F3 14F4	3G1	Monthly (when animals are on pasture) Semi-monthly (when animals are on pasture)	Iodine-131/monthly Gamma scan/monthly Iodine-131/semi-monthly Gamma scan/semi-monthly

TABLE 1 (cont'd)

SALEM AND HOPE CREEK GENERATING STATIONS
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
(PROGRAM OVERVIEW)

MEDIUM	STATION CODE				COLLECTION FREQUENCY	TYPE/FREQUENCY* OF ANALYSIS
	INDICATOR		CONTROL			
b. Well Water	3E1				Monthly	Gross alpha/monthly Gross beta/monthly Tritium/monthly Gamma scan/monthly
c. Potable Water (Raw & Treated)	2F3				Monthly (composited daily)	Gross alpha/monthly Gross beta/monthly Tritium/monthly Gamma scan/monthly Iodine-131/monthly
d. Vegetables	3E1	2F4	2F9	1G1	Annually (at harvest)	Gamma scan/on collection
	3F5	3F6	3F8	2G2		
	6F2	14F3		3H5		
e. Game (Muskrat)	11D1	3E1			Annually	Gamma scan/on collection
f. Fodder Crops	2F9	11F3	14F4	3G1	Annually	Gamma scan/on collection
g. Soil	6S2	2F7	11F3	3G1	Every 3 years	Gamma scan/on collection
	10D1	2F9	14F4			
	16E1	5F1				

TABLE 1 (cont'd)

SALEM AND HOPE CREEK GENERATING STATIONS
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
(PROGRAM OVERVIEW)

MEDIUM	STATION CODE					COLLECTION FREQUENCY	TYPE/FREQUENCY* OF ANALYSIS
	INDICATOR	CONTROL					
<u>IV. AQUATIC ENVIRONMENT</u>							
a. Surface Water	11A1	7E1	1F2	12C1	16F1	Monthly	Gross beta/monthly Gamma scan/monthly Tritium/quarterly
b. Edible Fish	11A1	7E1			12C1	Semi- annually	Sr-89 & Sr-90 (bones)/on 1 loc.** Sr-89 & Sr-90 (flesh)/on 1 loc.** Gamma scan (flesh)/on collection
c. Blue Crabs	11A1				12C1	Semi- annually	Gamma scan (flesh)/on collection
d. Sediment	11A1	6S2	7E1	12C1		Semi- annually	Gamma scan/on collection
	15A1	16F1					
	16A1						

* Except for TLDs, the quarterly analysis is performed on a composite of individual samples collected during the quarter.

** Management audit analyses, not required by Technical Specifications or by specific commitments to local officials.

FIGURE 1
GROSS BETA IN AIR PARTICULATE
1980 THROUGH 2000


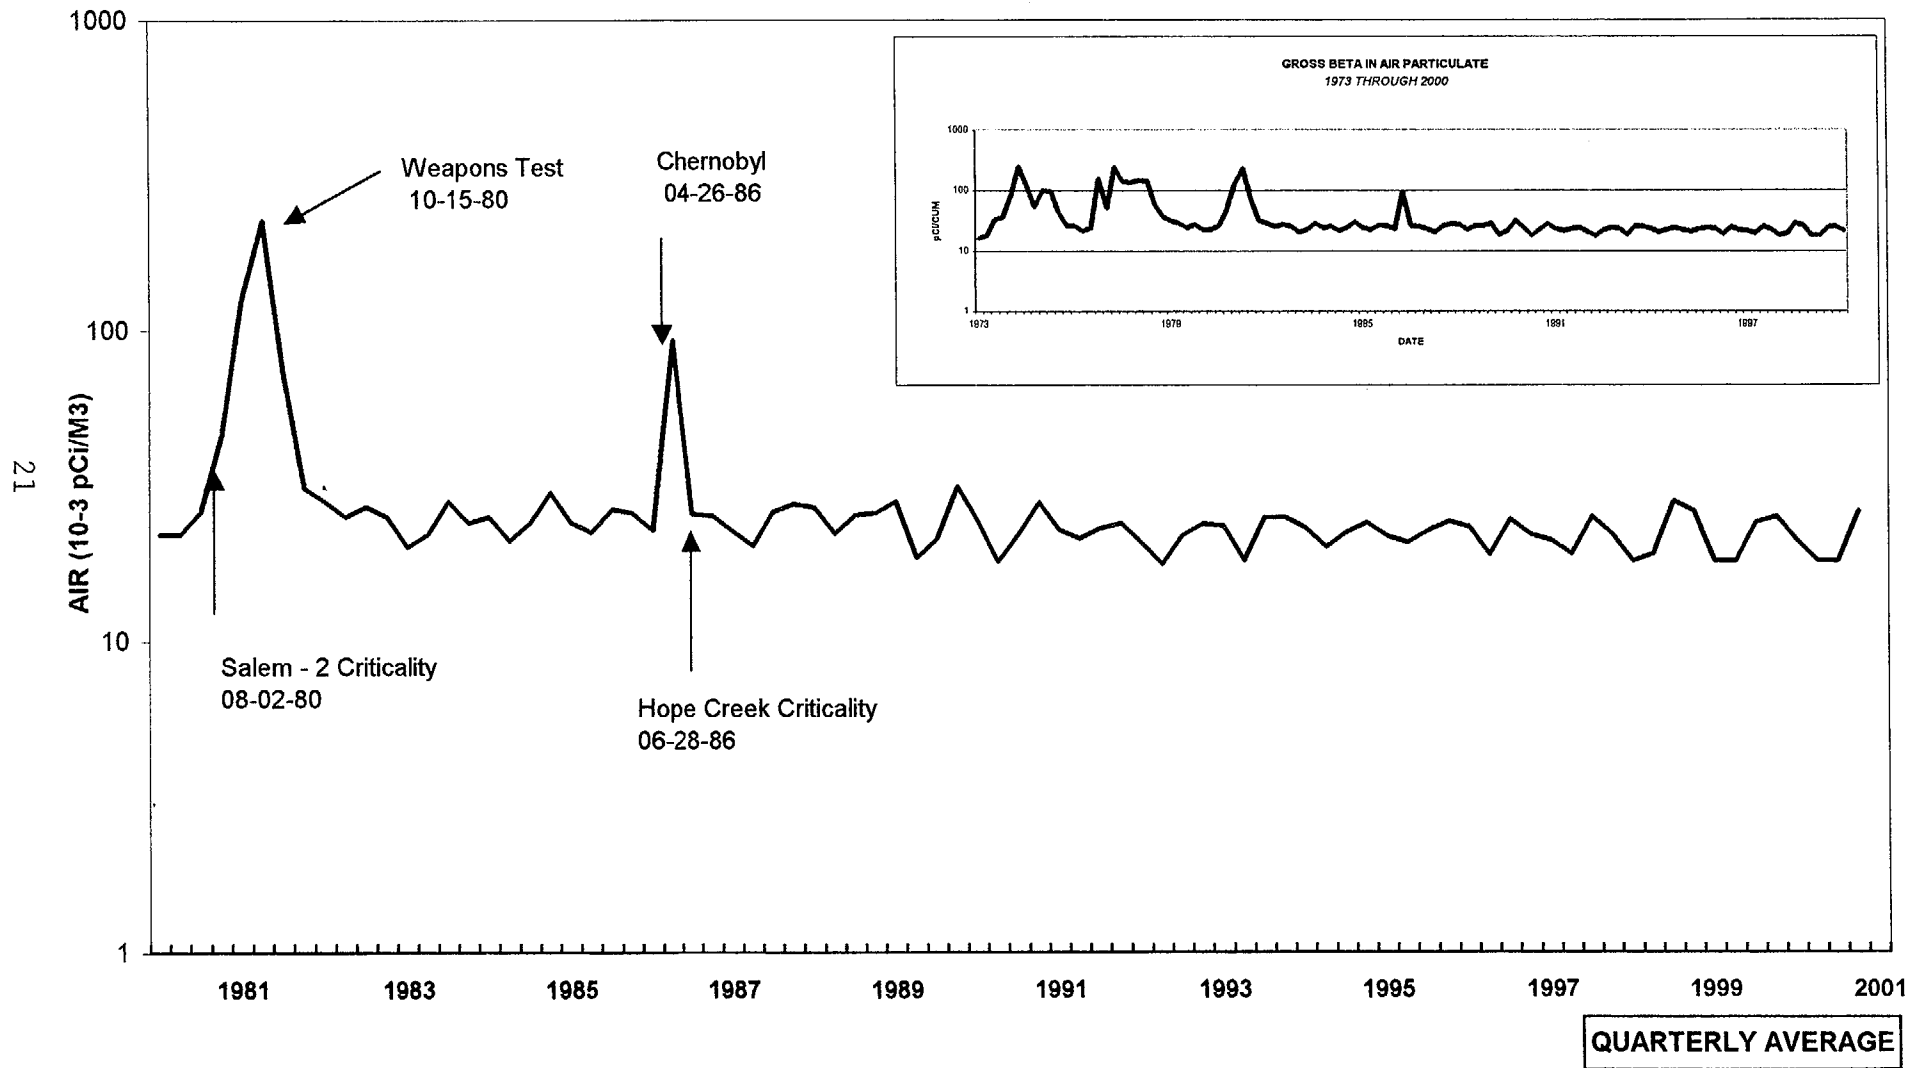


FIGURE 2
AMBIENT RADIATION - OFFSITE vs CONTROL STATION
1980 THROUGH 2000

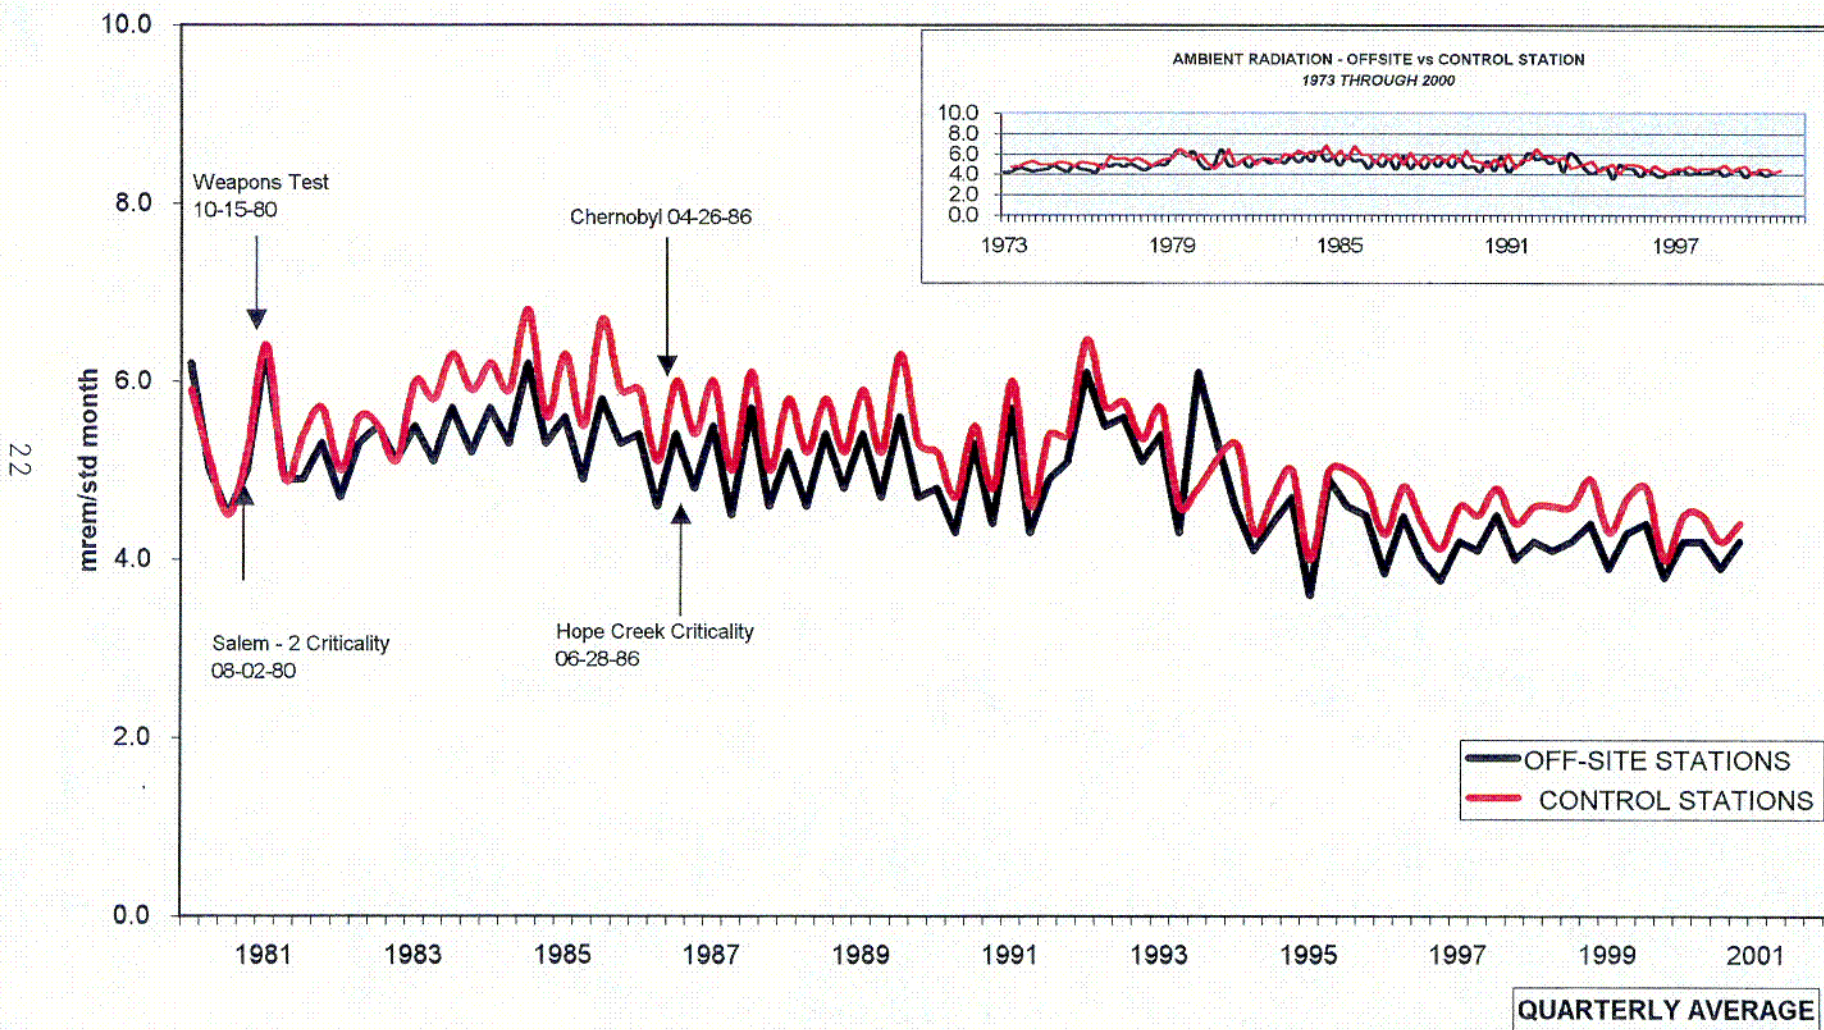

C01

FIGURE 3
IODINE - 131 ACTIVITY IN MILK
1980 THROUGH 2000

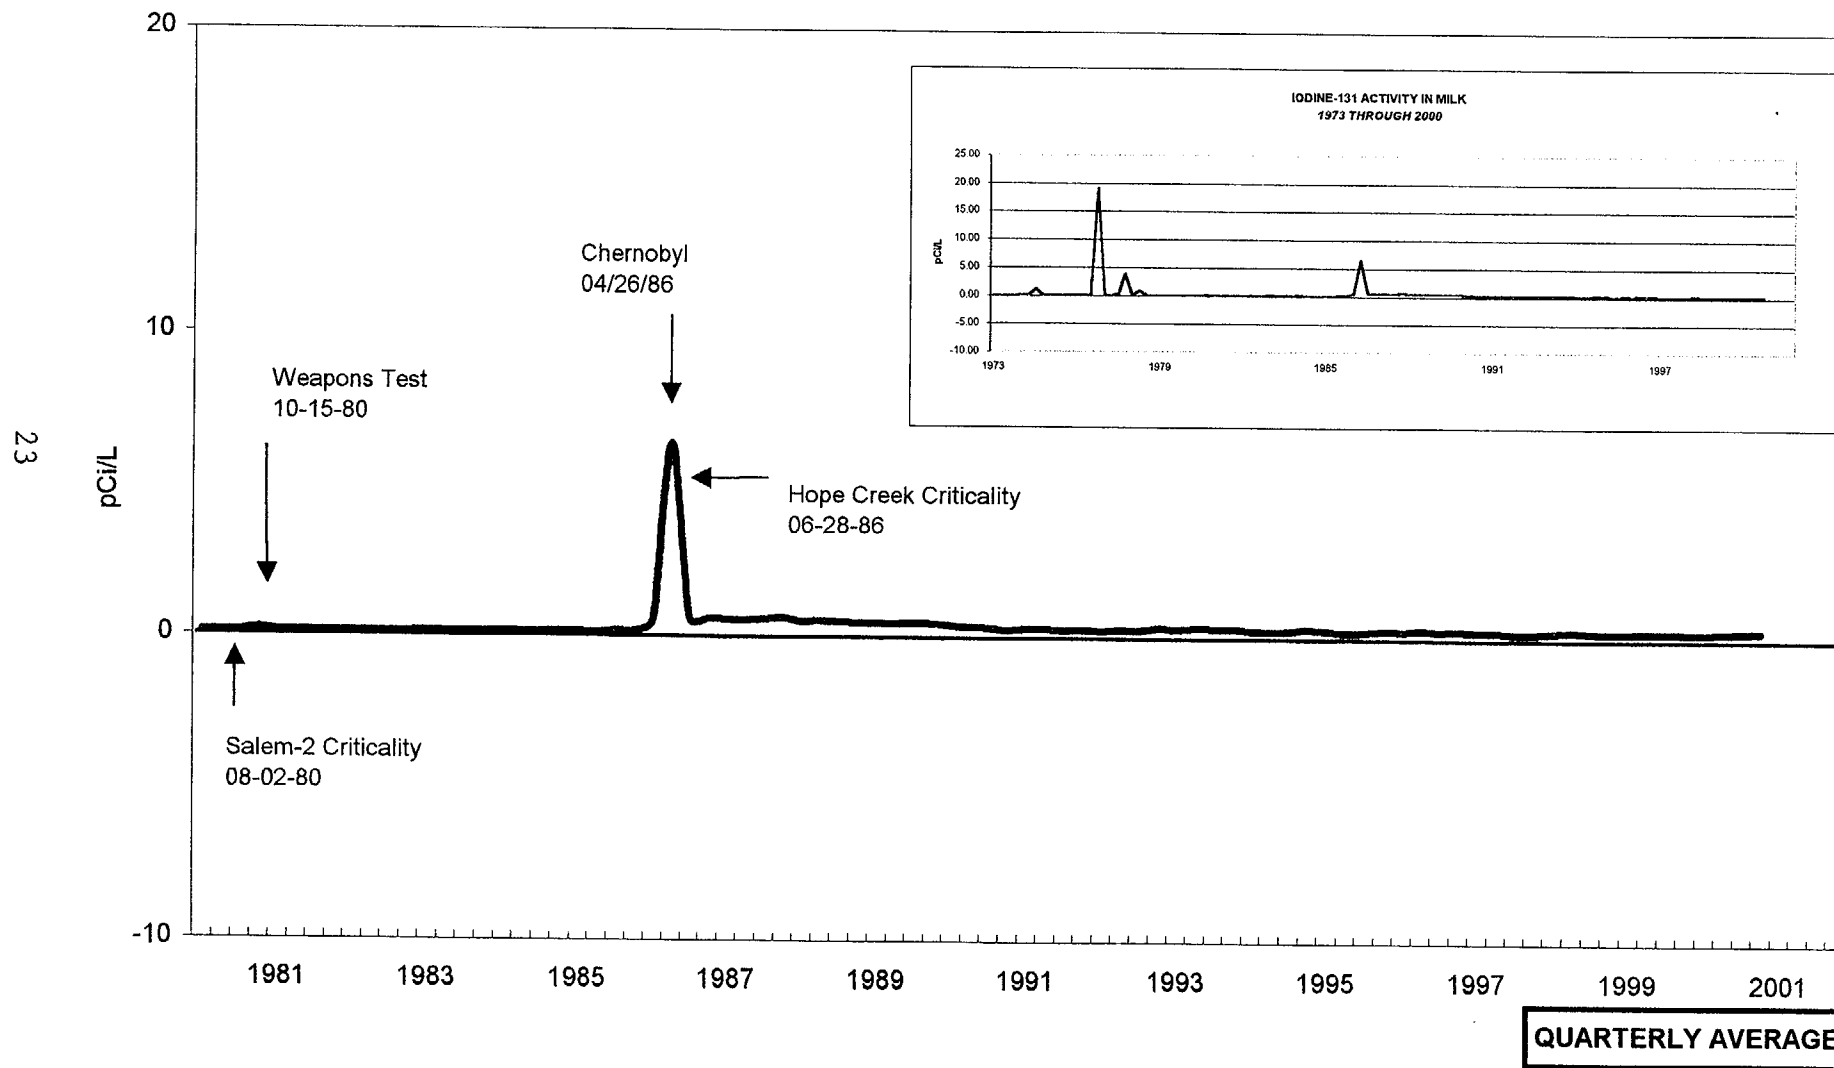


FIGURE 4
GROSS BETA ACTIVITY IN SURFACE WATER
1980 THROUGH 2000

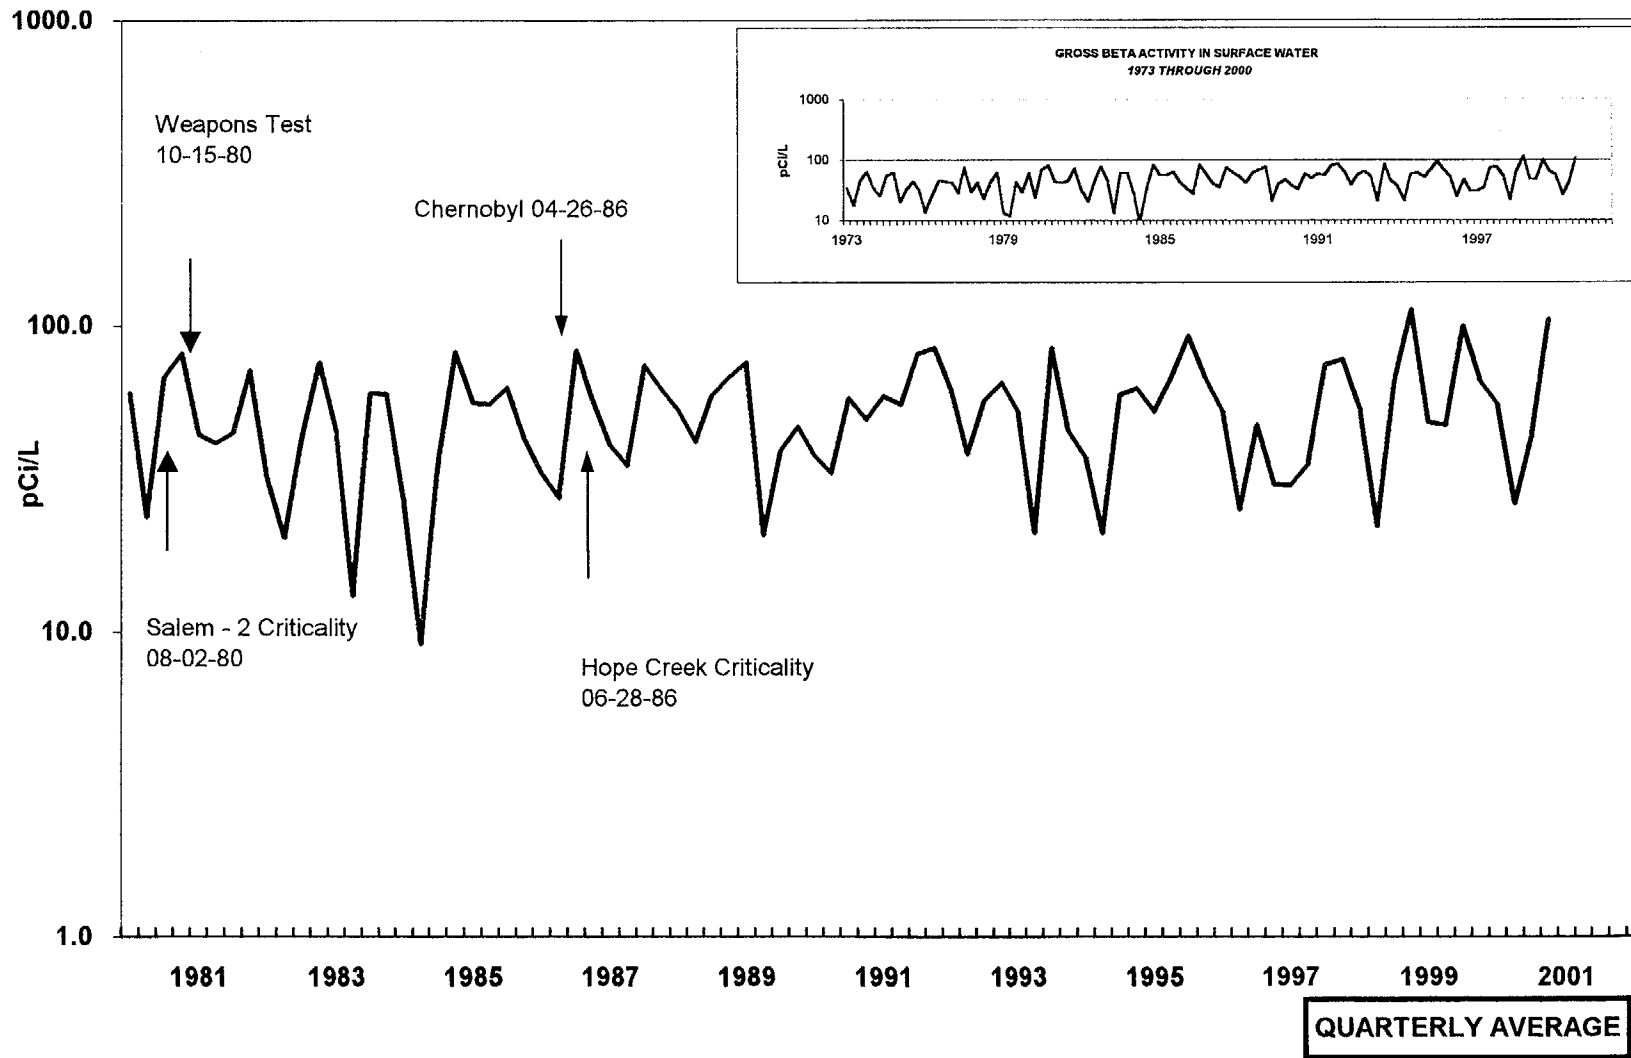


FIGURE 5
TRITIUM ACTIVITY IN SURFACE WATER
1980 THROUGH 2000

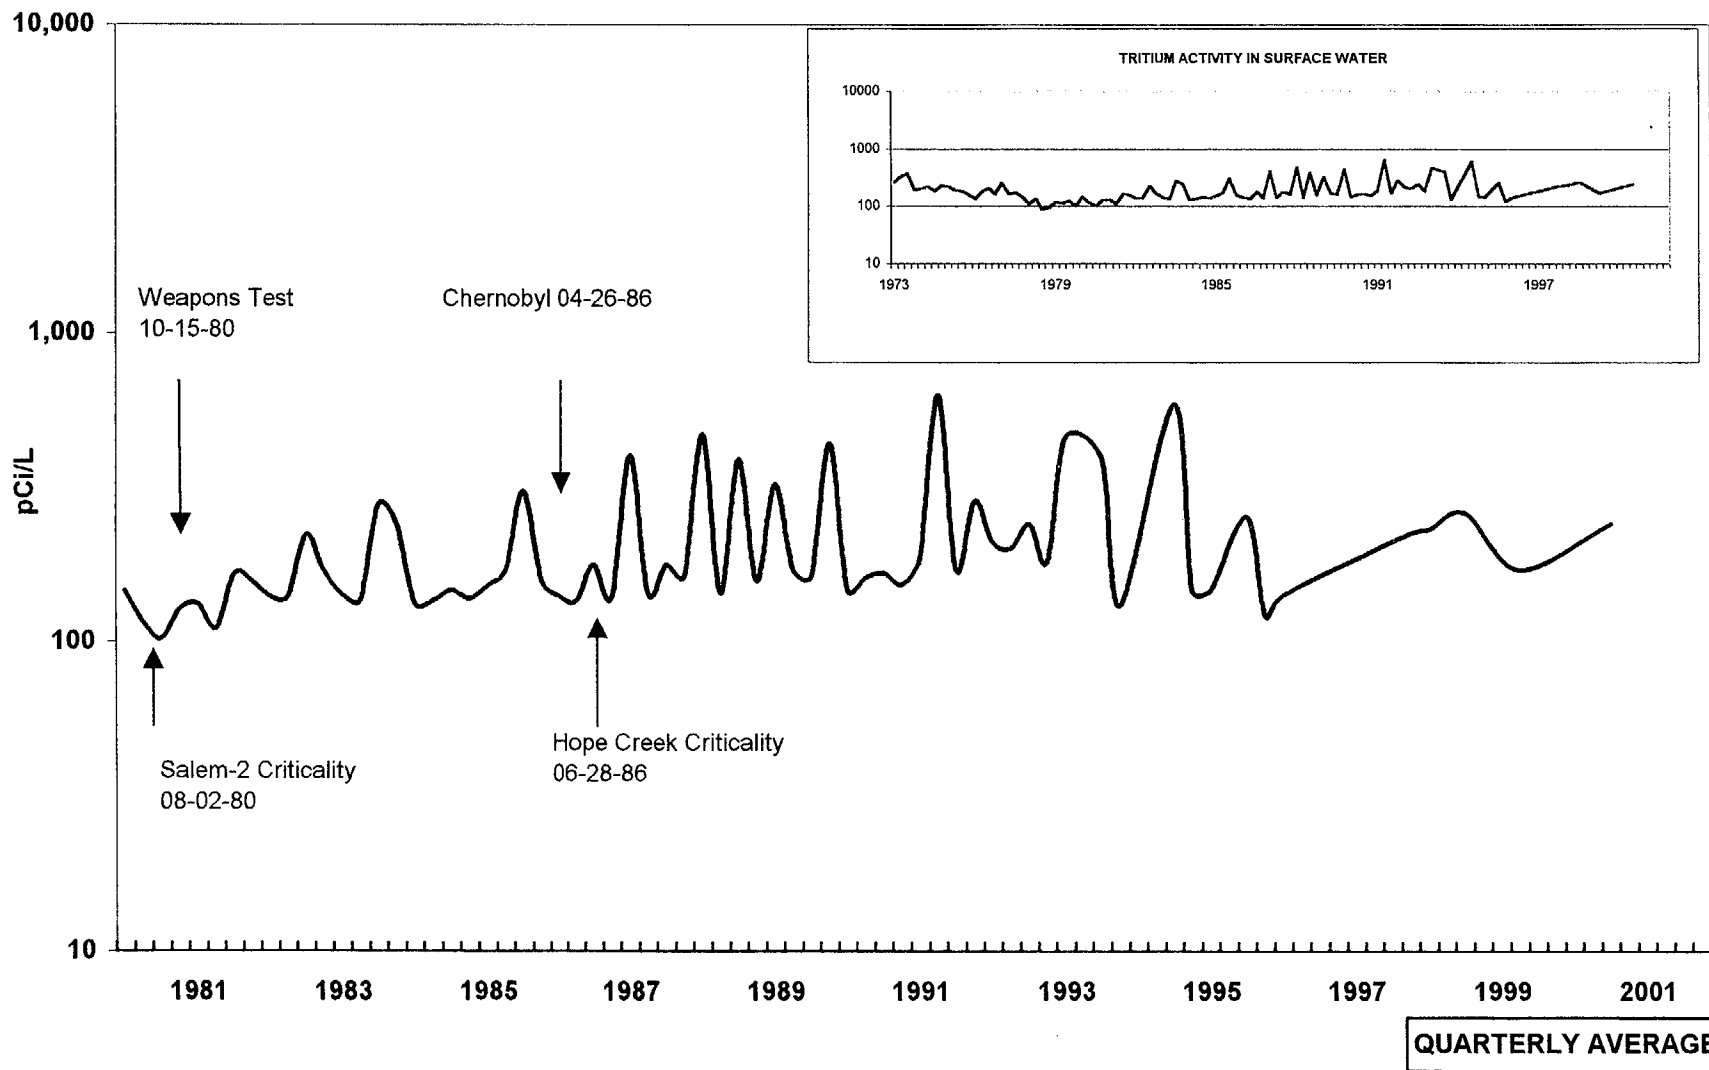


FIGURE 6A
CESIUM-137 ACTIVITY IN AQUATIC SEDIMENT
1980 THROUGH 2000


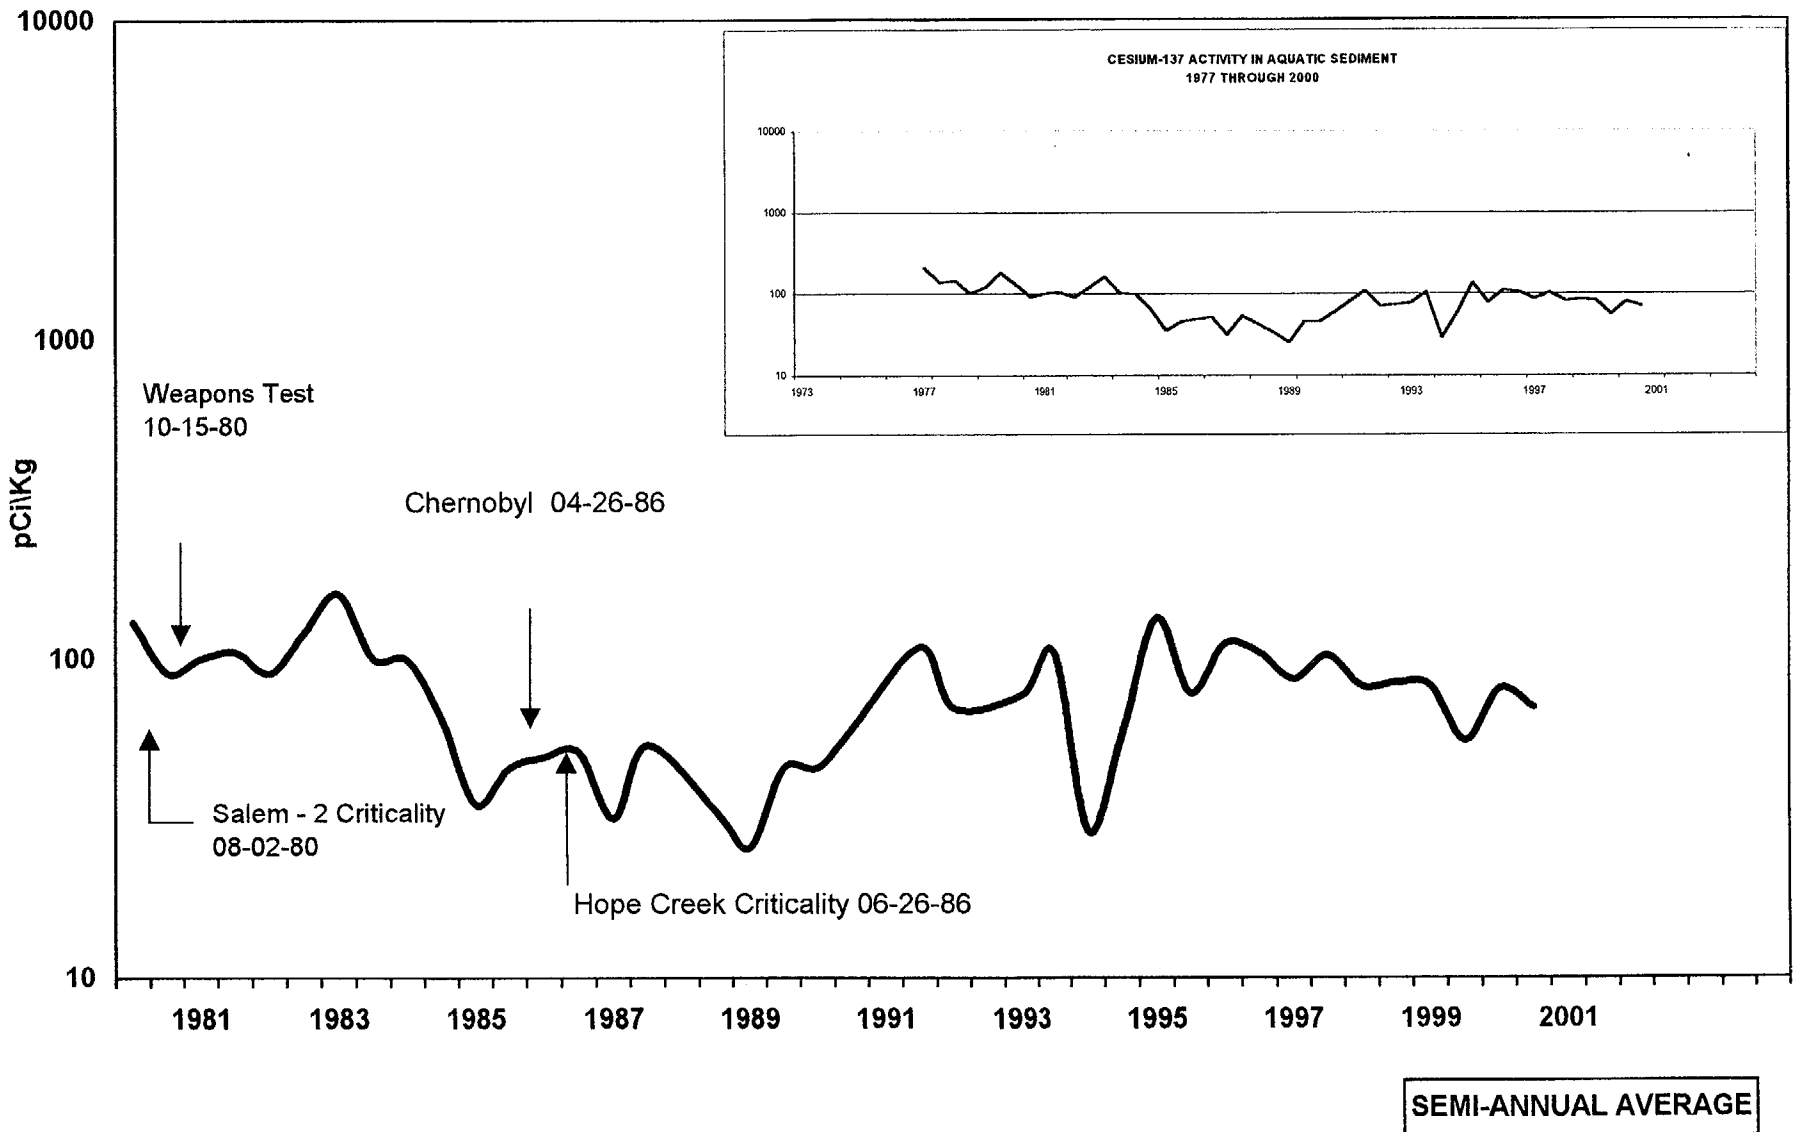


FIGURE 6B
COBALT- 60 ACTIVITY IN AQUATIC SEDIMENT
1980 THROUGH 2000

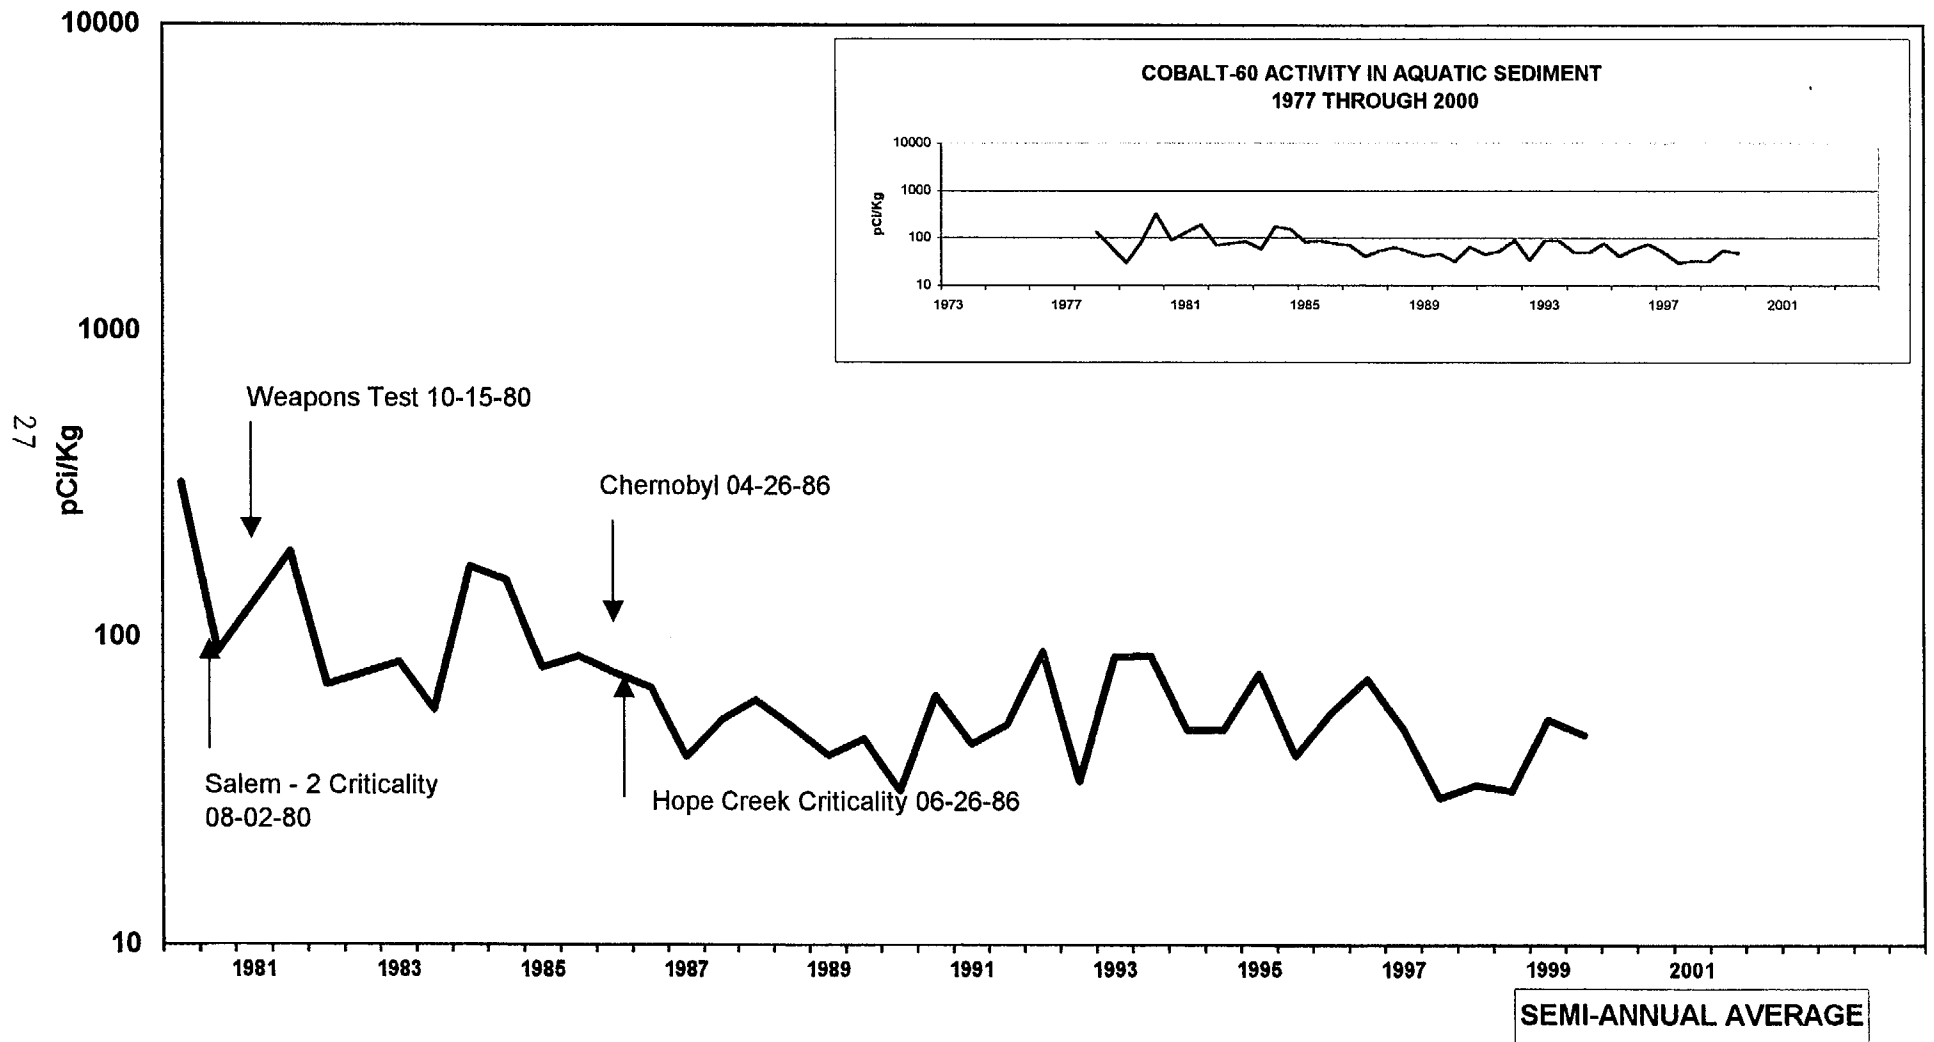

REFERENCES

- [1] Public Service Enterprise Group . "Environmental Report, Operating License Stage - Salem Nuclear Generating Station Units 1 and 2". 1971.
- [2] Public Service Enterprise Group . "Environmental Report, Operating License Stage - Hope Creek Generating Station". 1983.
- [3] United States Atomic Energy Commission. "Final Environmental Statement - Salem Nuclear Generating Station, Units 1 and 2". Docket No. 50-272 and 50-311. 1973.
- [4] United States Atomic Energy Commission. "Final Environmental Statement - Hope Creek Generating Station, Docket No. 50-354. 1983.
- [5] Public Service Enterprise Group . "Updated Final Safety Analysis Report - Salem Nuclear Generating Station, Units 1 and 2". 1982.
- [6] Public Service Enterprise Group . "Updated Final Safety Analysis Report - Hope Creek Generating Station.
- [7] Radiation Management Corporation. "Artificial Island Radiological Environmental Monitoring Program - Annual Reports 1973 through 1982".
- [8] Radiation Management Corporation. "Artificial Island Radiological Environmental Monitoring Program - Preoperation Summary - 1973 through 1976". RMC-TR-77-03, 1978.
- [9] Radiation Management Corporation. "Artificial Island Radiological Environmental Monitoring Program - December 11 to December 31, 1976". RMC-TR-77-02, 1977.
- [10] PSEG Power LLC Maplewood Testing Services. "Salem and Hope Creek Generating Stations' Radiological Environmental Monitoring Program - Annual Reports 1983 through 1999".
- [11] PSEG Power LLC Maplewood Testing Services. "Quality Assurance Plan." August, 1999
- [12] Public Service Enterprise Group . "Salem Nuclear Generating Station Technical Specifications", Appendix A to Operating License No. DPR-70, 1976, Sections 6.8.4.h - 1,2,3 and 6.9.1.7.
- [13] Public Service Enterprise Group . "Hope Creek Generating Station Technical Specifications", Appendix A to Facility Operating License No. NPF-57, 1986, Sections 6.8.4.h - 1,2,3 and 6.9.1.6.
- [14] Public Service Enterprise Group . "Offsite Dose Calculation Manual" - Salem Generating Station.

REFERENCES (cont'd)

- [15] Public Service Enterprise Group . "Offsite Dose Calculation Manual"
- Hope Creek Generating Station.
- [16] U.S. Environmental Protection Agency. "Prescribed Procedures for Measurement
of Radioactivity in Drinking Water." EPA-600/4-80-032, August, 1980.

APPENDIX A

PROGRAM SUMMARY

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SALEM GENERATING STATION
HOPE CREEK GENERATING STATION

DOCKET 50-272/-311
DOCKET NO. 50-354

SALEM COUNTY, NEW JERSEY JANUARY 1, 2000 to DECEMBER 31, 2000

MEDIUM OR PATHWAY SAMPLE (UNIT OF MEASUREMENT)	Analysis And Total Number of Analyses Performed		Lower Limit of Detection (LLD) *	All Indicator Locations	Location with Highest Mean	Control Location		Number of Nonroutine Reported Measurements
				Mean (Range)	Name Distance and Direction	Mean (Range)	Mean (Range)	
I. AIRBORNE								
Air Particulates (10 ⁻³ pCi/m ³)	Beta	311	6.0	21 (259 /259) (5.1-48)	14G1 11.8 mi WNW	22 (52 /52) (7.2-48)	22 (52 /52) (7.2-48)	0
	Gamma Be7	24	7.2	57 (20 /20) (42-79)	2F6 7.3 mi NNE	60 (4 /4) (50-70)	60 (4 /4) (47-71)	0
					14G1 11.8 mi WNW	60 (4 /4) (47-71)		0
	K-40	24	7.0	12 (20 /20) (6.7-16)	14G1 11.8 mi WNW	15 (4 /4) (14-17)	15 (4 /4) (14-17)	0
Air Iodine (10 ⁻³ pCi/m ³)	I-131	312	10	<LLD	-	<LLD	<LLD	0
II DIRECT								
Direct Radiation (mrad/std. month)	Quarterly Badges	194	-	4.1 (170 /170) (2.8-6)	7S1 0.12 mi SE	5.5 (4 /4) (4.8-6)	4.4 (24 /24) (3.3-5.1)	0
III TERRESTRIAL								
Milk (pCi/L)	I-131	80	0.5	<LLD	-	<LLD	<LLD	0
	Gamma K-40	80	120	1340 (60 /60) (1210-1450)	2F9 7.5 mi NNE	1350 (20 /20) (1260-1440)	1300 (20 /20) (1190-1450)	0

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SALEM GENERATING STATION
HOPE CREEK GENERATING STATION

DOCKET 50-272/-311
DOCKET NO. 50-354

SALEM COUNTY, NEW JERSEY JANUARY 1, 2000 to DECEMBER 31, 2000

MEDIUM OR PATHWAY SAMPLE (UNIT OF MEASUREMENT)	Analysis And Total Number of Analyses Performed		Lower Limit of Detection (LLD) *	All Indicator Locations	Location with Highest Mean	Mean (Range)	Control Location	Number of Nonroutine Reported Measurements
				Mean (Range)	Name Distance and Direction		Mean (Range)	
III TERRESTRIAL								
Well Water (pCi/L)	Alpha	12	1.7	2 (11 /12) (1.2-3.3)	3E1 4.1 mi NE	2 (11 /12) (1.2-3.3)	No Control Location	0
	Beta	12	1.0***	10 (12 /12) (9.5-11)	3E1 4.1 mi NE	10 (12 /12) (9.5-11)	No Control Location	0
	H-3	12	170	<LLD	-	<LLD	No Control Location	0
	Gamma K-40	12	15	68 (7 /12) (58-79)	3E1 4.1mi NE	68 (7 /12) (58-79)	No Control Location	0
	RA-NAT	12	4.4	140 (12 /12) (84-233)	3E1 4.1mi NE	140 (12 /12) (84-233)	No Control Location	0
Potable Water (pCi/L)	Alpha	24	1.0	0.8 (15 /24) (0.5-1.3)	2F3 8.0 mi NNE	0.8 (15 /24) (0.5-1.3)	No Control Location	0
	Beta	24	1.0***	2.7 (24 /24) (2-3.6)	2F3 8.0 mi NNE	2.7 (24 /24) (2-3.6)	No Control Location	0
	H-3	24	160	<LLD	-	<LLD	No Control Location	0
	Gamma K-40	24	15	46 (17 /24) (27-76)	2F3 8.0 mi NNE	46 (17 /24) (27-76)	No Control Location	0
	I-131	24	0.4	<LLD	-	<LLD	No Control Location	0
	RA-NAT	24	4.4	4.2 (1 /24) (4.2)	2F3 8.0 mi NNE	4.2 (1 /24) (4.2)	No Control Location	0

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SALEM GENERATING STATION
HOPE CREEK GENERATING STATION

DOCKET 50-272/-311
DOCKET NO. 50-354

SALEM COUNTY, NEW JERSEY JANUARY 1, 2000 to DECEMBER 31, 2000

MEDIUM OR PATHWAY SAMPLE (UNIT OF MEASUREMENT)	Analysis And Total Number of Analyses Performed		Lower Limit of Detection (LLD) *	All Indicator Locations	Location with Highest Mean	Control Location		Number of Nonroutine Reported Measurements
				Mean (Range)	Name Distance and Direction	Mean (Range)	Mean (Range)	
III TERRESTRIAL Fruit & Vegetables (pCi/Kg-wet)	Gamma K-40	27	70	2280 (16 /16) (1430-3100)	2F4 6.3 mi NNE	2500 (4 /4) (2120-3100)	2180 (11 /11) (1460-2650)	0
	RA-NAT	27	17	18 (2 /16) (16-20)	2F4 6.3 mi NNE	20 (1 /4) (20)	<LLD	0
Game (pCi/Kg-wet)	Gamma K-40	2	70	3240 (1 /1) (3240)	3E1 4.1 mi NE	3240 (1 /1) (3240)	2550 (1 /1) (2550)	0
Fodder Crops (pCi/Kg-wet)	Gamma Be-7	7	87	710 (3 /5) (490-840)	2F9 7.5 mi NNE	840 (1 /1) (840-840)	690 (1 /2) (690-690)	0
	K-40	7	70	8300 (5 /5) (3100-15600)	14F4 7.6 mi WNW	10020 (2 /2) (4430-15600)	9000 (2 /2) (3860-14100)	0
IV AQUATIC Surface Water (pCi/L)	Beta	60	3.8	59 (48 /48) (5.7-191)	7E1 4.5 mi SE	90 (12 /12) (30-191)	50 (12 /12) (20-123)	0
	H-3	20	170	240 (1 /16) (240)	11A1 0.2 mi SW	240 (1 /4) (240)	<LLD	0
	Gamma K-40	60	15	91 (46 /48) (39-208)	7E1 4.5 mi SE	106 (12 /12) (54-208)	72 (12 /12) (21-111)	0
	RA-NAT	60	4.4	<LLD	12C1 2.5 mi WSW	5 (1 /12) (5)	5 (1 /12) (5)	0

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SALEM GENERATING STATION
HOPE CREEK GENERATING STATION

DOCKET 50-272/-311
DOCKET NO. 50-354

SALEM COUNTY, NEW JERSEY JANUARY 1, 2000 to DECEMBER 31, 2000

MEDIUM OR PATHWAY SAMPLE (UNIT OF MEASUREMENT)	Analysis And Total Number of Analyses Performed		Lower Limit of Detection (LLD) *	All Indicator Locations	Location with Highest Mean		Control Location		Number of Nonroutine Reported Measurements
				Mean (Range)	Name Distance and Direction	Mean (Range)	Mean (Range)		
Blue Crabs (pCi/kg-wet)	Gamma K-40	4	70	2370 (2 / 2) (2240-2500)	11A1 0.2 mi SW	2370 (2 / 2) (2240-2500)	2195 (2 / 2) (2090-2300)	0	
	RA-NAT	4	10	<LLD	12C1 2.5 mi WSW	22 (1 / 2) (22)	22 (1 / 2) (22)	0	
Edible Fish (pCi/kg-dry)	Sr-89 (bones)	1	200	<LLD	-	<LLD	<LLD	0	
	Sr-90 (bones)	1	200	<LLD	-	<LLD	<LLD	0	
	Sr-89 (flesh)	1	200	<LLD	-	<LLD	<LLD	0	
	Sr-90 (flesh)	1	200	<LLD	-	<LLD	<LLD	0	
	Gamma K-40	6	70	3520 (4 / 4) (3190-3830)	7E1 4.5 mi SE	3525 (2 / 2) (3370-3680)	3475 (2 / 2) (3350-3600)	0	
Sediment (pCi/kg-dry)	Gamma Be-7	14	120	780 (2 / 12) (660-890)	16A1 0.7 mi NNW	780 (2 / 2) (660-890)	250 (1 / 2) (250)	0	
	K-40	14	70	11340 (12 / 12) (1330-16600)	15A1 0.3 mi NW	15350 (2 / 2) (14100-16600)	13700 (2 / 2) (13400-14000)	0	
	Co-60	14	19	<LLD	-	<LLD	<LLD	0	

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SALEM GENERATING STATION
HOPE CREEK GENERATING STATION

DOCKET 50-272/-311
DOCKET NO. 50-354

SALEM COUNTY, NEW JERSEY JANUARY 1, 2000 to DECEMBER 31, 2000

MEDIUM OR PATHWAY SAMPLE (UNIT OF MEASUREMENT)	Analysis And Total Number of Analyses Performed		Lower Limit of Detection (LLD) *	All Indicator Locations	Location with Highest Mean	Control Location		Number of Nonroutine Reported Measurements
				Mean (Range)	Name Distance and Direction	Mean (Range)	Mean (Range)	
IV AQUATIC								
Sediment (pCi/kg-dry)	Cs-134	14	36	25 (1 /12) (25)	11A1 0.2 mi SW	25 (1 /2) (25)	<LLD	0
	Cs-137	14	43	78 (8 /12) (32-168)	15A1 0.3 mi NW	139 (2 /2) (110-168)	47 (1 /2) (47)	0
	RA-NAT	14	45	550 (12 /12) (140-860)	7E1 4.5 mi SE	780 (2 /2) (700-860)	760 (2 /2) (710-800)	0
	Th-232	14	50	780 (12 /12) (150-1200)	15A1 0.3 mi NW	1140 (2 /2) (1070-1200)	890 (2 /2) (860-920)	0

* LLD listed is the lower limit of detection which we endeavored to achieve during this reporting period. In some instances nuclides were detected at concentrations above the LLD values shown. All strontium results are reported by DESEL as MDC. .

** Mean calculated using values above LLD only. Fraction of measurements above LLD are in parentheses.

*** Typical LLD values.

APPENDIX B

SAMPLE DESIGNATION AND LOCATIONS

APPENDIX B

SAMPLE DESIGNATION

The PSE&G Maplewood Testing Services identifies samples by a three part code. The first two letters are the program identification code. Because of the proximity of the Salem and Hope Creek Stations a common environmental surveillance program is being conducted. The identification code, "SA", has been applied to Salem and Hope Creek stations. The next three letters are for the media sampled.

AIO = Air Iodine	IDM = Immersion Dose (TLD)
APT = Air Particulate	MLK = Milk
ECH = Hard Shell Blue Crab	PWR = Potable Water (Raw)
ESF = Edible Fish	PWT = Potable Water (Treated)
ESS = Sediment	SOL = Soil
FPL = Green Leafy Vegetables	SWA = Surface Water
FPV = Vegetables (Various)	VGT = Fodder Crops (Various)
GAM = Game (Muskrat)	WWA = Well Water

The last four symbols are a location code based on direction and distance from a standard reference point. Of these, the first two represent each of the sixteen angular sectors of 22.5 degrees centered about the reactor site. Sector one is divided evenly by the north axis and other sectors are numbered in a clockwise direction; e.g., 2=NNE, 3=NE, 4=ENE, etc. The next digit is a letter which represents the radial distance from the reference point:

S = On-site location	E = 4-5 miles off-site
A = 0-1 miles off-site	F = 5-10 miles off-site
B = 1-2 miles off-site	G = 10-20 miles off-site
C = 2-3 miles off-site	H = >20 miles off-site
D = 3-4 miles off-site	

The last number is the station numerical designation within each sector and zone; e.g., 1,2,3,... For example, the designation SA-WWA-3E1 would indicate a sample in the Salem and Hope Creek program (SA), consisting of well water (WWA), which had been collected in sector number 3, centered at 45° (north east) with respect to the reactor site at a radial distance of 4 to 5 miles off-site, (therefore, radial distance E). The number 1 indicates that this is sampling station #1 in that particular sector.

TABLE B-1
SAMPLING LOCATIONS

Specific information about the individual sampling locations are given in Table B-1. Maps B-1 and B-2 show the locations of sampling stations with respect to the site. A Portable Global Positioning System (GPS) was used to provide the coordinates of sampling locations. The Datum used was WGS 84.

STATION CODE	STATION LOCATION	LATITUDINAL			LONGITUDINAL			SAMPLE TYPE
		DEG.	MIN.	SEC	DEG.	MIN.	SEC	
1S1	0.55mi. N of vent	39	28	16	75	32	15	IDM
2S2	0.4 mi. NNE of vent	39	28	07	75	31	57	IDM
2S4	0.59 mi. NNE of vent	39	28	16	75	31	55	IDM
3S1	0.58 mi. NE of vent	39	28	08	75	31	41	IDM
4S1	0.60 mi. ENE of vent	39	28	02	75	31	33	IDM
5S1	1.0 mi. E of vent; site access road	39	27	38	75	31	08	AIO, APT, IDM
6S2	0.2 mi. ESE of vent; observation building	39	27	43	75	31	55	IDM, SOL, ESS
7S1	0.12 mi. SE of vent; station personnel gate	39	27	44	75	32	03	IDM
10S1	0.14 mi. SSW of vent; inlet cooling water bldg.	39	27	39	75	32	10	IDM
11S1	0.09 mi. SW of vent; service water inlet bldg.	39	27	43	75	32	12	IDM
15S1	0.57 mi. NW of vent	39	28	10	75	32	32	IDM
16S1	0.54 mi. NNW of vent	39	28	13	75	32	26	IDM
11A1	0.2 mi. SW of vent; outfall area	39	27	59	75	32	25	ECH, ESF, ESS, SWA
15A1	0.3 mi. NW of vent; cooling tower blowdown discharge line outfall	39	27	67	75	32	19	ESS
16A1	0.7 mi. NNW of vent; south storm drain discharge line	39	28	24	75	32	58	ESS
12C1	2.5 mi. WSW of vent; west bank of Delaware River	39	27	22	75	34	08	ECH, ESF, ESS, SWA
4D2	3.7 mi. ENE of vent; Alloway Creek Neck Road	39	29	18	75	32	11	IDM
5D1	3.5 mi. E of vent; local farm	39	28	24	75	28	22	AIO, APT, IDM
10D1	3.9 mi. SSW of vent; Taylor's Bridge Spur	39	24	37	75	33	44	IDM, SOL
11D1	3.5 mi. SW of vent	39	24	49	75	34	26	GAM
14D1	3.4 mi. WNW of vent; Bay View, Delaware	39	29	02	75	35	31	IDM
15D1	3.8 mi. NW of vent; Rt. 9, Augustine Beach	39	30	08	75	35	02	IDM
2E1	4.4 mi. NNE of vent; local farm	39	31	23	75	30	26	IDM
3E1	4.1 mi. NE of vent; local farm	39	30	07	75	28	41	GAM, IDM, VGT, WWA, FPV

TABLE B-1 (cont'd)

STATION CODE	STATION LOCATION	LATITUDINAL			LONGITUDINAL			SAMPLE TYPE
		DEG.	MIN.	SEC	DEG.	MIN.	SEC	
7E1	4.5 mi. SE of vent; 1 mi. W of Mad Horse Creek	39	- 25	- 08	75	- 28	- 64	ESF, ESS, SWA
9E1	4.2 mi. S of vent	39	- 24	- 10	75	- 32	- 42	IDM
11E2	5.0 mi. SW of vent; Rt. 9	39	- 24	- 20	75	- 35	- 33	IDM
12E1	4.4 mi. WSW of vent; Thomas Landing	39	- 26	- 52	75	- 36	- 59	IDM
13E1	4.2 mi. W of vent; Diehl House Lab	39	- 27	- 59	75	- 36	- 44	IDM
16E1	4.1 mi. NNW of vent; Port Penn	39	- 30	- 47	75	- 34	- 34	AIO, APT, IDM, SOL
1F1	5.8 mi. N of vent; Fort Elfsborg	39	- 32	- 45	75	- 31	- 06	AIO, APT, IDM
1F2	7.1 mi. N of vent; midpoint of Delaware River	39	- 33	- 08	75	- 32	- 54	SWA
2F2	8.7 mi. NNE of vent; Corner of 5 th & Howell, Salem	39	- 34	- 38	75	- 28	- 04	IDM
2F3	8.0 mi. NNE of vent; Salem Water Company	39	- 33	- 40	75	- 27	- 18	PWR, PWT
2F4	6.3 mi. NNE of vent; local farm	39	- 33	- 21	75	- 30	- 33	FPV, FPL
2F5	7.4 mi. NNE of vent; Salem High School	39	- 33	- 27	75	- 28	- 31	IDM
2F6	7.3 mi. NNE of vent; Southern Training Center	39	- 33	- 43	75	- 28	- 48	AIO, APT, IDM
2F7	5.7 mi. NNE of vent; local farm	39	- 32	- 40	75	- 30	- 53	SOL
2F8	5.3 mi. NNE OF vent; local farm	39	- 31	- 54	75	- 29	- 18	FPV
2F9	7.5 mi. NNE of vent; Tilbury Farms , 45 S. Tilbury Rd, Salem	39	- 33	- 55	75	- 29	- 30	MLK, FPV, VGT, SOL
3F2	5.1 mi. NE of vent; Hancocks Bridge Municipal Bld	39	- 30	- 25	75	- 27	- 36	IDM
3F3	8.6 mi. NE of vent; Quinton Township School	39	- 32	- 38	75	- 24	- 45	IDM
3F5	9.4 mi. NE of vent; Harris's Farm Market	39	- 33	- 29	75	- 24	- 54	FPV
3F6	6.5 mi. NE of vent; #324 Salem/Hancocks Bridge Road	39	- 32	- 03	75	- 28	- 00	FPV
3F8	5.1 mi. NE of vent; 33 Maple Ave., Hancocks Bridge	39	- 30	- 25	75	- 27	- 37	FPV, FPL
4F2	6.0 mi. ENE of vent; Mays Lane, Harmersville	39	- 29	- 58	75	- 26	- 03	IDM
5F1	6.5 mi. E of vent; Canton	39	- 28	- 22	75	- 24	- 59	IDM, SOL
6F1	6.4 mi. ESE of vent; Stow Neck Road	39	- 26	- 24	75	- 25	- 09	IDM
6F2	8.2 mi. ESE of vent; RD#3 Box 160 Bridgeton, NJ	39	- 26	- 04	75	- 23	- 09	FPV, FPL
7F2	9.1 mi. SE of vent; Bayside, New Jersey	39	- 22	- 56	75	- 24	- 17	IDM
10F2	5.8 mi. SSW of vent; Rt. 9	39	- 23	- 01	75	- 34	- 09	IDM
11F1	6.2 mi. SW of vent; Taylor's Bridge Delaware	39	- 24	- 44	75	- 37	- 37	IDM
11F3	5.3 mi. SW of vent; Townsend, Delaware	39	- 24	- 06	75	- 36	- 20	MLK, VGT, SOL
12F1	9.4 mi. WSW of vent; Townsend Elementary School	39	- 23	- 47	75	- 41	- 18	IDM
13F2	6.5 mi. W of vent; Odessa, Delaware	39	- 27	- 18	75	- 39	- 21	IDM


TABLE B-1 (cont'd)

STATION CODE	STATION LOCATION	LATITUDINAL			LONGITUDINAL			SAMPLE TYPE
		DEG.	MIN.	SEC	DEG.	MIN.	SEC	
13F3	9.3 mi. W of vent; Redding Middle School, Middletown, Delaware	39	27	14	75	42	32	IDM
13F4	9.8 mi. W of vent; Middletown, Delaware	39	26	51	75	43	07	IDM
14F2	6.6 mi. WNW of vent; Boyds Corner	39	30	00	75	38	59	IDM
14F3	5.4 mi. WNW of vent; local farm	39	29	33	75	37	55	FPV, FPL
14F4	7.6 mi. WNW of vent; local farm	39	30	44	75	40	52	MLK, VGT, SOL
15F3	5.4 mi. NW of vent	39	30	58	75	36	36	IDM
16F1	6.9 mi. NNW of vent; C&D Canal	39	33	55	75	34	25	ESS, SWA
16F2	8.1 mi. NNW of vent; Delaware City Public School	39	34	18	75	35	25	IDM
1G1	10.3 mi. N of vent; local farm	39	36	31	75	29	59	FPV, FPL
1G3	19 mi. N of vent; N. Church St. Wilmington, Del	39	44	16	75	32	31	IDM
1G4	10.8 mi. N of vent; (Dads Produce) Rte. 49, South Broadway, Pennsville	39	37	55	75	30	44	FPV
2G2	13.5 mi. NNE of vent; Moore's Market	39	38	19	75	26	10	FPV
3G1	17 mi. NE of vent; local farm	39	35	56	75	16	47	IDM, MLK, VGT, SOL
10G1	12 mi. SSW of vent; Smyrna, Delaware	39	18	13	75	36	05	IDM
14G1	11.8 mi. WNW of vent; Rte. 286; Bethel Church Road; Delaware	39	31	18	75	46	30	AIO, APT, IDM
16G1	15 mi. NNW of vent; Greater Wilmington Airport	39	40	32	75	35	45	IDM
3H1	32 mi. NE of vent; National Park, New Jersey	39	51	36	75	11	06	IDM
3H5	25 mi. NE of vent; Sorbello Girl's Market	39	41	02	75	12	23	FPL, FPV
3H3	110 mi. NE of vent; Maplewood Testing Services	40	43	25	74	15	09	IDM


NOTE: All station locations are referenced to the midpoint of the two Salem Units' Vents. The coordinates of this location are: Latitude N 39° - 27' - 45.3" and Longitude W 75° - 32' - 09.7".

All Game (GAM), Vegetables (FPV & FPL) and Vegetation (VGT), are management audit samples. They are not required by the Salem & Hope Creek Stations' Tech Specs nor listed in the Station's ODCM. Vegetable samples are not always collected in consecutive years from the same farmer since they rotate the type of crop they grow.

MAP B-1 ON-SITE SAMPLING LOCATIONS

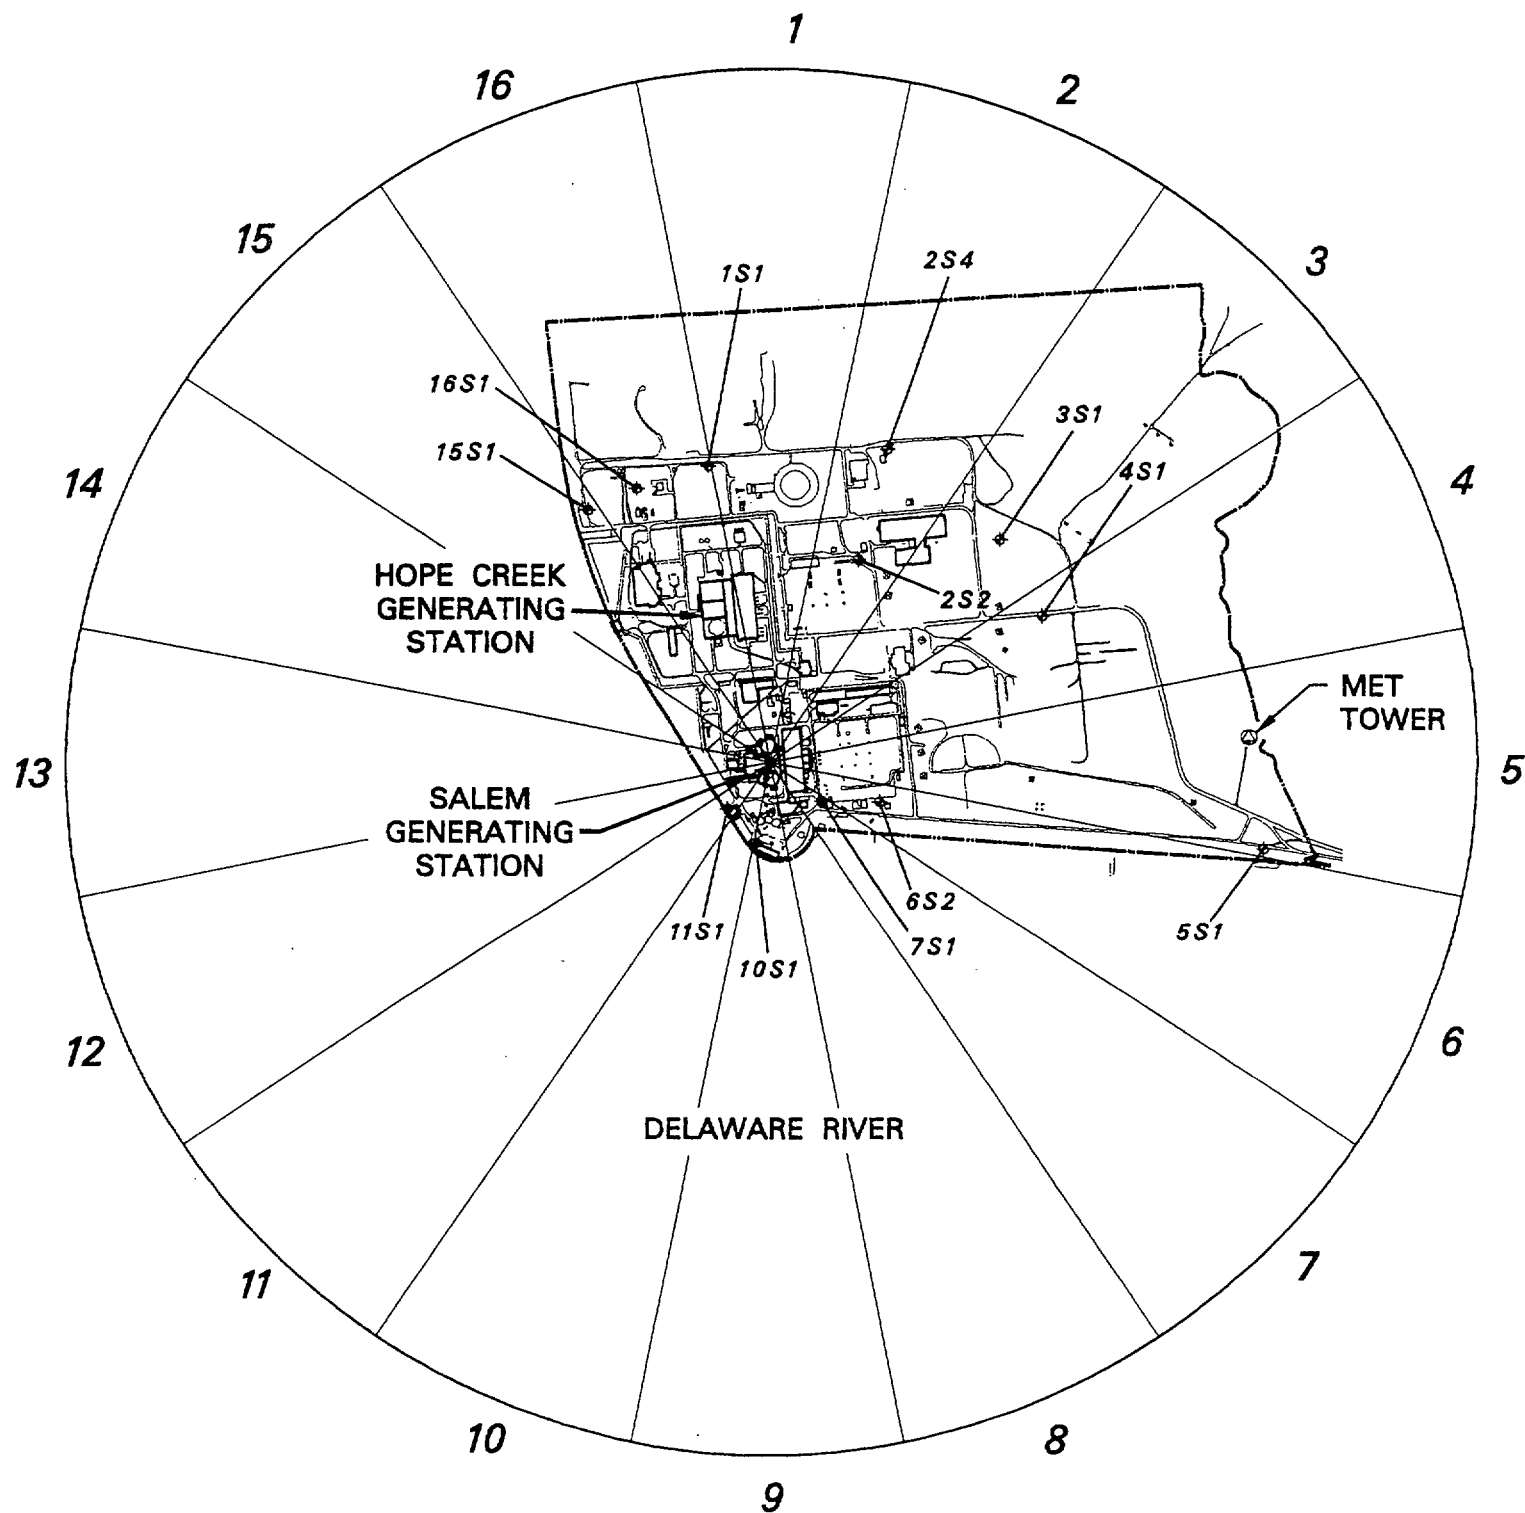

MAP B-2
SALEM AND HOPE CREEK GENERATING STATIONS
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
OFF-SITE SAMPLING LOCATION

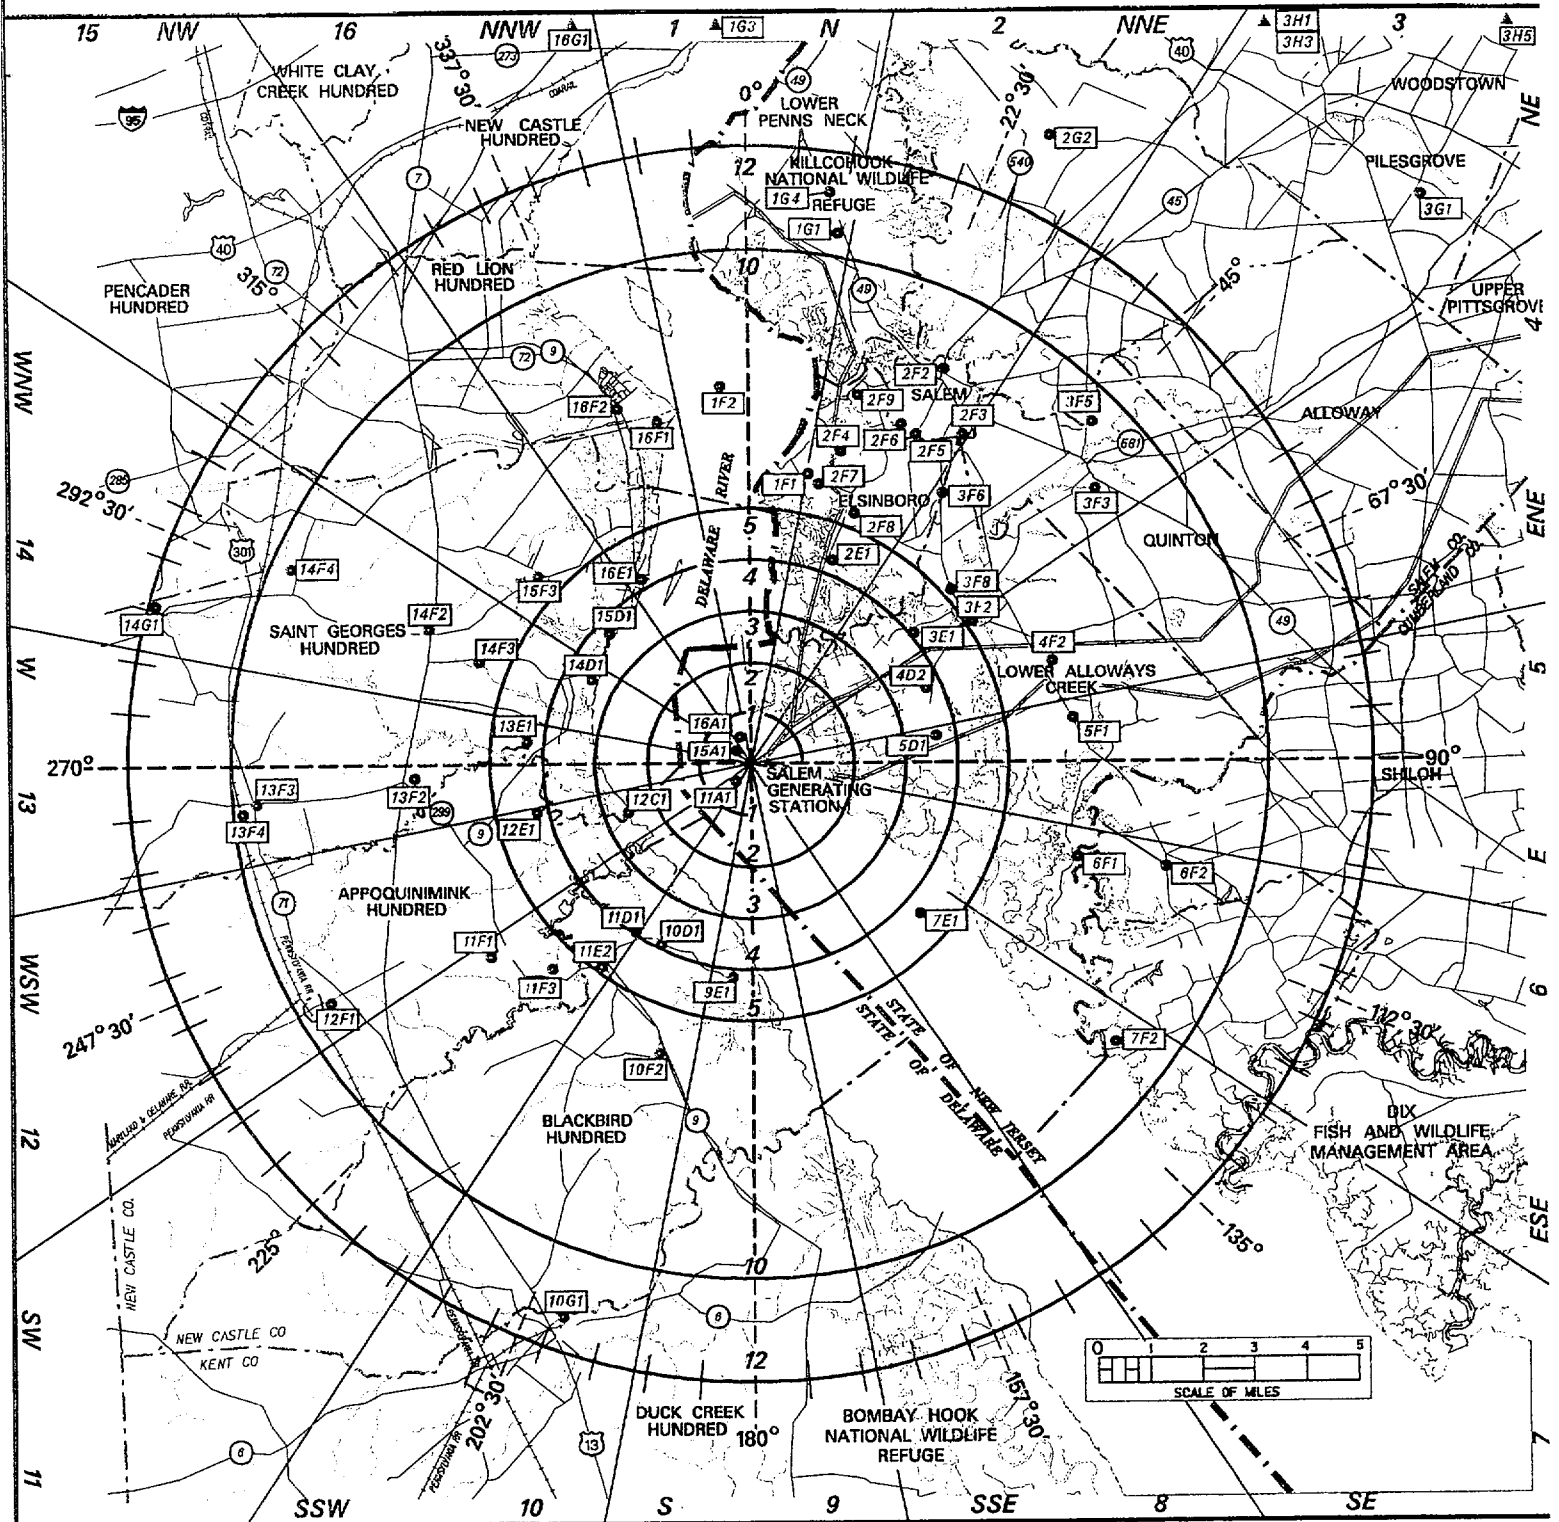

APPENDIX C

DATA TABLES

APPENDIX C

DATA TABLES

Appendix C presents the analytical results of the 2000 Radiological Environmental Monitoring Program for the period of January 1 to December 31, 2000.

TABLE OF CONTENTS		
TABLE NO.	TABLE DESCRIPTION	PAGE
<u>ATMOSPHERIC ENVIRONMENT</u>		
AIR PARTICULATES		
C-1	2000 Concentrations of Gamma Emitters in Quarterly Composites of Air Particulates.....	53
C-2	2000 Concentrations of Gross Beta Emitters in Air Particulates.	54
AIR IODINE		
C-3	2000 Concentrations of Iodine-131 in Filtered Air.....	56
<u>DIRECT RADIATION</u>		
THERMOLUMINESCENT DOSIMETERS		
C-4	2000 Direct Radiation Measurements - Quarterly TLD Results.....	58
<u>TERRESTRIAL ENVIRONMENT</u>		
MILK		
C-5	2000 Concentrations of Iodine-131 and Gamma Emitters in Milk...	59
WELL WATER		
C-6	2000 Concentrations of Gross Alpha and Gross Beta Emitters, and Tritium in Well Water.....	61

DATA TABLES (cont'd.)

TABLE NO	TABLE DESCRIPTION	PAGE
<u>TERRESTRIAL ENVIRONMENT (cont'd)</u>		
C-7	2000 Concentrations of Gamma Emitters in Well Water.....	62
	POTABLE WATER	
C-8	2000 Concentrations of Gross Alpha and Gross Beta Emitters, and Tritium in Raw and Treated Potable Waters.....	63
C-9	2000 Concentrations of Iodine 131 and Gamma Emitters in Raw and Treated Potable Water.....	64
	FOOD PRODUCTS	
C-10	2000 Concentrations of Gamma Emitters in Vegetables.....	65
C-11	2000 Concentrations of Gamma Emitters in Game.....	66
	FODDER CROPS	
C-12	2000 Concentrations of Gamma Emitters in Fodder Crops.....	67
<u>AQUATIC ENVIRONMENT</u>		
	SURFACE WATER	
C-13	2000 Concentrations of Gross Beta Emitters in Surface Water....	68
C-14	2000 Concentrations of Gamma Emitters in Surface Water.....	69
C-15	2000 Concentrations of Tritium in Quarterly Composites of Surface Water.....	71
	EDIBLE FISH	
C-16	2000 Concentrations of Strontium-89 and Strontium-90; and Gamma Emitters in Edible Fish.....	72
	BLUE CRABS	
C-17	2000 Concentrations of Gamma Emitters in Crabs.....	73

DATA TABLES (cont'd.)

<u>TABLE NO .</u>	<u>TABLE DESCRIPTION</u>	<u>PAGE</u>
SEDIMENT		
C-18	2000 Concentrations of Gamma Emitters in Sediment.....	74
<u>SPECIAL TABLES</u>		
LLDs		
C-19	2000 PSE&G Maplewood Testing Services' LLDs for Gamma Spectrometry.....	75

Table C-1

**2000 CONCENTRATIONS OF GAMMA EMITTERS*
IN QUARTERLY COMPOSITES OF AIR PARTICULATES**

Results in Units of 10^{-3} pCi/m³ +/- 2 sigma

STATION ID	Sampling Period		<--- Gamma Emitters --->	
	Start	Stop	Be-7	K-40
SA-APT-5S1	12/28/1999	to 03/27/2000	50 ± 4	7 ± 3
SA-APT-1F1	12/28/1999	to 03/27/2000	79 ± 7	11 ± 4
SA-APT-2F6	12/28/1999	to 03/27/2000	60 ± 5	15 ± 5
SA-APT-5D1	12/28/1999	to 03/27/2000	58 ± 5	13 ± 3
SA-APT-16E1	12/27/1999	to 03/28/2000	55 ± 5	14 ± 3
SA-APT-14G1(C)	12/27/1999	to 03/28/2000	71 ± 5	14 ± 3
SA-APT-5S1	03/27/2000	to 06/26/2000	63 ± 5	13 ± 3
SA-APT-1F1	03/27/2000	to 06/26/2000	64 ± 6	14 ± 3
SA-APT-2F6	03/27/2000	to 06/26/2000	70 ± 5	14 ± 3
SA-APT-5D1	03/27/2000	to 06/26/2000	60 ± 5	9 ± 2
SA-APT-16E1	03/28/2000	to 06/27/2000	64 ± 4	11 ± 2
SA-APT-14G1(C)	03/28/2000	to 06/27/2000	65 ± 7	17 ± 3
SA-APT-5S1	06/26/2000	to 09/25/2000	49 ± 4	10 ± 4
SA-APT-1F1	06/26/2000	to 09/25/2000	42 ± 5	12 ± 4
SA-APT-2F6	06/26/2000	to 09/25/2000	50 ± 4	12 ± 4
SA-APT-5D1	06/26/2000	to 09/25/2000	54 ± 4	13 ± 3
SA-APT-16E1	06/27/2000	to 09/26/2000	56 ± 5	12 ± 3
SA-APT-14G1(C)	06/27/2000	to 09/26/2000	47 ± 5	15 ± 4
SA-APT-5S1	09/25/2000	to 12/26/2000	52 ± 4	10 ± 2
SA-APT-1F1	09/25/2000	to 12/26/2000	49 ± 3	12 ± 2
SA-APT-2F6	09/25/2000	to 12/26/2000	58 ± 5	16 ± 4
SA-APT-5D1	09/25/2000	to 12/26/2000	55 ± 4	11 ± 3
SA-APT-16E1	09/26/2000	to 12/27/2000	54 ± 5	14 ± 3
SA-APT-14G1(C)	09/26/2000	to 12/27/2000	58 ± 5	15 ± 3
AVERAGE			58 ± 17	13 ± 5

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table 19.
(C) Control Station

TABLE C-2

2000 CONCENTRATIONS OF GROSS BETA EMITTERS IN AIR PARTICULATES

Results in Units of 10^{-3} pCi/m³ +/- 2 sigma

<----- STATION ID ----->							
MONTH	SA-APT-14G1	SA-APT-16E1	SA-APT-1F1	SA-APT-2F6	SA-APT-5D1	SA-APT-5S1	AVERAGE
January	31 ± 3	28 ± 3	29 ± 3	29 ± 3	31 ± 3	26 ± 3	29 ± 4
	21 ± 2	18 ± 2	18 ± 2	18 ± 2	21 ± 2	15 ± 2	18 ± 4
	21 ± 2	18 ± 2	18 ± 2	18 ± 2	19 ± 2	19 ± 2	19 ± 2
	27 ± 2	31 ± 2	32 ± 2	31 ± 2	28 ± 2	30 ± 3	30 ± 4
	28 ± 2	21 ± 2	22 ± 2	23 ± 2	22 ± 2	24 ± 2	23 ± 6
February	25 ± 3	23 ± 2	23 ± 2	25 ± 2	22 ± 2	24 ± 3	24 ± 3
	25 ± 2	21 ± 2	24 ± 2	21 ± 2	22 ± 2	20 ± 2	22 ± 4
	21 ± 2	23 ± 2	22 ± 2	20 ± 2	22 ± 2	20 ± 2	21 ± 2
	20 ± 2	16 ± 2	16 ± 2	17 ± 2	15 ± 2	16 ± 2	17 ± 3
March	26 ± 2	21 ± 2	25 ± 2	26 ± 2	20 ± 2	22 ± 2	23 ± 5
	21 ± 3	19 ± 2	21 ± 2	19 ± 2	18 ± 2	16 ± 2	19 ± 4
	20 ± 2	19 ± 2	19 ± 2	20 ± 2	21 ± 2	17 ± 2	19 ± 2
	14 ± 2	12 ± 2	12 ± 2	14 ± 2	16 ± 2	14 ± 2	14 ± 3
April	21 ± 2	18 ± 2	19 ± 2	22 ± 2	21 ± 2	20 ± 2	20 ± 3
	15 ± 2	17 ± 2	19 ± 2	20 ± 2	15 ± 2	17 ± 2	17 ± 4
	15 ± 2	15 ± 2	18 ± 2	14 ± 2	15 ± 2	17 ± 2	16 ± 3
	7 ± 2	7 ± 2	5 ± 2	5 ± 2	6 ± 2	7 ± 2	6 ± 2
	15 ± 2	16 ± 2	17 ± 2	15 ± 2	15 ± 2	12 ± 2	15 ± 3
May	31 ± 3	30 ± 3	32 ± 3	33 ± 3	32 ± 3	30 ± 3	31 ± 2
	28 ± 2	28 ± 2	24 ± 2	19 ± 3	21 ± 2	29 ± 3	25 ± 9
	15 ± 3	18 ± 2	17 ± 2	14 ± 2	13 ± 2	16 ± 2	16 ± 4
	16 ± 2	12 ± 2	17 ± 2	11 ± 2	12 ± 2	12 ± 2	13 ± 5
June	17 ± 3	13 ± 2	17 ± 3	18 ± 2	16 ± 2	16 ± 2	16 ± 3
	37 ± 3	(1)	26 ± 3	43 ± 3	26 ± 2	25 ± 3	31 ± 16
	10 ± 2	17 ± 2	12 ± 2	11 ± 2	13 ± 2	12 ± 2	13 ± 5
	18 ± 2	19 ± 2	17 ± 2	16 ± 2	19 ± 2	16 ± 2	18 ± 3

TABLE C-2

2000 CONCENTRATIONS OF GROSS BETA EMITTERS IN AIR PARTICULATES

Results in Units of 10^{-3} pCi/m³ +/- 2 sigma

<----- STATION ID ----->							
MONTH	SA-APT-14G1	SA-APT-16E1	SA-APT-1F1	SA-APT-2F6	SA-APT-5D1	SA-APT-5S1	AVERAGE
July	21 ± 3	22 ± 3	22 ± 2	18 ± 2	21 ± 2	21 ± 2	21 ± 3
	25 ± 2	24 ± 2	23 ± 2	22 ± 2	22 ± 2	21 ± 2	23 ± 3
	18 ± 2	17 ± 2	17 ± 2	10 ± 2	15 ± 2	15 ± 2	15 ± 6
	21 ± 2	20 ± 2	20 ± 2	14 ± 2	20 ± 2	15 ± 2	18 ± 6
	10 ± 2	10 ± 2	10 ± 2	15 ± 2	11 ± 2	11 ± 2	11 ± 4
August	21 ± 2	19 ± 2	18 ± 2	18 ± 2	20 ± 2	22 ± 2	20 ± 3
	18 ± 2	22 ± 2	16 ± 2	19 ± 2	17 ± 2	17 ± 2	18 ± 4
	15 ± 2	18 ± 2	16 ± 2	18 ± 2	16 ± 2	17 ± 2	17 ± 2
	22 ± 2	24 ± 2	16 ± 2	19 ± 2	21 ± 2	19 ± 2	20 ± 6
September	18 ± 2	14 ± 2	14 ± 2	18 ± 2	14 ± 2	13 ± 2	15 ± 5
	19 ± 3	21 ± 3	18 ± 2	21 ± 3	17 ± 2	18 ± 2	19 ± 3
	21 ± 2	19 ± 2	20 ± 2	19 ± 2	24 ± 2	20 ± 2	20 ± 3
	18 ± 2	17 ± 2	16 ± 2	20 ± 3	18 ± 2	18 ± 2	18 ± 3
October	21 ± 2	19 ± 2	18 ± 2	20 ± 2	18 ± 2	20 ± 2	19 ± 3
	28 ± 3	24 ± 2	22 ± 2	28 ± 3	26 ± 2	28 ± 3	26 ± 5
	48 ± 3	47 ± 3	46 ± 3	48 ± 3	47 ± 3	46 ± 3	47 ± 2
	34 ± 3	34 ± 3	35 ± 3	38 ± 3	36 ± 3	30 ± 3	34 ± 6
	31 ± 2	27 ± 2	27 ± 2	26 ± 2	23 ± 2	24 ± 2	26 ± 6
November	21 ± 3	22 ± 3	21 ± 3	23 ± 3	18 ± 2	22 ± 3	21 ± 3
	16 ± 2	16 ± 2	16 ± 2	18 ± 2	21 ± 3	12 ± 2	16 ± 6
	38 ± 3	30 ± 2	39 ± 3	35 ± 3	35 ± 2	35 ± 3	35 ± 6
	18 ± 2	14 ± 2	15 ± 2	16 ± 2	17 ± 2	15 ± 2	16 ± 3
December	25 ± 2	24 ± 2	22 ± 2	25 ± 2	22 ± 2	20 ± 2	23 ± 4
	27 ± 2	25 ± 2	20 ± 2	25 ± 2	24 ± 2	18 ± 2	23 ± 7
	20 ± 2	17 ± 2	19 ± 2	18 ± 2	19 ± 2	20 ± 2	19 ± 2
	36 ± 2	38 ± 2	35 ± 2	33 ± 2	35 ± 2	35 ± 2	35 ± 3
AVERAGE	22 ± 15	21 ± 14	21 ± 15	21 ± 16	21 ± 14	20 ± 14	
GRAND AVERAGE							21 ± 15

(1) Sample was vandalized. Results not included in any averages. (See Program Deviations).

TABLE C-3

2000 CONCENTRATIONS OF IODINE-131* IN FILTERED AIR

Results in Units of 10^{-3} pCi/m³

MONTH	<----- STATION ID ----->					
	Control SA-AIO-14G1	SA-AIO-16E1	SA-AIO-1F1	SA-AIO-2F6	SA-AIO-5D1	SA-AIO-5S1
January	<4.2	<4.3	<5.3	<4.5	<4.1	<1.7
	<3.6	<4.4	<6	<3.7	<2.6	<4.5
	<1.4	<5.3	<3.3	<1.9	<1.5	<3.8
	<6.5	<4.5	<2	<2.7	<4.4	<4
	<2.1	<2	<3.1	<4.4	<3.3	<2
February	<2.7	<4.2	<4.3	<1.5	<1.9	<3.7
	<3.6	<3.6	<1.7	<2.1	<2.7	<2.3
	<2.5	<2.5	<2.6	<2.3	<2	<1.6
	<1.7	<3.5	<1.3	<8	<2.8	<3.2
March	<1.5	<1.8	<2.4	<1.6	<3.2	<3.3
	<2.2	<5	<1.5	<3.7	<1.9	<2.3
	<1.9	<4.9	<1.5	<3.2	<3.8	<2
	<1.9	<2.3	<2.8	<3.2	<9.4	<2.2
April	<3	<3.1	<3.7	<2.8	<2.2	<2.1
	<1.5	<3.4	<1.4	<2.7	<2.7	<4.8
	<2	<4.3	<1.9	<3.7	<3.3	<3.4
	<3.5	<2.3	<2.1	<6.2	<2.7	<2.8
	<3.8	<3.2	<3.8	<1.9	<2.2	<3.8
May	<2.4	<3.1	<5.1	<3.8	<3.2	<4.1
	<2.9	<1.3	<2.2	<5.3	<2.8	<4.3
	<5.1	<2.7	<1.6	<6.4	<4.3	<1.9
	<2.4	<2.6	<3.8	<2.8	<2.2	<3.1
June	<2.7	<2.7	<2	<3	<1.6	<4
	<5.9	<2.7	<2.9	<3.2	<3.4	<4.1
	<1.9	<1.4	<1.9	<2.9	<4.5	<3.9
	<3.6	<3.4	<1.4	<2	<3.8	<4.8

TABLE C-3

2000 CONCENTRATIONS OF IODINE-131* IN FILTERED AIR

Results in Units of 10^{-3} pCi/m³

MONTH	STATION ID					
	SA-AIO-14G1	SA-AIO-16E1	SA-AIO-1F1	Control SA-AIO-2F6	SA-AIO-5D1	SA-AIO-5S1
July	<1.7	<4.1	<1.9	<3	<2.6	<1.8
	<2.4	<3.2	<2.7	<1.6	<1.8	<5.7
	<4.9	<1.6	<3	<3.9	<2.6	<2
	<2.7	<3.2	<2.5	<2.3	<1.8	<2.7
	<5.8	<3.9	<1.7	<7.5	<1.9	<6.2
August	<10	<1.7	<7.1	<2.4	<1.8	<6.1
	<8.8	<3.1	<8.5	<2.3	<2.5	<3.1
	<5.9	<1.3	<3.2	<9.5	<2.2	<1.8
	<2.6	<3.3	<2.6	<1	<4	<2.3
September	<2.7	<2.6	<2.6	<5.1	<4.3	<1.3
	<2.2	<1.8	<2.1	<4	<4.2	<1.7
	<2.1	<2.2	<4.6	<4.3	<3.6	<2.6
	<1.7	<3.8	<2.7	<2.8	<7.6	<6.8
October	<5.2	<2.1	<4.1	<8.4	<2.5	<4.1
	<2.9	<2	<4.2	<1.3	<2.4	<3.3
	<3.7	<2.1	<4.4	<1.7	<3.2	<3.2
	<3.9	<1.8	<2.3	<2	<2.1	<2.6
	<1.9	<5.2	<1.2	<2.1	<5.1	<1.9
November	<4	<2.8	<5	<3.4	<2.6	<3.7
	<2.2	<3.5	<2.4	<3.1	<2.6	<3.1
	<2.3	<3.8	<6.8	<9.8	<2.9	<1.7
	<7.9	<2.3	<2.3	<2.3	<1.9	<1.5
December	<4.6	<5.6	<2	<9.6	<2.2	<3.3
	<3	<3.5	<3.1	<3.1	<1.6	<2.8
	<3.9	<4.9	<1.4	<3.7	<1.6	<3.3
	<1.2	<1.6	<1.6	<3.2	<2.7	<2.8

* I-131 results are corrected for decay to sample stop date.

TABLE C-4

2000 DIRECT RADIATION MEASUREMENTS - QUARTERLY TLD RESULTS

Results in mrad/standard month* +/- 2 sigma

STATION ID					**
	JAN to MAR	APR to JUN	JUL to SEP	OCT to DEC	QTR ELEMENTS AVG
SA-IDM-2S2	5.6±0.4	4.1±0.4	5.5±0.7	6.0±0.5	5.3±1.6
SA-IDM-5S1	3.8±0.5	3.8±0.4	3.3±0.3	3.9±0.3	3.7±0.5
SA-IDM-6S2	5.2±0.5	5.0±0.6	4.9±0.3	5.3±0.4	5.1±0.4
SA-IDM-7S1	4.8±0.5	6.0±0.6	5.7±0.6	5.6±0.4	5.5±1.0
SA-IDM-10S1	3.7±0.5	4.5±0.5	4.0±0.5	4.4±0.5	4.1±0.7
SA-IDM-11S1	3.7±0.4	4.3±0.5	3.8±0.3	4.6±0.3	4.1±0.9
SA-IDM-4D2	4.2±0.4	4.6±0.6	4.0±0.4	4.5±0.5	4.3±0.5
SA-IDM-5D1	4.2±0.4	4.0±0.4	3.8±0.3	4.0±0.3	4.0±0.3
SA-IDM-10D1	4.6±0.3	4.8±0.5	4.3±0.3	4.8±0.4	4.6±0.5
SA-IDM-14D1	4.2±0.4	4.2±0.4	3.8±0.2	4.2±0.5	4.1±0.4
SA-IDM-15D1	4.5±0.4	4.7±0.5	4.3±0.4	4.6±0.4	4.5±0.3
SA-IDM-2E1	4.3±0.5	4.1±0.5	3.7±0.3	4.3±0.4	4.1±0.5
SA-IDM-3E1	3.7±0.4	3.6±0.5	3.3±0.3	3.6±0.3	3.5±0.3
SA-IDM-9E1	4.2±0.4	4.4±0.4	4.1±0.4	4.4±0.3	4.3±0.3
SA-IDM-11E2	4.6±0.4	4.5±0.4	4.4±0.6	4.6±0.3	4.5±0.2
SA-IDM-12E1	4.7±0.4	4.7±0.4	4.3±0.4	4.7±0.5	4.6±0.4
SA-IDM-13E1	3.9±0.3	3.9±0.3	3.3±0.3	3.8±0.3	3.7±0.6
SA-IDM-16E1	4.2±0.4	4.4±0.4	4.0±0.6	4.3±0.4	4.3±0.3
SA-IDM-1F1	4.1±0.4	4.4±0.6	3.9±0.3	4.2±0.4	4.1±0.4
SA-IDM-2F2	3.9±0.4	3.8±0.4	3.4±0.2	3.8±0.3	3.7±0.5
SA-IDM-2F5	4.2±0.4	4.3±0.4	4.0±0.5	4.4±0.3	4.2±0.3
SA-IDM-2F6	4.0±0.4	4.0±0.3	3.7±0.3	4.0±0.3	3.9±0.3
SA-IDM-3F2	3.7±0.3	3.7±0.6	3.4±0.3	3.7±0.3	3.6±0.3
SA-IDM-3F3	3.6±0.4	3.6±0.4	3.4±0.3	3.7±0.4	3.6±0.3
SA-IDM-4F2	3.8±0.4	3.7±0.5	3.3±0.3	3.7±0.3	3.6±0.4
SA-IDM-5F1	3.9±0.3	(1)	3.5±0.4	3.9±0.5	3.8±0.4
SA-IDM-6F1	3.3±0.3	3.3±0.3	2.8±0.3	3.3±0.3	3.2±0.5
SA-IDM-7F2	3.1±0.4	2.8±0.3	(2)	3.0±0.3	3.0±0.3
SA-IDM-10F2	4.4±0.4	4.3±0.4	4.2±0.4	4.4±0.3	4.3±0.2
SA-IDM-11F1	4.7±0.5	4.6±0.4	4.3±0.4	4.6±0.4	4.5±0.3
SA-IDM-12F1	4.4±0.3	4.3±0.5	4.0±0.4	4.4±0.3	4.3±0.4
SA-IDM-13F2	4.2±0.4	4.2±0.5	3.9±0.3	4.4±0.4	4.2±0.4
SA-IDM-13F3	4.1±0.4	4.2±0.5	3.9±0.3	4.1±0.3	4.1±0.2
SA-IDM-13F4	4.4±0.5	4.2±0.6	4.0±0.4	4.2±0.4	4.2±0.3
SA-IDM-14F2	4.9±0.5	4.8±0.6	4.4±0.6	4.7±0.4	4.7±0.5
SA-IDM-15F3	4.9±0.4	5.0±0.8	4.7±0.4	4.9±0.4	4.9±0.3
SA-IDM-16F2	3.9±0.4	4.0±0.3	3.7±0.5	4.0±0.3	3.9±0.3
SA-IDM-1G3 (C)	5.1±0.3	5.0±0.5	4.8±0.4	5.0±0.5	5.0±0.3
SA-IDM-3G1 (C)	4.6±0.5	4.6±0.4	4.1±0.5	4.5±0.4	4.4±0.4
SA-IDM-10G1(C)	4.5±0.4	4.4±0.4	4.2±0.5	4.4±0.3	4.4±0.3
SA-IDM-16G1(C)	4.7±0.4	4.6±0.4	4.4±0.2	4.6±0.4	4.6±0.3
SA-IDM-3H1 (C)	3.6±0.3	3.6±0.3	3.3±0.4	3.6±0.4	3.5±0.2
SA-IDM-1S1	4.7±0.6	4.3±0.4	4.3±0.5	4.6±0.3	4.5±0.4
SA-IDM-3S1	3.5±0.5	3.4±0.4	3.4±0.5	3.6±0.3	3.4±0.2
SA-IDM-2S4	4.0±0.3	3.7±0.5	3.5±0.3	3.9±0.3	3.7±0.4
SA-IDM-4S1	4.2±0.4	4.0±0.4	3.8±0.7	4.1±0.5	4.0±0.3
SA-IDM-15S1	3.9±0.4	3.5±0.5	3.4±0.3	3.6±0.4	3.6±0.5
SA-IDM-16S1	4.5±0.5	4.3±0.4	4.2±0.4	4.3±0.4	4.3±0.2
SA-IDM-14G1(C)	4.5±0.5	4.5±0.5	4.3±0.4	4.5±0.3	4.5±0.2
AVERAGE	4.2±1	4.2±1.1	4±1.1	4.3±1.1	

GRAND AVG

4.2±1.1

* The standard month = 30.4 days.

** Quarterly Element TLD results by DESEL.

(1) Results not reported by DESEL. See program deviations.

(2) TLD and pole missing. See program deviations.

TABLE C-5

2000 CONCENTRATIONS OF IODINE-131* AND GAMMA EMITTERS** IN MILK

Results in Units of pCi/L +/- 2 sigma

STATION ID	SAMPLING PERIOD		I-131	GAMMA EMITTERS K-40
	START	STOP		
SA-MLK-2F9	01/02/2000	01/03/2000	<0.2	1390 ± 70
SA-MLK-11F3	01/03/2000	01/04/2000	<0.2	1330 ± 80
SA-MLK-14F4	01/02/2000	01/03/2000	<0.2	1350 ± 60
SA-MLK-3G1 (C)	01/03/2000	01/04/2000	<0.2	1410 ± 90
SA-MLK-2F9	02/06/2000	02/07/2000	<0.2	1330 ± 70
SA-MLK-11F3	02/07/2000	02/08/2000	<0.2	1370 ± 70
SA-MLK-14F4	02/07/2000	02/08/2000	<0.2	1350 ± 70
SA-MLK-3G1 (C)	02/06/2000	02/07/2000	<0.2	1250 ± 70
SA-MLK-2F9	03/06/2000	03/07/2000	<0.3	1360 ± 80
SA-MLK-11F3	03/06/2000	03/07/2000	<0.2	1360 ± 70
SA-MLK-14F4	03/06/2000	03/07/2000	<0.2	1340 ± 80
SA-MLK-3G1 (C)	03/07/2000	03/08/2000	<0.2	1190 ± 70
SA-MLK-2F9	04/03/2000	04/04/2000	<0.2	1410 ± 70
SA-MLK-11F3	04/03/2000	04/04/2000	<0.2	1370 ± 90
SA-MLK-14F4	04/03/2000	04/04/2000	<0.2	1280 ± 80
SA-MLK-3G1 (C)	04/02/2000	04/03/2000	<0.2	1410 ± 70
SA-MLK-2F9	04/16/2000	04/17/2000	<0.2	1340 ± 80
SA-MLK-11F3	04/17/2000	04/18/2000	<0.2	1250 ± 60
SA-MLK-14F4	04/17/2000	04/18/2000	<0.3	1420 ± 80
SA-MLK-3G1 (C)	04/16/2000	04/17/2000	<0.3	1290 ± 70
SA-MLK-2F9	04/30/2000	05/01/2000	<0.1	1290 ± 70
SA-MLK-11F3	05/01/2000	05/02/2000	<0.2	1270 ± 70
SA-MLK-14F4	05/01/2000	05/02/2000	<0.2	1210 ± 70
SA-MLK-3G1 (C)	04/30/2000	05/01/2000	<0.3	1240 ± 70
SA-MLK-2F9	05/14/2000	05/15/2000	<0.2	1290 ± 70
SA-MLK-11F3	05/15/2000	05/16/2000	<0.2	1250 ± 70
SA-MLK-14F4	05/15/2000	05/16/2000	<0.3	1320 ± 60
SA-MLK-3G1 (C)	05/14/2000	05/15/2000	<0.3	1330 ± 80
SA-MLK-2F9	06/04/2000	06/05/2000	<0.2	1280 ± 70
SA-MLK-11F3	06/04/2000	06/05/2000	<0.1	1320 ± 80
SA-MLK-14F4	06/04/2000	06/05/2000	<0.3	1300 ± 70
SA-MLK-3G1 (C)	06/05/2000	06/06/2000	<0.2	1260 ± 60
SA-MLK-2F9	06/18/2000	06/19/2000	<0.1	1260 ± 70
SA-MLK-11F3	06/19/2000	06/20/2000	<0.2	1360 ± 70
SA-MLK-14F4	06/18/2000	06/19/2000	<0.2	1450 ± 90
SA-MLK-3G1 (C)	06/19/2000	06/20/2000	<0.3	1240 ± 80
SA-MLK-2F9	07/09/2000	07/10/2000	<0.2	1440 ± 80
SA-MLK-11F3	07/10/2000	07/11/2000	<0.2	1420 ± 80
SA-MLK-14F4	07/10/2000	07/11/2000	<0.2	1410 ± 90
SA-MLK-3G1 (C)	07/09/2000	07/10/2000	<0.2	1380 ± 70
SA-MLK-2F9	07/24/2000	07/25/2000	<0.2	1370 ± 80
SA-MLK-11F3	07/24/2000	07/25/2000	<0.3	1410 ± 90
SA-MLK-14F4	07/24/2000	07/25/2000	<0.2	1290 ± 70
SA-MLK-3G1 (C)	07/23/2000	07/24/2000	<0.1	1360 ± 70

TABLE C-5

2000 CONCENTRATIONS OF IODINE-131 * AND GAMMA EMITTERS** IN MILK

Results in Units of pCi/L +/- 2 sigma				

STATION ID	SAMPLING PERIOD		I-131	GAMMA EMITTERS K-40
	START	STOP		
SA-MLK-2F9	08/07/2000	08/08/2000	<0.2	1430 ± 80
SA-MLK-11F3	08/07/2000	08/08/2000	<0.2	1410 ± 80
SA-MLK-14F4	08/07/2000	08/08/2000	<0.2	1300 ± 70
SA-MLK-3G1 (C)	08/06/2000	08/07/2000	<0.3	1450 ± 90
SA-MLK-2F9	08/20/2000	08/21/2000	<0.2	1310 ± 70
SA-MLK-11F3	08/21/2000	08/22/2000	<0.3	1350 ± 70
SA-MLK-14F4	08/20/2000	08/21/2000	<0.2	1280 ± 80
SA-MLK-3G1 (C)	08/20/2000	08/21/2000	<0.2	1240 ± 60
SA-MLK-2F9	09/04/2000	09/05/2000	<0.2	1310 ± 70
SA-MLK-11F3	09/05/2000	09/06/2000	<0.2	1330 ± 60
SA-MLK-14F4	09/05/2000	09/06/2000	<0.2	1240 ± 70
SA-MLK-3G1 (C)	09/04/2000	09/05/2000	<0.3	1270 ± 70
SA-MLK-2F9	09/18/2000	09/19/2000	<0.2	1440 ± 80
SA-MLK-11F3	09/19/2000	09/20/2000	<0.3	1260 ± 70
SA-MLK-14F4	09/18/2000	09/19/2000	<0.3	1320 ± 70
SA-MLK-3G1 (C)	09/18/2000	09/19/2000	<0.3	1210 ± 60
SA-MLK-2F9	10/02/2000	10/03/2000	<0.2	1370 ± 70
SA-MLK-11F3	10/02/2000	10/03/2000	<0.2	1310 ± 60
SA-MLK-14F4	10/02/2000	10/03/2000	<0.3	1290 ± 70
SA-MLK-3G1 (C)	10/01/2000	10/02/2000	<0.3	1250 ± 70
SA-MLK-2F9	10/16/2000	10/17/2000	<0.2	1400 ± 80
SA-MLK-11F3	10/16/2000	10/17/2000	<0.2	1310 ± 70
SA-MLK-14F4	10/16/2000	10/17/2000	<0.2	1300 ± 70
SA-MLK-3G1 (C)	10/15/2000	10/16/2000	<0.2	1290 ± 90
SA-MLK-2F9	11/13/2000	11/14/2000	<0.4	1320 ± 70
SA-MLK-11F3	11/12/2000	11/13/2000	<0.2	1360 ± 90
SA-MLK-14F4	11/13/2000	11/14/2000	<0.3	1270 ± 90
SA-MLK-3G1 (C)	11/12/2000	11/13/2000	<0.3	1310 ± 70
SA-MLK-2F9	11/26/2000	11/27/2000	<0.2	1380 ± 70
SA-MLK-11F3	11/26/2000	11/27/2000	<0.2	1360 ± 70
SA-MLK-14F4	11/27/2000	11/28/2000	<0.3	1380 ± 80
SA-MLK-3G1 (C)	11/26/2000	11/27/2000	<0.5	1340 ± 70
SA-MLK-2F9	12/11/2000	12/12/2000	<0.2	1320 ± 80
SA-MLK-11F3	12/11/2000	12/12/2000	<0.2	1330 ± 70
SA-MLK-14F4	12/11/2000	12/12/2000	<0.2	1290 ± 70
SA-MLK-3G1 (C)	12/10/2000	12/11/2000	<0.2	1310 ± 80
AVERAGE			-	1300 ± 100

* Iodine-131 results are corrected for decay to midpoint of collection period & analyzed to a sensitivity of 1.0 pCi/L.

** All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19.

*** Monthly sample collected during Jan., Feb., March and Dec., when animals are not on pasture
(C) Control Station

TABLE C-6**2000 CONCENTRATIONS OF GROSS ALPHA AND GROSS BETA EMITTERS,
AND TRITIUM IN WELL WATER**

Results in Units of pCi/L +/- 2 sigma

STATION ID	SAMPLING DATE	GROSS ALPHA	GROSS BETA	TRITIUM
SA-WWA-3E1	01/31/2000	1.6 ± 1.1	10 ± 0.8	< 130
SA-WWA-3E1	02/29/2000	3.3 ± 1.2	9.9 ± 0.8	< 120
SA-WWA-3E1	03/27/2000	1.9 ± 1.2	9.5 ± 0.8	< 150
SA-WWA-3E1	04/24/2000	3.2 ± 1.2	10 ± 0.8	< 150
SA-WWA-3E1	05/30/2000	< 1.2	11 ± 0.8	< 150
SA-WWA-3E1	06/26/2000	1.3 ± 0.8	11 ± 0.8	< 150
SA-WWA-3E1	07/31/2000	1.9 ± 1.1	9.9 ± 0.8	< 150
SA-WWA-3E1	08/28/2000	1.6 ± 1.2	10 ± 0.8	< 150
SA-WWA-3E1	09/25/2000	1.2 ± 1	10 ± 0.8	< 150
SA-WWA-3E1	10/31/2000	2.6 ± 1.1	11 ± 0.8	< 160
SA-WWA-3E1	11/28/2000	1.7 ± 1	10 ± 0.8	< 160
SA-WWA-3E1	12/26/2000	2.2 ± 1	10 ± 0.8	< 170
AVERAGE		2 ± 1.4	10 ± 1	-

TABLE C-7**2000 CONCENTRATIONS OF GAMMA EMITTERS* IN WELL WATER**

Results in Units of pCi/L +/- 2 sigma

STATION ID	SAMPLING DATE	<----GAMMA EMITTERS ---->	
		K-40	RA-NAT
SA-WWA-3E1	01/31/2000	<15	143 ± 4
SA-WWA-3E1	02/29/2000	75 ± 29	160 ± 6
SA-WWA-3E1	03/27/2000	60 ± 22	84 ± 4
SA-WWA-3E1	04/24/2000	74 ± 23	163 ± 6
SA-WWA-3E1	05/30/2000	58 ± 22	160 ± 6
SA-WWA-3E1	06/26/2000	62 ± 22	89 ± 5
SA-WWA-3E1	07/31/2000	70 ± 22	125 ± 5
SA-WWA-3E1	08/28/2000	<14	107 ± 3
SA-WWA-3E1	09/25/2000	79 ± 31	147 ± 6
SA-WWA-3E1	10/31/2000	<14	159 ± 4
SA-WWA-3E1	11/28/2000	<24	233 ± 6
SA-WWA-3E1	12/26/2000	<46	145 ± 5
AVERAGE		49 ± 51	140 ± 80

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19.

TABLE C-8

**2000 CONCENTRATIONS OF GROSS ALPHA AND GROSS BETA EMITTERS AND TRITIUM
IN RAW AND TREATED POTABLE WATER**

Results in Units of pCi/L +/- 2 sigma

TYPE	SAMPLING PERIOD	GROSS ALPHA	GROSS BETA	TRITIUM
RAW	1/1-31/00	0.6±0.4	3.1±0.5	<130
TREATED	1/1-31/00	<0.8	2.9±0.5	<130
RAW	2/1-29/00	1.1±0.5	3.1±0.5	<130
TREATED	2/1-29/00	<0.7	3.6±0.5	<120
RAW	3/1-31/00	<0.7	2.3±0.4	<150
TREATED	3/1-31/00	<0.9	2.5±0.4	<150
RAW	4/1-30/00	0.9±0.5	2.5±0.5	<150
TREATED	4/1-30/00	1.3±0.6	2.4±0.4	<140
RAW	5/1-31/00	0.8±0.5	2.8±0.5	<160
TREATED	5/1-31/00	<0.7	2.8±0.5	<150
RAW	6/1-30/00	0.8±0.4	2.8±0.5	<150
TREATED	6/1-30/00	0.6±0.4	2.5±0.5	<150
RAW	7/1-31/00	0.8±0.5	2.9±0.5	<150
TREATED	7/1-31/00	<0.7	2.3±0.4	<160
RAW	8/1-31/00	0.8±0.6	2.5±0.4	<150
TREATED	8/1-31/00	<0.8	2.5±0.4	<150
RAW	9/1-30/00	0.6±0.4	2.2±0.4	<150
TREATED	9/1-30/00	<0.8	2±0.4	<160
RAW	10/1-31/00	0.6±0.4	2.9±0.5	<150
TREATED	10/1-31/00	0.9±0.6	2.8±0.5	<160
RAW	11/1-30/00	0.7±0.4	3±0.5	<160
TREATED	11/1-30/00	<0.6	2.5±0.4	<150
RAW	12/1-31/00	0.5±0.3	3.1±0.5	<160
TREATED	12/1-31/00	0.5±0.4	3±0.5	<150
AVERAGE				
RAW		0.7±0.4	2.8±0.6	-
TREATED		0.8±0.5	2.7±0.8	-
GRAND AVERAGE		0.8±0.4	2.7±0.7	-

TABLE C-9

2000 CONCENTRATIONS OF IODINE-131* AND GAMMA EMITTERS
IN RAW AND TREATED POTABLE WATER**

Results in Units of pCi/L +/- 2 sigma

TYPE	SAMPLING PERIOD	I-131	<-----GAMMA EMITTERS ----->	
			K-40	RA-NAT
RAW	1/1-31/2000	<0.3	47 ± 10	<2
TREATED	1/1-31/2000	<0.1	<15	<1.6
RAW	2/1-29/2000	<0.2	<14	<1.8
TREATED	2/1-29/2000	<0.1	<14	<1.8
RAW	3/1-31/2000	<0.3	50 ± 17	<3.1
TREATED	3/1-31/2000	<0.2	54 ± 16	<1.8
RAW	4/1-30/2000	<0.2	<36	<1.9
TREATED	4/1-30/2000	<0.3	61 ± 18	<2.1
RAW	5/1-31/2000	<0.2	76 ± 26	<2.3
TREATED	5/1-31/2000	<0.3	27 ± 12	<1.7
RAW	6/1-30/2000	<0.2	37 ± 14	<1.9
TREATED	6/1-30/2000	<0.2	56 ± 19	<1.7
RAW	7/1-31/2000	<0.2	31 ± 11	<1.4
TREATED	7/1-31/2000	<0.2	<15	<1.7
RAW	8/1-31/2000	<0.2	<15	<2
TREATED	8/1-31/2000	<0.1	44 ± 22	4.2 ± 1.6
RAW	9/1-30/2000	<0.3	36 ± 17	<1.4
TREATED	9/1-30/2000	<0.2	43 ± 18	<2.3
RAW	10/1-31/2000	<0.3	39 ± 19	<1.6
TREATED	10/1-31/2000	<0.2	<14	<3.4
RAW	11/1-30/2000	<0.2	42 ± 15	<1.8
TREATED	11/1-30/2000	<0.3	50 ± 15	<3.3
RAW	12/1-31/2000	<0.3	43 ± 25	<1.9
TREATED	12/1-31/2000	<0.4	44 ± 13	<1.9
AVERAGES				
RAW		-	39 ± 32	-
TREATED		-	36 ± 36	-
GRAND AVERAGE			38 ± 34	-

* Iodine-131 analyzed to a sensitivity of 1.0 pCi/L.

** All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19.

TABLE C-10

2000 CONCENTRATIONS OF GAMMA EMITTERS* IN VEGETABLES

Results in Units of pCi/kg (Wet) +/- 2 sigma				
STATION ID	SAMPLING DATE	SAMPLE TYPE	<--- GAMMA EMITTERS --->	
			K-40	Ra-NAT
SA-FPV-2F9	05/08/2000	Asparagus	1910 ± 170	<9.2
SA-FPV-2G2 (C)	05/08/2000	Asparagus	2650 ± 220	<10
AVERAGE			2280 ± 1050	-
SA-FPL-2F4	07/18/2000	Cabbage	2240 ± 110	<4.7
SA-FPL-3H5 (C)	07/18/2000	Cabbage	2050 ± 110	<4.6
SA-FPL-6F2	07/19/2000	Cabbage	2170 ± 110	<4.7
SA-FPL-3F5	07/19/2000	Collard Greens	2520 ± 100	<3.6
AVERAGE			2250 ± 400	-
SA-FPV-2F4	07/18/2000	Corn	2520 ± 200	<12
SA-FPV-2F9	07/17/2000	Corn	2790 ± 150	16 ± 5.4
SA-FPV-3F5	07/17/2000	Corn	2510 ± 170	<7.2
SA-FPV-1G1 (C)	07/17/2000	Corn	2620 ± 180	<7
SA-FPV-3H5 (C)	07/18/2000	Corn	2490 ± 90	<8.9
SA-FPV-2G2 (C)	07/17/2000	Corn	2570 ± 180	<7.8
SA-FPV-14F3	07/19/2000	Corn	2440 ± 90	<9.3
AVERAGE			1660 ± 580	-
SA-FPV-2F4	07/18/2000	Peppers	2120 ± 200	<14
SA-FPV-3F5	07/17/2000	Peppers	1520 ± 150	<9.9
SA-FPV-1G1 (C)	07/17/2000	Peppers	1510 ± 160	<9.9
SA-FPV-3H5 (C)	07/18/2000	Peppers	1460 ± 90	<9.3
SA-FPV-2G2 (C)	07/17/2000	Peppers	1940 ± 150	<10
SA-FPV-14F3	07/19/2000	Peppers	1430 ± 160	<14
AVERAGE			1660 ± 580	-
SA-FPV-2F4	07/18/2000	Tomatoes	3100 ± 180	20 ± 4.8
SA-FPV-2F9	07/17/2000	Tomatoes	2160 ± 180	<9.9
SA-FPV-3F5	07/17/2000	Tomatoes	2360 ± 160	<7.2
SA-FPV-1G1 (C)	07/17/2000	Tomatoes	2370 ± 90	<8.4
SA-FPV-3H5 (C)	07/18/2000	Tomatoes	2420 ± 150	<7.6
SA-FPV-2G2 (C)	07/17/2000	Tomatoes	1940 ± 80	<5.4
SA-FPV-6F2	07/19/2000	Tomatoes	2290 ± 160	<6.9
SA-FPV-14F3	07/19/2000	Tomatoes	2020 ± 140	<6
AVERAGE			2330 ± 710	-
GRAND AVERAGE			2230 ± 840	-

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19
(C) Control Station

TABLE C-11**2000 CONCENTRATIONS OF GAMMA EMITTERS* IN GAME**

Results in Units of pCi/kg (wet) +/- 2 sigma

STATION ID	SAMPLING DATE	SAMPLE TYPE	GAMMA EMITTERS
			K-40
SA-GAM-11D1 (C)	02/22/2000	Muskrat	2550 ± 160
SA-GAM-3E1	02/29/2000	Muskrat	3240 ± 200
AVERAGE		Muskrat	2900 ± 980

*All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19.

TABLE C-12**2000 CONCENTRATIONS OF GAMMA EMITTERS* IN FODDER CROPS**

Results in Units of pCi/kg (wet) +/- 2 sigma

STATION ID	SAMPLING DATE	SAMPLE TYPE	< - GAMMA EMITTERS - >	
			Be-7	K-40
SA-VGT-2F9	10/17/2000	Silage	840 ± 80	3100 ± 200
SA-VGT-3G1 (C)	10/16/2000	Silage	690 ± 60	3860 ± 140
SA-VGT-14F4	10/17/2000	Silage	800 ± 80	4430 ± 220
SA-VGT-11F3	11/01/2000	Silage	490 ± 60	4310 ± 200
AVERAGE			710 ± 310	3930 ± 1200
SA-VGT-11F3	11/03/2000	Soybeans	< 40	13900 ± 260
SA-VGT-14F4	11/06/2000	Soybeans	< 40	15600 ± 340
SA-VGT-3G1 (C)	11/13/2000	Soybeans	< 30	14100 ± 270
AVERAGE			-	14500 ± 1900

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19.
 (C) Location 3G1 is the Control Station.

TABLE C-13

2000 CONCENTRATIONS OF GROSS BETA EMITTERS IN SURFACE WATER

Results in Units of pCi/L +/- 2 sigma						
SAMPLING DATE	STATION ID					AVERAGE
	SA-SWA-11A1	SA-SWA-12C1 (Control)	SA-SWA-16F1	SA-SWA-1F2	SA-SWA-7E1	
January	77 ± 6	34 ± 4	37 ± 4	28 ± 4	100 ± 7	55 ± 63
February	96 ± 6	66 ± 5	58 ± 5	49 ± 4	115 ± 7	77 ± 55
March	31 ± 4	31 ± 4	21 ± 3	14 ± 3	64 ± 5	32 ± 38
April	13 ± 3	20 ± 3	13 ± 3	6 ± 2	30 ± 4	16 ± 18
May	43 ± 4	26 ± 3	16 ± 3	16 ± 3	61 ± 5	33 ± 39
June	35 ± 4	29 ± 4	18 ± 3	13 ± 3	53 ± 5	29 ± 32
July	51 ± 5	35 ± 4	24 ± 3	16 ± 3	64 ± 5	38 ± 39
August	39 ± 4	24 ± 3	17 ± 3	14 ± 3	55 ± 5	30 ± 34
September	76 ± 6	56 ± 5	35 ± 4	38 ± 4	100 ± 7	61 ± 54
October	61 ± 5	46 ± 4	37 ± 4	34 ± 4	82 ± 6	52 ± 40
November	160 ± 9	123 ± 7	113 ± 7	115 ± 7	191 ± 10	140 ± 68
December	153 ± 9	109 ± 7	79 ± 6	95 ± 6	168 ± 9	121 ± 76
AVERAGE	70 ± 93	50 ± 68	39 ± 61	37 ± 69	90 ± 96	
GRAND AVERAGE						57 ± 86

TABLE C-14

2000 CONCENTRATIONS OF GAMMA EMITTERS* IN SURFACE WATER

Results in Units of pCi/L +/- 2 sigma

STATION ID	SAMPLING DATE	<----- GAMMA EMITTERS ----->	
		K-40	RA-NAT
SA-SWA-1F2	01/06/2000	72 ± 19	< 2
SA-SWA-7E1	01/06/2000	77 ± 22	< 1.9
SA-SWA-11A1	01/06/2000	109 ± 21	< 1.6
SA-SWA-12C1(C)	01/06/2000	100 ± 30	< 2.1
SA-SWA-16F1	01/06/2000	86 ± 25	< 2
SA-SWA-1F2	02/18/2000	71 ± 20	< 1.5
SA-SWA-7E1	02/18/2000	97 ± 21	< 1.8
SA-SWA-11A1	02/18/2000	135 ± 21	< 2.1
SA-SWA-12C1(C)	02/18/2000	57 ± 22	< 1.7
SA-SWA-16F1	02/18/2000	48 ± 13	< 1.8
SA-SWA-1F2	03/10/2000	< 18	< 1.8
SA-SWA-7E1	03/10/2000	54 ± 24	< 1.8
SA-SWA-11A1	03/10/2000	83 ± 17	< 1.6
SA-SWA-12C1(C)	03/10/2000	59 ± 17	< 1.9
SA-SWA-16F1	03/10/2000	80 ± 20	< 2.6
SA-SWA-1F2	04/10/2000	39 ± 16	< 1.8
SA-SWA-7E1	04/10/2000	78 ± 23	< 2
SA-SWA-11A1	04/10/2000	47 ± 12	< 2
SA-SWA-12C1(C)	04/10/2000	83 ± 14	< 2.4
SA-SWA-16F1	04/10/2000	66 ± 21	< 2.4
SA-SWA-1F2	05/04/2000	72 ± 22	< 1.7
SA-SWA-7E1	05/04/2000	111 ± 17	< 2
SA-SWA-11A1	05/04/2000	66 ± 18	< 1.8
SA-SWA-12C1(C)	05/04/2000	53 ± 10	< 1.8
SA-SWA-16F1	05/04/2000	44 ± 14	< 1.8
SA-SWA-1F2	06/10/2000	< 16	< 1.9
SA-SWA-7E1	06/10/2000	103 ± 19	< 2
SA-SWA-11A1	06/10/2000	76 ± 20	< 1.9
SA-SWA-12C1(C)	06/10/2000	21 ± 14	< 1.6
SA-SWA-16F1	06/10/2000	58 ± 14	< 6.3
SA-SWA-1F2	07/11/2000	41 ± 13	< 1.7
SA-SWA-7E1	07/11/2000	80 ± 24	< 2
SA-SWA-11A1	07/11/2000	87 ± 18	< 1.7
SA-SWA-12C1(C)	07/11/2000	73 ± 21	< 1.6
SA-SWA-16F1	07/11/2000	57 ± 19	< 2.4

TABLE C-14

2000 CONCENTRATIONS OF GAMMA EMITTERS* IN SURFACE WATER

Results in Units of pCi/L +/- 2 sigma

STATION ID	SAMPLING DATE	<----- GAMMA EMITTERS ----->	
		K-40	RA-NAT
SA-SWA-1F2	08/10/2000	68 ± 26	< 2.1
SA-SWA-7E1	08/10/2000	104 ± 22	< 2.4
SA-SWA-11A1	08/10/2000	73 ± 21	< 1.6
SA-SWA-12C1(C)	08/10/2000	62 ± 17	< 1.7
SA-SWA-16F1	08/10/2000	66 ± 21	< 1.7
SA-SWA-1F2	09/08/2000	77 ± 20	< 1.9
SA-SWA-7E1	09/08/2000	81 ± 25	< 1.6
SA-SWA-11A1	09/08/2000	61 ± 19	< 1.8
SA-SWA-12C1(C)	09/08/2000	76 ± 28	< 2.1
SA-SWA-16F1	09/08/2000	106 ± 19	< 2.4
SA-SWA-1F2	10/05/2000	93 ± 31	< 2.4
SA-SWA-7E1	10/05/2000	131 ± 25	< 2.1
SA-SWA-11A1	10/05/2000	92 ± 18	< 2.1
SA-SWA-12C1(C)	10/05/2000	79 ± 17	< 1.8
SA-SWA-16F1	10/05/2000	80 ± 24	< 1.8
SA-SWA-1F2	11/13/2000	165 ± 26	< 2.4
SA-SWA-7E1	11/13/2000	208 ± 28	< 2.1
SA-SWA-11A1	11/13/2000	180 ± 26	< 3.4
SA-SWA-12C1(C)	11/13/2000	111 ± 28	5 ± 2
SA-SWA-16F1	11/13/2000	101 ± 16	< 2
SA-SWA-1F2	12/11/2000	102 ± 20	< 1.8
SA-SWA-7E1	12/11/2000	151 ± 26	< 2
SA-SWA-11A1	12/11/2000	185 ± 31	< 4.9
SA-SWA-12C1(C)	12/11/2000	92 ± 21	< 1.8
SA-SWA-16F1	12/11/2000	140 ± 24	< 4.2
AVERAGE		85 ± 77	-

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19
C) Control Station

TABLE C-15

2000 CONCENTRATIONS OF TRITIUM IN QUARTERLY COMPOSITES OF SURFACE WATER

Results in Units of pCi/L +/- 2 sigma

SAMPLING PERIOD	STATION ID					AVERAGE
	SA-SWA-11A1	SA-SWA-12C1 (Control)	SA-SWA-16F1	SA-SWA-1F2	SA-SWA-7E1	
01/06/2000 to 03/10/2000	<150	<150	<150	<150	<150	-
04/10/2000 to 06/10/2000	<150	<150	<150	<150	<150	-
07/11/2000 to 09/08/2000	240 ± 90	<160	<160	<150	<150	-
10/05/2000 to 12/11/2000	<160	<170	<170	<170	<170	-

TABLE C-16

2000 STRONTIUM-89 90* AND GAMMA EMITTERS** IN EDIBLE FISH

Results in Units of pCi/kg (wet) +/- 2 sigma
(Strontium in bone is reported in pCi/kg (dry))

STATION ID	SAMPLING PERIOD	STRONTIUM <----- BONES ----->		STRONTIUM <----- FLESH ----->		GAMMA EMITTERS (FLESH)
		Sr-89	Sr-90	Sr-89	Sr-90	K-40
SA-ESF-7E1	5/24-26/2000	*	*	*	*	3680 ± 190
SA-ESF-11A1	5/24-26/2000	< 130	< 120	< 35	< 18	3830 ± 220
SA-ESF-12C1 (C)	5/24-26/2000	*	*	*	*	3600 ± 180
AVERAGE		-		-	-	3700 ± 230
SA-ESF-7E1	9/13-15/2000	*	*	*	*	3370 ± 190
SA-ESF-11A1	9/13-15/2000	*	*	*	*	3190 ± 180
SA-ESF-12C1 (C)	9/13-15/2000	*	*	*	*	3350 ± 170
AVERAGE		-	-	-	-	3300 ± 200
GRAND AVERAGE				-	-	3500 ± 480

* Strontium results for one location for the first semi annual collection are analyzed and reported by Duke Engineering & Services Environmental Laboratory (DESEL) as MDC. This is done as a management audit sample.

** All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19
(C) Control Station

TABLE C-17

2000 CONCENTRATIONS OF GAMMA EMITTERS* IN CRABS

Results in Units of pCi/kg (wet) +/- 2 sigma

STATION ID	SAMPLING PERIOD	<--- GAMMA EMITTERS ---> (FLESH)	
		K-40	RA-NAT
SA-ECH-11A1	7/10-12/2000	2240 ± 150	< 7.4
SA-ECH-12C1 (C)	7/10-12/2000	2090 ± 80	22 ± 3
AVERAGE		2170 ± 210	-
SA-ECH-11A1	9/11-14/2000	2500 ± 90	< 6.1
SA-ECH-12C1 (C)	9/11-14/2000	2300 ± 170	< 9.7
AVERAGE		2400 ± 280	-
GRAND AVERAGE		2280 ± 340	-

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19
(C) Control Station

TABLE C-18

2000 CONCENTRATIONS OF GAMMA EMITTERS* IN SEDIMENT

Results in Units of pCi/kg (dry) +/- 2 sigma

STATION ID	SAMPLING DATE	<----- GAMMA EMITTERS ----->						
		Be-7	K-40	Co-60	Cs-134	Cs-137	RA NAT	Th-232
SA-ESS-6S2	06/26/2000	<40	1630 ± 110	<6	<2.6	<3	140 ± 10	150 ± 20
SA-ESS-11A1	06/21/2000	<70	8740 ± 310	<10	25 ± 8.5	32 ± 8	600 ± 20	760 ± 50
SA-ESS-15A1	06/21/2000	<110	16600 ± 280	<13	<8	168 ± 9	620 ± 10	1200 ± 40
SA-ESS-16A1	06/21/2000	660 ± 210	13300 ± 460	<13	<9	76 ± 20	590 ± 30	820 ± 80
SA-ESS-12C1(C)	06/21/2000	<70	14000 ± 380	<10	<5.7	<15	800 ± 30	920 ± 55
SA-ESS-7E1	06/21/2000	<80	11200 ± 340	<19	<5.7	<43	860 ± 30	950 ± 50
SA-ESS-16F1	06/21/2000	<80	14400 ± 390	<11	<6.7	44 ± 14	600 ± 20	820 ± 70
AVERAGE		-	11400 ± 10000	-	-	54 ± 110	600 ± 460	910 ± 320
SA-ESS-6S2	10/23/2000	<50	1330 ± 110	<3.2	<2.1	<3.4	210 ± 10	150 ± 20
SA-ESS-11A1	10/18/2000	<110	9930 ± 270	<8	<3.9	61 ± 11	470 ± 20	690 ± 40
SA-ESS-15A1	10/18/2000	<70	14100 ± 280	<13	<7.1	110 ± 8.2	660 ± 10	1070 ± 30
SA-ESS-16A1	10/18/2000	890 ± 110	15600 ± 250	<14	<6.5	90 ± 10	600 ± 20	980 ± 60
SA-ESS-12C1(C)	10/18/2000	250 ± 80	13400 ± 210	<12	<7	47 ± 6.5	710 ± 10	860 ± 30
SA-ESS-7E1	10/18/2000	<120	13000 ± 370	<11	<5.9	42 ± 20	700 ± 20	840 ± 70
SA-ESS-16F1	10/18/2000	<100	16200 ± 230	<13	<7.7	<9.9	540 ± 10	980 ± 40
AVERAGE		-	11900 ± 10200	-	-	52 ± 78	560 ± 350	900 ± 270
GRAND AVERAGE		-	11700 ± 9700	-	-	53 ± 92	580 ± 400	910 ± 280

* All other gamma emitters searched for were <LLD; typical LLDs are given in Table C-19
(C) Control Station

TABLE C-19

2000 MAPLEWOOD TESTING SERVICES
LLDs FOR GAMMA SPECTROMETRY

SAMPLE TYPE:	<-----AIR----->		<-----WATER----->		<-----MILK----->	
	IODINE	PARTICULATES	GAMMA SCAN	IODINE	GAMMA SCAN	IODINE
ACTIVITY:	10-3 pCi/m ³	10 ⁻³ pCi/m ³	pCi/L	pCi/L	pCi/L	pCi/L
GEOMETRY:	47 ML	13 FILTERS	3.5 LITER	100 ML	3.5 LITER	100 ML
COUNT TIME:	120 MINS	500 MINS	1000 MIN	1000 MINS	500 MINS	1000 MINS
DELAY TO	2 DAYS	5 DAYS	7 DAYS	3 DAYS	2 DAYS	2 DAYS
COUNT:						
NUCLIDES						
BE-7	-	7.2	12	-	23	-
NA-22	-	1.2	10	-	6.7	-
K-40	-	7.0	15	-	120	-
CR-51	-	2.6	12	-	12	-
MN-54	-	0.31	1.2	-	3.6	-
CO-58	-	0.60	1.3	-	4.3	-
FE-59	-	1.07	5.6	-	7.9	-
CO-60	-	0.39	1.3	-	4.7	-
ZN-65	-	0.88	3.1	-	12	-
ZRNB-95	-	0.57	2.0	-	4.5	-
MO-99	-	69	60	-	24	-
RU-103	-	0.49	1.2	-	2.4	-
RU-106	-	2.3	13	-	18	-
AG-110M	-	0.60	3.0	-	3.3	-
SB-125	-	0.62	3.8	-	6.2	-
TE-129M	-	12	79	-	84	-
I-131	10	0.82	2.5	0.4	1.8	0.5
TE-132	-	2.6	62	-	2.7	-
BA-133	-	0.29	1.6	-	1.7	-
CS-134	-	0.32	1.5	-	2.7	-
CS-136	-	0.81	3.0	-	3.9	-
CS-137	-	0.61	4.2	-	3.7	-
BALA-140	-	1.5	5.0	-	10	-
CE-141	-	0.25	1.8	-	2.5	-
CE-144	-	0.85	11	-	9.2	-
RA-NAT	-	0.77	4.4	-	5.7	-
TH-232	-	2.4	10	-	21	-

TABLE C-19 (Cont'd)

2000 PSE&G MAPLEWOOD TESTING SERVICES

LLDs FOR GAMMA SPECTROMETRY

SAMPLE TYPE:	FOOD PRODUCTS	VEGETATION	GAME	FISH	SEDIMENT
ACTIVITY:	pCi/kg WET	pCi/kg WET	pCi/kg WET	SHELLFISH	& SOIL
GEOMETRY:	500 ml	3.5 LITER	500 ml	pCi/kg WET	pCi/kg DRY
COUNT TIME:	500 MINS	500 MINS	500 MINS	500 ml	500 ml
DELAY TO	3 DAYS	7 DAYS	5 DAYS	500 MINS	500 MINS
COUNT:				5 DAYS	30 DAYS
NUCLIDES					
BE-7	42	87	24	34	120
NA-22	16	12	7.7	16	28
K-40	70	70	70	70	70
CR-51	34	34	28	30	100
MN-54	5.8	4.8	3.0	5.0	23
CO-58	8.6	6.5	3.0	6.0	11
FE-59	17	16	8.0	19	40
CO-60	8.5	6.5	5.5	12	19
ZN-65	16	17	7.8	16	28
ZRNB-95	14	8.0	8.5	9.5	25
MO-99	89	135	50	159	150000
RU-103	5.2	5.0	3.2	5.0	12
RU-106	59	46	35	40	99
AG-110M	14	8.3	9.0	7.2	23
SB-125	11	10	11	14	23
TE-129M	323	186	157	160	543
I-131	5.8	8.4	2.8	6.4	96
TE-132	5.0	70	3.8	12	4300
BA-133	6.4	12	3.7	19	15
CS-134	8.1	4.2	4.3	5.0	36
CS-136	8.8	8.2	7.0	8.9	48
CS-137	14	7.9	6.1	10	43
BALA-140	29	15	15	19	135
CE-141	6.1	5.0	3.5	4.2	20
CE-144	27	26	18	19	50
RA-NAT	17	10	7.5	10	45
TH-232	45	33	28	31	50

APPENDIX D

SUMMARY OF RESULTS FROM ANALYTICS AND ENVIRONMENTAL RESOURCE ASSOCIATES INTERLABORATORY COMPARISON PROGRAMS

APPENDIX D

SUMMARY OF ANALYTICS AND ENVIRONMENTAL RESOURCE ASSOCIATES INTERLABORATORY COMPARISON PROGRAM

Appendix D presents a summary of the analytical results for the 2000 Analytics and Environmental Resource Associates Inter-laboratory Comparison Program.

TABLE OF CONTENTS

<u>TABLE NO.</u>	<u>TABLE DESCRIPTION</u>	<u>PAGE</u>
D-1	Gross Alpha and Gross Beta Emitters in Water	81
D-2	Gamma Emitters in Water and Milk.....	82
D-3	Gamma Emitters in Air and Soil.....	83
D-4	Tritium in Water and Iodine in Air.....	84

TABLE D-1

RESULTS FOR ANALYTICS AND ERA INTERLABORATORY COMPARISON PROGRAM

Gross Alpha and Gross Beta Analysis of Water (pCi/L)

DATE MM-YY	PSEG SAMPLE CODE	MEDIUM	ANALYSIS	* PSEG Mean \pm s.d.	ANALYTICS ERA Known	ANALYTICS/ERA Acceptance Criteria	
						Lower Limit	Upper Limit
06-2000	ANL-WAT-AB509	Water	Alpha	52 \pm 0	44	34	54
			Beta	159 \pm 0	170	116	224
12-2000	ANL-WAT-AB516	Water	Alpha	54 \pm 2	40	28	52
			Beta	215 \pm 11	218	152	284

* s.d. - one standard deviation of three individual analytical results

TABLE D-2

RESULTS FOR ANALYTICS AND ERA INTERLABORATORY COMPARISON PROGRAM

Gamma Analysis of Water and Milk (pCi/L)

DATE MM-YY	PSEG SAMPLE CODE	MEDIUM	ANALYSIS	* PSEG Mean \pm s.d.	ANALYTICS ERA Known	ANALYTICS/ERA Acceptance Criteria	
						Lower Limit	Upper Limit
03-2000	ANL-WAT-G505	Water	Cr-51	254 \pm 15	238	166	310
			Mn-54	167 \pm 2	159	111	207
			Fe-59	109 \pm 5	92	62	122
			Co-60	47 \pm 1	44	32	56
			Zn-65	200 \pm 9	196	136	256
			I-131	78 \pm 4	74	50	98
			Cs-137	137 \pm 5	128	92	164
			Ce-141	444 \pm 8	427	301	553
03-2000	ANL-MLK-G507	Milk	Cr-51	264 \pm 6	256	178	334
			Mn-54	179 \pm 6	171	117	225
			Fe-59	118 \pm 11	99	69	129
			Co-60	125 \pm 4	125	89	161
			Zn-65	201 \pm 29	208	148	268
			I-131	88 \pm 1	84	60	108
			Cs-137	148 \pm 8	138	96	180
			Ce-141	472 \pm 16	460	322	598
12-2000	ANL-WAT-G518	Water	Cr-51	559 \pm 17	532	370	694
			Mn-54	176 \pm 6	161	113	209
			Fe-59	111 \pm 6	86	62	110
			Co-60	203 \pm 1	194	134	254
			Zn-65	174 \pm 5	156	108	204
			I-131	66 \pm 1	60	42	78
			Cs-134	87 \pm 9	90	60	120
			Cs-137	221 \pm 4	210	144	276
06-2000	ERA-WAT-G521	Water	Ce-141	385 \pm 8	376	57	490
			Ba-133	25 \pm 1.1	26	34	57
			Co-60	70 \pm 1.2	66	57	74
			Zn-65	59 \pm 3.2	55	45	64
			Cs-134	14 \pm 0.3	14	5.1	22
			Cs-137	240 \pm 3.5	238	217	259

* s.d. - one standard deviation of three individual analytical results

TABLE D-3

RESULTS OF ANALYTICS AND ERA INTERLABORATORY COMPARISON PROGRAM

Gamma Analysis of Soil (pCi/Kg-dry)
and Air Particulate Samples (pCi/m³)

DATE MM-YY	PSEG SAMPLE CODE	MEDIUM	ANALYSIS	* PSEG Mean \pm s.d.	ANALYTICS ERA Known	ANALYTICS/ERA Acceptance Criteria	
						Lower Limit	Upper Limit
03-2000	ANL-SOL-G506	Soil	Cr-51	427 \pm 20	473	329	617
			Mn-54	326 \pm 1	316	220	412
			Fe-59	197 \pm 16	184	130	238
			Co-60	227 \pm 8	231	159	303
			Zn-65	376 \pm 5	383	269	497
			Cs-137	355 \pm 8	382	268	496
			Ce-141	813 \pm 20	849	597	1101
06-2000	ANL-APT-G511	APT	Cr-51	443 \pm 18	312	216	408
			Mn-54	256 \pm 7	175	121	229
			Co-60	286 \pm 8	209	149	269
			Fe-59	113 \pm 3	74	50	98
			Zn-65	326 \pm 9	218	152	284
			Cs-134	154 \pm 3	135	93	177
			Cs-137	418 \pm 10	281	197	365
09-2000	ANL-SOL-G514	Soil	Ce-141	144 \pm 2	102	72	132
			Cr-51	359 \pm 26	403	283	523
			Mn-54	161 \pm 5	157	109	205
			Fe-59	103 \pm 10	95	65	125
			Co-60	409 \pm 6	432	300	564
			Zn-65	224 \pm 1	235	163	307
			Cs-134	195 \pm 17	224	158	290
			Cs-137	490 \pm 6	510	354	666
			Ce-141	322 \pm 9	335	233	437

* s.d. - one standard deviation of three individual analytical results

TABLE D-4

RESULTS OF ANALYTICS AND ERA INTERLABORATORY COMPARISON PROGRAM

Tritium and Iodine Analysis of Water (pCi/L)
And Iodine in Air Samples (pCi/m³)

DATE MM-YY	PSEG SAMPLE CODE	MEDIUM	ANALYSIS	* PSEG Mean \pm s.d.	ANALYTICS ERA Known	ANALYTICS/ERA Acceptance Criteria	
						Lower Limit	Upper Limit
03-2000	ANL-WAT-H504	Water	H-3	4147 \pm 53	4170	2916	5424
03-2000	ANL-AIO-I508	AIO	I-131	79 \pm 4	81	57	105
06-2000	ANL-AIO-I510	AIO	I-131	71 \pm 4	71	47	95
06-2000	ANL-WAT-H512	Water	H-3	11445 \pm 262	11400	7980	14820
09-2000	ANL-AIO-I513	AIO	I-131	87 \pm 1	85	61	109
09-2000	ANL-WAT-H515	Water	H-3	9222 \pm 252	8947	6265	11629
12-2000	ANL-AIO-I517	AIO	I-131	66 \pm 2	63	45	81
12-2000	ANL-WAT-H519	Water	H-3	10695 \pm 198	10082	7058	13106
03-2000	ERA-WAT-I520	Water	I-131	19 \pm 2	20	15	25
08-2000	ERA-WAT-H522	Water	H-3	8399 \pm 832	8320	6910	9730

* s.d. - one standard deviation of three individual analytical results

APPENDIX E

SYNOPSIS OF LAND USE CENSUS

APPENDIX E

SYNOPSIS OF 2000 LAND USE CENSUS

A land use census was conducted to identify, within a distance of 8 km (5 miles), the location of the nearest milk animal, the nearest residence, and the nearest garden of greater than 50m² (500ft²) producing broad leaf vegetation, in each of the 16 meteorological sectors.

Tabulated below are the results of these surveys:

<u>Meteorological Sector</u>	<u>Milk Animal July, 2000 km (miles)</u>	<u>Nearest Residence July, 2000 km (miles)</u>	<u>Vegetable Garden July, 2000 km (miles)</u>
N	None	None	None
NNE	None	None	None
NE	None	6.4 (4.0)	None
ENE	None	5.8 (3.6)	None
E	None	5.4 (3.4)	None
ESE	None	None	None
SE	None	None	None
SSE	None	None	None
S	None	None	None
SSW	None	5.5 (3.4)	None
SW	None	6.9 (4.3)	7.7 (4.8)
WSW	None	7.1 (4.4)	None
W	7.8 (4.9)	6.5 (4.0)	None
WNW	None	5.5 (3.4)	None
NW	None	5.9 (3.7)	None
NNW	None	6.8 (4.2)	None