



Duke Energy

Oconee Nuclear Station
7800 Rochester Highway
Seneca, SC 29672

(864) 885-3107 OFFICE
(864) 885-3564 FAX

W. R. McCollum, Jr.
Vice President

May 9, 2001


U. S. Nuclear Regulatory Commission
Document Control Desk
Washington, D. C. 20555

Subject: Oconee Nuclear Site Docket No. 50-270
Core Operating Limits Report (COLR)

Gentlemen:

Attached, pursuant to Oconee Technical Specifications 5.6.5, is an information copy of a revision to the Core Operating Limits Report for Oconee Unit 2, Cycle 19, Rev. 16.

Very truly yours,



W. R. McCollum, Jr.
Site Vice President
Oconee Nuclear Site

Attachment

ADD i

NRC Document Control Desk
May 9, 2001
Page 2

xc w/att: Mr. L. A. Reyes, Regional Administrator
U. S. Nuclear Regulatory Commission, Region II

Mr. D. E. LaBarge, Project Manager
Office of Nuclear Reactor Regulation

Mr. M. C. Shannon
Senior Resident Inspector
Oconee Nuclear Site

PRIORITY SuperRush

DISPOSITION OF THE ORIGINAL DOCUMENT WILL BE TO THE TRANSMITTAL SIGNATURE UNLESS RECIPIENT IS OTHERWISE IDENTIFIED BELOW

- 1) 00813 DOC MGMT EC03C ORIGINAL
- 2) 06358 ONS REGUL COMPLIANCE ON03RC
- 3) 06700 ONS MANUAL MASTER FILE ON03DM

Duke Power Company DOCUMENT TRANSMITTAL FORM

REFERENCE

OCONEE NUCLEAR STATION
RESP GROUP: NE
O2C19
COLR
M.5

Page 1 of 1

Date: 04/26/01

Document Transmittal #: DUK011160007

QA CONDITION Yes No.

OTHER ACKNOWLEDGEMENT REQUIRED Yes

IF QA OR OTHER ACKNOWLEDGEMENT REQUIRED, PLEASE ACKNOWLEDGE RECEIPT BY RETURNING THIS FORM TO:

Duke Power Company
7800 Rochester Highway
Document Management
ON02DM
Seneca, South Carolina 29672

Rec'd By _____

Date _____

DOCUMENT NO	QA COND	REV #/ DATE	DISTR CODE	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	TOTAL
ONEI-0400-051	1	016 04/26/01	NOMD-27	X	V1	V1													2

FOR INFORMATION ONLY

REMARKS: DUKE DOCUMENT RELEASE EXEMPT FROM (NUCLEAR) MODIFICATION PROGRAM

K S CANADY
MANAGER
NUCLEAR ENGINEERING

BY:
J.W.SIMMONS JWS/MEG EC08H

Duke Power Company

Oconee 2 Cycle 19

Core Operating Limits Report

FOR INFORMATION ONLY

QA Condition 1

REVIEWED AND APPROVED BY CFAM 3.13

~~Not Reviewed or Approved by CFAM 3.13~~

REVIEWED AND APPROVED BY CFAM 3.13

Prepared By : L. D. McClain / *L. D. McClain*

Date : 24 Apr 2001

Checked By : G. M. Presnell / *G. Michael Presnell*

Date : April 24, 2001

CDR By : J. L. Abbott / *J. L. Abbott*

Date : 24 APR 2001

Approved By : R. R. St. Clair / *R. R. St. Clair*

Date : 26 APR 2001

Oconee 2 Cycle 19
Core Operating Limits Report

Insertion Sheet for Revision 16

This revision is not valid until the end of operation for Oconee 2 Cycle 18.

Remove these revision 15 pages

1 - 31

Insert these revision 16 pages

1 - 31

Revision Log

Revision	Effective Date	Pages Revised	Pages Added	Pages Deleted	Total Effective Pages
Oconee 2 Cycle 19 revisions below					
16	May 2001	1 - 31	-	-	31
Oconee 2 Cycle 18 revisions below					
15	Apr 2001	1-4	-	-	31
14	Feb 2000	1-4	-	-	31
13	Nov 1999	1-31	-	-	31
12	Sep 1999	1-31	-	-	31
11	Apr 1999	1-4, 6	-	-	31
10	Mar 1999	1-31	-	-	31

Oconee 2 Cycle 19

1.0 Error Adjusted Core Operating Limits

The Core Operating Limits Report for O2C19 has been prepared in accordance with the requirements of TS 5.6.5. The core operating limits within this report have been developed using NRC approved methodology identified in references 1 through 10. The RPS protective limits and maximum allowable setpoints are documented in references 11 through 13. These limits are validated for use in O2C19 by references 14 through 16. The O2C19 analyses assume a design flow of 107.5% of 88,000 gpm per RCS pump, radial local peaking ($F_{\Delta h}$) of 1.714, an axial peaking factor (F_z) of 1.5, and an EOC (≤ 100 ppmB) Tavg reduction of up to 10 °F provided 4 RCPs are in operation and Tavg does not decrease below 569 °F.

The error adjusted core operating limits included in section 1 of this report incorporate all necessary uncertainties and margins required for operation of the O2C19 reload core.

1.1 References

1. Nuclear Design Methodology Using CASMO-3 / SIMULATE-3P, DPC-NE-1004A, Revision 0, SER dated November 23, 1992.
2. Oconee Nuclear Station Reload Design Methodology II, DPC-NE-1002A, Revision 1, SER dated October 1, 1985.
3. Oconee Nuclear Station Reload Design Methodology, NFS-1001A, Revision 4, SER dated July 29, 1981.
4. ONS Core Thermal Hydraulic Methodology Using VIPRE-01, DPC-NE-2003A, SER dated July 19, 1989.
5. Thermal Hydraulic Statistical Core Design Methodology, DPC-NE-2005P-A, Revision 2, SER dated June 8, 1999.
6. Fuel Mechanical Reload Analysis Methodology Using TACO3, DPC-NE-2008P-A, SER dated April 3, 1995.
7. UFSAR Chapter 15 Transient Analysis Methodology, DPC-NE-3005-PA, Revision 1, SER dated May 25, 1999.
8. DPC-NE-3000P-A, Thermal Hydraulic Transient Analysis Methodology, Rev. 2, SER dated October 14, 1998.
9. BAW-10192P-A, BWNT LOCA - BWNT Loss of Coolant Accident Evaluation Model for Once-Through Steam Generator Plants, SER dated February 18, 1997.
10. BAW-10227-PA, Evaluation of Advanced Cladding and Structural Material (M5) in PWR Reactor Fuel, SER dated February 4, 2000.
11. Variable Low Pressure Safety Limit, OSC-4048, Revision 3, July 1998.
12. Power Imbalance Safety Limits and Tech Spec Setpoints Using Error Adjusted Flux-Flow Ratio of 1.094, OSC-5604, Revision 1, November 1998.
13. ΔT_c and EOC Reduced Tavg Operation, OSC-7265, Rev. 0, Duke Power Co., April 2001.
14. O2C19 Maneuvering Analysis, OSC-7679, Revision 1, April 2001.
15. O2C19 Specific DNB Analysis, OSC-7684, Revision 0, December 2000.
16. O2C19 Reload Safety Evaluation & 10CFR50.59, OSC-7756, Revision 0, April 2001.

Oconee 2 Cycle 19

Miscellaneous Setpoints

BWST boron concentration shall be greater than 2220 ppm and less than 3000 ppm.
Referred to by TS 3.5.4.

Spent fuel pool boron concentration shall be greater than 2220 ppm and less than 3000 ppm.
Referred to by TS 3.7.12.

The equivalent of at least 1100 cubic feet of 11,000 ppm boron shall be maintained in the CBAST.
Referred to by TS SLC 16.5.13.

CFT boron concentration shall be greater than 1835 ppm. The average boron concentration in the CFTs shall be less than 4000 ppm. Referred to by TS 3.5.1.

RCS and Refueling canal boron concentration shall be greater than 2220 ppm.
Referred to by TS 3.9.1.

Shutdown Margin (SDM) shall be greater than 1% $\Delta k/k$.
Referred to by TS 3.1.1.

Moderator Temperature Coefficient (MTC) shall be less than :	MTC x 10 ⁻⁴	% FP
Linear interpolation is valid within table provided.	$\Delta\rho$ / °F	
Referred to by TS 3.1.3.	+0.70	0
	+0.40	15
	0.00	80
	-0.125	100
	-0.25	120

Departure from Nucleate Boiling (DNB) parameter for RCS loop pressure shall be
Referred to by TS 3.4.1.

4 RCP:	measured hot leg pressure \geq 2125 psig
3 RCP:	measured hot leg pressure \geq 2125 psig

DNB parameter for RCS loop average temperature shall be: Referred to by TS 3.4.1.	Max Loop Tav _g (Incl 2°F unc)	
	ΔT_c , °F	
	4 RCP Op	3 RCP Op
	0	581.0 * 581.0 *
	1	581.4 581.2
	2	581.8 581.4
	3	582.1 581.7
	4	582.5 581.9
	5	582.9 582.1

The measured Tav_g must be less than the temperature specified by an amount equal to the uncertainty corresponding to the instrument from which it is read.
 ΔT_c is the setpoint value selected by the operators.

* This limit is applied to the loop with the lowest loop average temperature consistent with the NOTE in SR 3.4.1.2. All other temperature limits apply to the maximum loop Tav_g.

DNB parameter for RCS loop total flow shall be: Referred to by TS 3.4.1.	4 RCP:	Measured \geq 107.5 %df
	3 RCP:	Measured \geq 74.7 % of 4 RCP min flow

Regulating rod groups shall be withdrawn in sequence starting with group 5, group 6, and finally group 7.
Referred to by TS 3.2.1.

Regulating rod group overlap shall be 25% \pm 5% between two sequential groups.
Referred to by TS 3.2.1.

Oconee 2 Cycle 19

Steady State Operating Band

EFPD	Rod Index		APSR %WD	
	Min	Max	Min	Max
0 to 452	292 ± 5	300	30	40
452 to EOC	292 ± 5	300	100	100


Quadrant Power Tilt Setpoints

Core Power Level, %FP	Steady State		Transient		Maximum 0 - 100
	30 - 100	0 - 30	30 - 100	0 - 30	
Full Incore	3.50	7.92	7.42	9.71	16.86
Out of Core	2.07	6.09	5.63	7.72	14.22
Backup Incore	2.16	3.87	3.63	4.81	10.07

Referred to by TS 3.2.3.

Oconee 2 Cycle 19 Variable Low RCS Pressure RPS Setpoints

Referred to by TS 3.3.1

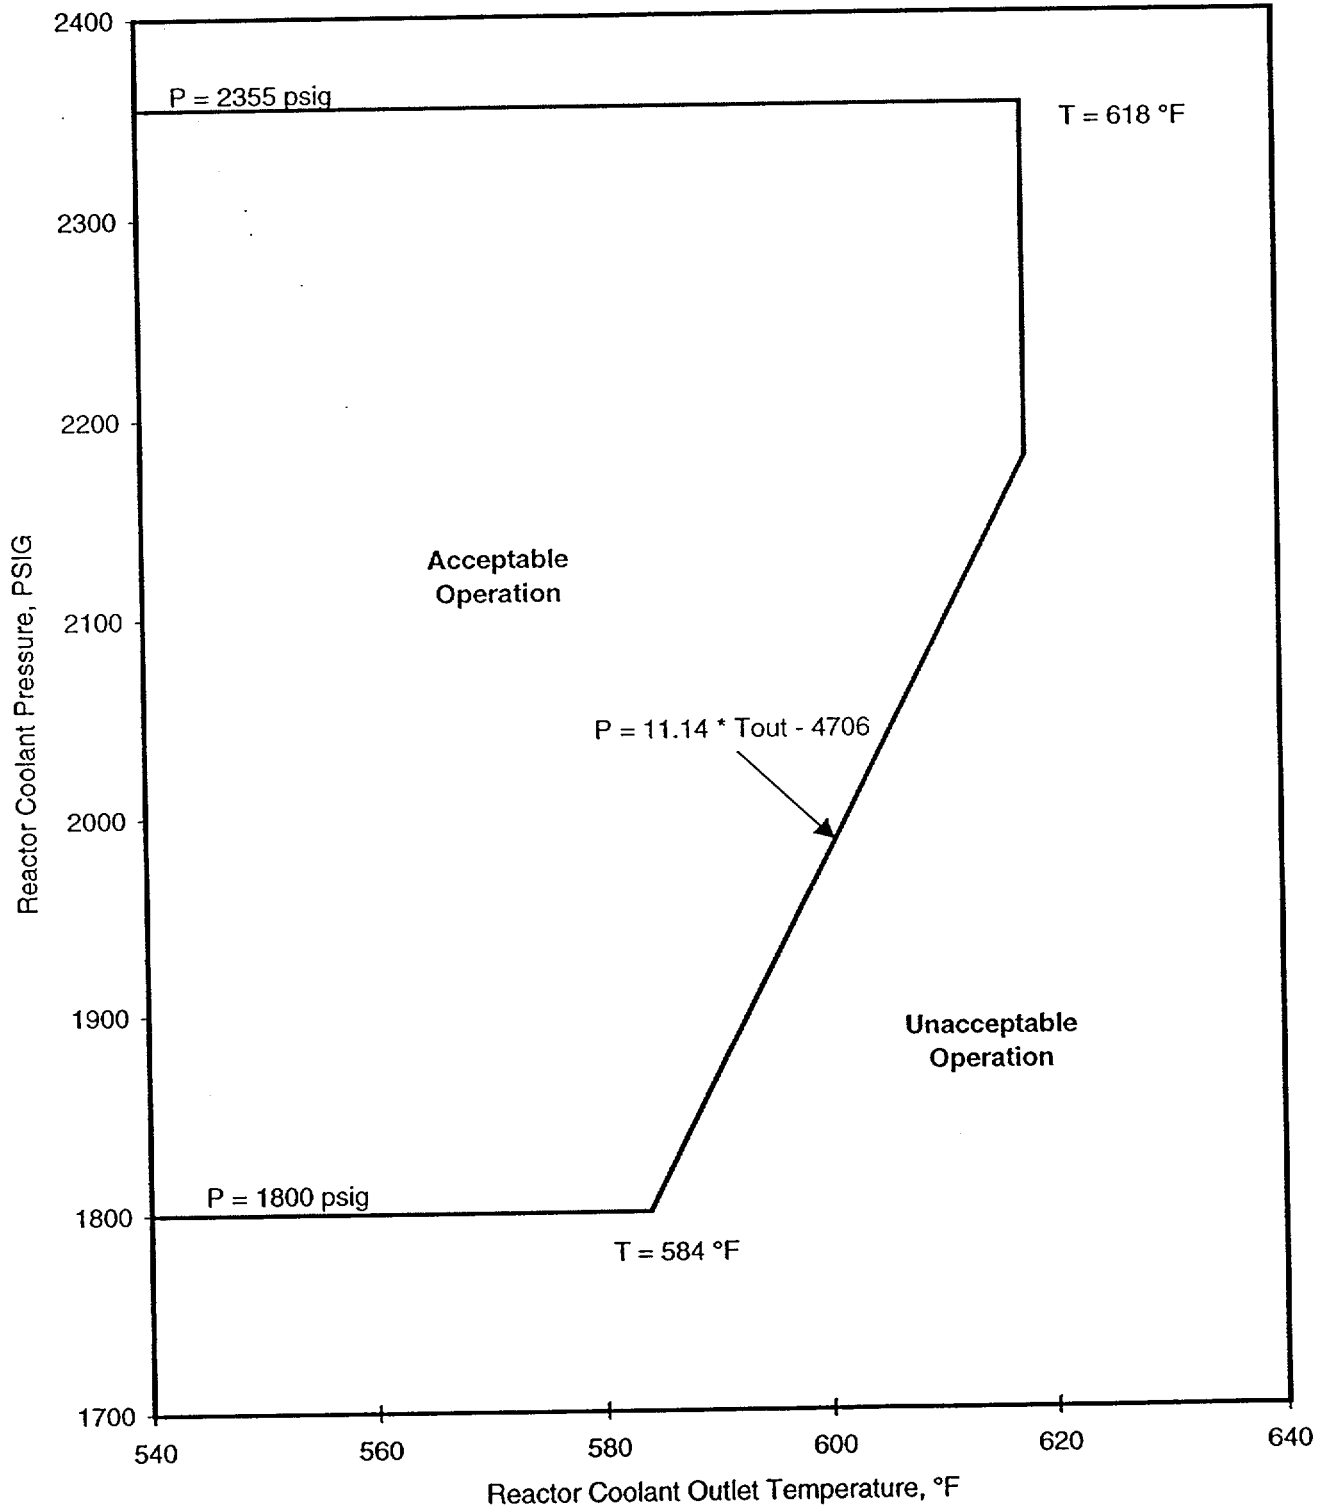

Oconee 2 Cycle 19

RPS Power Imbalance Setpoints

	% FP	% Imbalance
4 Pumps	0	-33.0
	90.4	-33.0
	107.9	-14.4
	107.9	14.4
	90.4	33.0
	0	33.0
	3 Pumps	0
63.1		-33.0
80.6		-14.4
80.6		14.4
63.1		33.0
0		33.0

Maximum Allowable RPS Power Imbalance Setpoints

	% FP	% Imbalance
4 Pumps	0	-35.0
	90	-35.0
	109.4	-14.4
	109.4	14.4
	90	35.0
	0	35.0
	3 Pumps	0
62.3		-35.0
81.7		-14.4
81.7		14.4
62.3		35.0
0		35.0

Oconee 2 Cycle 19

Operational Power Imbalance Setpoints

	%FP	Full Incore	Backup Incore	Out of Core
4 Pumps	0	-28.5	-28.0	-28.5
	80	-28.5	-28.0	-28.5
	90	-25.3	-25.0	-25.3
	100	-18.4	-18.2	-18.4
	102	-17.0	-16.8	-17.0
	102	15.7	15.4	15.7
	100	17.0	16.7	17.0
	90	23.4	23.0	23.4
	80	28.2	27.7	28.2
	0	28.2	27.7	28.2
3 Pumps	0.0	-28.5	-28.0	-28.5
	66.13	-28.5	-	-28.5
	66.61	-	-28.0	-
	77.0	-17.0	-16.8	-17.0
	77.0	15.7	15.4	15.7
	66.89	-	27.7	-
	66.42	28.2	-	28.2
	0.0	28.2	27.7	28.2

Oconee 2 Cycle 19
Operational Power Imbalance Setpoints
Operation with 4 RCS Pumps, BOC to EOC

% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	
107.9	-14.40	14.40				
107	-15.36	15.36				
106	-16.42	16.42				
105	-17.48	17.48				
104	-18.55	18.55				
103	-19.61	19.61				
102	-20.67	20.67	-17.00	15.70	-17.00	15.70
101	-21.73	21.73	-17.70	16.35	-17.70	16.35
100	-22.80	22.80	-18.40	17.00	-18.40	17.00
99	-23.86	23.86	-19.09	17.64	-19.09	17.64
98	-24.92	24.92	-19.78	18.28	-19.78	18.28
97	-25.99	25.99	-20.47	18.92	-20.47	18.92
96	-27.05	27.05	-21.16	19.56	-21.16	19.56
95	-28.11	28.11	-21.85	20.20	-21.85	20.20
94	-29.17	29.17	-22.54	20.84	-22.54	20.84
93	-30.24	30.24	-23.23	21.48	-23.23	21.48
92	-31.30	31.30	-23.92	22.12	-23.92	22.12
91	-32.36	32.36	-24.61	22.76	-24.61	22.76
90.4	-33.00	33.00	-25.02	23.14	-25.02	23.14
90	-33.00	33.00	-25.30	23.40	-25.30	23.40
89	-33.00	33.00	-25.62	23.88	-25.62	23.88
88	-33.00	33.00	-25.94	24.36	-25.94	24.36
87	-33.00	33.00	-26.26	24.84	-26.26	24.84
86	-33.00	33.00	-26.58	25.32	-26.58	25.32
85	-33.00	33.00	-26.90	25.80	-26.90	25.80
84	-33.00	33.00	-27.22	26.28	-27.22	26.28
83	-33.00	33.00	-27.54	26.76	-27.54	26.76
82	-33.00	33.00	-27.86	27.24	-27.86	27.24
81	-33.00	33.00	-28.18	27.72	-28.18	27.72
80	-33.00	33.00	-28.50	28.20	-28.50	28.20
0	-33.00	33.00	-28.50	28.20	-28.50	28.20
% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	


Oconee 2 Cycle 19
Operational Power Imbalance Setpoints
Operation with 3 RCS Pumps, BOC to EOC

% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	
80.6	-14.40	14.40				
80	-15.04	15.04				
79	-16.10	16.10				
78	-17.16	17.16				
77	-18.23	18.23	-17.00	15.70	-17.00	15.70
76	-19.29	19.29	-18.06	16.88	-18.06	16.88
75	-20.35	20.35	-19.12	18.06	-19.12	18.06
74	-21.41	21.41	-20.18	19.24	-20.18	19.24
73	-22.48	22.48	-21.23	20.42	-21.23	20.42
72	-23.54	23.54	-22.29	21.61	-22.29	21.61
71	-24.60	24.60	-23.35	22.79	-23.35	22.79
70	-25.67	25.67	-24.41	23.97	-24.41	23.97
69	-26.73	26.73	-25.47	25.15	-25.47	25.15
68	-27.79	27.79	-26.53	26.33	-26.53	26.33
67	-28.85	28.85	-27.58	27.51	-27.58	27.51
66.4	-29.47	29.47	-28.20	28.20	-28.20	28.20
66.1	-29.77	29.77	-28.50	28.20	-28.50	28.20
66	-29.92	29.92	-28.50	28.20	-28.50	28.20
65	-30.98	30.98	-28.50	28.20	-28.50	28.20
64	-32.04	32.04	-28.50	28.20	-28.50	28.20
63.1	-33.00	33.00	-28.50	28.20	-28.50	28.20
63	-33.00	33.00	-28.50	28.20	-28.50	28.20
62	-33.00	33.00	-28.50	28.20	-28.50	28.20
61	-33.00	33.00	-28.50	28.20	-28.50	28.20
60	-33.00	33.00	-28.50	28.20	-28.50	28.20
0	-33.00	33.00	-28.50	28.20	-28.50	28.20
% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	


Oconee 2 Cycle 19 RPS Power Imbalance Setpoints

Referred to by TS 3.3.1


Thermal Power Level, %FP

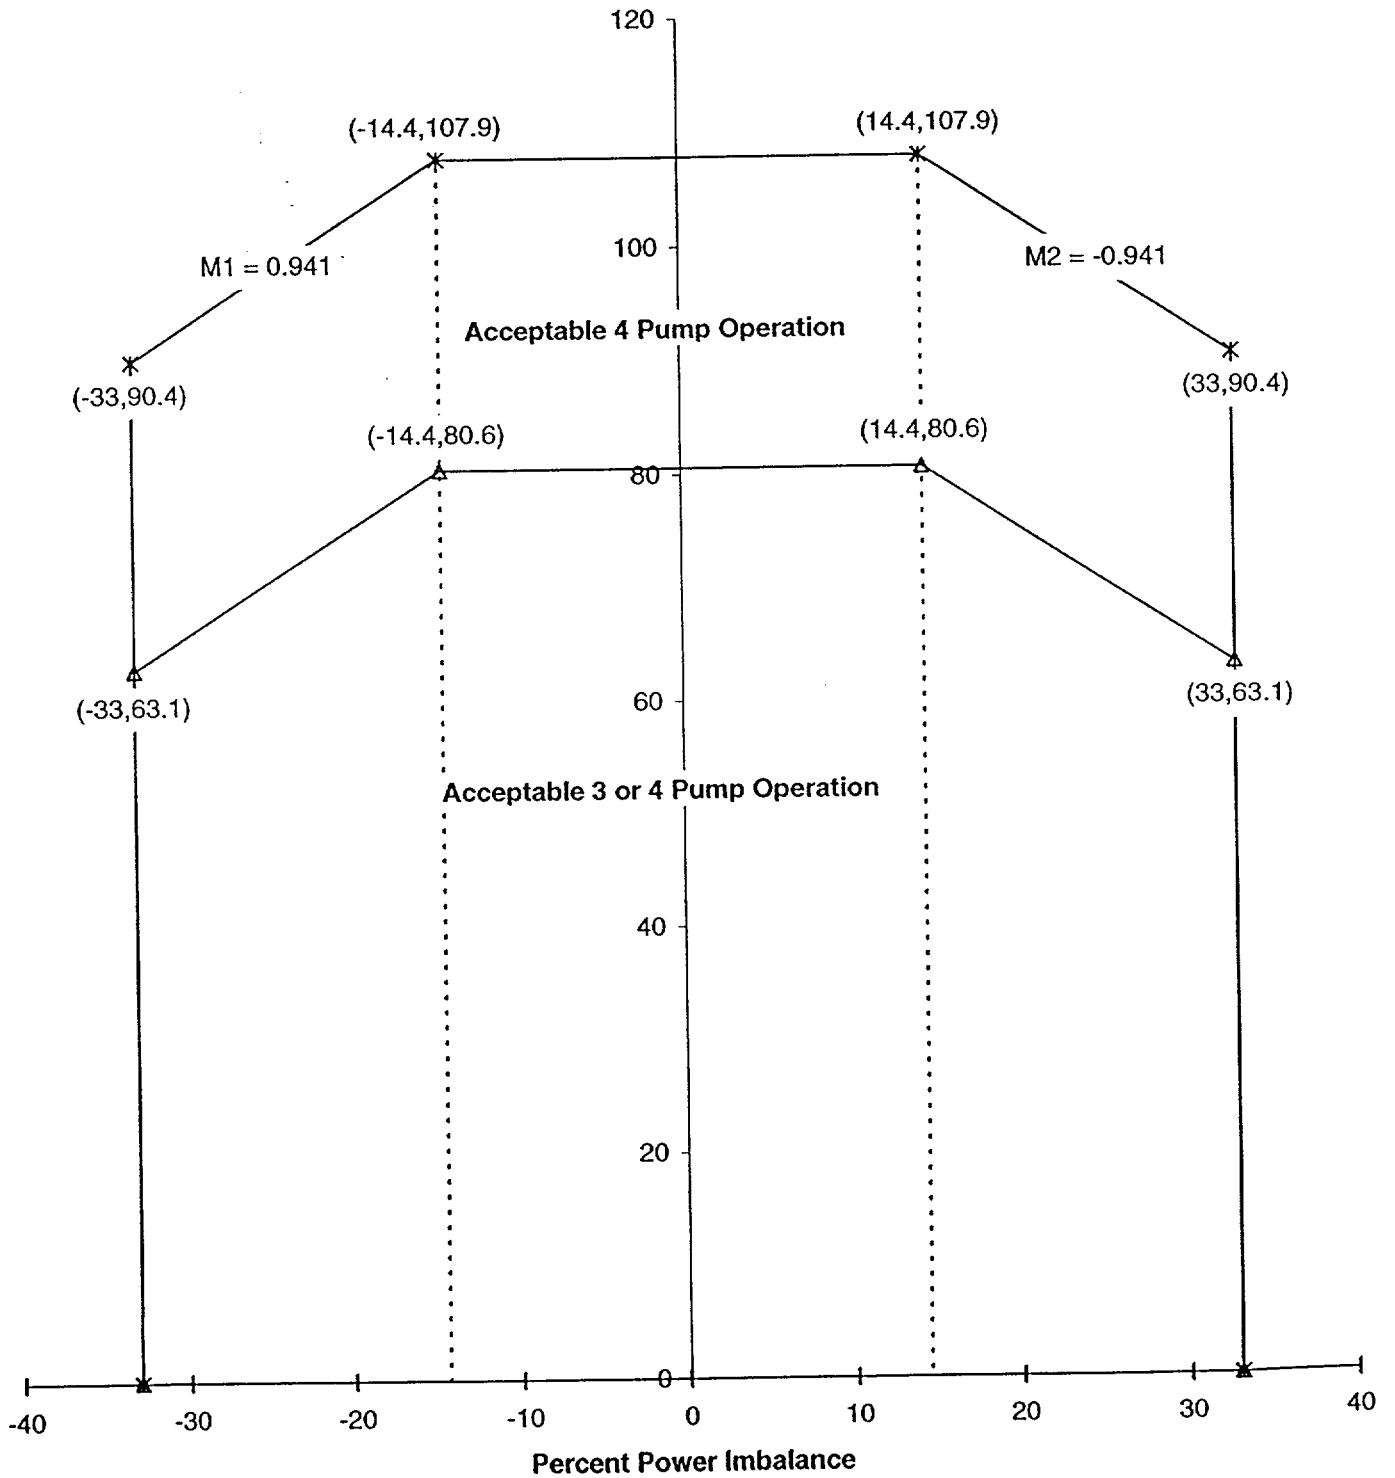

Oconee 2 Cycle 19 Imbalance Setpoints for 4 Pump Operation, BOC to EOC

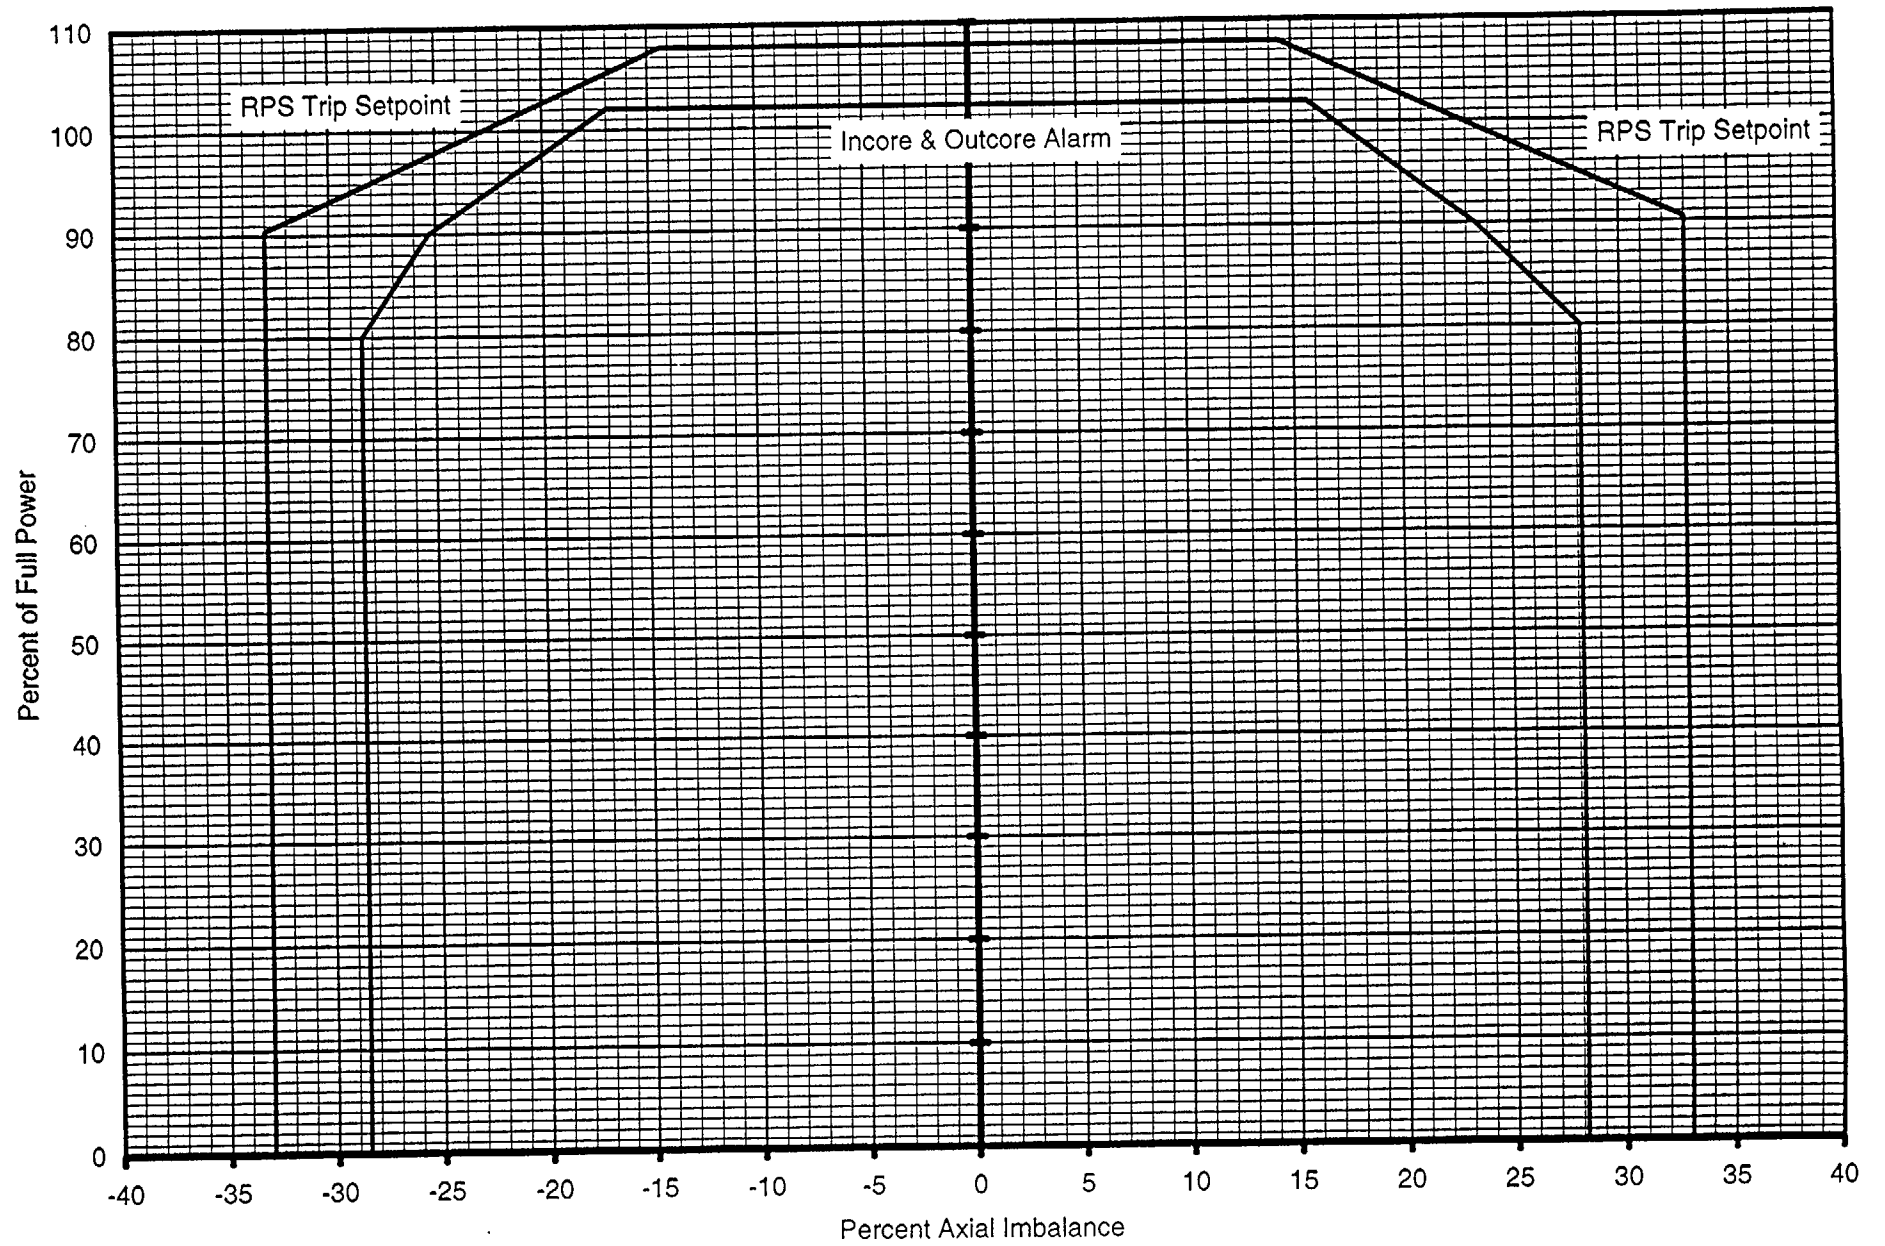

Oconee 2 Cycle 19 Imbalance Setpoints for 3 Pump Operation, BOC to EOC

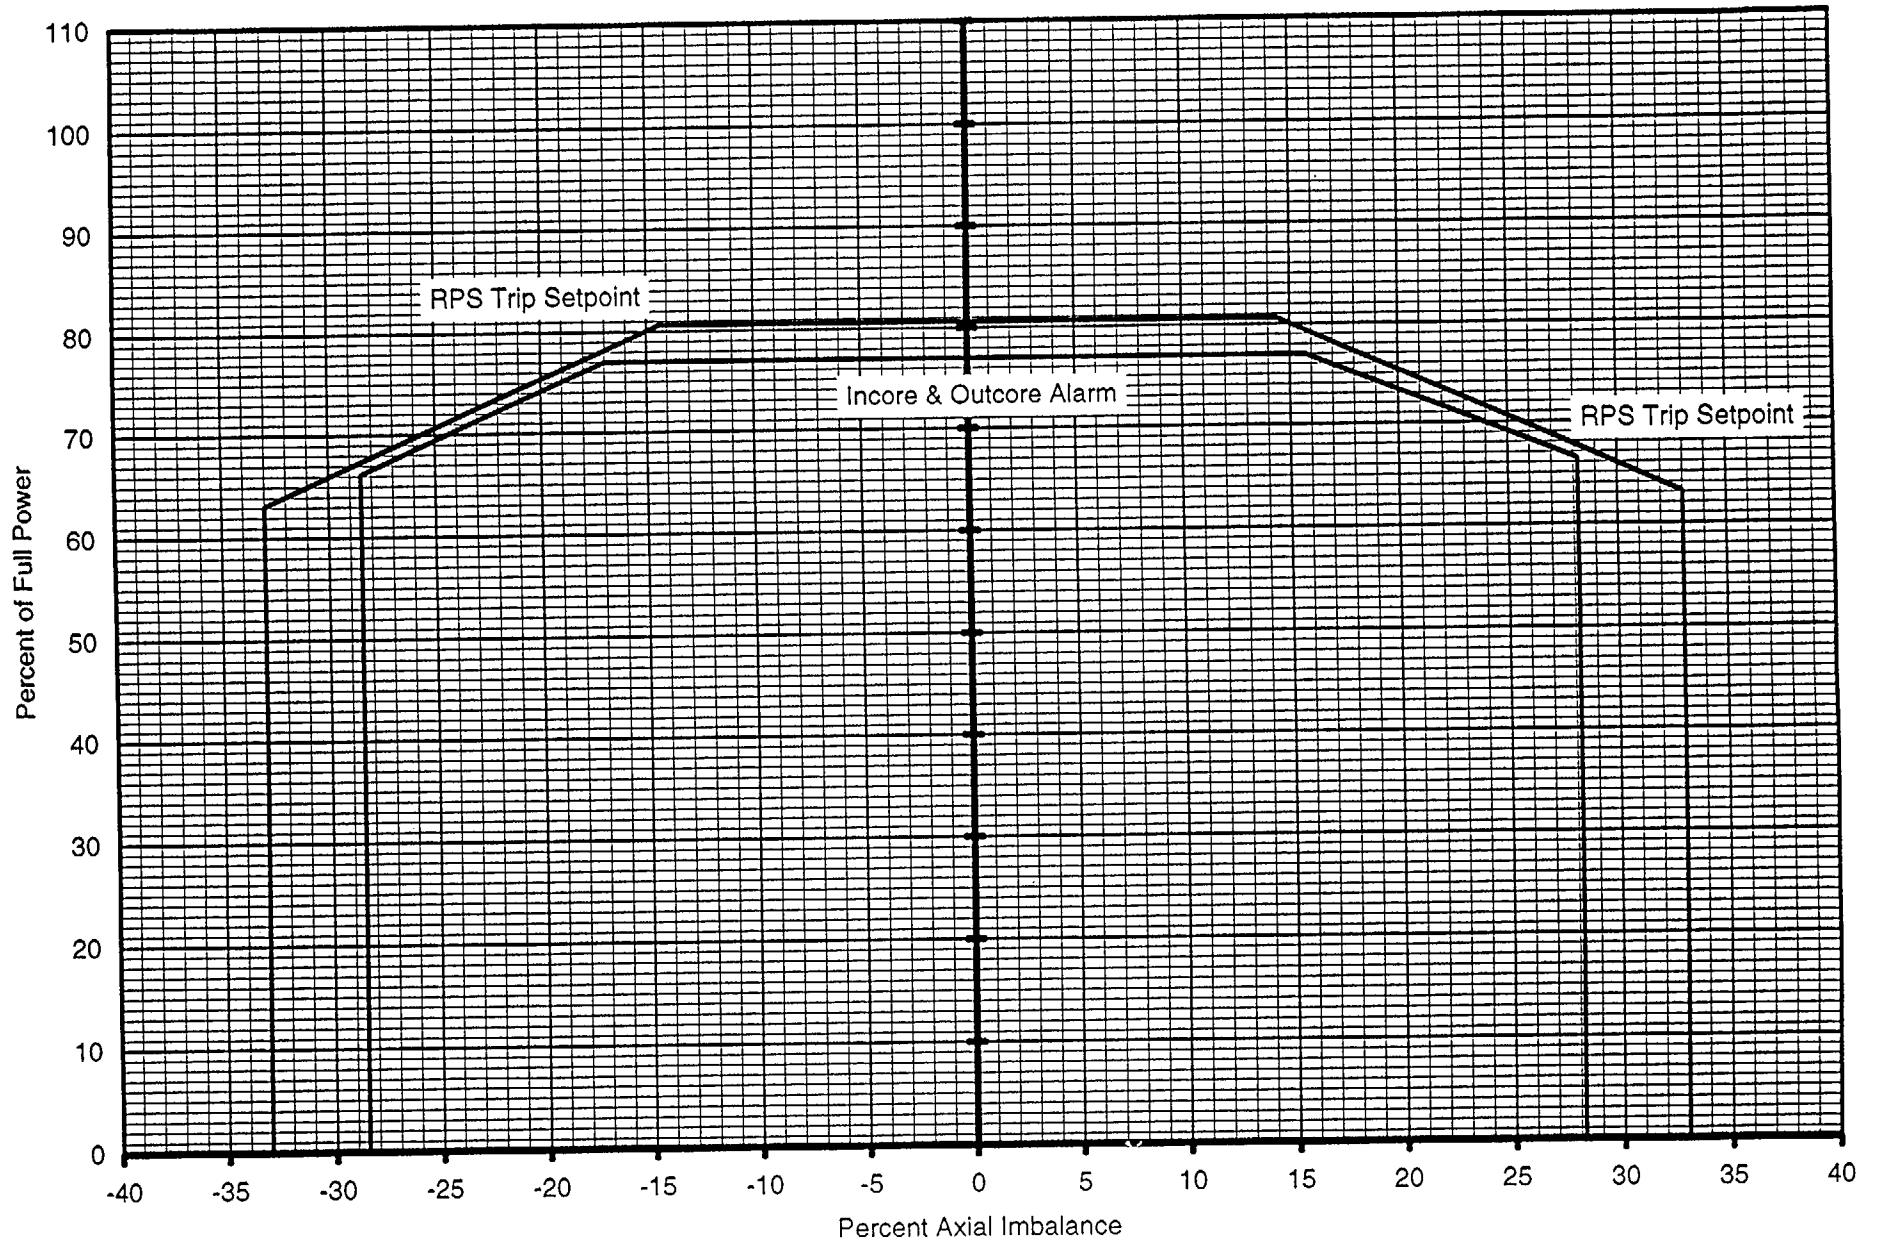

Oconee 2 Cycle 19

Operational Rod Index Setpoints

	%FP	RI Insertion Setpoint		RI Withdrawal Setpoint
		No Inop Rod	1 Inop Rod	
4 Pumps	102.0	263.5	283.4	300
	100.0	261.5	281.5	300
	90.0	251.5	271.9	300
	80.0	241.5	262.3	300
	50.0	201.5	233.4	300
	48.0	195.2	231.5	300
	15.0	91.5	165.5	300
	13.0	76.5	161.5	300
	5.0	16.5	93.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
0.0	0.0	51.0	300	
3 Pumps	77.0	237.5	285.2	300
	75.0	234.8	281.5	300
	50.0	201.5	235.2	300
	48.0	195.2	231.5	300
	15.0	91.5	165.5	300
	13.0	76.5	161.5	300
	5.0	16.5	93.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300

Oconee 2 Cycle 19

Shutdown Margin Rod Index Setpoints

	%FP	RI Insertion Setpoint		RI Withdrawal Setpoint
		No Inop Rod	1 Inop Rod	
4 Pumps	102.0	224.6	283.4	300
	100.0	221.5	281.5	300
	48.0	141.5	231.5	300
	13.0	76.5	161.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300
3 Pumps	77.0	227.4	285.2	300
	75.0	221.5	281.5	300
	48.0	141.5	231.5	300
	13.0	76.5	161.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300

4 Pump Operation, No Inoperable Rods, BOC to EOC

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
102	100	99.8	24.8	100	100	63.5
101	100	99.0	24.0	100	100	62.5
100	100	98.2	23.2	100	100	61.5
99	100	97.5	22.5	100	100	60.5
98	100	96.7	21.7	100	100	59.5
97	100	95.9	20.9	100	100	58.5
96	100	95.2	20.2	100	100	57.5
95	100	94.4	19.4	100	100	56.5
94	100	93.6	18.6	100	100	55.5
93	100	92.9	17.9	100	100	54.5
92	100	92.1	17.1	100	100	53.5
91	100	91.3	16.3	100	100	52.5
90	100	90.6	15.6	100	100	51.5
89	100	89.8	14.8	100	100	50.5
88	100	89.0	14.0	100	100	49.5
87	100	88.2	13.2	100	100	48.5
86	100	87.5	12.5	100	100	47.5
85	100	86.7	11.7	100	100	46.5
84	100	85.9	10.9	100	100	45.5
83	100	85.2	10.2	100	100	44.5
82	100	84.4	9.4	100	100	43.5
81	100	83.6	8.6	100	100	42.5
80	100	82.9	7.9	100	100	41.5
79	100	82.1	7.1	100	100	40.2
78	100	81.3	6.3	100	100	38.8
77	100	80.6	5.6	100	100	37.5
76	100	79.8	4.8	100	100	36.2
75	100	79.0	4.0	100	100	34.8
74	100	78.2	3.2	100	100	33.5
73	100	77.5	2.5	100	100	32.2
72	100	76.7	1.7	100	100	30.8
71	100	75.9	0.9	100	100	29.5
70	100	75.2	0.2	100	100	28.2
69.8	100	75.0	0	100	100	27.9
69	100	73.8	0	100	100	26.8
68	100	72.3	0	100	100	25.5
67.6	100	71.7	0	100	100	25.0
67	100	70.7	0	100	99.6	24.6
66	100	69.2	0	100	98.9	23.9
65	100	67.7	0	100	98.2	23.2
64	100	66.1	0	100	97.6	22.6
63	100	64.6	0	100	96.9	21.9
62	100	63.0	0	100	96.2	21.2
61	100	61.5	0	100	95.6	20.6
60	100	60.0	0	100	94.9	19.9
59	100	58.4	0	100	94.2	19.2
58	100	56.9	0	100	93.6	18.6
57	100	55.3	0	100	92.9	17.9
56	100	53.8	0	100	92.2	17.2
55	100	52.3	0	100	91.6	16.6
54	100	50.7	0	100	90.9	15.9
53	100	49.2	0	100	90.2	15.2
52	100	47.7	0	100	89.6	14.6
51	100	46.1	0	100	88.9	13.9
50	100	44.6	0	100	88.2	13.2
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
49	100	43.0	0	100	86.7	11.7
48	100	41.5	0	100	85.1	10.1
47	100	39.6	0	100	83.5	8.5
46	100	37.8	0	100	82.0	7.0
45	100	35.9	0	100	80.4	5.4
44	100	34.1	0	100	78.8	3.8
43	100	32.2	0	100	77.2	2.2
42	100	30.4	0	100	75.7	0.7
41.6	100	29.6	0	100	75.0	0
41	100	28.5	0	100	73.2	0
40	100	26.6	0	100	70.1	0
39.1	100	25.0	0	100	67.3	0
39	99.9	24.9	0	100	66.9	0
38	99.0	24.0	0	100	63.8	0
37	98.0	23.0	0	100	60.6	0
36	97.1	22.1	0	100	57.5	0
35	96.2	21.2	0	100	54.3	0
34	95.2	20.2	0	100	51.2	0
33	94.3	19.3	0	100	48.1	0
32	93.4	18.4	0	100	44.9	0
31	92.5	17.5	0	100	41.8	0
30	91.5	16.5	0	100	38.6	0
29	90.6	15.6	0	100	35.5	0
28	89.7	14.7	0	100	32.4	0
27	88.8	13.8	0	100	29.2	0
26	87.8	12.8	0	100	26.1	0
25.7	87.5	12.5	0	100	25.0	0
25	86.9	11.9	0	99.0	24.0	0
24	86.0	11.0	0	97.4	22.4	0
23	85.0	10.0	0	95.8	20.8	0
22	84.1	9.1	0	94.2	19.2	0
21	83.2	8.2	0	92.7	17.7	0
20	82.2	7.2	0	91.1	16.1	0
19	81.3	6.3	0	89.5	14.5	0
18	80.4	5.4	0	88.0	13.0	0
17	79.5	4.5	0	86.4	11.4	0
16	78.5	3.5	0	84.8	9.8	0
15	77.6	2.6	0	83.2	8.2	0
14	76.7	1.7	0	79.5	4.5	0
13	75.8	0.8	0	75.8	0.8	0
12.8	75.0	0	0	75.0	0	0
12	69.0	0	0	69.0	0	0
11	61.5	0	0	61.5	0	0
10	54.0	0	0	54.0	0	0
9	46.5	0	0	46.5	0	0
8	39.0	0	0	39.0	0	0
7	31.5	0	0	31.5	0	0
6	24.0	0	0	24.0	0	0
5	16.5	0	0	16.5	0	0
4	9.0	0	0	9.0	0	0
3	1.5	0	0	1.5	0	0
2.8	0	0	0	0	0	0
2	0	0	0	0	0	0
1	0	0	0	0	0	0
0	0	0	0	0	0	0
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

RI = 300 is withdrawal limit at all power levels.

Oconee 2 Cycle 19
 Rod Index Setpoints
 3 Pump Operation, No Inoperable Rods, BOC to EOC

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
77	100	100	27.4	100	100	37.5
76.2	100	100	25.0	100	100	36.4
76	100	99.7	24.7	100	100	36.1
75	100	98.2	23.2	100	100	34.8
74	100	96.8	21.8	100	100	33.5
73	100	95.3	20.3	100	100	32.1
72	100	93.8	18.8	100	100	30.8
71	100	92.3	17.3	100	100	29.5
70	100	90.8	15.8	100	100	28.1
69	100	89.4	14.4	100	100	26.8
68	100	87.9	12.9	100	100	25.5
67.6	100	87.4	12.4	100	100	25.0
67	100	86.4	11.4	100	99.6	24.6
66	100	84.9	9.9	100	98.9	23.9
65	100	83.4	8.4	100	98.2	23.2
64	100	82.0	7.0	100	97.6	22.6
63	100	80.5	5.5	100	96.9	21.9
62	100	79.0	4.0	100	96.2	21.2
61	100	77.5	2.5	100	95.6	20.6
60	100	76.0	1.0	100	94.9	19.9
59.3	100	75.0	0	100	94.4	19.4
59	100	74.1	0	100	94.2	19.2
58	100	71.1	0	100	93.6	18.6
57	100	68.2	0	100	92.9	17.9
56	100	65.2	0	100	92.2	17.2
55	100	62.2	0	100	91.6	16.6
54	100	59.3	0	100	90.9	15.9
53	100	56.3	0	100	90.2	15.2
52	100	53.4	0	100	89.6	14.6
51	100	50.4	0	100	88.9	13.9
50	100	47.4	0	100	88.2	13.2
49	100	44.5	0	100	86.7	11.7
48	100	41.5	0	100	85.1	10.1
47	100	39.6	0	100	83.5	8.5
46	100	37.8	0	100	82.0	7.0
45	100	35.9	0	100	80.4	5.4
44	100	34.1	0	100	78.8	3.8
43	100	32.2	0	100	77.2	2.2
42	100	30.4	0	100	75.7	0.7
41.6	100	29.6	0	100	75.0	0
41	100	28.5	0	100	73.2	0
40	100	26.6	0	100	70.1	0
39.1	100	25.0	0	100	67.3	0
39	99.9	24.9	0	100	66.9	0
38	99	24.0	0	100	63.8	0
37	98	23.0	0	100	60.6	0
36	97.1	22.1	0	100	57.5	0
35	96.2	21.2	0	100	54.3	0
34	95.2	20.2	0	100	51.2	0
33	94.3	19.3	0	100	48.1	0
32	93.4	18.4	0	100	44.9	0
31	92.5	17.5	0	100	41.8	0
30	91.5	16.5	0	100	38.6	0
29	90.6	15.6	0	100	35.5	0
28	89.7	14.7	0	100	32.4	0
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

Oconee 2 Cycle 19
 Rod Index Setpoints
 4 Pump Operation, 1 Inoperable Rod, BOC to EOC

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
102	100	100	83.4	100	100	83.4
101	100	100	82.5	100	100	82.5
100	100	100	81.5	100	100	81.5
99	100	100	80.5	100	100	80.5
98	100	100	79.6	100	100	79.6
97	100	100	78.6	100	100	78.6
96	100	100	77.7	100	100	77.7
95	100	100	76.7	100	100	76.7
94	100	100	75.7	100	100	75.7
93	100	100	74.8	100	100	74.8
92	100	100	73.8	100	100	73.8
91	100	100	72.9	100	100	72.9
90	100	100	71.9	100	100	71.9
89	100	100	70.9	100	100	70.9
88	100	100	70.0	100	100	70.0
87	100	100	69.0	100	100	69.0
86	100	100	68.1	100	100	68.1
85	100	100	67.1	100	100	67.1
84	100	100	66.1	100	100	66.1
83	100	100	65.2	100	100	65.2
82	100	100	64.2	100	100	64.2
81	100	100	63.3	100	100	63.3
80	100	100	62.3	100	100	62.3
79	100	100	61.3	100	100	61.3
78	100	100	60.4	100	100	60.4
77	100	100	59.4	100	100	59.4
76	100	100	58.4	100	100	58.4
75	100	100	57.5	100	100	57.5
74	100	100	56.5	100	100	56.5
73	100	100	55.6	100	100	55.6
72	100	100	54.6	100	100	54.6
71	100	100	53.6	100	100	53.6
70	100	100	52.7	100	100	52.7
69	100	100	51.7	100	100	51.7
68	100	100	50.7	100	100	50.7
67	100	100	49.8	100	100	49.8
66	100	100	48.8	100	100	48.8
65	100	100	47.8	100	100	47.8
64	100	100	46.9	100	100	46.9
63	100	100	45.9	100	100	45.9
62	100	100	45.0	100	100	45.0
61	100	100	44.0	100	100	44.0
60	100	100	43.0	100	100	43.0
59	100	100	42.1	100	100	42.1
58	100	100	41.1	100	100	41.1
57	100	100	40.2	100	100	40.2
56	100	100	39.2	100	100	39.2
55	100	100	38.2	100	100	38.2
54	100	100	37.3	100	100	37.3
53	100	100	36.3	100	100	36.3
52	100	100	35.3	100	100	35.3
51	100	100	34.4	100	100	34.4
50	100	100	33.4	100	100	33.4
49	100	100	32.5	100	100	32.5
48	100	100	31.5	100	100	31.5
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		


4 Pump Operation, 1 Inoperable Rod, BOC to EOC

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
47	100	100	29.5	100	100	29.5
46	100	100	27.5	100	100	27.5
45	100	100	25.5	100	100	25.5
44.8	100	100	25.0	100	100	25.0
44	100	99.2	24.2	100	99.2	24.2
43	100	98.2	23.2	100	98.2	23.2
42	100	97.2	22.2	100	97.2	22.2
41	100	96.2	21.2	100	96.2	21.2
40	100	95.2	20.2	100	95.2	20.2
39	100	94.2	19.2	100	94.2	19.2
38	100	93.2	18.2	100	93.2	18.2
37	100	92.2	17.2	100	92.2	17.2
36	100	91.2	16.2	100	91.2	16.2
35	100	90.2	15.2	100	90.2	15.2
34	100	89.2	14.2	100	89.2	14.2
33	100	88.2	13.2	100	88.2	13.2
32	100	87.2	12.2	100	87.2	12.2
31	100	86.2	11.2	100	86.2	11.2
30	100	85.2	10.2	100	85.2	10.2
29	100	84.2	9.2	100	84.2	9.2
28	100	83.2	8.2	100	83.2	8.2
27	100	82.2	7.2	100	82.2	7.2
26	100	81.2	6.2	100	81.2	6.2
25	100	80.2	5.2	100	80.2	5.2
24	100	79.2	4.2	100	79.2	4.2
23	100	78.2	3.2	100	78.2	3.2
22	100	77.2	2.2	100	77.2	2.2
21	100	76.2	1.2	100	76.2	1.2
20	100	75.2	0.2	100	75.2	0.2
19.8	100	75.0	0	100	75.0	0
19	100	73.5	0	100	73.5	0
18	100	71.5	0	100	71.5	0
17	100	69.5	0	100	69.5	0
16	100	67.5	0	100	67.5	0
15	100	65.5	0	100	65.5	0
14	100	63.5	0	100	63.5	0
13	100	61.5	0	100	61.5	0
12	100	53.0	0	100	53.0	0
11	100	44.5	0	100	44.5	0
10	100	36.0	0	100	36.0	0
9	100	27.5	0	100	27.5	0
8.7	100	25.0	0	100	25.0	0
8	97.0	22.0	0	97.0	22.0	0
7	92.8	17.8	0	92.8	17.8	0
6	88.5	13.5	0	88.5	13.5	0
5	84.2	9.2	0	84.2	9.2	0
4	80.0	5.0	0	80.0	5.0	0
3	75.8	0.8	0	75.8	0.8	0
2.8	74.8	0	0	74.8	0	0
2	68.0	0	0	68.0	0	0
1	59.5	0	0	59.5	0	0
0	51.0	0	0	51.0	0	0
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		


RI = 300 is withdrawal limit at all power levels.


Oconee 2 Cycle 19
 Rod Index Setpoints
 3 Pump Operation, 1 Inoperable Rod, BOC to EOC


% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
77	100	100	85.2	100	100	85.2
76	100	100	83.4	100	100	83.4
75	100	100	81.5	100	100	81.5
74	100	100	79.6	100	100	79.6
73	100	100	77.8	100	100	77.8
72	100	100	75.9	100	100	75.9
71	100	100	74.1	100	100	74.1
70	100	100	72.2	100	100	72.2
69	100	100	70.4	100	100	70.4
68	100	100	68.5	100	100	68.5
67	100	100	66.7	100	100	66.7
66	100	100	64.8	100	100	64.8
65	100	100	63.0	100	100	63.0
64	100	100	61.1	100	100	61.1
63	100	100	59.3	100	100	59.3
62	100	100	57.4	100	100	57.4
61	100	100	55.6	100	100	55.6
60	100	100	53.7	100	100	53.7
59	100	100	51.9	100	100	51.9
58	100	100	50.0	100	100	50.0
57	100	100	48.2	100	100	48.2
56	100	100	46.3	100	100	46.3
55	100	100	44.5	100	100	44.5
54	100	100	42.6	100	100	42.6
53	100	100	40.8	100	100	40.8
52	100	100	38.9	100	100	38.9
51	100	100	37.1	100	100	37.1
50	100	100	35.2	100	100	35.2
49	100	100	33.4	100	100	33.4
48	100	100	31.5	100	100	31.5
47	100	100	29.5	100	100	29.5
46	100	100	27.5	100	100	27.5
45	100	100	25.5	100	100	25.5
44.8	100	100	25.0	100	100	25.0
44	100	99.2	24.2	100	99.2	24.2
43	100	98.2	23.2	100	98.2	23.2
42	100	97.2	22.2	100	97.2	22.2
41	100	96.2	21.2	100	96.2	21.2
40	100	95.2	20.2	100	95.2	20.2
39	100	94.2	19.2	100	94.2	19.2
38	100	93.2	18.2	100	93.2	18.2
37	100	92.2	17.2	100	92.2	17.2
36	100	91.2	16.2	100	91.2	16.2
35	100	90.2	15.2	100	90.2	15.2
34	100	89.2	14.2	100	89.2	14.2
33	100	88.2	13.2	100	88.2	13.2
32	100	87.2	12.2	100	87.2	12.2
31	100	86.2	11.2	100	86.2	11.2
30	100	85.2	10.2	100	85.2	10.2
29	100	84.2	9.2	100	84.2	9.2
28	100	83.2	8.2	100	83.2	8.2
27	100	82.2	7.2	100	82.2	7.2
26	100	81.2	6.2	100	81.2	6.2
25	100	80.2	5.2	100	80.2	5.2
24	100	79.2	4.2	100	79.2	4.2
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

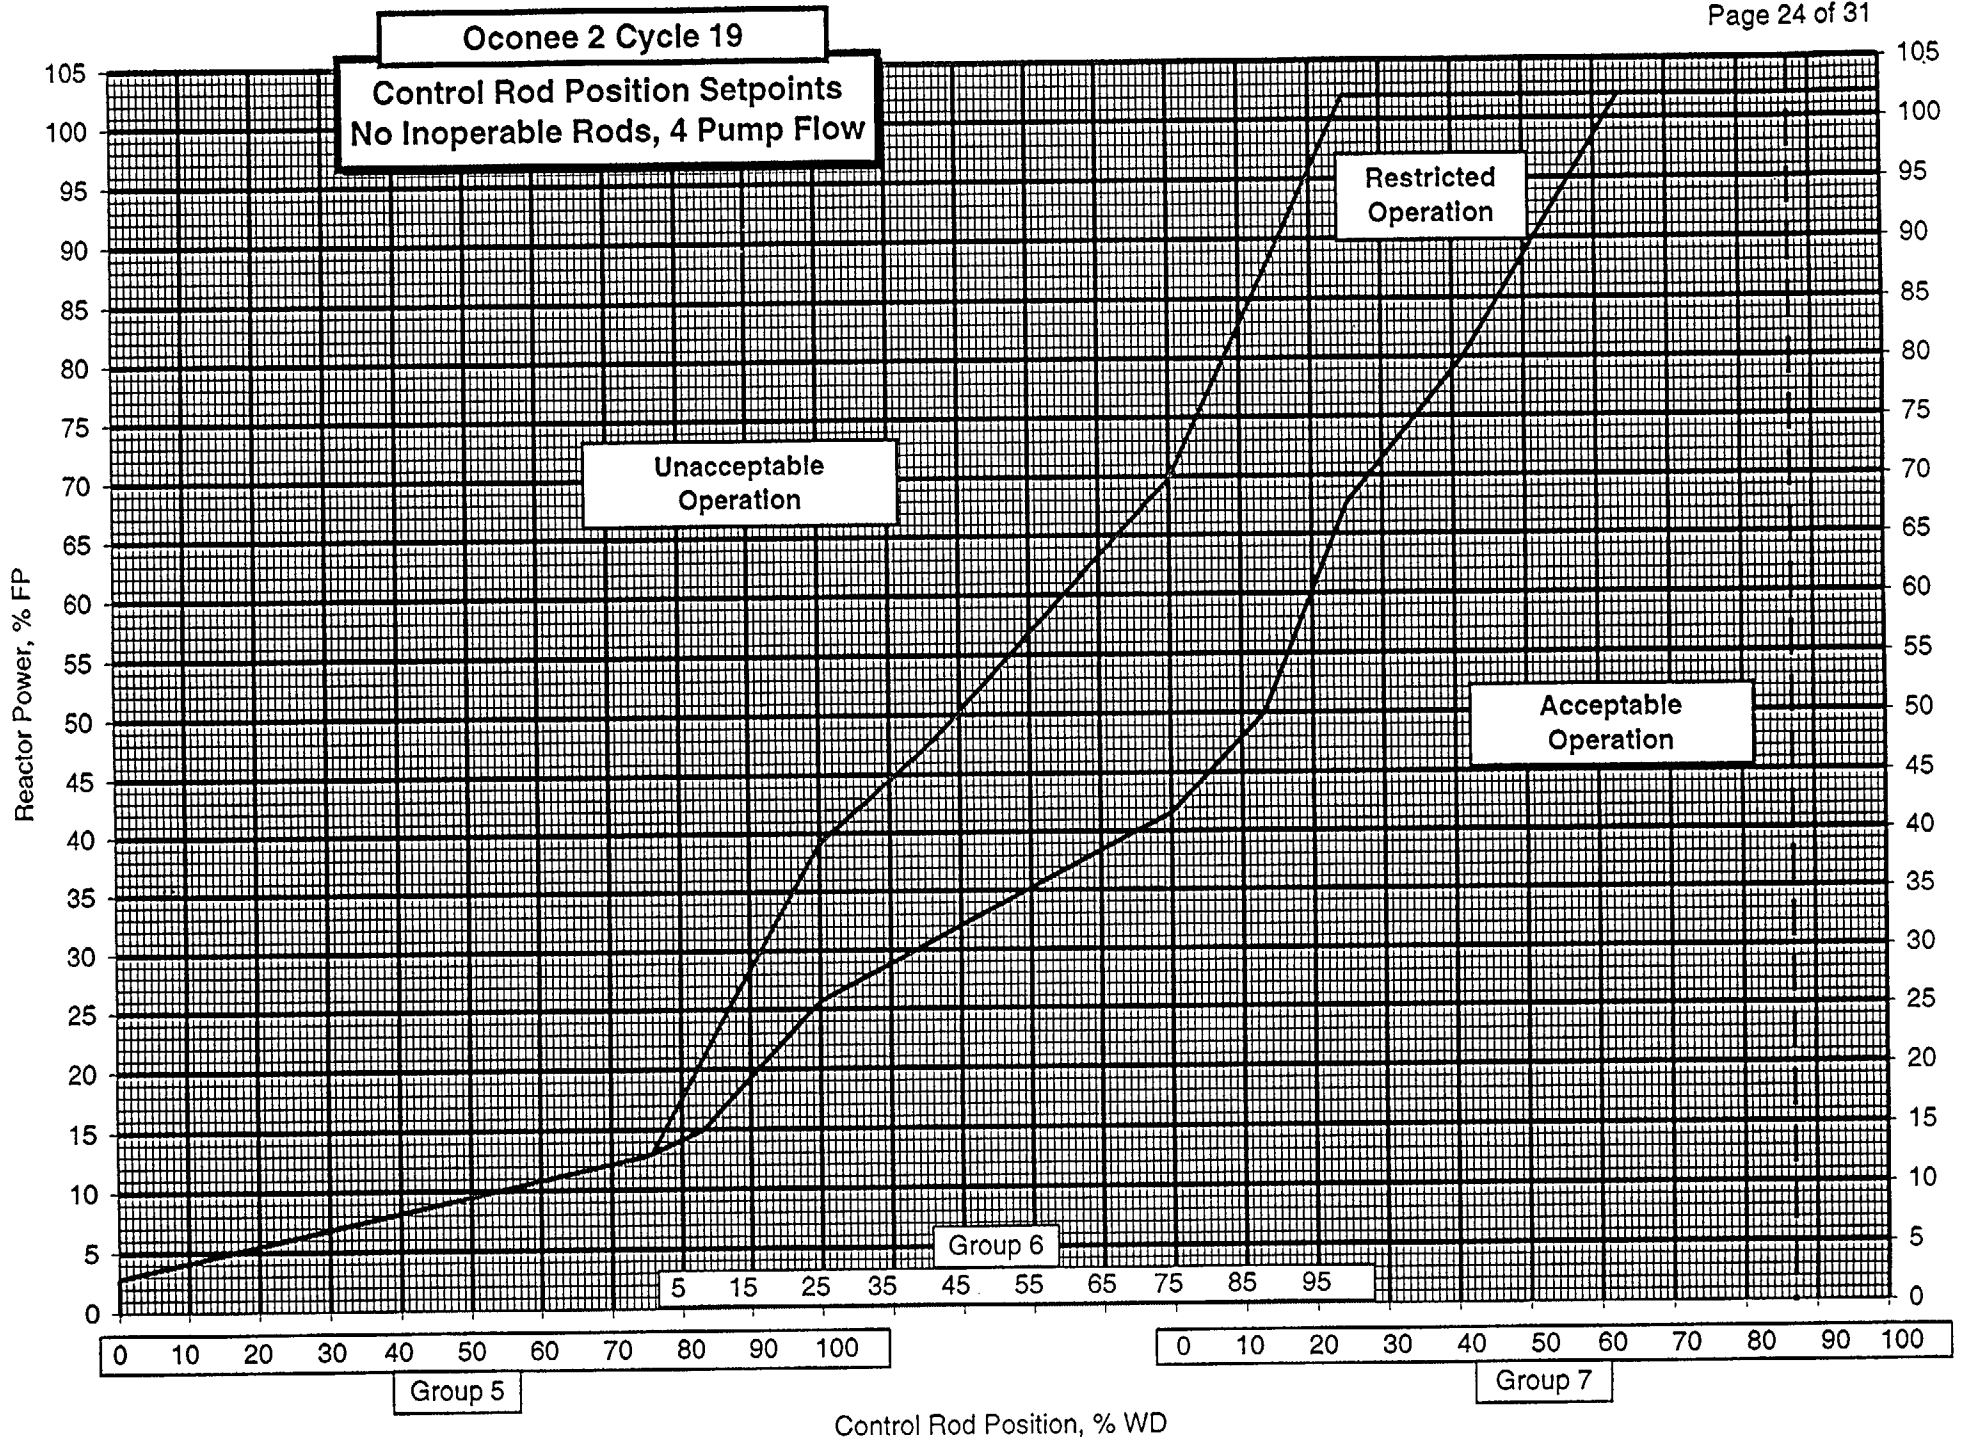

Control Rod Position, % WD

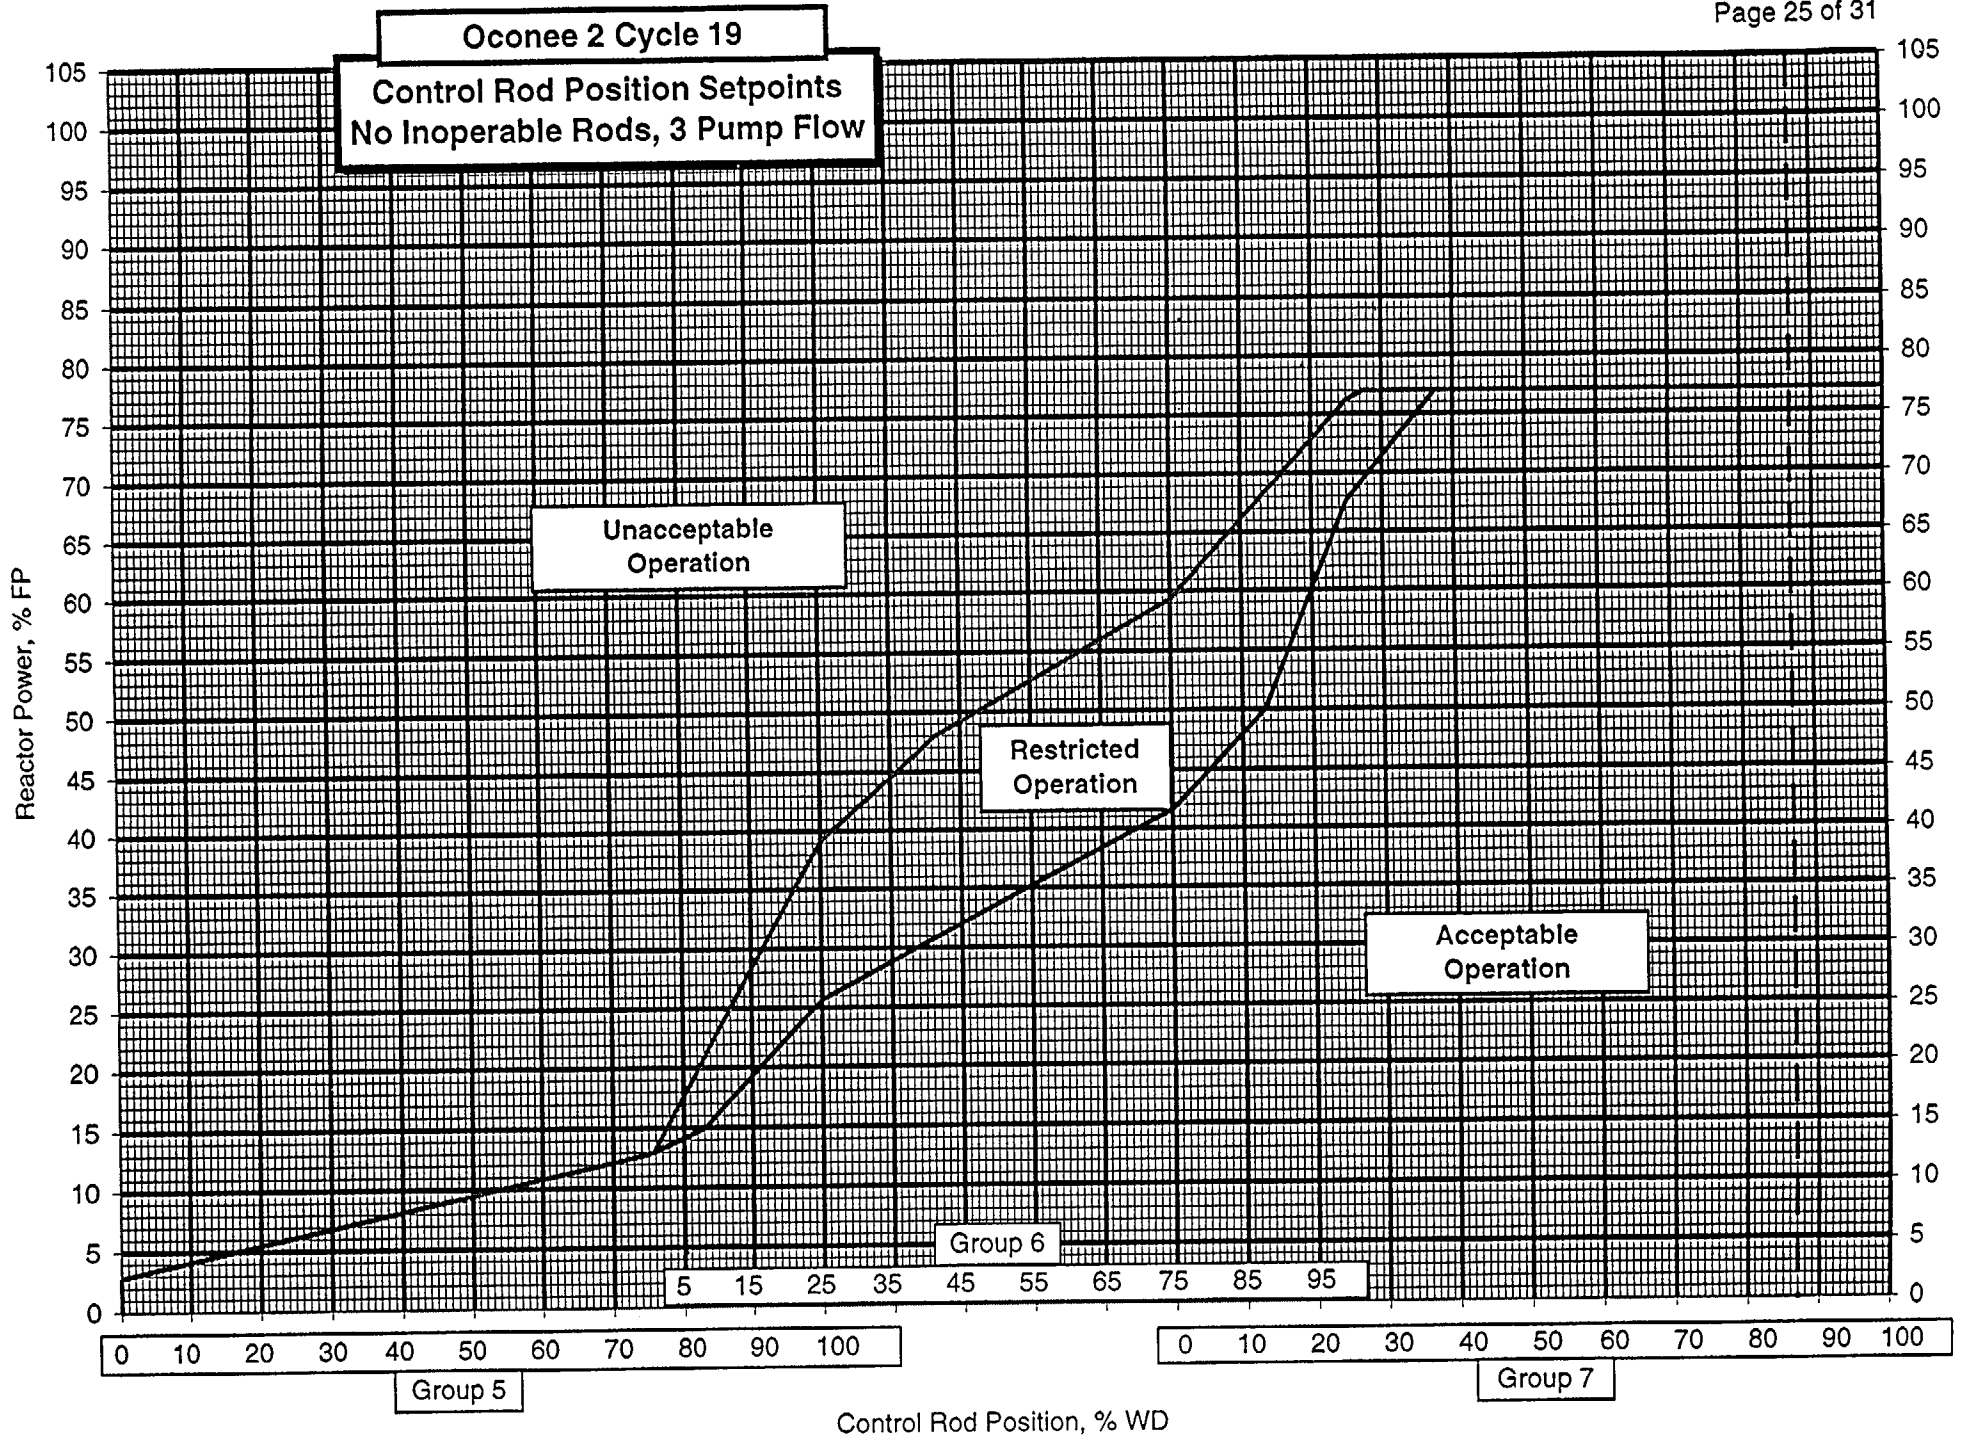

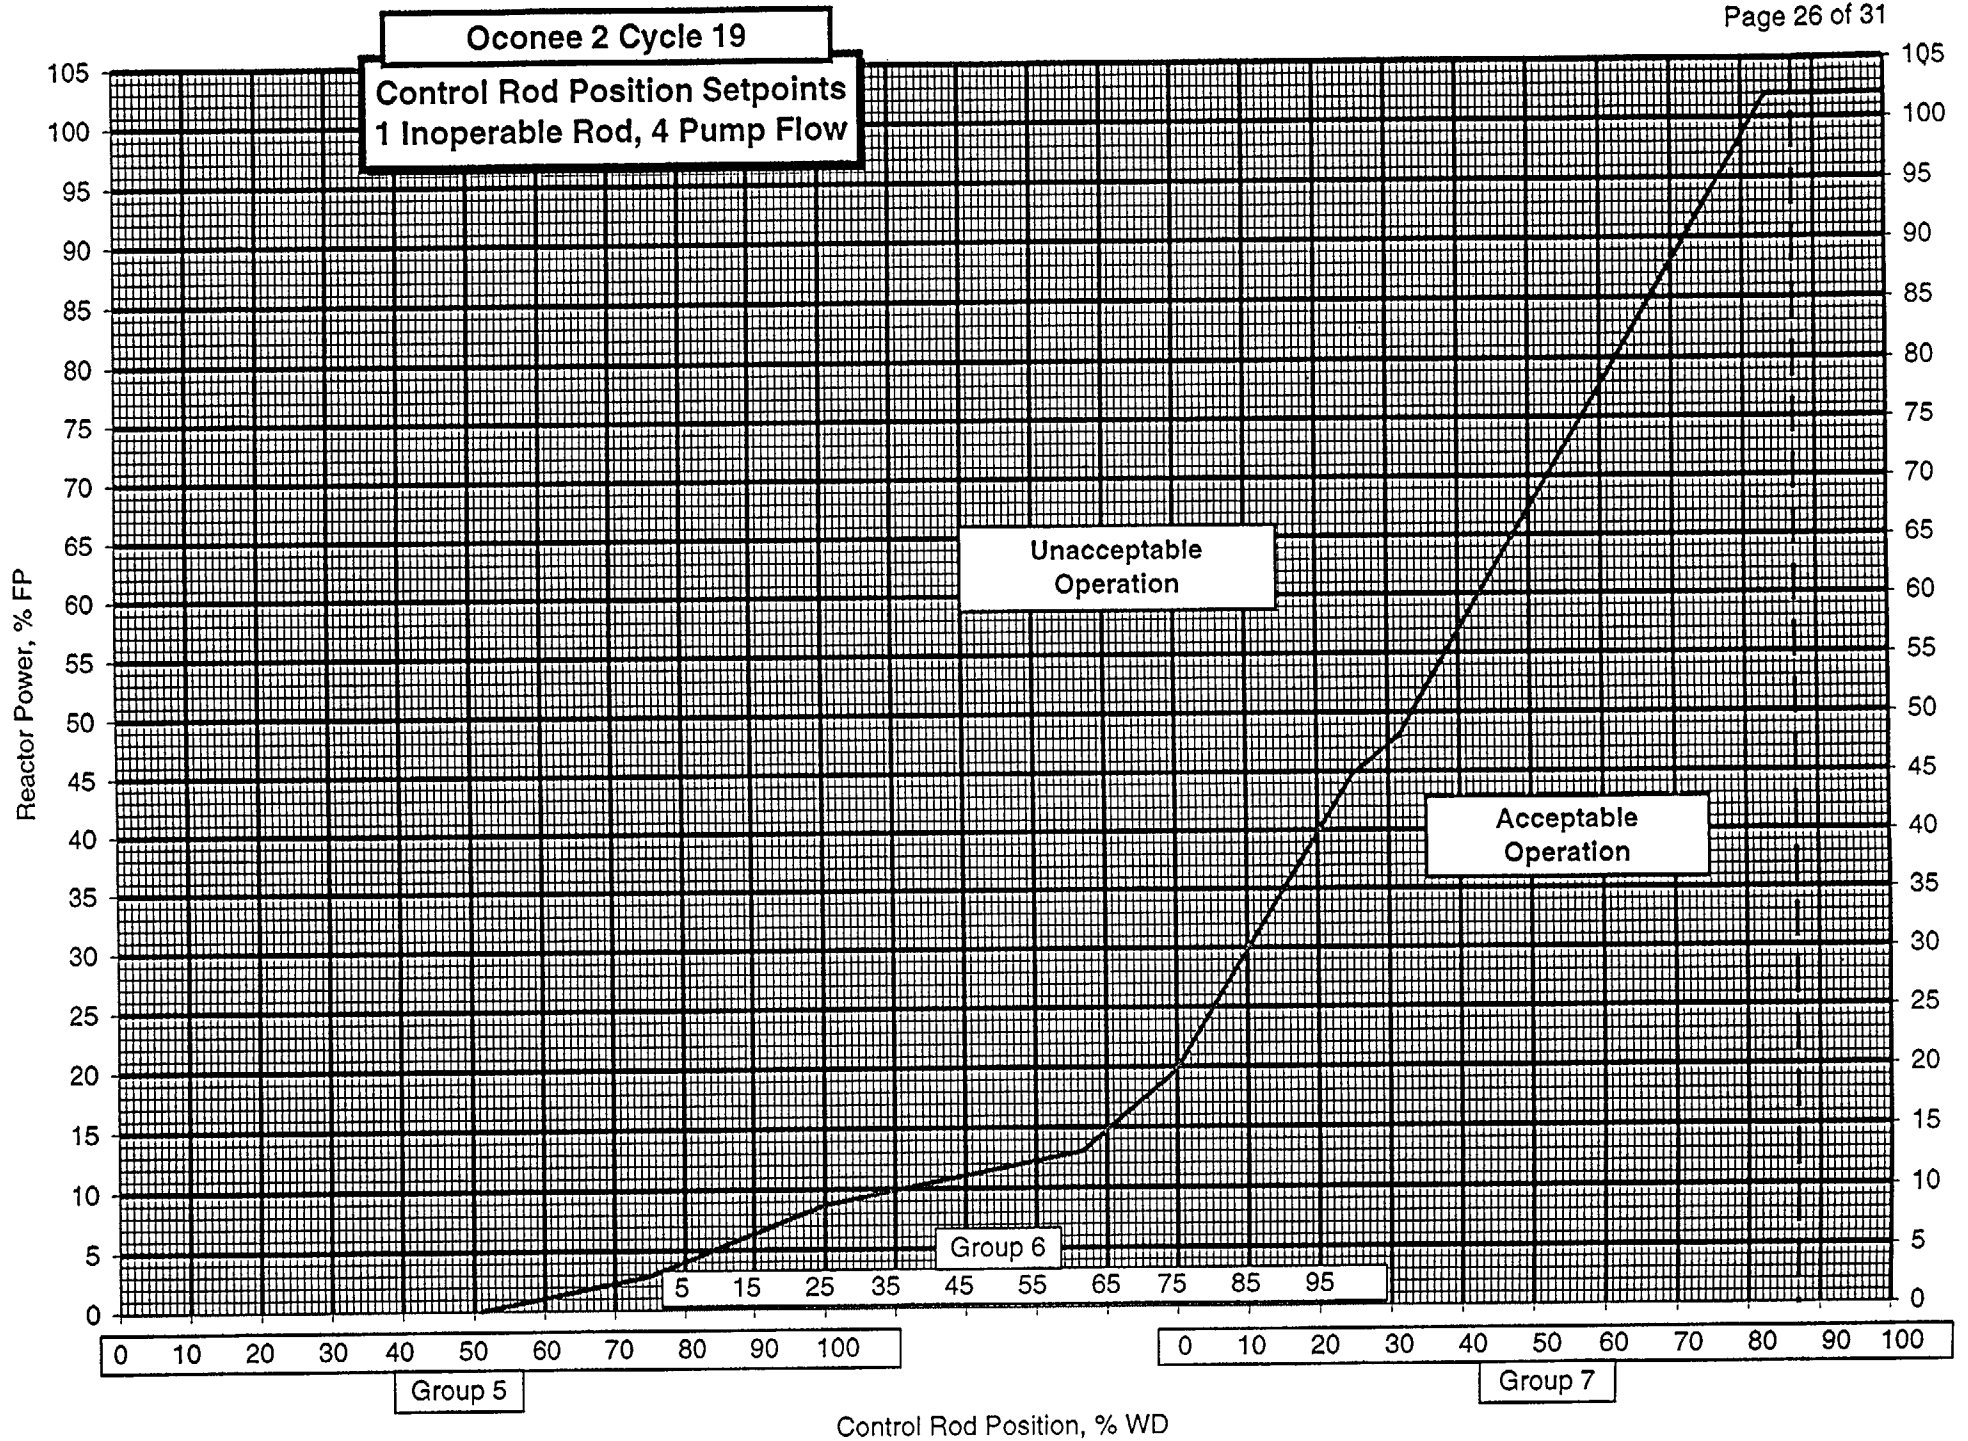

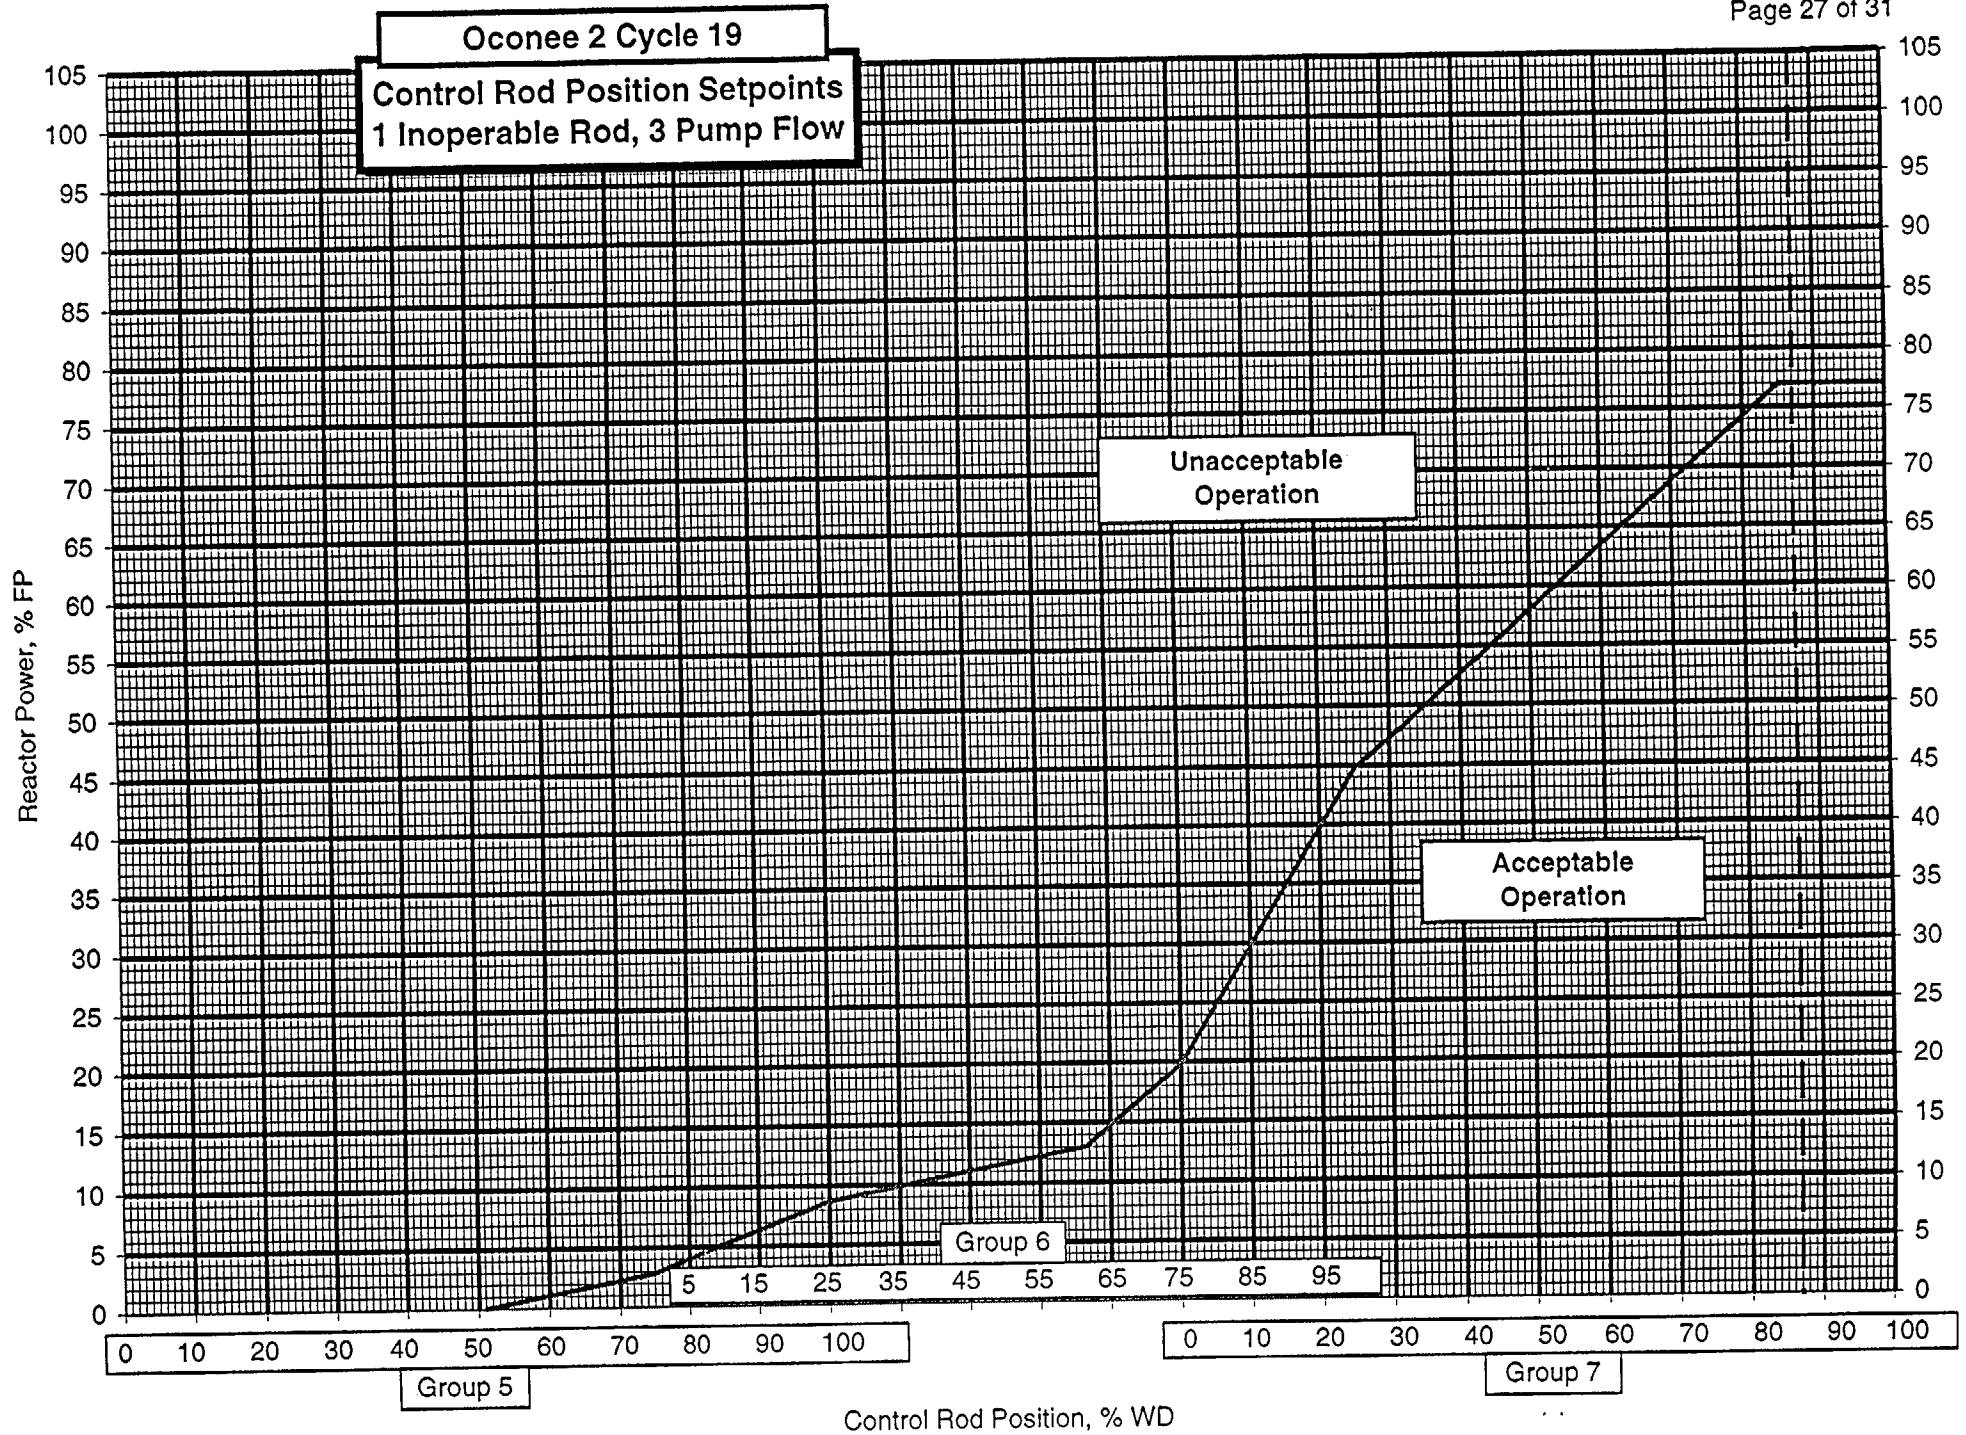

Oconee 2 Cycle 19

2.0 Core Operating Limits -- Not Error Adjusted

The data provided on the following pages satisfies a licensing commitment to identify specific parameters before instrumentation uncertainties are incorporated.

References provided in section 1 of this COLR identify the sources for the data which follows.

Information provided in this section should not be used in plant procedures.

Quadrant Power Tilt Limits

Referred to by TS 3.2.3.

	Steady State		Transient		Maximum
	30 - 100	0 - 30	30 - 100	0 - 30	
Core Power Level, %FP	30 - 100	0 - 30	30 - 100	0 - 30	0 - 100
Quadrant Power Tilt, %	5.05	10.00	9.44	12.00	20.00

Variable Low RCS Pressure Protective Limits

Referred to by TS 2.1.1.

Core Outlet Pressure psia	Reactor Coolant Outlet Temperature, °F	
	3 RCS Pumps	4 RCS Pumps
1800	581.0	578.3
1900	590.0	587.3
2000	598.9	596.3
2100	607.9	605.2
2200	616.9	614.2
2300	625.9	623.2

Oconee 2 Cycle 19

Axial Power Imbalance Protective Limits

Referred to by TS 2.1.1

Not for Plant Use

	%FP	RPS	Operational
4 Pumps	0	-48.0	-40.1
	80	-	-40.1
	90	-	-36.9
	100	-48.0	-29.2
	112	-31.1	-
	112	31.1	-
	100	48.0	27.4
	90	-	34.6
	80	-	39.8
	0	48.0	39.8
3 Pumps	0	-48.0	-40.1
	74.6	-48.0	-
	77.0	-	-40.1
	86.6	-31.1	-
	86.6	31.1	-
	77.0	-	39.8
	74.6	48.0	-
	0	48.0	39.8

Oconee 2 Cycle 19

Rod Index Limits

Referred to by TS 3.2.1

Not for Plant Use

	%FP	Operational RI Insertion Limit	Shutdown Margin RI Insertion Limit		RI Withdrawal Limit
			No Inop Rod	1 Inop Rod	
4 Pumps	102	262	220	280	300
	100	260	-	-	300
	90	250	-	-	300
	80	240	-	-	300
	50	200	140	230	300
	15	90	75	160	300
	5	0	0	75	300
3 Pumps	77	236	220	280	300
	50	200	140	230	300
	15	90	75	160	300
	5	0	0	75	300

Oconee 2 Cycle 19

LOCA Limits

Not for Plant Use

Core Elevation Feet		LOCA LHR kw/ft Limit Versus Burnup		
Mk-B10F and Mk-B10L Fuel		0 GWd/mtU	30 GWd/mtU	62 GWd/mtU
	0.000	15.6	15.6	11.6
	2.506	16.5	16.5	11.6
	4.264	16.8	16.8	11.6
	6.021	17.0	17.0	11.6
	7.779	17.0	17.0	11.6
	9.536	16.7	16.7	11.6
12.00	15.8	15.8	11.6	
Mk-B11 Fuel		0 GWd/mtU	40 GWd/mtU	62 GWd/mtU
	0.000	15.5	15.5	12.6
	2.506	16.3	16.3	12.6
	4.264	16.5	16.5	12.6
	6.021	16.8	16.8	12.6
	7.779	16.5	16.5	12.6
	9.536	16.2	16.2	12.6
12.00	15.4	15.4	12.6	
Mk-B11 Fuel (LTA)		0 GWd/mtU	30 GWd/mtU	60 GWd/mtU
	0.000	14.3	14.3	9.2
	2.506	15.1	15.1	9.2
	4.264	15.4	15.4	9.2
	6.021	15.8	15.8	9.2
	7.779	15.6	15.6	9.2
	9.536	15.1	15.1	9.2
12.00	14.3	14.3	9.2	