

September 20, 1989

Docket No. 50-352

DISTRIBUTION

Docket File
NRC PDR
Local PDR
PDI-2 Reading
SVarga
BBoger
WButler
MO'Brien
RClark
RMartin
ETrottier
GSuh
OGC

DHagan
EJordan
TMeek (4)
Wanda Jones
JCalvo
ACRS (10)
GPA/PA
OC/LFMB

Mr. George A. Hunger, Jr.
Director-Licensing, MC 5-2A-5
Philadelphia Electric Company
Correspondence Control Desk
955 Chesterbrook Boulevard
Wayne, Pennsylvania 19087-5691

Dear Mr. Hunger:

SUBJECT: CORRECTION TO AMENDMENT NO. 19

RE: LIMERICK GENERATING STATION, UNIT 1

In Amendment No. 19, page 3/4 2-9 should have included reference to two figures revised as part of the reload. A corrected copy of this page which now is exactly as contained in your submittal of January 27, 1989, is enclosed.

We apologize for any inconvenience this may have caused you.

Sincerely,

Original signed by
Richard J. Clark

Richard J. Clark, Project Manager
Project Directorate I-2
Division of Reactor Projects I/II
Office of Nuclear Reactor Regulation

Enclosure:
TS page

cc w/enclosure
See next page

8910060261 890920
PDR ADDCK 05000352
P PNU

[GAHUNGER]

PDI-2/PA
MO'Brien
9/20/89

PDI-2/PM
RClark:mj
09/19/89

PDI-2/D
WButler
9/20/89

WB

DFOL
11

DFOL
11



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

September 20, 1989

Docket No. 50-352

Mr. George A. Hunger, Jr.
Director-Licensing, MC 5-2A-5
Philadelphia Electric Company
Correspondence Control Desk
955 Chesterbrook Boulevard
Wayne, Pennsylvania 19087-5691

Dear Mr. Hunger:

SUBJECT: CORRECTION TO AMENDMENT NO. 19

RE: LIMERICK GENERATING STATION, UNIT 1

In Amendment No. 19, page 3/4 2-9 should have included reference to two figures revised as part of the reload. A corrected copy of this page which now is exactly as contained in your submittal of January 27, 1989, is enclosed.

We apologize for any inconvenience this may have caused you.

Sincerely,

A handwritten signature in cursive script that reads "Richard J. Clark". The signature is written in dark ink and is positioned above the typed name and title.

Richard J. Clark, Project Manager
Project Directorate I-2
Division of Reactor Projects I/II
Office of Nuclear Reactor Regulation

Enclosure:
TS page

cc w/enclosure
See next page

Mr. George A. Hunger, Jr.
Philadelphia Electric Company

Limerick Generating Station
Units 1 & 2

cc:

Troy B. Conner, Jr., Esquire
Conner and Wetterhahn
1747 Pennsylvania Ave., N.W.
Washington, D. C. 20006

Mr. Ted Ullrich
Manager - Unit 2 Startup
Limerick Generating Station
P. O. Box A
Sanatoga, Pennsylvania 19464

Mr. Rod Krich S7-1
Philadelphia Electric Company
955 Chesterbrook Boulevard
Wayne, Pennsylvania 19087-5691

Mr. John Doering
Superintendent-Operations
Limerick Generating Station
P. O. Box A
Sanatoga, Pennsylvania 19464

Mr. Charles W. Elliott
Poswistilo, Elliott and Elliott
325 N. 10th Street
Easton, Pennsylvania 18042

Thomas Gerusky, Director
Bureau of Radiation Protection
PA Dept. of Environmental Resources
P. O. Box 2063
Harrisburg, Pennsylvania 17120

Mr. Graham M. Leitch, Vice President
Limerick Generating Station
Post Office Box A
Sanatoga, Pennsylvania 19464

Single Point of Contact
P. O. Box 11880
Harrisburg, Pennsylvania 17108-1880

Mr. James Linville
U.S. Nuclear Regulatory Commission
Region I
475 Allendale Road
King of Prussia, PA 19406

Mr. Philip J. Duca
Superintendent-Technical
Limerick Generating Station
P. O. Box A
Sanatoga, Pennsylvania 19464

Mr. Thomas Kenny
Senior Resident Inspector
US Nuclear Regulatory Commission
P. O. Box 596
Pottstown, Pennsylvania 19464

Mr. John S. Kemper
Senior Vice President-Nuclear
Philadelphia Electric Company
2301 Market Street
Philadelphia, Pennsylvania 19101

POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION

- a. With the end-of-cycle recirculation pump trip system inoperable per Specification 3.3.4.2, operation may continue provided that, within 1 hour, MCPR is determined to be greater than or equal to the MCPR limit as a function of the average scram time shown in Figure 3.2.3-1a (BP/P8X8R fuel), Figure 3.2.3-1b (BP/P8X8R fuel), Figure 3.2.3-1c (GE8X8EB fuel) and Figure 3.2.3-1d (GE8X8EB fuel), EOC-RPT inoperable curve, times the k_f shown in Figure 3.2.3-2.
- b. With MCPR less than the applicable MCPR limit shown in Figures 3.2.3-1a, 3.2.3-1b, 3.2.3-1c, 3.2.3-1d and 3.2.3-2, initiate corrective action within 15 minutes and restore MCPR to within the required limit within 2 hours or reduce THERMAL POWER to less than 25% of RATED THERMAL POWER within the next 4 hours.

SURVEILLANCE REQUIREMENTS


4.2.3 MCPR, with:

- a. $\tau = 1.0$ prior to performance of the initial scram time measurements for the cycle in accordance with Specification 4.1.3.2, or
- b. τ as defined in Specification 3.2.3 used to determine the limit within 72 hours of the conclusion of each scram time surveillance test required by Specification 4.1.3.2,

shall be determined to be equal to or greater than the applicable MCPR limit determined from Figures 3.2.3-1a, 3.2.3-1b, 3.2.3-1c, 3.2.3-1d and 3.2.3-2.

- a. At least once per 24 hours,
- b. Within 12 hours after completion of a THERMAL POWER increase of at least 15% of RATED THERMAL POWER, and
- c. Initially and at least once per 12 hours when the reactor is operating with a LIMITING CONTROL ROD PATTERN for MCPR.
- d. The provisions of Specification 4.0.4 are not applicable.

8910100002 890920
PDR ADDCK 05000352
PNU

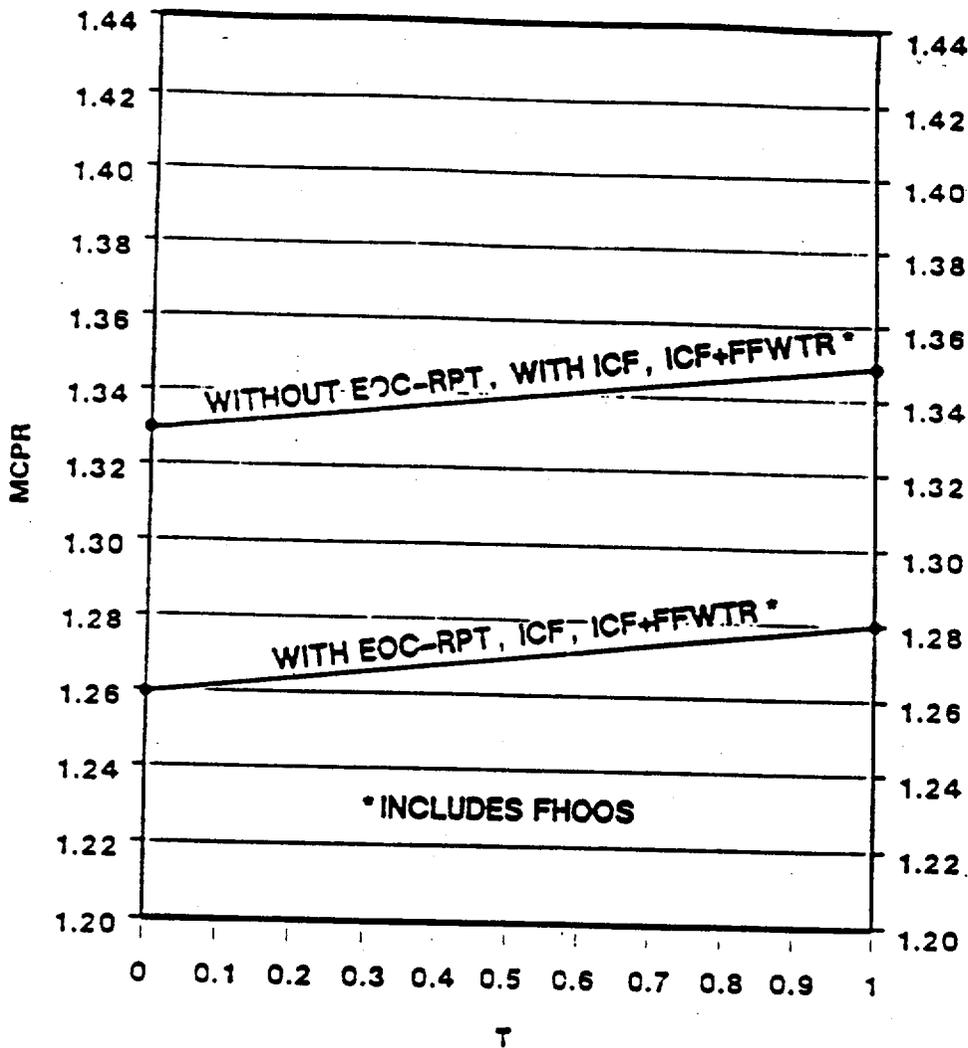

Note: These limits apply to Both Two Recirculation Loop and Single Recirculation Loop Operation.

DEFINITIONS:

ICF - INCREASED CORE FLOW (UP TO 105% RATED)

FHOOS - FEEDWATER HEATING OUT OF SERVICE THROUGHOUT CYCLE (UP TO 60°F TEMP. REDUCTION; ACHIEVED BY REMOVAL OF FEEDWATER HEATER(s))

FFWTR - FINAL FEEDWATER TEMPERATURE REDUCTION AT END OF CYCLE (UP TO 60°F TEMP. REDUCTION; ACHIEVED BY REMOVAL OF ALL 6TH STAGE HEATERS)

MINIMUM CRITICAL POWER RATIO (MCPR) VERSUS τ (P8x8R/BP8x8R FUEL)
(BOC TO EOC - 2000 MWD/ST)

FIGURE 3.2.3-1a