

Docket No. 50-271

FEB 28 1973

Vermont Yankee Nuclear Power Corporation
ATTN: Mr. Albert A. Cree
President
77 Grove Street
Rutland, Vermont 05701

Gentlemen:

Pursuant to an Initial Decision of the Atomic Safety and Licensing Board, dated February 27, 1973, the Atomic Energy Commission has issued Facility Operating License DPR-28 (Amendment No. 5) to the Vermont Yankee Nuclear Power Corporation. Amendment No. 5, a copy of which is enclosed, authorizes full term operation of the Vermont Yankee Nuclear Power Station at steady power levels not to exceed 1593 megawatts thermal subject to the conditions set forth therein and in accordance with the Technical Specifications attached as Appendices "A" and "B" thereto.

A related notice which has been forwarded to the Office of the Federal Register for filing and publication is enclosed for your information.

Sincerely,

Original Signed by
Roger S. Boyd

Roger S. Boyd, Assistant Director
for Boiling Water Reactors
Directorate of Licensing

Enclosures:

- Amendment No. 5 to DPR-28, w/attached Technical Specifications
- Federal Register Notice

cc:
See next page

OFFICE ▶	L: BWRs M Maigne mm	L: BWR-1 WR Butler	OGC Mafflich W Massar	L: AD/BNR RS Boyd	L: AD/EP D. Muller
SURNAME ▶	<i>M Maigne</i>	<i>WR Butler</i>	<i>Mafflich</i>	<i>RS Boyd</i>	<i>D. Muller</i>
DATE ▶	2/28/73	2/28/73	2/28/73	2/28/73	2/28/73

Vermont Yankee Nuclear
Power Corporation

- 2 -

cc w/enclosures w/o attached
Tech. Specs. to Encl. 1:

Mr. Lawrence E. Minnick
Vice President
Vermont Yankee Nuclear Power
Corporation
Turnpike Road, Route 9
Westboro, Massachusetts 01581

Mr. Donald Vandenburg
Vice President
Vermont Yankee Nuclear Power
Corporation
Turnpike Road, Route 9
Westboro, Massachusetts 01581

John A. Ritsher, Esq.
Ropes and Gray
225 Franklin Street
Boston, Massachusetts 02110

Mr. Richard V. deGrasse
State of Vermont
Public Service Board
7 School Street
Montpelier, Vermont 05602

Mr. Raymond H. Puffer
Chairman, Board of Selectmen
Vernon, Vermont 05354

Mr. Craig Roberts (2)
Environmental Protection Agency
Room 18-81, Parklawn Building
5600 Fishers Lane
Rockville, Maryland 20852

Mr. Bartlett A. Hague
Environmental Protection Agency
JFK Federal Building, Room 2303
Boston, Massachusetts 02203

Dr. Ira F. Zartman
848 Holly Drive South
Route #6
Annapolis, Maryland 21401

Gregor I. McGregor, Esq.
Assistant Attorney General
Department of the Attorney
General
State House, Room 370
Boston, Massachusetts 02133

Richard E. Ayres, Esq.
David Schoenbrod, Esq.
National Resources Defense
Council, Inc.
15 West 44th Street
New York, New York 10036

Honorable James M. Jeffords
Attorney General
State of Vermont
Montpelier, Vermont 05602

Anthony Z. Roisman, Esq.
Berlin, Roisman and Kessler
1712 N Street, N.W.
Washington, D. C. 20036

Jonathan N. Brownell, Esq.
Paterson, Gibson, Noble &
Brownell
26 State Street
Montpelier, Vermont 05602

Harvey D. Carter, Jr., Esq.
Williams, Witten & Carter
115 Elm Street
Bennington, Vermont 05201

OFFICE ▶						
SURNAME ▶						
DATE ▶						

Vermont Yankee Nuclear
Power Corporation

- 3 -

Peter S. Paine, Jr., Esq.
Cleary, Gottlieb, Steen & Hamilton
52 Wall Street
New York, New York 10005

J. Eric Anderson, Esq.
Fitts and Olson
16 High Street
Brattleboro, Vermont 05301

William H. Ward, Esq.
Assistant Attorney General
Office of the Attorney General
State Capitol Building
Topeka, Kansas 66612

Donald W. Stever, Jr., Esq.
Office of the Attorney General
State House Annex
Concord, New Hampshire 03301

Chairman, Vermont Public Service
Corporation
Seven School Street
Montpelier, Vermont 05602

Distribution:
Docket Files (50-271)
AEC PDR
Local PDR
L Reading
RP Reading
BWR-1 Reading
WMassar, OGC
MHaflich, OGC
RSBoyd
REG Ops (3)
NDube
MJinks (4 enclosures)
DSkovholt
PCollins
BWR B/Cs
CHEbron, DROA
JDelaney, F&M
JSaltzman, A&I
WMiller, BMB/OA-R
Bernadine Schraf
GOWsley
MMAigret
HMcAlduff, ORO
HMueller, GMR/H
JAHarris, IS
JRBuchanan, ORNL
TWLaughlin, DTIE
NHGoodrich, ASLBP
FKaras, SECY

OFFICE ▶						
SURNAME ▶						
DATE ▶						



UNITED STATES
ATOMIC ENERGY COMMISSION
WASHINGTON, D.C. 20545

Vermont Yankee Nuclear Power Corporation
(Vermont Yankee Nuclear Power Station)

Docket No. 50-271

Facility Operating License

License No. DPR-28
Amendment No. 5

The Atomic Energy Commission (the Commission) having found that:

- a. Construction of the Vermont Yankee Nuclear Power Station (the facility) has been substantially completed in conformity with the application, as amended, the Provisional Construction Permit No. CPPR-36, the provisions of the Atomic Energy Act of 1954, as amended (the Act), and the rules and regulations of the Commission as set forth in Title 10, Chapter 1, CFR; and
- b. The facility will operate in conformity with the application, as amended, the provisions of the Act, and the rules and regulations of the Commission; and
- c. There is reasonable assurance (i) that the activities authorized by this amended operating license can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the rules and regulations of the Commission; and
- d. The Vermont Yankee Nuclear Power Corporation (Vermont Yankee) is technically and financially qualified to engage in the activities authorized by this amended operating license, in accordance with the rules and regulations of the Commission; and
- e. Vermont Yankee has satisfied the applicable provisions of 10 CFR Part 140, "Financial Protection Requirements and Indemnity Agreements" of the Commission's regulations; and
- f. The issuance of this amended operating license will not be inimical to the common defense and security or to the health and safety of the public; and

- g. After weighing the environmental, economic, technical and other benefits of the facility against environmental costs and considering available alternatives, the issuance of this amended operating license (subject to the conditions for protection of the environment set forth herein) is in accordance with 10 CFR Part 50, Appendix D, of the Commission's regulations and all applicable requirements of said Appendix D have been satisfied.

Accordingly, Facility Operating License No. DPR-28, as amended, issued to Vermont Yankee Nuclear Power Corporation (Vermont Yankee), is hereby amended in its entirety to read:

1. This license applies to the Vermont Yankee Nuclear Power Station (the facility), a single cycle, boiling water, light water moderated and cooled reactor, and associated electric generating equipment. The facility is located on Vermont Yankee's site, in the Town of Vernon, Windham County, Vermont, and is described in the application as amended.
2. Subject to the conditions and requirements incorporated herein, the Commission hereby licenses the applicant:
 - A. Pursuant to Sections 104b of the Atomic Energy Act of 1954, as amended (the Act), and 10 CFR Part 50, "Licensing of Production and Utilization Facilities," to possess, use, and operate the facility as a utilization facility at the designated location on the Vermont Yankee site.
 - B. Pursuant to the Act and 10 CFR Part 70, "Special Nuclear Material," to receive, possess, and use at any one time up to 3300 kilograms of U-235 and 16 grams of plutonium encapsulated as Pu-Be-Neutron source assemblies in connection with operation of the facility.
 - C. Pursuant to the Act and 10 CFR Part 30, "Rules of General Applicability to Licensing of Byproduct Material," to receive, possess, and use in connection with operation of the facility any byproduct material with Atomic numbers between 3 and 83, inclusive, in any form with no nuclide to exceed 2 millicuries; 50 curies of cesium 137, 25 millicuries of cobalt 60 both as sealed sources; 100 microcuries of strontium 90 as sealed instrument check sources, each source not to exceed 5 microcuries; 6 curies of americium 241 as sealed sources; eight sources of 1200 curies each of antimony 124 as sealed sources; and 1 curie of krypton 85 as gas.

- D. Pursuant to the Act and 10 CFR Parts 30 and 70, to possess, but not to separate, such byproduct and special nuclear material as may be produced by operation of the facility.
3. This license shall be deemed to contain and is subject to the conditions specified in the following Commission regulations: 10 CFR Part 20, Section 30.34 of 10 CFR Part 30, Section 40.41 of 10 CFR Part 40, Sections 50.54 and 50.59 of 10 CFR Part 50, and Section 70.32 of 10 CFR Part 70; and is subject to all applicable provisions of the Act and to the rules, regulations, and orders of the Commission now or hereafter in effect; and is subject to the additional conditions specified below:

A. Maximum Power Level

Vermont Yankee is authorized to operate the facility at reactor core power levels not to exceed 1593 megawatts thermal in accordance with the Technical Specifications (Appendices A and B) appended hereto.

B. Technical Specifications

The Technical Specifications contained in Appendices A and B appended hereto are hereby incorporated in this license. Vermont Yankee shall operate the facility at power levels not to exceed 1593 megawatts thermal in accordance with the Technical Specifications, and may make changes in the Technical Specifications only when authorized by the Commission, in accordance with the provisions of Section 50.59 of 10 CFR Part 50.

C. Reports

Vermont Yankee shall make reports in accordance with the requirements of the Technical Specifications.

D. Records

Vermont Yankee shall keep facility operating records in accordance with the requirements of the Technical Specifications

E. Environmental Conditions

Pursuant to the Initial Decision of the presiding Atomic Safety and Licensing Board issued February 27, 1973, the following conditions for the protection of the environment are incorporated herein:

1. Anything hereinabove or in the Technical Specifications to the contrary notwithstanding, the facility shall be operated in the closed-cycle cooling mode only, until such time as data are developed and determinations made respecting significant adverse impacts on the environment by the advisory group for non-radiological environmental monitoring established by the Technical Specifications.
2. The total residual chlorine concentration will be limited to 0.1 ppm in the immediate vicinity of the plant discharge, and such limit on chlorine discharge shall continue until evaluation of test results, which may permit a change if approved by the Commission.
3. Vermont Yankee will define a comprehensive environmental (chemical, biological, and thermal) monitoring program for inclusion in the Technical Specifications, which is acceptable to the Commission for determining changes which may occur in land and water ecosystems as a result of plant operation.
4. If harmful effects or evidence of irreversible damage in land or water ecosystems as a result of facility operation are detected by the monitoring program, Vermont Yankee shall provide an analysis of the problem to the Commission and to the advisory group for the Technical Specifications, and Vermont Yankee thereafter will provide, subject to the review by the aforesaid advisory group, a course of action to be taken immediately to alleviate the problem.
5. Vermont Yankee will grant authorized representatives of the Massachusetts Department of Public Health (MDPH) and Metropolitan District Commission (MDC) access to records and charts related to discharge of radioactive materials to the Connecticut River.
6. Prior to discharge of each tank (batch) of liquid radioactive effluents, a representative sample thereof shall be collected and held for independent analysis by the Commonwealth of Massachusetts. Authorized representatives of the Commonwealth shall pick up such samples at the plant site.

7. Vermont Yankee will furnish advance notification of each scheduled calibration of liquid effluent monitors to MDPH and MDC and, upon request, will permit authorized representatives of the Commonwealth of Massachusetts to be present during such calibrations.
8. Vermont Yankee will permit authorized representatives of the MDPH and MDC to examine the chemical and radioactivity analyses performed by Vermont Yankee.
9. Vermont Yankee shall immediately notify MDPH, or an agency designated by MDPH, in the event concentrations of radioactive materials in liquid effluents, measured at the point of release from Vermont Yankee, exceed the limit set forth in the facility Technical Specifications, Appendix A, paragraph 3.8,B.2. Vermont Yankee will also notify MDPH in writing within 30 days following the release of radioactive materials in liquid effluents in excess of 10 times the administrative limit set forth in the facility Technical Specifications, Appendix A, paragraph 3.8,F.1.b.
10. A report shall be submitted to MDPH and MDC within sixty days of January 1st and July 1st of each year of plant operation, specifying the total quantities of radioactive materials released to the Connecticut River during the previous six months. The report shall contain the following information:
 - (a) Total curie activity discharged other than tritium and dissolved gases.
 - (b) Total curie alpha activity discharged.
 - (c) Total curies of tritium discharged.
 - (d) Total curies of dissolved radio-gases discharged.
 - (e) Total volume (in gallons) of liquid waste discharged.


- (f) Total volume (in gallons) of dilution water.
 - (g) Average concentration at discharge outfall.
 - (h) Time, date and duration of maximum concentration released (average over the period of release).
 - (i) Total radioactivity (in curies) released by nuclide including dissolved radio-gases.
 - (j) Percent of technical specification limit for total activity released.
11. Upon notification by MDPH or MDC that all plans and construction for the diversion of water from the Connecticut River to recharge Quabbin Reservoir have been completed, Vermont Yankee shall establish a system of communication and notification, satisfactory to MDPH and MDC, to give adequate warning to the appropriate agency or agencies of the Commonwealth of Massachusetts of any accidental discharge of radioactive materials into the Connecticut River from the facility.
12. Upon notification in writing by MDPH or MDC that water from the Connecticut River is being diverted to recharge Quabbin Reservoir, Vermont Yankee shall submit to both MDPH and MDC, until receipt of notification that such diversion has been terminated, monthly reports of liquid radioactive releases.
13. Vermont Yankee shall establish and maintain a system of emergency notification to the states of Vermont and New Hampshire, and the Commonwealth of Massachusetts, satisfactory to the appropriate public health and public safety officials of those states and the Commonwealth, which provides for:
- a. Notice of site emergencies as well as general emergencies.
 - b. Direct microwave communication with the state police headquarters of the respective states and the Commonwealth when the transmission facilities of the respective states and the Commonwealth so permit, at the expense of Vermont Yankee.

c. A verification or coding system for emergency messages between Vermont Yankee and the state police headquarters of the respective states and the Commonwealth.

14. Vermont Yankee shall furnish advance notification to MDPH, or to another Commonwealth agency designated by MDPH, of the time, method and proposed route through the Commonwealth of any shipments of nuclear fuel and wastes to and from the Vermont Yankee facility which will utilize railways or roadways in the Commonwealth.

4. This license is effective as of the date of issuance and shall expire at midnight on December 11, 2007.

FOR THE ATOMIC ENERGY COMMISSION


for A. Giambusso, Deputy Director
for Reactor Projects
Directorate of Licensing

Enclosures:
Appendices A & B - Technical Specifications

Date of Issuance:

FEB 28 1973

APPENDIX B
TO
OPERATING LICENSE DPR-28
NON-RADIOLOGICAL TECHNICAL SPECIFICATIONS
AND BASES
FOR
VERMONT YANKEE NUCLEAR POWER STATION
VERNON, VERMONT
VERMONT YANKEE NUCLEAR POWER CORPORATION
DOCKET NO. 50-271

Revised 2-28-73

1.0 LIMITING CONDITIONS FOR OPERATION

2.0 SURVEILLANCE REQUIREMENTS

1.1 CONDENSER COOLING WATER

Applicability:

Applies to discharges of non-radioactive effluents from the station.

Objective:

To assure that non-radioactive effluents are released to the environment in an orderly manner and are maintained below established limits.

Specification:

A. Discharge Temperature

1. Thermal discharges into the Vernon Pond will be controlled to meet the following temperature rise conditions:

<u>Maximum River Temperature Measured At The Upstream Monitor</u>	<u>Allowable Increase In Temperature Measured At The Downstream Monitor</u>
Above 66°F	1°F
63°F to 65°F	2°F
59°F to 62°F	3°F
55°F to 58°F	4°F
Below 55°F	5°F

2.1 CONDENSER COOLING WATER

Applicability:

Applies to monitoring and sampling of non-radioactive effluents discharged from the station and the determination of their environmental impact.

Objective:

To ascertain that the non-radioactive releases are below the established limits and to determine their effects on the environment.

Specification:

A. Discharge Temperature

1. River water temperatures shall be continuously measured at locations 3-1/2 miles upstream of the plant and 0.65 miles downstream of the Vernon Dam. The downstream monitoring location is subject to confirmation that it provides a representative, well-mixed water temperature of Vernon Pond as determined by the Temperature Monitoring Survey, pg. 11 and 12, Table 2.2-1.

1.0 LIMITING CONDITIONS FOR OPERATION

2. No discharge of heated wastes, except for cooling tower blowdown, shall be made from the plant when the temperature of the river upstream of the condenser water inlet is 70°F or higher.

3. The discharges of heated water shall be controlled so that the rate of change due to operation or normal startup or shutdown conditions shall not exceed 0.5°F per hour from May 1 through October 31 nor 1.0°F per hour from November 1 through April 30, as measured at the upstream and downstream monitors.

4. Thermal discharges into the Vernon Pond will be controlled so that the resultant temperature at the periphery of a 50 acre zone shall not exceed 45°F when the ambient river water temperature is less than 40°F or increase more than 5°F when the ambient river water temperature is above 40°F.

2.0 SURVEILLANCE REQUIREMENTS

2. Mixing zone configuration and extent shall be monitored as described in Table 2.2-1, "Temperature Monitoring Survey" (as modified for the temporary operating license). The results of the temperature monitoring program shall be used to establish the 50 acre zones under varying river flows for open-cycle operation.

1.0 LIMITING CONDITIONS FOR OPERATION

B. Chemical Concentrations

1. The free residual chlorine in the plant effluent at the aerating structure shall be maintained at or below 0.1 mg/liter during chlorination by the automatic control system.
2. The desired criteria and goal toward which the applicant should strive is a total residual chlorine concentration of 0.1 mg/l or less in the plant effluent to Vernon Pond. However, plant design and the uncertainties of the interaction of chlorine residuals in the environment are such that flexibility must be incorporated into the criteria. Because of these uncertainties, the applicant will be permitted a period of 120 days in which total residual chlorine level in the discharge shall not exceed 0.5 mg/l, in accord with the detailed monitoring and analysis described in B2 under Surveillance Requirements. After evaluation of the report described in B2 the limiting condition of operation for total residual chlorine will be reconsidered.

2.0 SURVEILLANCE REQUIREMENTS

B. Chemical Concentrations

1. Free residual chlorine concentration shall be continuously monitored and recorded at the discharge from the condenser. At least once per month the automatic control system will be calibrated. During chlorination weekly free chlorine analyses shall be made at the end of the aerating structure by use of analytical methods that are sensitive to chlorine discharge concentration limits to determine the effectiveness of the aerating structure in removing free chlorine.
2. During the first 90 days following the issuance of a full power operating license a series of samples will be taken at least on a weekly basis at the end of the aerating structure and in the immediate receiving water to characterize the chlorine discharge to Vernon Pond. Sampling shall be done in such a manner as to define the concentration-time relationships of free and combined chlorine at the end of the aeration structure and in the immediate receiving water area (100 ft from the discharge) during chlorination. Within 120 days of the issuance of a full power operating license, the applicant will submit a report describing the chlorine monitoring program and indicate the lowest practical total residual chlorine discharge level

1.0 LIMITING CONDITIONS FOR OPERATION

2.0 SURVEILLANCE REQUIREMENTS

If the total residual chlorine level at the aerating structure exceeds 0.5 mg/l or 0.1 mg/l in the receiving water 100 ft from the discharge structure, as determined by an analysis of 3 samples, chlorination shall cease until the system is corrected. Any corrective actions required to maintain the 0.5 mg/l limit shall be described in the plant Monthly Operations Report. During chlorination the discharge area shall be visually inspected (6 times per week) for evidence of detrimental effects on aquatic life, such as dead fish or fish in distress. Such evidence, if any, shall be noted and a record of such evidence shall be maintained.

3. The hydrogen ion concentration of plant discharges shall be controlled within pH limits of 6.5 - 8.0, except when due to natural causes.
5. Approximately 10,600 gallons per month of sodium hypochlorite (15% solution) will be released to condenser cooling water during chlorination (during open-cycle) for slime and algae control. During closed-cycle cooling water operation about 900 gallons per month of sulfuric acid will be used for pH control. In the regeneration of cation and anion make-up demineralizers, about 470 gallons per month of sodium hydroxide will be used. Mixed bed demineralizers will require approximately 340 gallons per month of sulfuric acid for regeneration.

to Vernon Pond (i.e. concentration over a given time period) that is compatible with plant operation.

3. The pH of the condenser cooling water shall be continuously monitored and recorded.
4. During operation with inoperable analyzers or recorders, daily grab samples shall be collected and analyzed to confirm chemical concentration limits.
5. The usage of sodium hypochlorite and sulfuric acid for the treatment of cooling water and the usage of sulfuric acid and sodium hydroxide for demineralizer regeneration shall be recorded in the Plant Monthly Operation Report.

1.0 LIMITING CONDITIONS FOR OPERATION

2.0 SURVEILLANCE REQUIREMENTS

C. River Flow

A minimum flow of 1,200 cubic feet per second of water will be provided through the dam at Vernon, Vermont at all times during plant operation. If, due to causes beyond Vermont Yankee's control, the flow must be reduced below 1,200 cfs, the condenser cooling system will be operated in a closed cycle mode and a report will be made to the AEC in accordance with Section 6.7 (a) of Appendix A.

D. Fish Kill

Fish collected on the trash racks or traveling water screens at the station shall be identified by species, size and quantity. While the impact of fish mortalities which may occur at Vermont Yankee with respect to the local fishery resource is unknown, these data will be collected and assessed as described in Section 2.2.2 of this Appendix (Non-Radiological Monitoring).

C. River Flow

Measurement of continuous river flow through the dam at Vernon, Vermont shall be recorded via the U.S.G.S. tailrace gage at the Vernon hydroelectric station.

D. Fish Kill

Data on fish collected shall be included in the monthly plant operating report.

E. Administrative Controls

1. The action to be taken in the event of an abnormal occurrence in plant operation will be in accordance with Section 6.3 of Appendix A.

1.0 LIMITING CONDITIONS FOR OPERATION

2.0 SURVEILLANCE REQUIREMENTS

2. Records and logs relative to the following items shall be retained for 5 years:
 - a) River water temperature measurement at the upstream and downstream monitors.
 - b) Free and total chlorine residual measurements.
 - c) pH measurements.
3. The following items shall be reported in the Monthly Operating Report:
 - a) Free and total chlorine residual measurements.
 - b) Usage of sodium hypochlorite, sulfuric acid and sodium hydroxide.
 - c) Fish killed.

VYNPS

BASES - CONDENSER COOLING WATER

- A. The condenser cooling water system is designed to operate with minimal thermal effects on the Connecticut River and is capable of meeting the river temperature requirements of the permit issued by the State of Vermont Water Resources Board, dated June 10, 1968, as amended November 26, 1971, and as set forth above in Specification 1.1, A - Limiting Conditions For Operation - Discharge Temperature. The Water Resources Board, in arriving at the conditions of the permit, had the advantage of considering the opinions of expert witnesses from the Fish & Game Department of the State of Vermont, New Hampshire and Massachusetts, as well as from the Technical Committee for Fishery Management of the Connecticut River Basin. The conditions of the permit, as amended, conform to the "Regulations Governing Water Classification and Control of Quality" (Section 11, Vermont Water Quality Regulations). This regulation has been approved by the Environmental Protection Agency and was adopted by the State of Vermont Water Resources Board on May 29, 1971.

The absolute temperature of the condenser cooling water discharge will be dependent upon the allowable temperature rise in the river and upon river flow. Cooling water leaves the condenser at about 20°F above ambient river water temperature during full power operation. This water is discharged directly to the river, if the river flow is sufficient to reduce the temperature to the allowable increase over ambient within the mixing zone. With low river flows, a portion of the condenser cooling water is diverted through the cooling towers prior to discharge to the river. Thus, when ambient river water temperature reaches 70°F wet bulb temperature, blowdown discharge temperature to the river is estimated to be approximately 90°F which, after mixing with the specified minimum river flow, is calculated to result in a rise in river temperature of 0.146°F. The rate of change of heat discharged to the river is a function of plant power level and condenser cooling system operation. Based on the fact that the station will normally be operated at a steady load, the heat rejected to the condenser cooling system should be constant. Control of this system is maintained such that sudden changes of flow from the discharge structure to the river, or sudden changes in the mode of cooling tower operation, are avoided -- thus minimizing rate of temperature changes.

BASES - CONDENSER COOLING WATER (continued)

Aquatic ecology investigations of the Connecticut River in the vicinity of Vernon, Vermont were undertaken by the Applicant during a four year period prior to plant operation. These investigations included qualitative and quantitative studies of the fish community, phytoplankton, zooplankton, benthic fauna, vascular plants and the physical and chemical characteristics of the river. Continuation of these studies as set forth in Specification 1.2, in conjunction with operation of the station in conformance with conditions of paragraph A of Specification 1.1, is designed to evaluate the impact of the plant on the ecosystem of the Connecticut River.

A temperature limitation in the Vernon Pond of 45°F when the ambient river water temperature is less than 40°F or an increase of no more than 5°F when the ambient river water temperature is above 40°F has been established by the Atomic Energy Commission. A 50 acre area has been exempted from these limitations for the first year during which a comprehensive study of the temperature variations in the Vernon Pond will be made. If the results of the temperature monitoring survey and the results of the operational monitoring program provide information which shows that there is no significant or irreversible effects on the Vernon Pond, an appropriate exempted area will be considered. Otherwise 10 acres will be established as the extent of the exempt area. Because the thermal plume from the plant discharge is dependent on the varying river flows, no permanent exempt area is specified. Rather the location of the exempt area will be established by a temperature monitoring program described in Table 2.2-1 as modified for the temporary operating license.

- B. Chlorine, in the form of sodium hypochlorite, is introduced to the condenser cooling system to control biological fouling of the traveling water screens, piping, condenser tubes and cooling towers. The free chlorine residual in the condenser discharge is maintained at a preset limit by a chlorine residual analyzer-controller. The level of chlorine used in batch injection is determined by its effective concentration within the condenser tubes by the need to avoid deleterious effects in the discharge effluent and by the relative high cost of chlorine. The batch treatment is administered twice per day for 40 minute periods.

VYNPS

BASES - CONDENSER COOLING WATER (continued)

Vernon Pond contains ammonia and nitrogenous materials which will react to form chloramines (combined chlorine) with the free chlorine injection. Thus during chlorination both free and combined chlorine will be discharged to Vernon Pond.

As mentioned previously, the interim use of a 0.5 mg/liter total residual chlorine discharge limit in conjunction with a detailed monitoring program is based on the uncertainties of chlorine behavior in the environment, and the fact that plant design is such that the desired effluent limit of 0.1 mg/liter total residual chlorine may not be compatible with plant operation. Although the selection of 0.5 mg/liter total residual chlorine as a discharge limit is primarily a judgment decision based on limited information on chlorine interaction with the aquatic environment, the Staff believes that the maintenance of a 0.1 mg/liter or less free chlorine residual at the discharge will result in a total residual chlorine discharge less than 0.5 mg/liter. The Staff is also of the opinion that a 0.5 mg/liter total residual chlorine effluent diluted with receiving water is not likely to have an adverse impact on those organisms that are capable of avoiding the immediate discharge area (e.g. fish).

During closed cycle operation nearly all chlorine is expected to be dissipated as the cooling water passes through the cooling towers. In addition the discharge flow to the river is approximately 1% of the flow during open cycle operation. For cooling tower operation, the unlikely occurrence of 0.5 mg/liter of total residual chlorine discharged at minimum flow (1200 cfs) into Vernon Pond would result in a concentration of 0.005 mg/liter in the immediate receiving water. Much lower concentrations would be predicted for average and maximum river flows.

The discharge during open cycle operation is diluted with river water and subsequent unchlorinated condenser cooling water. The unchlorinated condenser cooling water further reduces the chlorine residual in the river. Each chlorine injection is followed by a period of over 11 hours during which no chlorine is discharged to the river. Estimated total chlorine residuals in the immediate discharge area during open cycle operation and

VYNPS

BASES - CONDENSER COOLING WATER (continued)

considering only river dilution would be 0.01 and 0.009 mg/liter for average and maximum river flows. For minimum flow, a discharge of 0.5 mg/liter of total residual chlorine would result in 0.4 mg/liter of the same in the immediate receiving water. Although this concentration has been shown to be a lethal to a number of different aquatic species in laboratory studies, and in field studies where organisms (e.g. fish) have been held in discharge areas, the applicability of these studies and their toxicity results to an operating power plant and to organisms that can avoid unfavorable stresses is questionable. Because few sessile organisms inhabit the immediate discharge area and mobile species such as fish would be expected to avoid 0.4 mg/liter of total residual chlorine no adverse impact on the Vernon Pond ecosystem is expected.

Vermont Yankee will establish the minimum chlorine injection program consistent with the requirements for control of biological fouling of the condenser cooling system and protection of aquatic life.

During closed cycle operation, sulfuric acid is used to maintain neutral pH and to prevent delignification of the wood in the cooling tower. The sulfuric acid addition is controlled by a pH control system which automatically adjusts the feed of sulfuric acid to correct and maintain the pre-established pH limit. The pH sample point is located in the condenser discharge.

Effluents from the regeneration of the makeup demineralizer are also introduced into the circulating water discharge. Sulfuric acid is used to regenerate cation exchange resins and sodium hydroxide is used to regenerate the anion exchange resins. These chemicals in the form of sodium sulfate are brought to a neutral pH prior to discharge into the circulating water system.

- C. A minimum flow of 1200 cubic feet per second will be maintained through the dam at Vernon, Vermont at all times during plant operation. This flow is maintained to provide the Connecticut River and its tributaries with the advantages and benefits of more adequate and sustained flow of water.

1.0 LIMITING CONDITIONS FOR OPERATION2.0 SURVEILLANCE REQUIREMENTS

1.2 NON-RADIOLOGICAL ENVIRONMENTAL MONITORING

1. An environmental monitoring program will be conducted to monitor the effects of plant operation on the environment.

2.2 NON-RADIOLOGICAL ENVIRONMENTAL MONITORING

1. An environmental monitoring program given in Table 2.2 shall be conducted. An annual report of the previous year's studies will be submitted by April of each year. This report will record the results of the previous year's studies and discuss any significant trends of change observed in the parameters examined.
2. An advisory group comprised of representatives from the State of Vermont, the State of New Hampshire, and the Commonwealth of Massachusetts shall meet with representatives from the Vermont Yankee Nuclear Power Corporation as often as necessary, but at least annually, to review and evaluate results and conclusions of the environmental monitoring program. The Vermont Yankee Nuclear Power Corporation shall submit minutes of these meetings complete with the advisory group's recommendations and conclusions concerning the adequacy of the program or concerning plant operation to the Atomic Energy Commission. Any recommendations for altering the monitoring program or plant operation should be supported with adequate technical basis to permit the staff of the Directorate of Licensing to make a technical evaluation. The results of this evaluation, the concurrence, non-concurrence, or any other action by the Directorate of Licensing and the basis for such action will be provided, in writing, to Vermont Yankee Nuclear Power Corporation upon completion of such technical evaluation. Vermont Yankee Nuclear Power Corporation will provide the group with copies of all AEC responses to the advisory group's minutes, conclusions and recommendations.

(Change No. 4 dated 1/10/73)

TABLE 2.2-1

OPERATIONAL MONITORING PROGRAM

As in the case of the pre-operational monitoring program, the operational monitoring program includes the following studies:

1. Hydrology
2. Water Quality
 - a. D. O. and Temperature
 - b. Automatic Water Quality Monitoring
 - c. Laboratory Analyses
3. Biological
 - a. Phytoplankton
 - b. Zooplankton
 - c. Benthic Fauna
 - d. Fish
 - e. Vascular Plants
4. Entrainment
5. Sound Studies

TABLE 2.2-1 (Continued)

1. Hydrology - Hydrology records will be obtained from the U.S. Department of Interior Geological Survey Gage at the Vernon Dam, for all years of the study, one-four. These data will be plotted to show the following:

1. Maximum instantaneous discharge
2. Cumulative discharge distribution
3. Mean monthly discharge
4. Mean daily discharge
5. Representative bi-hourly discharge

Plant operational data will be incorporated into this area of study so that a complete record of heat addition and flow rates will be available for understanding the biological and chemical parameters. Discussions of unusual flow patterns, as well as the 1200 cfs minimum flow, will be contained in reports and compared to the river flow prior to plant operation, primarily during the years 1967-1971.

Mixing zone configuration and extent under various rates of river flow and plant discharge modes will be determined from dye diffusion and temperature monitoring studies during the first year of full power plant operation. The studies to be performed are outlined in more detail below.

a) Temperature Monitoring Survey

A comprehensive temperature monitoring survey will be conducted when the plant goes on open cycle operation which will provide horizontal and vertical coverage of the thermal plume under varying river flows and plant discharge modes.

1. Station Locations - Transects will be established at approximately 500 foot intervals commencing 500 feet upstream of the intake structure and extending downstream to Vermont Yankee Station No. 3, a distance of 1.5 miles. Permanent range markers will be established on both shores to provide alignment control. Buoys will be placed at quarter points along each transect to facilitate vertical measurement. A minimum of 2 mobile temperature monitors shall be installed in Vernon Pond in appropriate locations selected by the applicant to monitor the thermal plume. These monitors shall be installed to monitor the blowdown during the temporary license period.

TABLE 2.2-1 (Continued)

2. Procedure - Monitoring of the plume will be performed at eleven stations upstream of Vernon Dam and also at Vermont Yankee Station No. 3 and the most upstream station below Vernon Dam which is safe to navigate. Bottom contours will be obtained at each station. Immediately prior to each temperature sampling time ambient temperatures will be measured and recorded at three depths (1', 5' and 10') simultaneously with the boat underway across the river at a constant speed.

In addition to the horizontal temperature tracking, vertical measurements throughout the entire water column will be obtained at quarter points in the river.

3. Monitoring Schedule - Based upon the available U.S.G.S. Flow Records of the area it is felt that the following schedule will adequately cover all flow conditions of the river and plant discharge modes.

<u>Dates</u>	<u>Interval</u>	<u>No. Sampling Days/ Interval</u>	<u>Sampling Times/ Day</u>
October - December	6 Days	2	2
January - March 15	9 Days	1	2
March 16 - June 1	6 Days	1	2

The above dates represent the approximate periods that ambient temperatures in the river are below 66°F. Additions or deletions from the above schedule will be made should extreme conditions be present on other than a scheduled sampling time or as a careful review of the data might dictate. The actual sampling times during any given day will be conducted once during the high flow period and once during the low flow period of the day. Time will be allowed for these flows to stabilize before commencing the survey. Close coordination with the operation of the plant will be maintained to determine changes in discharge modes.

TABLE 2.2-1 (Continued)

4. Equipment Calibration - All instrumentation used will be calibrated prior to, during and at the completion of the survey. All temperature measurements will be determined by the use of thermometers and thermistors whose calibration has been performed by or is directly traceable to the National Bureau of Standards.

5. Data Reduction - Data obtained from each complete set of temperature measurements will be reduced and ΔT above ambient river temperature will be plotted as isotherms. Plotted data will include date, time, river flow, ambient temperatures, and surface areas within different isotherms. River flows will be computed from river stage observations at the Vernon Hydroelectric plant without regard to backwater corrections. Actual flows will be submitted pending receipt from U.S.G.S.

b) Dye Diffusion Study

A dye diffusion survey will be conducted in Vernon Pond, concurrently with one or more of the temperature surveys. As the natural temperatures in Vernon Pond vary at times up to 1.5°F this dye study would help determine increases in ambient not due to plant heat load as background fluorescence is relatively constant. In addition, this study will provide a check on the diffusion characteristics of the Vernon Pond.

2. Water Quality

a. Dissolved Oxygen and Temperature - Special dissolved oxygen and temperature studies of the Connecticut River will be undertaken during the first two years of plant operation. Variations of temperature and dissolved oxygen at selected stations with respect to location and depth in the river will be determined at different times of the year. The stations to be used in these studies will be those used in the pre-operational special dissolved oxygen and temperature studies (Stations 1, 2, 3, 4, 5 and 7 on Figure 2.2) unless the hydrology studies indicate a need to change the location of these stations.

If weather and river flow conditions permit, a set of data will be collected once each month in the first year, once every other month in the second and four times a year during the third and fourth years. Data will be presented as in the pre-operational study and any significant changes in D. O. or temperature patterns will be noted.

TABLE 2.2-1 (Continued)

b. Water Quality Monitoring - Operation of two Honeywell monitors at Stations 3 and 7 will continue. River temperatures at these locations will be reduced to hourly average temperatures from which daily and monthly average temperatures will be calculated and tabulated. D. O. will be tabulated as daily averages and as maxima and minima with their respective times of occurrence. pH will be tabulated as daily maxima, daily minima, and daily range. Turbidity and Conductivity will be tabulated as daily averages.

c. Laboratory Analysis of Water Quality Parameters - Laboratory analyses for selected water quality parameters will be conducted on a routine basis throughout the survey period. It is proposed to establish a 3 phase program for the sampling and analysis. Samples of water collected at the groundwater stations listed in Table 4.8.1c of Appendix A of the Technical Specifications shall be analyzed during the Spring and Fall for sulfates, sodium and chloride concentrations.

Phase I (First Year) - Grab samples for water quality parameters will be collected from each of six Vermont Yankee sample stations (Stations 1, 2, 3, 4, 5 and 7 on Figure 2.2) once every month during the first year. These samples will be analyzed for the following water quality parameters: pH, dissolved oxygen (D.O.) biochemical oxygen demand (BOD), total hardness, calcium hardness, chloride, sulfate, sulfite, total phosphorus, nitrate solids, cadmium, total chromium, copper, total iron, nickel, sodium, zinc, mercury, silver and lead.

If the BOD is found to be significantly different from that encountered in the pre-operational studies, a new determination of the deoxygenation constant, K_1 , will be made and other studies of the organic wastes in the stream will be undertaken.

Phase II (Second Year) - The sampling and analysis program of the second year will be identical to the 1969-1970 year long intensive sampling program at Stations 3 and 7. Samples at these two stations will be collected every 15 days ensuring a progression of sampling dates through each day of the week. Every other set of samples will be collected as a composite sample from noon one day to noon the following day. The alternative set of samples will be collected as a grab sample at one time. Water quality tests to be performed on these samples will be identical to those in the Phase I program.

TABLE 2.2-1 (Continued)

Phase III (Third and Fourth Years) - Samples taken for water quality analysis in the third and fourth years will be grab samples collected four times a year at Stations 3 and 7.

The parameters for which analyses will be performed will be the same as those in Phases I and II, unless this previous work indicates a need to modify the list of tests.

Variation in magnitude of these parameters in all years of study will be related in the volume of flow in the river. Other trends and changes will be noted in reports and be available for use in evaluation of the biological parameters.

3. Biological

a. Phytoplankton and Zooplankton Studies - If phytoplankton and zooplankton changes occur as a result of thermal enrichment in the river, it is probable that such changes will be evident during the first years of operation of Vermont Yankee. Therefore, the major emphasis in the first two years of operational biological studies will be on plankton. Samples will be collected from each of the six stations that were used in the pre-operational study. These stations are:

- a) Vermont Yankee Station 7 (midstream), 4.25 miles north of Vernon Dam. Average depth 35 feet.
- b) Vermont Yankee Station 5 (midstream), 1.25 miles north of Vernon Dam. Average depth 20 feet.
- c) Vermont Yankee Station 4 (New Hampshire quarter), 0.75 miles north of Vernon Dam. Average depth 9 feet.
- d) Vermont Yankee Station 4 (Vermont quarter), 0.75 miles north of Vernon Dam. Average depth 10 feet.
- e) Vermont quarter, 0.1 miles north of Vernon Dam. Average depth 49 feet.
- f) Vermont Yankee Station 3 (monitor), 0.65 miles south of Vernon Dam.

TABLE 2.2-1 (Continued)

Each station will be sampled monthly during the first through fourth years. An additional sample will be taken at each station during the months of May through October in the first and second year. Phytoplankton and zooplankton counts will be made in all samples collected and planktons will be identified to the appropriate level.

b. Benthic Fauna - Samples of benthic fauna from each of the six Vermont Yankee Stations will be collected once during the months of May and August in the first and in the fourth year. One sample from each station will be collected monthly in May through December in the second and third year. In the third year the program will be intensified by the collection of an additional sample set each month in June, July, August and September. The number of genera at each station will be determined and the relative abundance of each genus will be recorded.

c. Fish - In the first year the collection of approximately 500 fish above and below Vernon Dam will be made. All fish will be weighed and measured and representative scale samples will be taken for age-growth determination. Preliminary age-growth studies will be completed during the first year as well as the completion of age-growth studies from the pre-operational sampling programs. In the second year a collection of approximately 750 fish above and 750 fish below Vernon Dam will be made. All fish will be weighed and measured. Scale samples will be taken for age-growth determinations. In the third year a collection of approximately 2,000 fish above and 2,000 fish below Vernon Dam will be made. During the third year, these data, as well as previous data, will be used to determine and prepare a detailed report regarding the growth rates in the fish population both above and below Vernon Dam. In the fourth year, a collection of approximately 1,000 fish upstream and downstream of Vernon Dam for final age-growth determination, species diversity and weights will be completed. Species make-up and population changes, if they occur, will be compared with pre-operational data.

d. Vascular Plants - In the first, second and fourth years, vascular plant studies will be limited primarily to the observation of two marshes which were examined in considerable detail in the pre-operational studies. Any unusual changes will be noted and recorded. During the third year transect studies will be completed in these marshes duplicating the methods used in the pre-operational survey of these areas.

TABLE 2.2-1 (Continued)

4. Entrainment

The following studies will be conducted to better understand the immediate effects of the entrainment:

1. Phytoplankton and zooplankton samples will be taken in the cooling water intake and discharge structures when the plant is operating in an open cycle mode. Samples will be taken bi-weekly at approximately two week intervals. Each sample will be analyzed to determine the number of organisms present per unit volume of water and the dominant organisms present will be identified. The number of organisms surviving in the discharge sample will be determined by generally accepted methods and recorded.

2. Fish larvae in the samples mentioned in (1) above will be counted and identified.

3. When the plant is operating in a closed cycle mode phytoplankton and zooplankton samples will be taken in the service water intake structure. Samples will be taken bi-weekly at approximately two week intervals and analyzed as noted in (1) and (2) above.

5. Sound Studies - An environmental sound survey will be conducted during the first year of plant operation. The survey will be conducted during at least two seasons of the year. It will consist of sound pressure level measurements taken at 12 sampling points described below. These sampling points are the same as those for which background sound level measurements are available. The sample points are as follows:


1. North property line of Vermont Yankee
2. Closest residence to Vermont yankee - Zalusny home
3. Gasoline station at the entrance road
4. Vernon school
5. Hinsdale school
6. Home on the east shore of the river opposite the plant
7. Intersection of New Hampshire Route No. 119 and dirt road to shoreline opposite Vermont Yankee
8. Water Quality Monitor No. 3
9. Entrance gate to Hinsdale Race Track
10. Home in New Hampshire (Paul Aust house)
11. Route No. 142, west of Vernon school
12. Route No. 142, in parking lot of Vernon Post Office

TABLE 2.2-1 (Continued)

Sound level measurements will be taken on the "A", "B", "C" and "All Pass (Linear)" scales with analyses in 10 preferred frequency bands ranging from 31.5 Hz to 32,000 Hz.

A report will be issued reporting the results of the environmental sound survey.

VERMONT YANKEE SAMPLE STATIONS CONN. RIVER

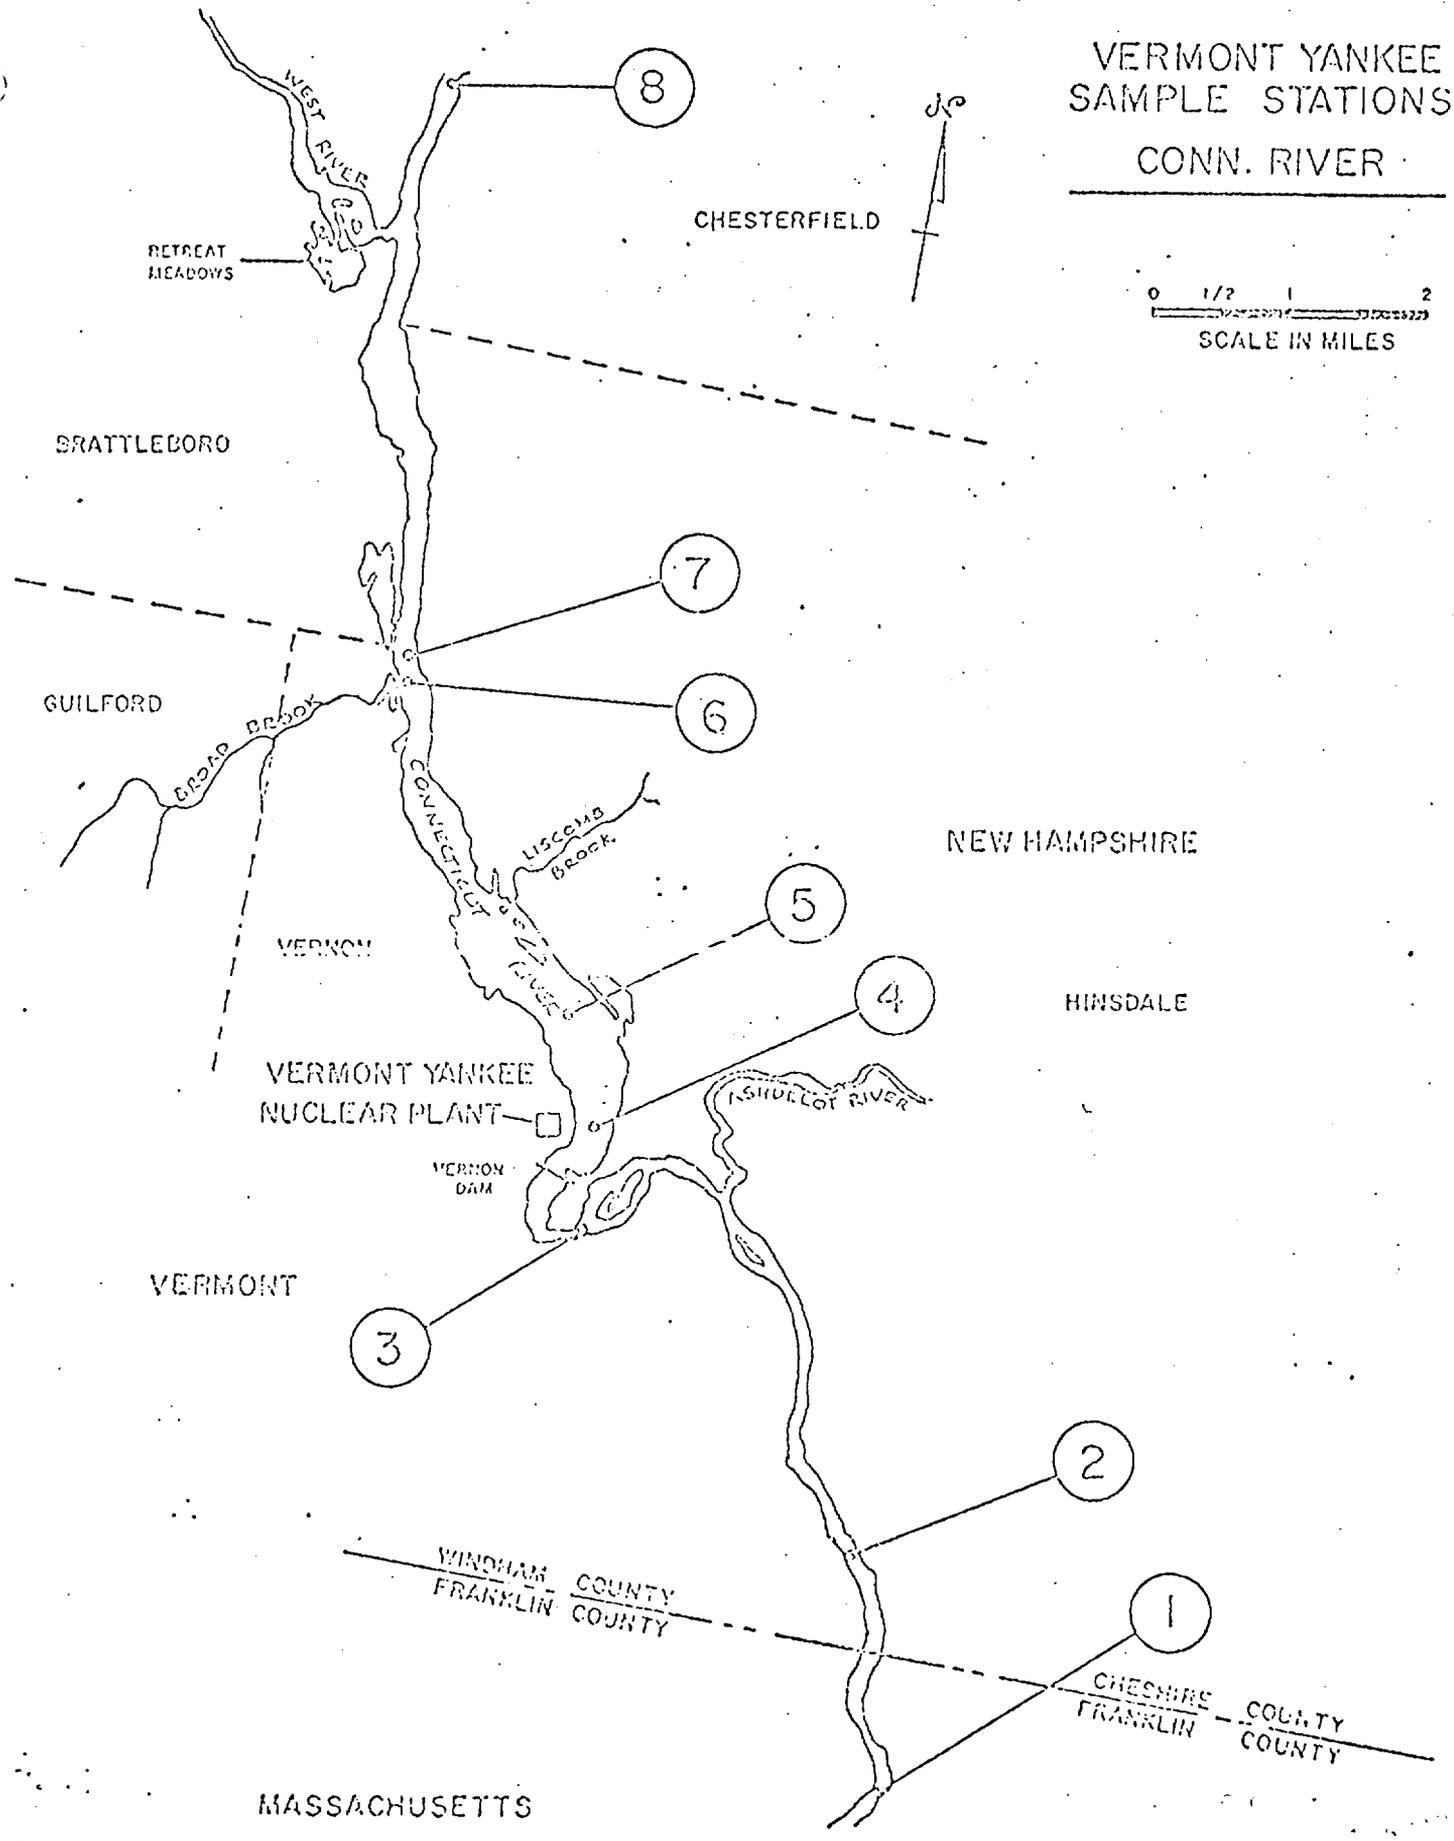

RETREAT MEADOWS

CHESTERFIELD

BRATTLEBORO

GUILFORD

BROAD BROOK

LISCOMB BROOK

NEW HAMPSHIRE

VERNON

VERMONT YANKEE NUCLEAR PLANT

VERNON DAM

HINSDALE

VERMONT

WINDHAM COUNTY
FRANKLIN COUNTY

CHESHIRE COUNTY
FRANKLIN COUNTY

MASSACHUSETTS

0 1/2 1 2
SCALE IN MILES

TABLE 2.2-2

VERMONT YANKEE OPERATIONAL STUDIES
YEARLY SAMPLING TIMES/NUMBER STATIONS

	First Year		Second Year		Third Year		Fourth Year	
	Number Sampling Times	No. Stations	Number Sampling Times	No. Stations	Number Sampling Times	No. Stations	Number Sampling Times	No. Stations
<u>Hydrology</u>	12	1	12	1	12	1	12	1
<u>Water Quality</u>								
D.O. & Temperature	9*	6	5*	6	4	5	4	6
Water Quality Monitor	Continuous	2	Continuous	2	Continuous	2	Continuous	2
Laboratory	12*	6	24	2	4	2	4	2
<u>Biological</u>								
Phytoplankton	18	6	18	8	12	6	12	6
Zooplankton	18	6	18	6	12	6	12	6
Benthic Fauna	2*	6	9*	6	13*	6	2*	6
Fish	**	6	**	6	**	6	**	6
Vascular Plants	1	2	1	2	12	2	1	2

*Estimated - Actual Number of Sampling Times will depend on weather conditions.

**Actual Number of Sampling Times will depend on success of sampling.

BASES - OPERATIONAL MONITORING PROGRAM

Environmental changes as a result of the Vermont Yankee Nuclear Power Plant operation may occur at various rates for different physical, chemical and biological parameters. Biological changes as a result of thermal enrichments do not occur at all biological levels at the same time. In general, lower forms of life such as zooplankton and phytoplankton respond more quickly to warmer temperatures than do such higher forms as fish and vascular plants. In view of this fact, a graded program of monitoring of different ecological parameters is planned. Emphasis of plankton, bottom fauna and water chemistry will be made during the first three (3) years of the study. Fish and vascular plants will have major study emphasis in the second through fourth years. All parameters will be studied each year to some degree and the various programs will be kept flexible enough to accommodate any indicated need for a change in emphasis or an immediate expansion of the monitoring program.

Instrumentation calibration will be performed bi-weekly. The temperature monitor is calibrated to 0.1°F, the conductivity sensor is calibrated to $\pm 0.75\%$ full scale at 25°C and the dissolved oxygen sensor is calibrated to 0.1 ppm.

The following lists the sensitivity of the techniques used in water quality analysis:

pH	0.001
Alkalinity	0.1 mg/liter
Total Hardness	1.0 mg/liter
Calcium Hardness	1.0 mg/liter
Chloride	0.1 mg/liter
Sulfate	0.1 mg/liter
Total Phosphate	0.01 mg/liter
Ortho Phosphate	0.01 mg/liter
Nitrate Nitrogen	0.01 mg/liter
Ammonia Nitrogen	0.01 mg/liter
Color	0.5 Standard Units
Turbidity	0.01 Formazin turbidity units
Total Solids	1.0 mg/liter
Fixed Total Solids	1.0 mg/liter
Settleable Solids	0.1 mg/liter
Mercury	0.0005 mg/liter
Cadmium	0.001 mg/liter
Chromium	0.005 mg/liter
Copper	0.02 mg/liter
Iron	0.01 mg/liter
Lead	0.005 mg/liter
Nickel	0.1 mg/liter
Chlorine Residual (Free)	0.02 mg/liter
Total Chlorine Residual	0.05 mg/liter

(Chemical)

UNITED STATES ATOMIC ENERGY COMMISSION

DOCKET 50-271

VERMONT YANKEE NUCLEAR POWER CORPORATION

NOTICE OF ISSUANCE OF AMENDMENT TO FACILITY OPERATING LICENSE

Pursuant to an Initial Decision of the Atomic Safety and Licensing Board, issued February 27, 1973, notice is hereby given that the Atomic Energy Commission (the Commission) has issued Amendment No. 5 to Facility Operating License No. DPR-28 to Vermont Yankee Nuclear Power Corporation (Vermont Yankee) which authorizes full-term operation of the Vermont Yankee Nuclear Power Station (the facility) at steady state power levels not to exceed 1593 megawatts thermal in accordance with the Technical Specifications attached as appendices "A" and "B" thereto. The facility is a single cycle, forced circulation, boiling water reactor located at the licensee's site in Windham County, Vermont.

On March 21, 1972 the Commission issued Facility Operating License No. DPR-28 pursuant to an Initial Decision of the Atomic Safety & Licensing Board, issued March 14, 1972 which authorized fuel loading and low-power testing at power levels not to exceed 15.9 megawatts thermal (1% of the rated power level of the facility). Amendment No. 1 issued April 21, 1972, authorized receipt, possession and use of additional source and special nuclear materials. Amendment No. 2 issued September 7, 1972, authorized temporary operation at thermal power levels not to exceed 318.6 (20% of the facility's rated power). Amendment No. 3 issued on October 12, 1972, authorized temporary operation of the facility at steady state power levels not to exceed 1593 megawatts thermal.

Amendment No. 4 issued on January 8, 1973, authorized receipt, possession and use of up to 3300 kilograms of U-235 and 16 grams of plutonium in connection with the operation of the facility.

The Commission's regulatory staff has inspected the facility and has determined that, for operation as authorized by the amended license, the facility has been constructed in accordance with the application, as amended, the provisions of Provisional Construction Permit No. CPPR-36, as amended, the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations. The licensee has submitted proof of financial protection in satisfaction of the requirements of 10 CFR Part 140.

The Board has concluded that the facility will operate in conformity with the application, as amended, the provisions of the Act, and the rules and regulations of the Commission and will not be inimical to the common defense and security or to the health and safety of the public and that Vermont Yankee is technically and financially qualified to engage in the activities authorized by the amended license. The Board, after weighing the environmental, economic, technical and other benefits of the facility against environmental costs and considering available alternatives, concluded that issuance of the amended operating license (subject to the conditions for protection of the environment set forth therein) is in accordance with 10 CFR Part 50, Appendix D, of the Commission's regulations and that all applicable requirements of said Appendix D have been satisfied.

The license as amended is effective as of the date of issuance and shall expire at midnight on December 11, 2007.

Copies of (1) the Initial Decision, dated February 27, 1973, (2) Amendment No. 5 to Facility Operating License No. DPR-28 and the Technical Specifications attached as Appendices A and B thereto, (3) the Safety Evaluation for the Vermont Yankee Nuclear Power Station, dated June 1, 1971, and Supplements 1 and 2, thereto, dated July 7, 1971, and July 19, 1971, respectively and the report of the Advisory Committee on Reactor Safeguards, dated March 9, 1971, and attached to the Safety Evaluation as Appendix A, (4) Draft Detailed Statement on the Environmental considerations Related to the Proposed Issuance of an Operating License to the Vermont Yankee Nuclear Power Station, dated April 7, 1972; and (5) the Final Environmental Statement, dated July 1972, are available for public inspection in the Commission's Public Document Room, 1717 H Street, N.W., Washington, D.C. and at the Brooks Memorial Library, 224 Main Street, Brattleboro, Vermont. Copies of items (2), (3), and (5) may be obtained upon request addressed to the Atomic Energy Commission, Washington, 20545, Attention: Deputy Director for Reactor Projects, Directorate of Licensing.

Dated at Bethesda, Maryland, this 28th day of February, 1972.

FOR THE ATOMIC ENERGY COMMISSION

Walter R. Butler
Walter R. Butler, Chief
Boiling Water Reactors Branch 1
Directorate of Licensing

CHECKLIST FOR ISSUANCE OF FACILITY LICENSE

Applicant Vermont Yankee Nuclear Power Corporation

Facility Vermont Yankee Nuclear Power Station

Project Leader Gerald Owsley

Licensing Assistant Madelyn Maignet

Date

Notice of Intent to Issue License:

Published in Federal Register

Action Date

N/A
N/A

OR

Initial Decision ~~on Order~~ for Amend. #5 100% Full-power, full-term 40 year license.

2/27/73

Environmental Review:

Final Environmental Statement

Published in Federal Register

July 1972
12 July 72
(FR 37 13655)

OR

Mini-Review Discussion & Findings Issued

Water Quality Certification:

Submitted by Applicant

Transmitted to EPA

Yes - Date Unknown
12/11/70

License Fee:

Amount: \$149,815 increase from the 20% fee.

Paid ~~on 7/1/72~~ July 1972 Annual fee for 1973 due March 21, 1973.

10/12/72

Indemnity Agreement:

OAI Concurrence issued with DPR-28, March 24, 1972

J. Saltzman 3/24/72

Regulatory Operations Final Report:

(attach copy if available)

Technical Specifications: Issued with 1% license 3/21/72

RP Concurrence

Appendix B reissued 2/28/73

EP Concurrence

3/20/72

2/28/73

Public Announcement (to be released):

~~(attach copy if available)~~

Copy attached.

3/1/73

Issuance Package: OGC Concurrence

1. License
2. Federal Register Notice
3. Letter to Applicant
4. Memorandum to Commission

2/28/73
2/28/73
2/28/73
3/2/73

License Approved By:


A. Giambusso, Deputy Director for RP

2/28/73
(Date)

AEC ISSUES FULL TERM OPERATING LICENSE FOR
VERMONT YANKEE NUCLEAR POWER STATION

The Atomic Energy Commission has issued a full term license to Vermont Yankee Nuclear Power Corporation for full power operation of its nuclear power ^{station} plant at Vernon, Vermont. The term of the license is 40 years from December 1967 -- the date the construction permit was issued.

A temporary full power license, which expired ^{on} February 28, 1973, was issued to the company on October 12, 1972, following a public hearing conducted by an Atomic Safety and Licensing Board. This temporary license was issued under legislative authority granted to the Commission by Congress in June 1972 in an amendment to the Atomic Energy Act designed to meet specified energy needs.

Issuance of the full term license was authorized by a February 27 decision of the Atomic Safety and Licensing Board which conducted ~~a~~ public hearings on the application for a full term, full power license between August 10, 1971 and November 9, 1972.

The facility uses a boiling water reactor ^{in its nuclear steam supply system} and is located on the west shore of the Connecticut River near ^{Vermont} Vernon. At full power, it is capable of producing approximately 514,000 electrical kilowatts.