DWG. NO. MC-ISIN-1567-03.00 REV 0

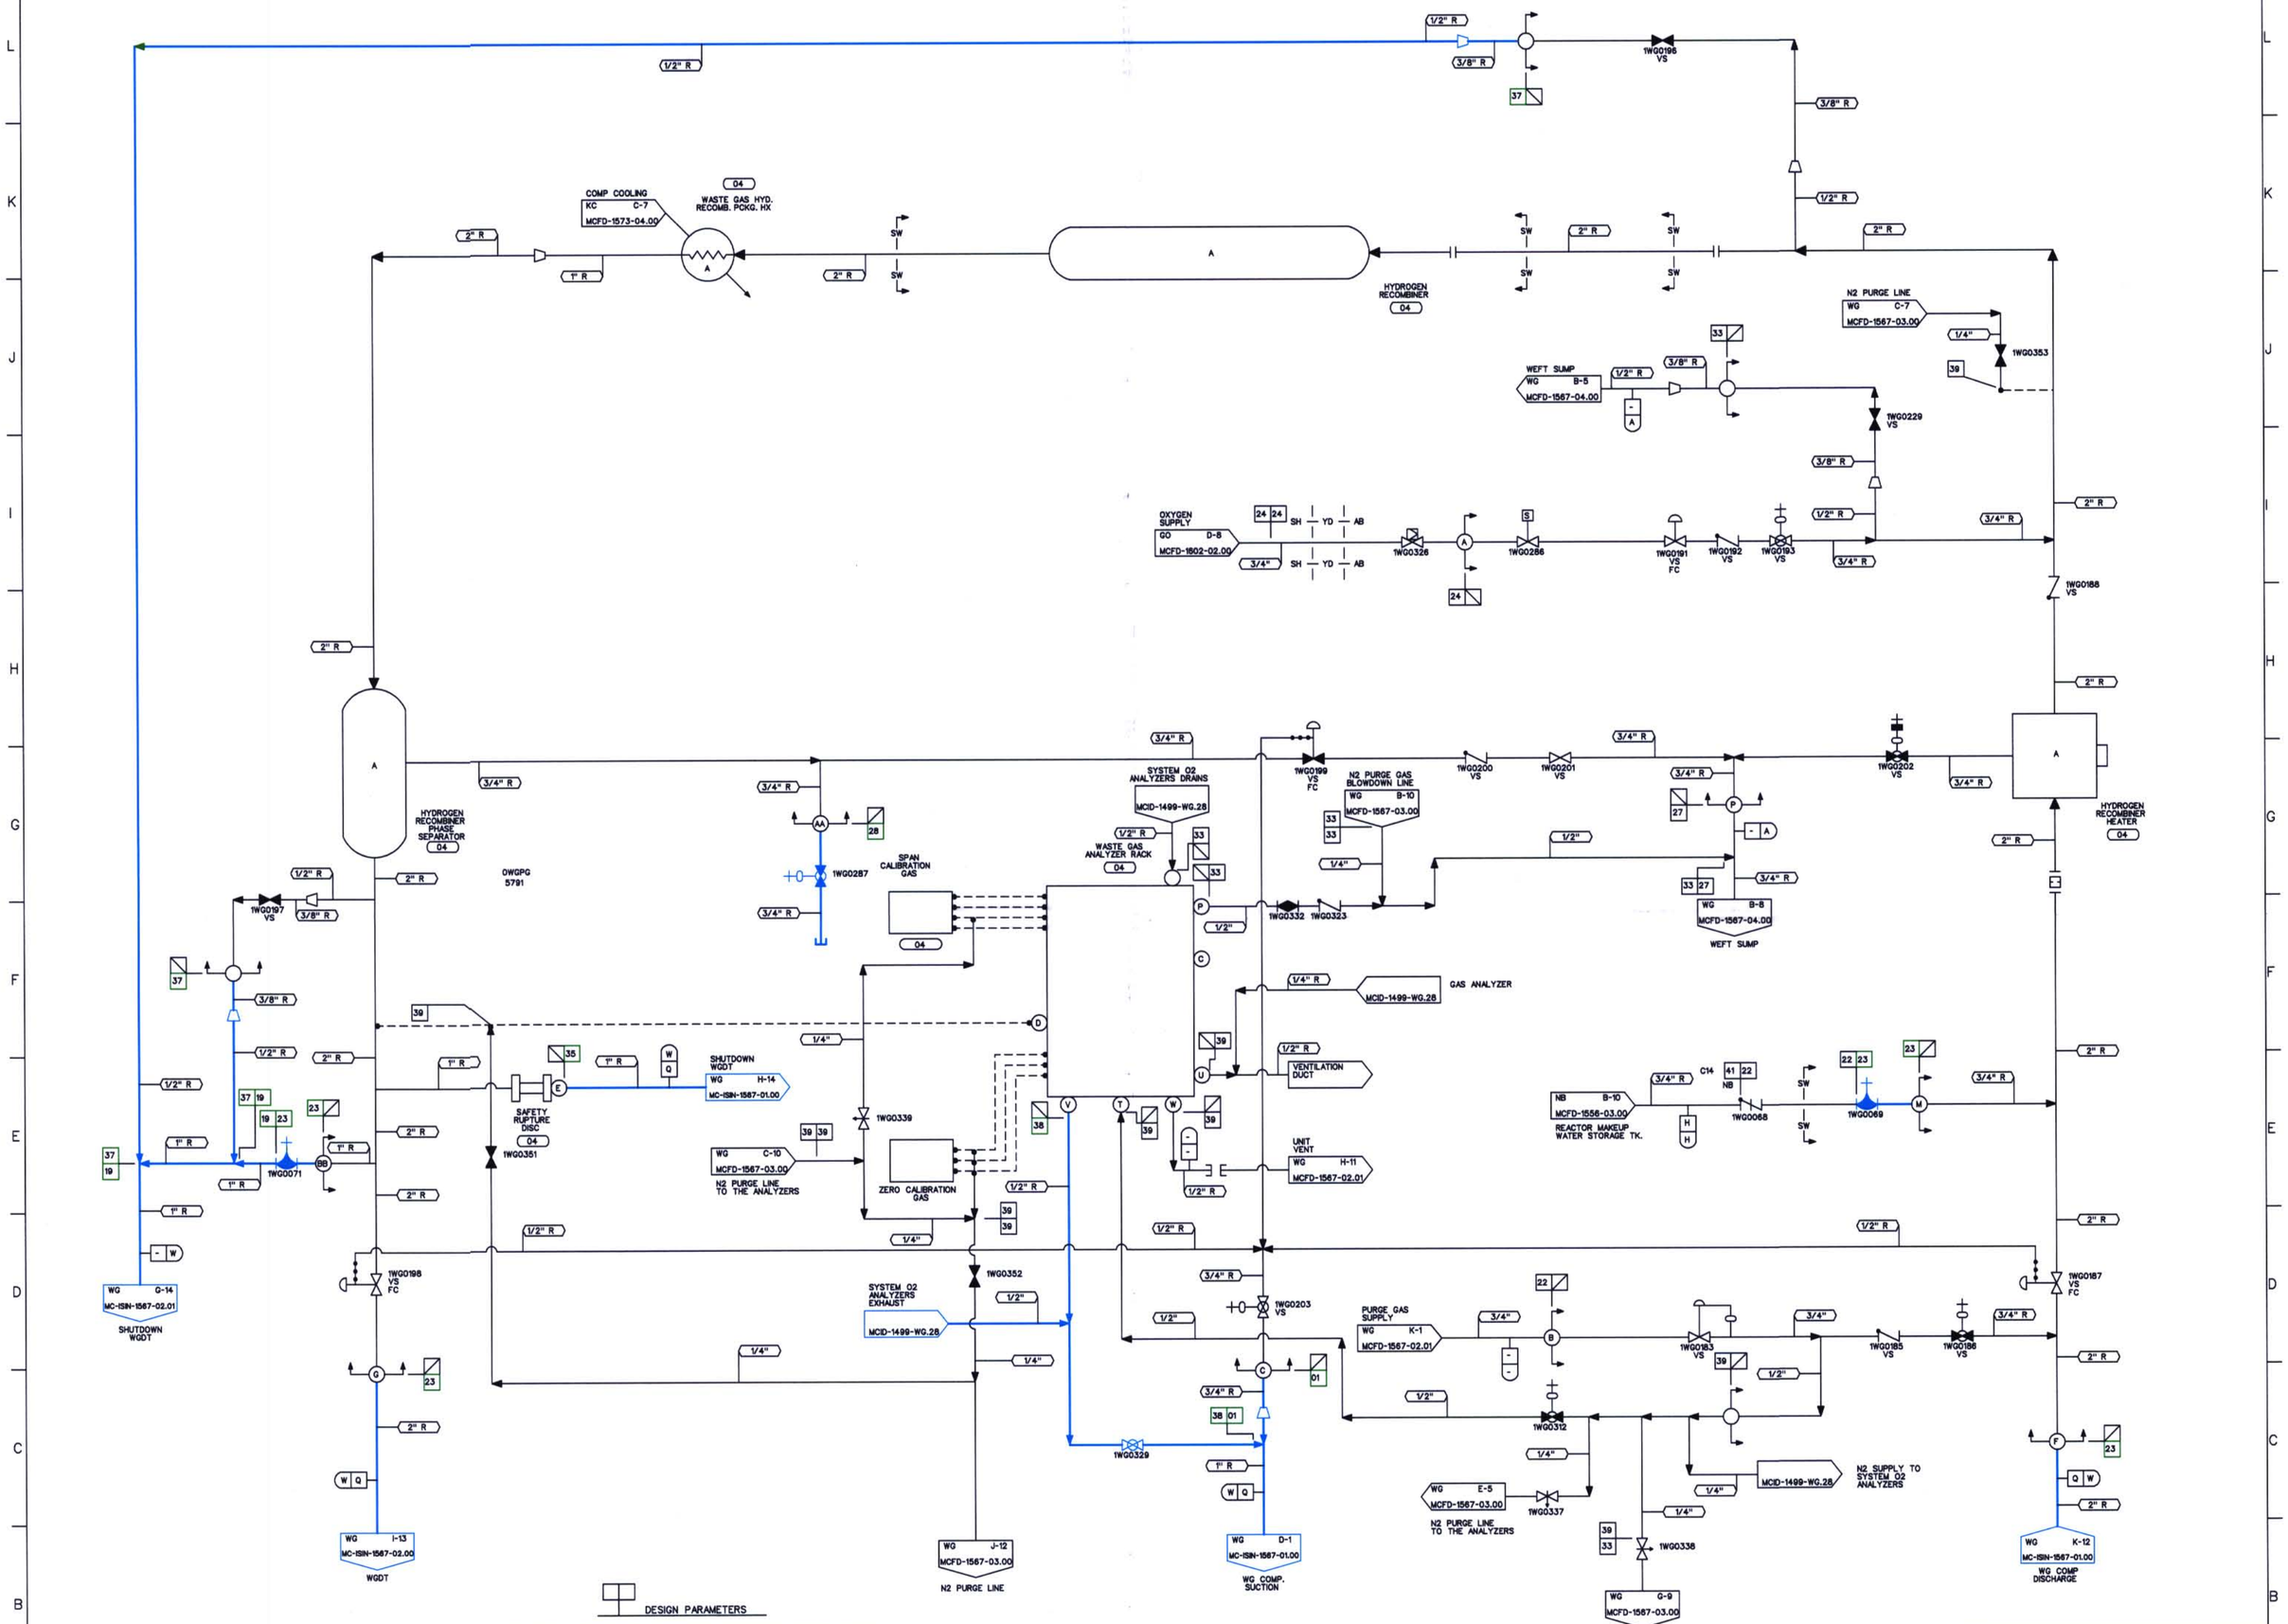

DESIGN PARAMETERS

LINE LISTING	PIPE SPEC.	PRESSURE	TEMPERATURE	CLASS	MATERIAL
NB41	PS 151.4	30 PSIG	100 F	E	SS
WG01	PS 151.3	100 PSIG	200 F	C	SS
WG19	PS 150.3	150 PSIG	140 F	C	CS
WG22	PS 151.4	150 PSIG	140 F	E	SS
WG23	PS 151.3	150 PSIG	140 F	C	SS
WG24	PS 151.4	100 PSIG	140 F	Q	SS
WG27	PS 151.4	150 PSIG	140 F	E	SS
WG28	PS 151.3	150 PSIG	140 F	C	SS
WG33	TS 2701.1	150 PSIG	140 F	E	ST
WG35	PS 150.3	100 PSIG	140 F	C	CS
WG37	TS 2701.1	150 PSIG	140 F	C	ST
WG38	TS 2701.1	100 PSIG	200 F	C	ST
WG39	TS 2701.1	100 PSIG	140 F	E	ST

NOTES:

1. PIPING SHOWN IN BLUE IN THE FOLLOWING LINE LISTINGS IS EXEMPT DUE TO NOT BEING CONSIDERED A PART OF D-A CATEGORY PER ENG. NOTE DATED 5/22/00: WG01, WG19, WG23, WG28, WG35, WG37, WG38.

LEGEND

- ISI CLASS 1
- ISI CLASS 2
- ISI CLASS 3
- ISI EXEMPT
- NON-ISI

THIS DRAWING IS FOR INSERVICE INSPECTION ONLY AND SHALL NOT BE USED FOR OTHER PURPOSES SUCH AS MAINTENANCE, MODIFICATION, OR REPAIRS. THIS DRAWING SHALL BE REVISED WHEN AS-BUILT CHANGES AFFECT THE INSERVICE INSPECTION BOUNDARIES AND DETAILS OF THE COMPONENTS/SYSTEMS SHOWN.

NO.	REVISIONS	DRN	DATE	CHKD	DATE	APPR	DATE
ORIG	RELEASED FOR ISI USE ONLY	TDM	11-7-00	GDS	11-13-00	RKR	12-14-00

W A I V E D — INSPECTED: CIVIL, ELEC., MECH

QA CONDITION 1 AND 2

DUKE POWER COMPANY
MCGUIRE NUCLEAR STATION UNIT 1 AND 2

ASME SECTION XI
INSERVICE INSPECTION NDE BOUNDARY OF
WASTE GAS SYSTEM (WG)

DESIGNER	TIM MYERS	DATE 11-7-00	INSP.	WAIVED	DATE —
DRAWN	TIM MYERS	DATE 11-7-00	INSP.	WAIVED	DATE —
CHECKED	GARY D SCARBORO	DATE 11-7-00	APPR.	R. KEVIN RHYNE	DATE 12-14-00

SCALE — DWG. NO. MC-ISIN-1567-03.00 — REV 0

REFERENCE FLOW DIAGRAM
MCFD-1567-03.00 REV. 2
ERN: MC0099X9

D-42