12/13/99

Comments on NRC Draft Screening Criteria for Assessing Potential Seismic Vulnerabilities of Spent Fuel Pools at Decommissioning Plants – December 3, 1999 NRC Memorandum

Summary of NRC Draft

To increase the efficiency and effectiveness of decommissioning regulations, the NRC staff has engaged in rulemaking activities that would reduce the need to routinely process exemptions once a plant is permanently shut down. The December 3, 1999 memorandum from W. Huffman to S. Richards (Reference 1) provides a summary of the staff's current concerns regarding a screening criteria for assessing potential seismic vulnerabilities to spent fuel pools (SFP) at decommissioning plants. Attachments to this memorandum contain suggested enhancements to the proposed seismic checklist and also excerpts from an independent technical review by Dr. Robert Kennedy. The report by Kennedy endorsed the feasibility of the use of a seismic screening concept. The Kennedy report identified eight sites for which the seismically induced probability of SFP failure is greater than 3.0×10^{-6} using the LLNL 93 hazard data.

The seismic risk of failure of the spent fuel pool can be estimated by rigorously convolving a family of fragility curves with a family of seismic hazard curves (Reference 2), or by simplified approximation methods. Two simplified methods are described in the attachments to the December 3, 1999 memorandum (Reference 1).

The first simplified method was presented by the Staff in their preliminary draft of June 16, 1999 (Reference 3). This method is based on use of the SFP high confidence low probability of failure (HCLPF) value and the simplifying assumption that the conditional probability of SFP failure is about a factor of 20 less than the annual probability of exceeding the SFP HCLPF value. Given that the SFP HCLPF value is more than or equal to three times the SSE (and less than 10^{-5}) then the SFP failure frequency should be less than 5×10^{-7}. This simplified method is based on use of peak ground acceleration (PGA) curves.

The second simplified method was suggested by Kennedy and is based on use of spectral acceleration (S_a) rather than PGA. Kennedy states that damage to structures, systems, and components (SSCs) does not correlate well to PGA ground motions but correlates much better with spectral accelerations between 2.5 and 10 Hz at nuclear power plants. Based on previous studies Kennedy proposes to screen SFPs based on use of the peak spectral acceleration (PSA) HCLPF seismic capacity of 1.2g. This value is equivalent to 0.5g PGA. This simplified approach is based on calculating the 10% conditional probability of failure capacity ($C_{10\%}$) given the PSA value of 1.2g. Using Equation 6 in the Reference 1 attachment results in a $C_{10\%}$ S_a value of 1.82g. The annual probability of exceeding this value at 10, 5 and 2.5 Hz is then calculated using the LLNL hazard results. These value are then multiplied by 0.5 and the highest of the 10, 5, and 2.5 Hz results is used as the SFP failure probability. For example, the $C_{10\%}$ at 5 Hz is 1.82g or about 56.8 cm/sec spectral velocity. For LLNL site 1, the annual probability of

Q/128

exceeding 56.8 cm/sec is about 2.0×10^{-6}. This value is multiplied by 0.5 which results in a SFP failure probability for site 1 of about 1.0×10^{-6}. This same calculation is performed at 10 and 2.5 Hz.

Based on comparisons made by Kennedy he concludes that simplified method 1 (Reference 3) underestimates the seismic risk by factors of 2.3 and 3.5 for Vermont Yankee and Robinson respectively. Using simplified method 2 the seismic risk is overestimated by 20% and 5% respectively for these two cases.

Kennedy noted that in his judgement it will be necessary to have seismic fragility HCLPF computations performed on at least six different aboveground SFPs with walls not supported by soil before HCLPF screening levels can be established for these SFPs.

Recommendation Number 4 of the December 3, 1999 memorandum requested that industry provide input concerning:

a. the list of high hazard sites,
b. a credible ground motion description at which the seismic hazard frequency is low enough at these sites, and
c. plant specific seismic capacity evaluations using credible ground motion descriptions at these sites.

Recommendation Number 5 requests that industry propose treatment of sites West of the Rocky Mountains.

Preliminary Industry Comments

Industry concurs that use of a seismic screening checklist is an excellent approach to plant-specific seismic assessments. In addition, we will incorporate into our earlier seismic checklist those suggestions presented in Recommendation numbers 1, 2, and 3 to the December 3, 1999 memorandum.

With respect to the simplified methods to estimate seismic failure frequency of SFP failure the method proposed by Kennedy appears to be reasonable.

In the recommendations section of the 12/3/99 memorandum (Reference 1) some actions by industry are proposed. Recommendation Number 4.b requests that industry recommend a credible ground motion description at which the seismic hazard frequency is low enough at these "high" hazard sites. These "high" hazard sites were identified based on use of the Kennedy simplified SFP failure methodology and the LLNL 1993 hazard results. The response to

Recommendation Numbers 4.a and 4.c are dependent on the resolution of 4.b.

Comments on Recommendation Number 4.b

1. Using the Kennedy simplified SFP failure methodology $C_{10\%}$ values are determined at 10, 5, and 2.5 Hz. At 5 Hz the spectral acceleration value is 1.82g or about 56.8 cm/sec.

2. The PSA values associated with these $C_{10\%}$ values are consistent with spectral values which describe the San Onofre and Diablo Canyon SSEs, i.e., large magnitude, near field earthquakes.

3. The issue of large earthquakes occurring near EUS NPPs was resolved by the Charleston Issue (SECY-91-135, Reference 4). As stated in SECY-91-135, "Large 1886 Charleston-size earthquakes, greater than or equal to magnitude 6.5, are not significant contributors to the seismic hazard for nuclear facilities along the eastern seaboard outside the Charleston region. This result is consistent with the results emerging from the ongoing studies of earthquake-induced liquefaction features along the eastern seaboard. These studies have found no evidence of large prehistoric earthquakes originating outside the South Carolina region. Thus the issue of the Charleston earthquake occurring elsewhere in the eastern seaboard is considered to be closed."

4. Credible, versus not credible in terms of annual probability, is typically associated with greater than about 10^{-6} (credible) and 10^{-6} or less (not credible). Within the context of the Kennedy simplified SFP failure methodology, if the annual probability of exceeding the screening level value (for example 56.8 cm/sec at 5 Hz) times 0.5 is less than 10^{-6}, then only the seismic checklist must be satisfied. Implicit in this approach is that the probabilistic estimates at the $C_{10\%}$ level are credible.

5. For a site to be screened out the $C_{10\%}$ value should be on the order of 10^{-6}. Figure 1 (attached) shows the 5 Hz spectral acceleration values associated with the 10^{-6} LLNL results at each of the 69 sites. As can be seen, for site number 36 (which in Table 3 of the Kennedy report is the site with the highest SFP failure frequency) the 10^{-6} spectral acceleration is about 7,700 cm/sec^2 or about 245 cm/sec. As stated previously, 57 cm/sec is consistent with 5 Hz spectral velocities associated with a magnitude 6.6 earthquake 8 km from the site (San Onofre SSE), therefore these predicted groundmotions must be associated with a very large earthquake, greater than magnitude 6.5, very near to the site – which is counter to the conclusions of SECY-91-135. Other values at other sites are equally incredible. Based on these results, it is concluded that the LLNL results, at the probability/ground motion levels of interest, are deterministically incredible and therefore their use in screening is questionable. Figure 2 (attached) shows the 5 Hz spectral acceleration values associated with the 10^{-6} EPRI results. As can be seen, the EPRI

results, at the probability/ground motion levels of interest, are credible, and consistent with SECY-91-135.

5. Figure 3 (Figure 2 from NUREG-1488, Reference 5) illustrates the problems associated with the LLNL results at high ground motions/low annual probabilities. As can be seen from Figure 3, at high probabilities there is reasonable agreement between LLNL and EPRI. However, the slope of the LLNL results at high ground motions is too shallow. The effect of this shallow slope is to predict incredible ground motions at credible probability levels.

6. Based on this review, industry contends that it would be appropriate to only use EPRI results in the SFP seismic screening analysis. We believe this to be reasonable in light of the difficulties associated with the LLNL results at low probabilities. The effect of using only the EPRI results is shown in column 3 of Table 3 in the Kennedy report (Reference 1). As can be seen, only 1 plant would be required to perform further analyses. However, because both LLNL and EPRI are considered to provide valid results, it is proposed that the results from each study be geometrically averaged such that equal weight is provided the results from each study. Arithmetic averaging is considered unacceptable in light of the difficulties associated with the LLNL results. Figure 4 provides the results of geometrically averaging the LLNL and EPRI results.

Comments on Recommendation Number 4.a

Based on Figure 4 about 6 sites would be preliminarily screened in due to exceeding the 10^{-6} criterion. One of the 6 sites is Shoreham. If these screened in SFPs are above ground then further analyses will be required.

Comments on Recommendation Number 4.c

It is industry's understanding of Section 4.2 of the Kennedy report that given that a plant satisfies the seismic screening checklist then the SFP is likely to have a seismic capacity higher than the screening level capacity. If plant-specific information is conveniently available, additional seismic capacity values will be developed in a manner similar to that described in NUREG/CR-5176.

Comments on Recommendation Number 5

A response to the NRC Recommendation Number 5 requesting industry to provide "Proposed treatment of sites West of the Rocky Mountains" will be provided later. However, as a result of detailed deterministic investigations at and around each site, a better understanding of the sources and causes of earthquakes is developed in the licensing of Western U.S. (WUS) plants.

Therefore, it would be reasonable to describe the credible ground motion for WUS sites deterministically.

References:

1. Memorandum, W. Hauffman to S. A. Richards, USNRC, Screening Criteria for Assessing Potential Seismic Vulnerabilities of Spent Fuel Pools at Decommissioning Plants, December 3, 1999.

2. NUREG/CR-5176, Seismic Failure and Cask Drop Analyses of the Spent Fuel Pools at Two Representative Nuclear Power Plants, Lawrence Livermore National Laboratory, January 1989.

3. USNRC, Preliminary Draft Technical Study of Spent Fuel Pool Accidents for Decommissioning Plants, June 16, 1999.

4. SECY-91-135, Conclusions of the Probabilistic Seismic Hazard Studies Conducted for Nuclear Power Plants in the Eastern United States, May 14, 1991.

5. NUREG-1488, Revised Livermore Seismic Hazard Estimates for 69 Nuclear Power Plant Sites East of the Rocky Mountains, October, 1993.

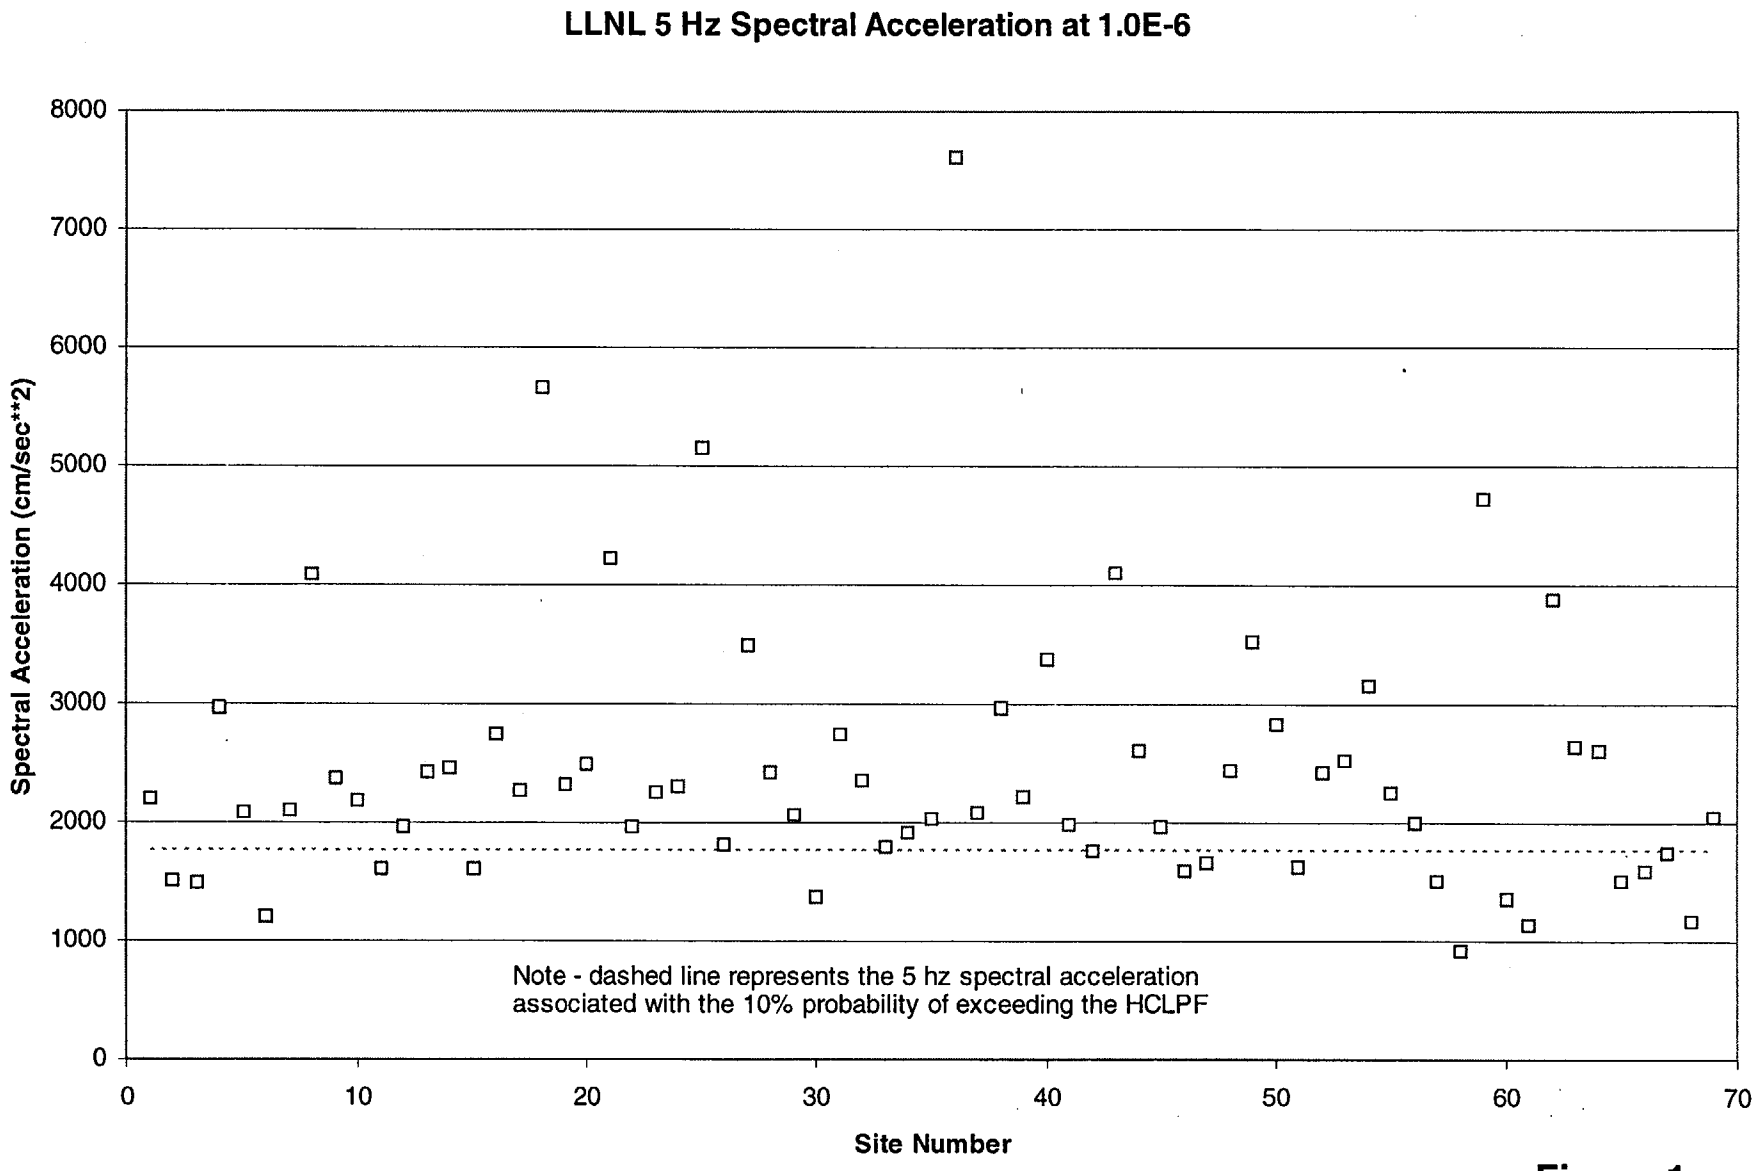
LLNL 5 Hz Spectral Acceleration at 1.0E-6
Spectral Acceleration (cm/sec**2)
8000
7000
6000
5000
4000
3000
2000
1000
0
0
10
20
30
40
50
60
70
Site Number
Note - dashed line represents the 5 hz spectral acceleration associated with the 10% probability of exceeding the HCLPF

Figure 1

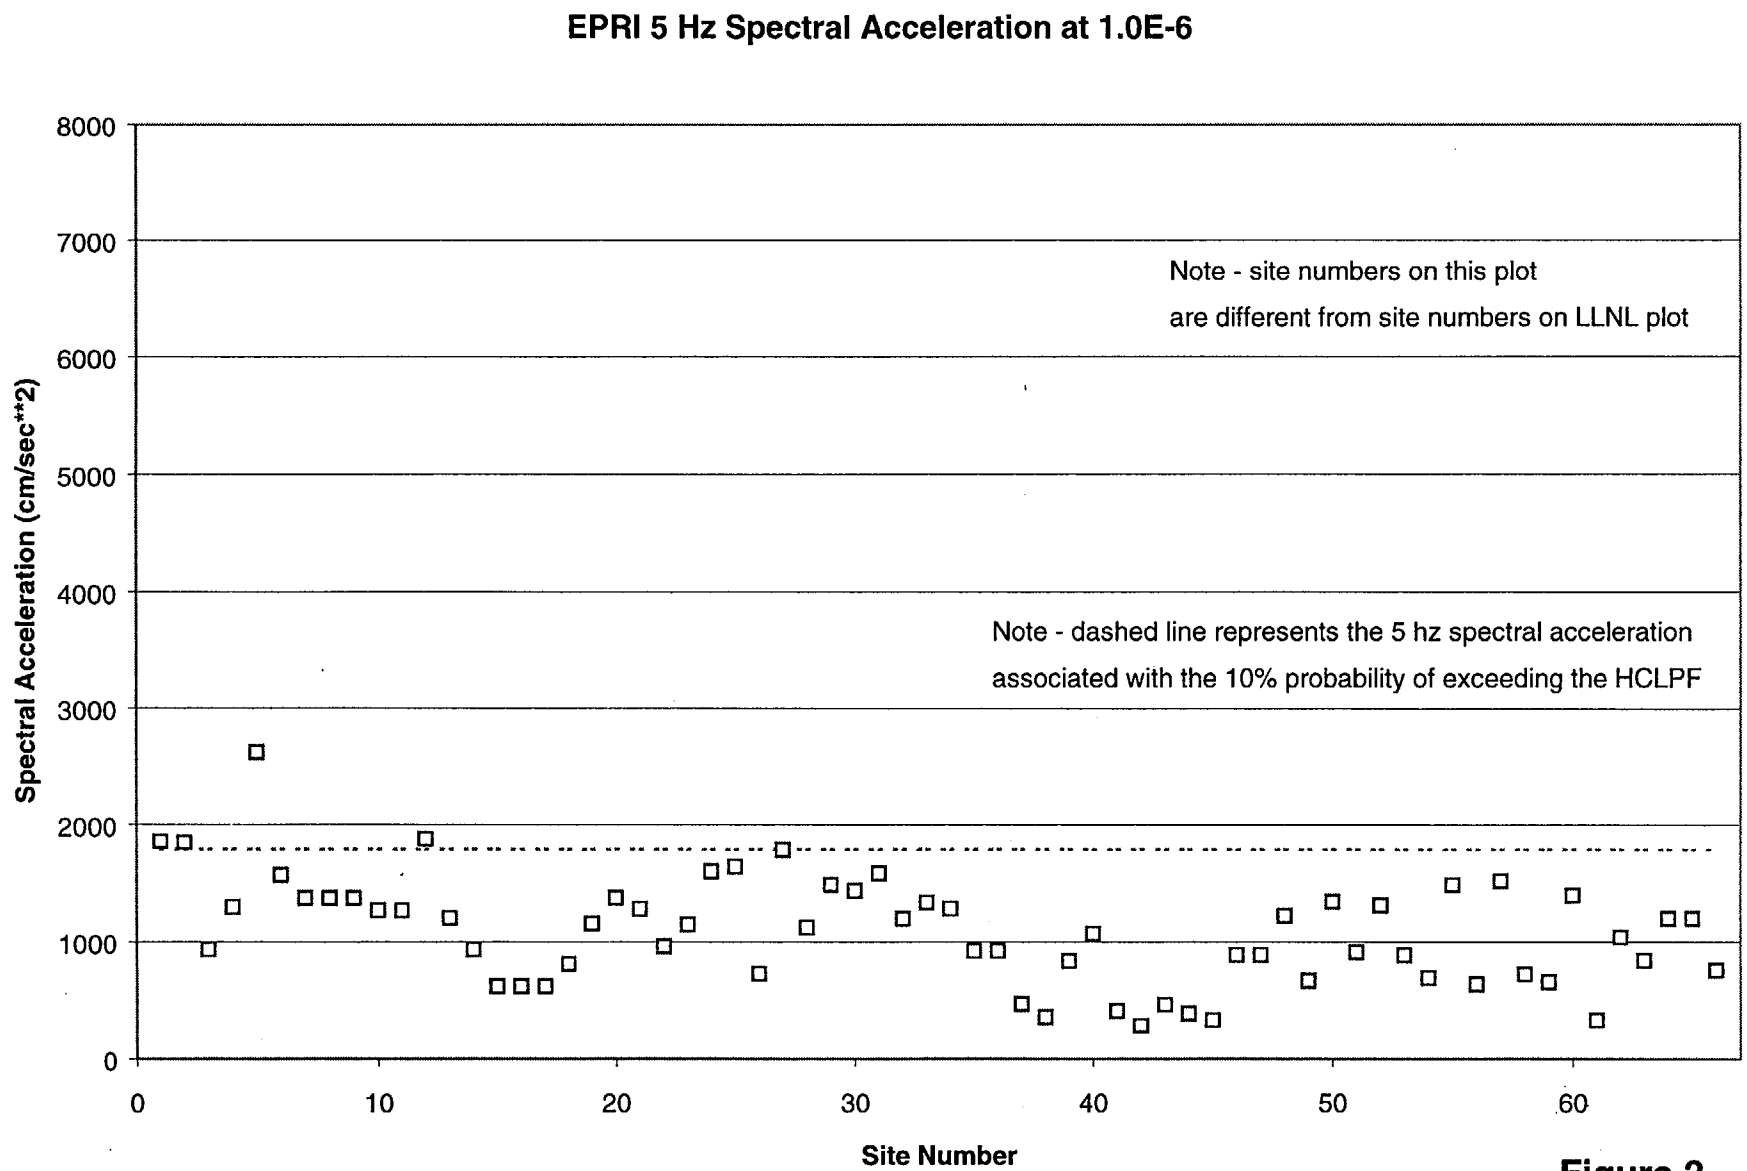
EPRI 5 Hz Spectral Acceleration at 1.0E-6
Spectral Acceleration (cm/sec**2)
8000
7000
6000
5000
4000
3000
2000
1000
0
0
10
20
30
40
50
60
Site Number
Note - site numbers on this plot
are different from site numbers on LLNL plot
Note - dashed line represents the 5 hz spectral acceleration
associated with the 10% probability of exceeding the HCLPF

Figure 2

Comparison of 1989 LLNL, 1992 LLNL and EPRI Estimates of Probability of Exceeding Peak Ground Acceleration per Year versus Acceleration - Pilgrim site

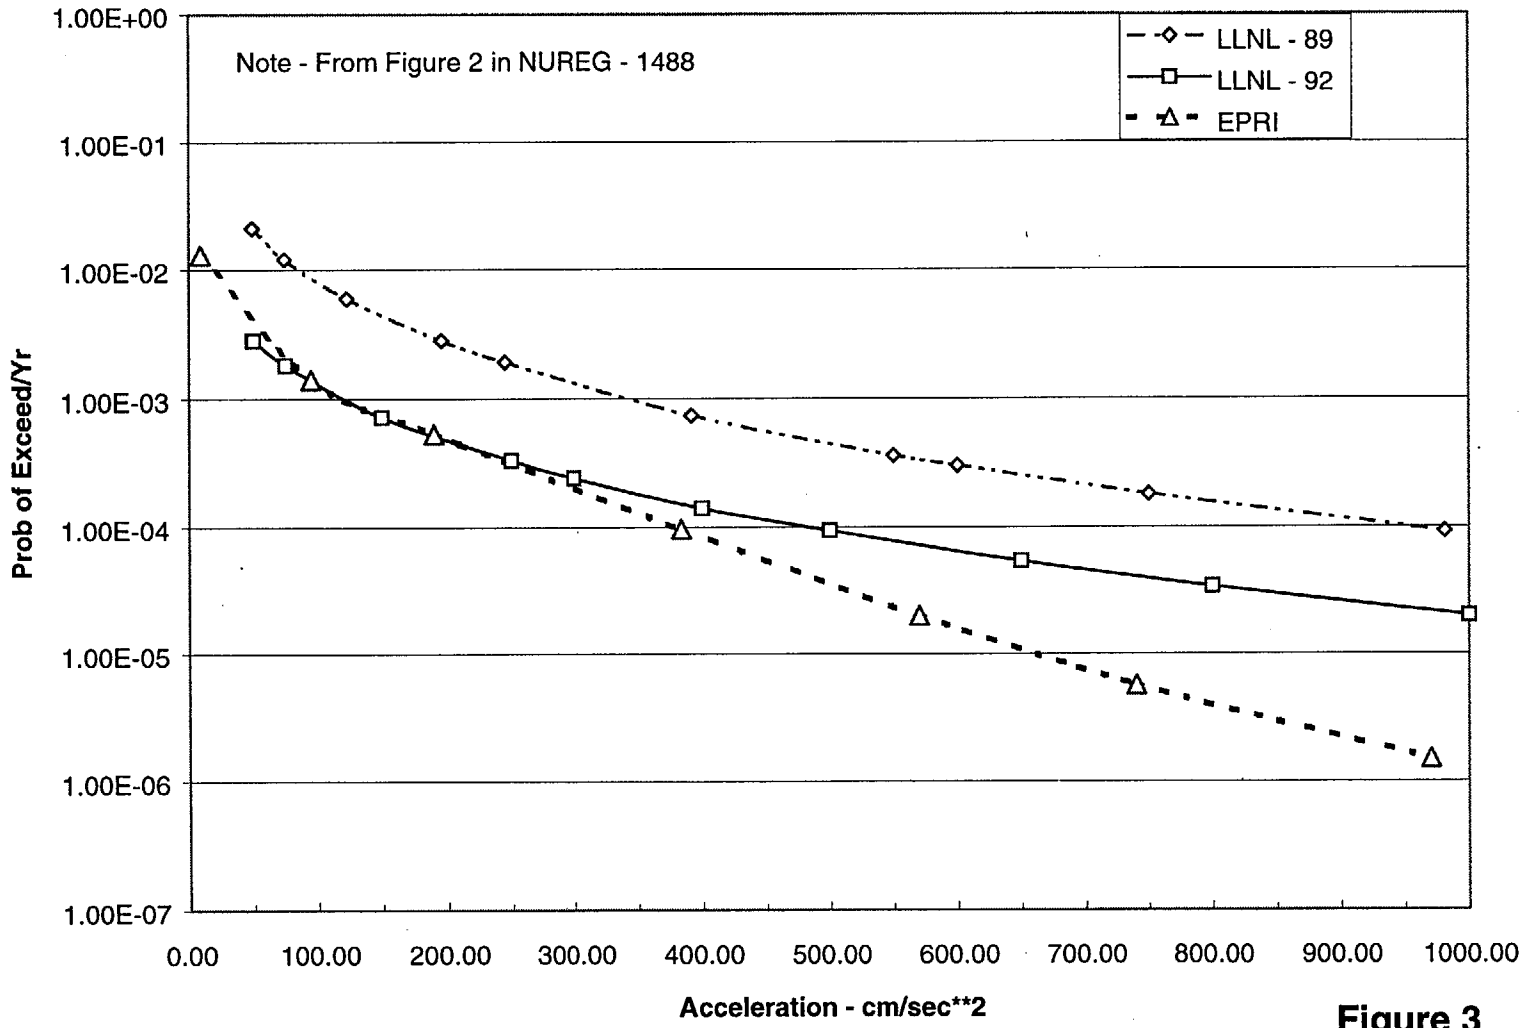

Figure 3

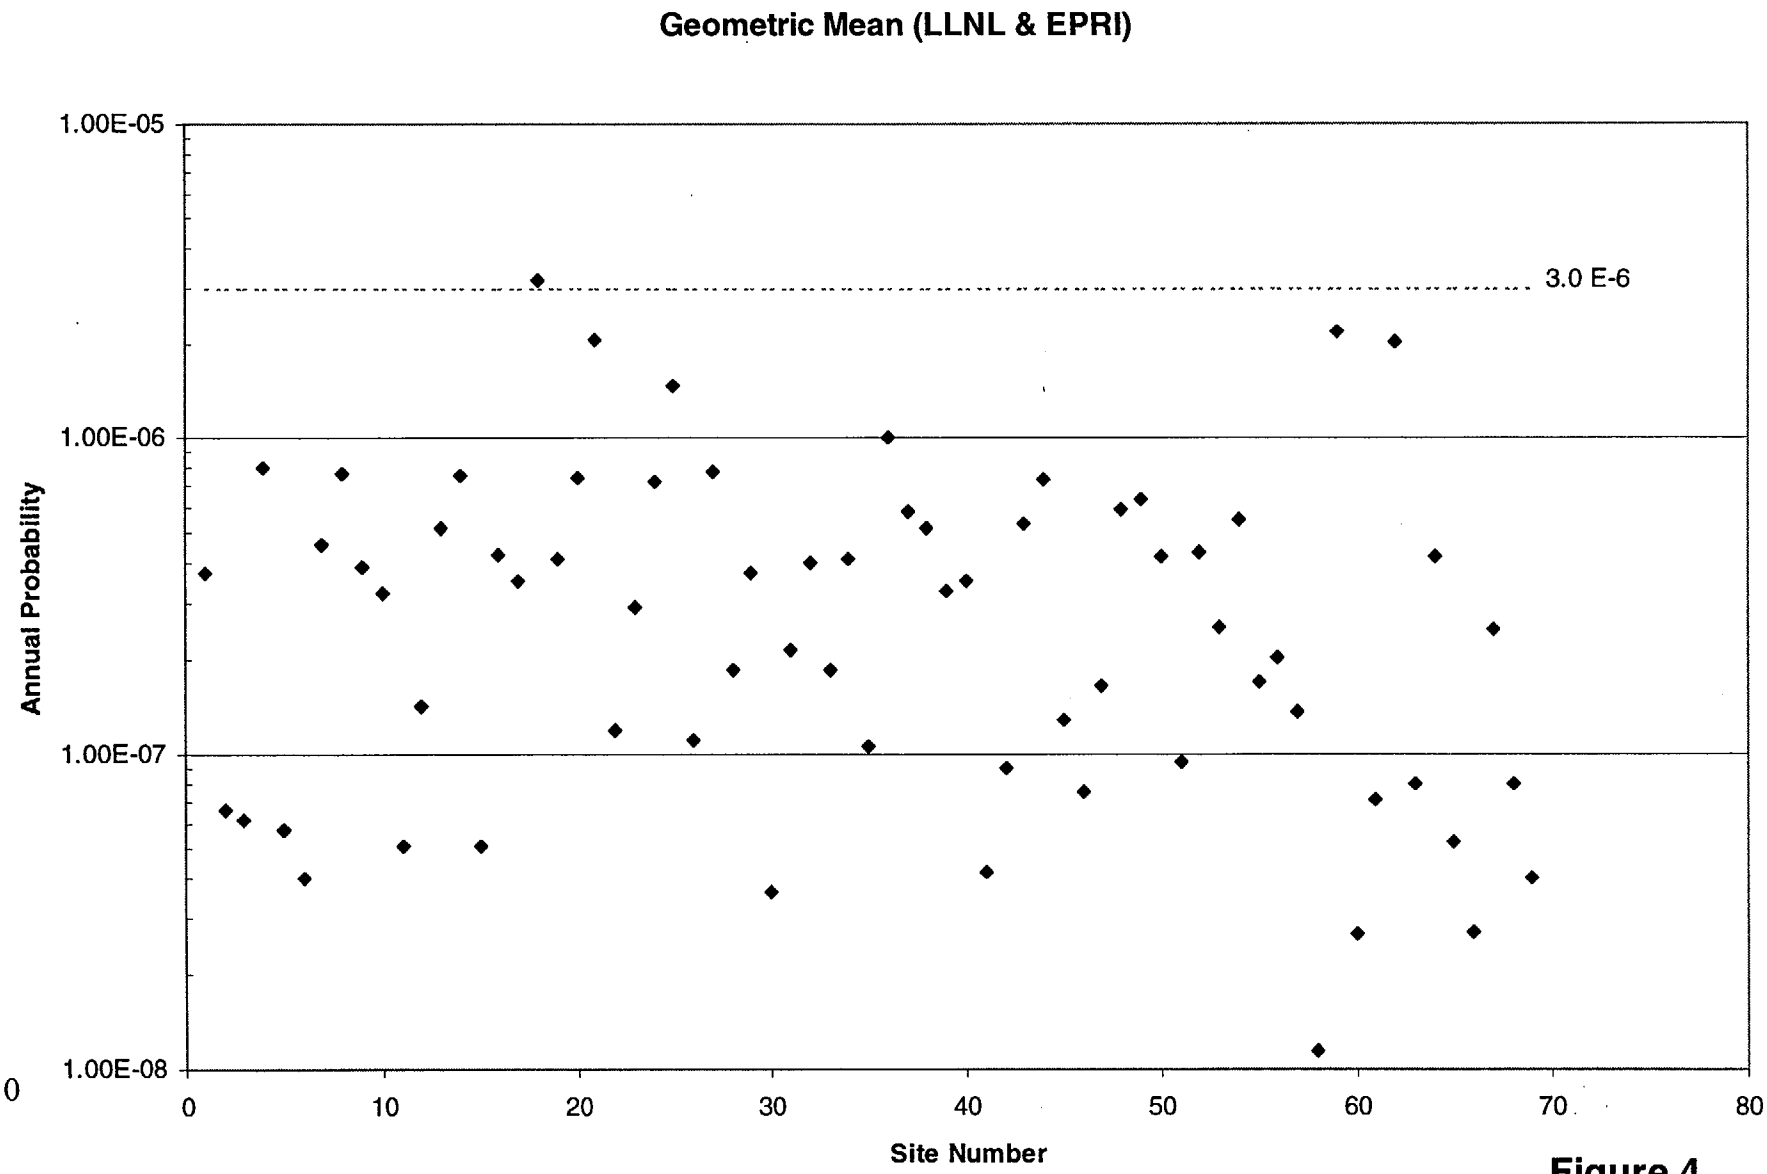
Geometric Mean (LLNL & EPRI)
1.00E-05
1.00E-06
1.00E-07
1.00E-08
Annual Probability
3.0 E-6
0
10
20
30
40
50
60
70
80
Site Number

Figure 4