



Duke License Renewal Project

McGuire - Catawba License Renewal Application Overview

*Bob Gill
Mary Hazeltine
Rounette Nader
Greg Robison*

July 12, 2001




Agenda

Opening Remarks	Chris Grimes Greg Robison
Overview of the Application	Duke Energy
Demonstration of the CD-ROM ...	Duke Energy
Discussion.....	NRC and Duke
Closing Remarks	Chris Grimes Greg Robison



McGuire - Catawba License Renewal Application

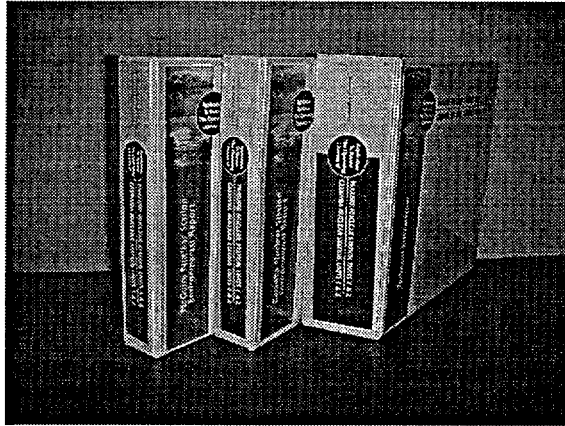

Submitted June 13, 2001

July 12, 2001

Duke License Renewal Project

3



Today's Objective


- Better prepare us for processing the application by reviewing key aspects of the application
 - ◆ Orientation to McGuire and Catawba, Duke Team
 - ◆ Cover letter key topics
 - ◆ Integrated Plant Assessment
 - » Scoping / Screening
 - » Aging Management Review
 - ◆ Programs
 - ◆ Time-limited Aging Analyses
 - ◆ UFSAR Supplement

July 12, 2001

Duke License Renewal Project


4

DUKE POWER GENERATING SYSTEM

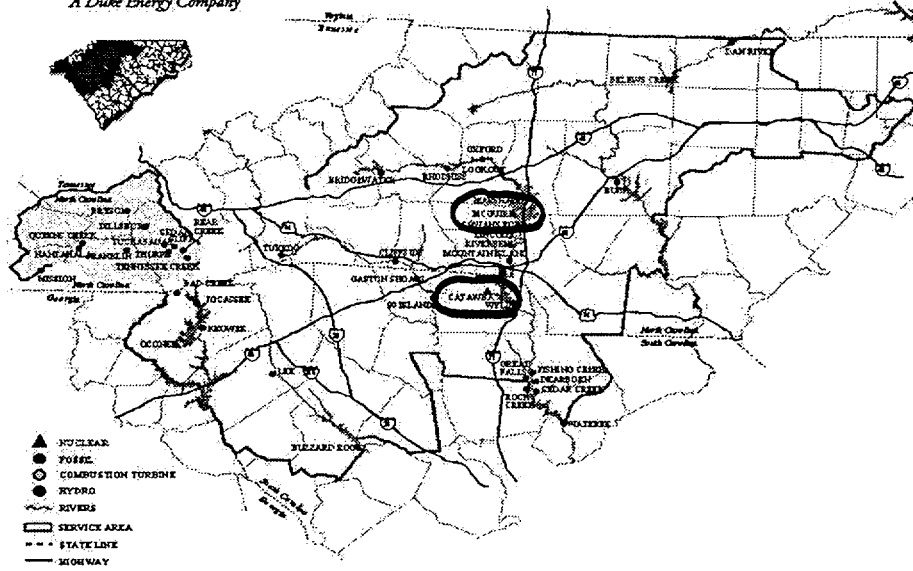


July 12, 2001

Duke License Renewal Project

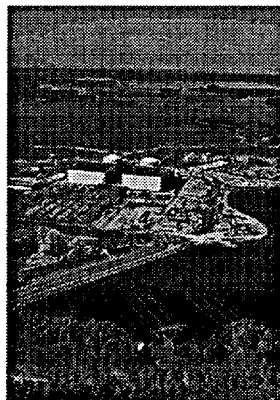

McGuire Nuclear Station
Huntersville, North Carolina

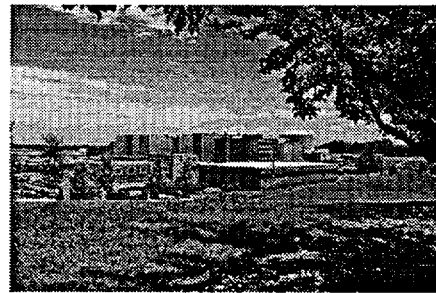

Catawba Nuclear Station
York, South Carolina

July 12, 2001

Duke License Renewal Project



Other Interesting Points

- McGuire and Catawba application involves the first SRP (NUREG-0800) plants to pursue renewal
- McGuire and Catawba are the first ice condenser containment plants to pursue renewal
- Steam generators have been replaced on McGuire 1 & 2 and Catawba 1
- Duke is first second renewal applicant

July 12, 2001

Duke License Renewal Project

7



Duke Team

- Greg Robison, Project Manager
- Bob Gill, Licensing
- Bill Miller & Chris Hallman, Environmental
- Debbie Keiser, Civil/Structural
- Paul Colaianni, Electrical
- Mary Hazeltine, RCS
- Terry Cox, Rounette Nader & Mike Semmler, Mechanical

July 12, 2001

Duke License Renewal Project

8



Cover Letter Key Topics

- Expiration dates of each renewed license are unit specific
 - ◆ 20 years from expiration of current license or 40 years from date of issuance of the renewed operating license, whichever is earlier
- Safety and environmental reviews cover 60-years

July 12, 2001

Duke License Renewal Project

9



Cover Letter Key Topics

- August 2000 versions of the guidance documents were used
 - ◆ Duke provided comments on draft documents
 - ◆ Duke was involved in industry/NRC meetings
 - ◆ Format of application follows the format presented in the SRP-LR
 - ◆ April 2001 versions of guidance documents were received after the license renewal reviews were complete

July 12, 2001

Duke License Renewal Project

10



Cover Letter Key Topics

- Any changes to the CLB during the review of this application will be made in accordance with the AEA and Commission regulations
- One potential change involves the use of MOX fuel at McGuire and Catawba
 - ◆ Regulatory review of license renewal is independent of the regulatory review of any future amendment requests concerning the use of MOX fuel at either McGuire or Catawba
 - ◆ Any potential impacts on the plant from the use of MOX fuel will be addressed in the MOX-related submittals

July 12, 2001

Duke License Renewal Project

11



Integrated Plant Assessment Topics

- Integrated Plant Assessment steps
 - ◆ Scoping/Screening methodology and results format
 - ◆ Aging Management Review methodology and results format
- IPA performed along discipline lines
 - ◆ Mechanical
 - ◆ Reactor Coolant (Class 1)
 - ◆ Structural
 - ◆ Electrical

July 12, 2001

Duke License Renewal Project

12



10 CFR 54.4 Scoping

- Scoping and Screening methodology for all disciplines given in Section 2.1 of the Application
- Plant-level scoping results for all disciplines given in Section 2.2 of the Application
- Scoping and screening results descriptions:
 - ◆ Mechanical and Reactor Coolant (including links to drawings and UFSAR) in Section 2.3
 - ◆ Structural in Section 2.4
 - ◆ Electrical in Section 2.5- the bounding approach used for electrical results in the scoping criteria only being applied when beneficial to eliminate scope

July 12, 2001

Duke License Renewal Project

13



Application Keys

- System names were obtained from engineering drawings
- These names are sometimes different than UFSAR names
- The system drawings submitted as a complement to the application are highlighted
- Most highlighting is blue with Reactor Coolant System Class 1 highlighted in yellow

July 12, 2001

Duke License Renewal Project

14



10 CFR 54.4(a)(1) Safety Related

- 10 CFR 54.4(a)(1) scoping was performed using piping and structural safety classifications
- These safety classifications are based on Regulatory Guides and Standard Review Plan (NUREG-0800) safety classifications
- A review of these classifications on flow diagrams and in the UFSAR resulted in systems and structures being included in scope and the mechanical evaluation boundaries used for screening

July 12, 2001

Duke License Renewal Project

15



10 CFR 54.4(a)(2) Non-safety Related

- 10 CFR 54.4(a)(2) scoping was performed using Duke Safety Classification assigned to those SSCs whose failure may adversely affect essential systems or components
- A review of these classifications on flow diagrams and in the UFSAR resulted in systems and structures being included in scope and the mechanical evaluation boundaries used for screening

July 12, 2001

Duke License Renewal Project

16



10 CFR 54.4(a)(3) Regulated Events

- Design and licensing documents were reviewed to determine those SSCs required to demonstrate compliance with the regulated events
 - ◆ FP
 - ◆ EQ
 - ◆ PTS
 - ◆ ATWS
 - ◆ SBO

July 12, 2001

Duke License Renewal Project

17



Application Keys

- System and structure descriptions are generically applicable to both McGuire and Catawba unless otherwise stated

- Electrical and Instrumentation and Control descriptions are done on a component basis and are generically applicable to both McGuire and Catawba unless otherwise stated

July 12, 2001

Duke License Renewal Project

18



10 CFR 54.21(a) Screening

- All disciplines consistent with NEI 95-10 Appendix B
 - ◆ Mechanical
 - ◆ Reactor Coolant (Class 1)
 - ◆ Structural
 - ◆ Electrical
- All disciplines' screening results are included with AMR results in Chapter 3 tables of the Application

July 12, 2001

Duke License Renewal Project

19



Aging Management Review Methodology

- The AMR process is the same as was used for Oconee:
 - Component
 - +Aging Effect
 - +Program
 - +Demonstration
 - Reasonable Assurance

July 12, 2001

Duke License Renewal Project

20



Aging Management Review Results

- Chapter 3 of the Application presents AMR results for all disciplines in the 6-column table format (industry standard)

1	2	3	4	5	6
Component Type	Component Function	Material	Environment	Aging Effect	Aging Management Programs and Activities

July 12, 2001

Duke License Renewal Project

21



AMR Results Structural

- Structural AMR results are presented in three tables
 - ◆ Reactor Buildings
 - ◆ Other structures
 - ◆ Component supports
- Component type within a table is presented in alphabetical order
- Tables are combined for McGuire and Catawba

July 12, 2001

Duke License Renewal Project

22



AMR Results Electrical

- Electrical AMR results are presented alphabetically by component
- Table is combined for McGuire and Catawba
- Application Key: Results are presented in a one-page table

July 12, 2001

Duke License Renewal Project

23



AMR Results Mechanical

- Mechanical AMR results tables are presented by system
- Component type within a system is presented in alphabetical order
- McGuire and Catawba system tables are combined unless entries vary significantly

July 12, 2001

Duke License Renewal Project

24



Application Keys

Division of mechanical system results:

- Engineered Safety Features
 - ◆ 8 Common Systems
- Auxiliary Systems
 - ◆ 41 Total Systems- Many common, some plant specific systems
- Steam and Power Conversion Systems
 - ◆ 10 Common Systems

July 12, 2001

Duke License Renewal Project

25



AMR Results Reactor Coolant

- Reactor Coolant System AMR results tables are presented by component

- Compared with other mechanical system results and similar to previous Applications, Reactor Coolant System component evaluations are presented at a greater level of detail

July 12, 2001

Duke License Renewal Project

26



AMR Results Reactor Coolant

- Identified specific components and their material - environment combinations using engineering records
- Determined applicable aging effects using a Duke engineering specification
- Identified programs to manage aging using Oconee or common department program descriptions as applicable

July 12, 2001

Duke License Renewal Project

27



Application Keys

- Many Reactor Coolant System programs are equivalent to Oconee programs previously reviewed in NUREG-1723
- Examples
 - ◆ Chemistry Control Program
 - ◆ Reactor Vessel Internals Inspection
 - ◆ CRDM and Other Vessel Closure Penetration Inspection Program
 - ◆ Alloy 600 Aging Management Review

July 12, 2001

Duke License Renewal Project

28



Application Keys

- In contrast with some previous Applications, the McGuire and Catawba Application does not reference Owner's Group topical reports
- Generic Topical Reports are high level rather than specific
- Use of existing Duke information precluded need for referencing these reports

July 12, 2001

Duke License Renewal Project

29



Programs / Activities

- Appendix B of the application includes
 - ◆ Identification of Program Types,
 - ◆ Definitions of Program Attributes, and
 - ◆ Descriptions of each Aging Management Program and Activity
- Level of detail in each program / activity description is consistent with the level of detail provided during the Oconee review

July 12, 2001

Duke License Renewal Project

30



Programs / Activities

- 54 total programs credited in safety work
 - ◆ 51 aging management programs
 - » 34 are existing programs
 - » 9 are new programs for renewal
 - » 8 are one-time inspections
 - ◆ 3 time-limited aging analysis programs
- 48 of these are common to both sites (91%)
- 31 are equivalent to Oconee renewal programs accepted by NRC (60%)

July 12, 2001

Duke License Renewal Project

31



Unique McGuire Programs

- 6 are unique to McGuire
 - ◆ Boraflex Monitoring Program
 - » due to high density spent fuel racks
 - ◆ Augmented ISI - Reactor Coolant CASS cold leg elbow
 - » due to material characteristics
 - ◆ Flood Barrier Inspection
 - » Catawba equivalent covered by another program also credited for renewal

July 12, 2001

Duke License Renewal Project

32



Unique McGuire Programs

- 6 are unique to McGuire (continued)
 - ◆ Refueling Water Storage Tank Coating Inspection
 - » Catawba equivalent is made of stainless steel and does not require coating
 - ◆ Pump Motor Air Handling Units Preventive Maintenance Activity
 - » Raw water cooling at McGuire vs. Component cooling at Catawba
 - ◆ Pump Oil Coolers Preventive Maintenance Activity
 - » Raw water cooling at McGuire vs. Component cooling at Catawba

July 12, 2001

Duke License Renewal Project

33



Unique Catawba Programs

- 2 are unique to Catawba
 - ◆ Standby Nuclear Service Water Pond Monitoring Program
 - » Pond settlement does have a time-limited calculational limit at Catawba, but not at McGuire
 - ◆ Diesel Generator Engine Starting Air Heat Exchanger Preventive Maintenance Activity
 - » Diesel design differences exist between the plants

July 12, 2001

Duke License Renewal Project

34



Time-limited Aging Analyses

The TLAA chapter of the application follows format of Chapter 4 of the SRP-LR:

- Reactor Vessel Embrittlement
 - ◆ PTS, USE and P-T limits are analyzed for 60-years
- Metal Fatigue
 - ◆ *Thermal Fatigue Management Program* is credited
 - ◆ Fatigue Environmental Effects addressed consistent with EPRI guidance submitted by NEI 12/13/2000
- EQ of Electric Equipment
 - ◆ *Environmental Qualification Program* is credited

July 12, 2001

Duke License Renewal Project

35



Time-limited Aging Analyses

- Containment Related Topics
 - ◆ Concrete Containment Prestressed Tendons are not installed at McGuire or Catawba
 - ◆ Containment liner plate, metal containment and penetration fatigue analyses are not TLAA (local leak testing is credited for cracking of bellows)
- Plant Specific TLAA
 - ◆ RCP Flywheel fatigue for 60-years
 - ◆ Leak-before-break analyzed for 60-years
 - ◆ Catawba specific TLAA - SNSW pond volume monitoring credits *SNSW Pond Volume Program*

July 12, 2001

Duke License Renewal Project

36



Updated Final Safety Analysis Report Supplement

- Contents of the plant specific UFSAR Supplements are based on the contents of Appendix B (program descriptions) and Chapter 4 (TLAA)
- Format and level of detail are consistent with that previously deployed during the Oconee license renewal review
- Level of detail in the plant specific UFSAR Supplements are similar to or greater than that provided in the examples contained in the SRP-LR

July 12, 2001

Duke License Renewal Project

37



Demonstration of the CD-ROM

Discussion



July 12, 2001

Duke License Renewal Project

38