

4.0 DESIGN FEATURES

4.1 Site Location

The Point Beach Nuclear Plant is located on property owned by Wisconsin Electric Power Company at a site on the shore of Lake Michigan, approximately 30 miles southeast of the city of Green Bay. The minimum distance from the reactor containment center line to the site exclusion boundary as defined in 10 CFR 100.3 is 1200 meters.

4.2 Reactor Core

4.2.1 Fuel Assemblies

The reactor shall contain 121 fuel assemblies. Each assembly shall consist of a matrix of Zircaloy-4 or ZIRLO™ fuel rods with an initial composition of natural or slightly enriched uranium dioxide (UO_2) as fuel material. Limited substitutions of zirconium alloy or stainless steel filler rods or vacancies for fuel rods, in accordance with approved applications of fuel rod configurations, may be used. Fuel assemblies shall be limited to those fuel designs that have been analyzed with applicable NRC staff approved codes and methods and shown by tests or analyses to comply with all fuel safety design bases. A limited number of lead test assemblies that have not completed representative testing may be placed in nonlimiting core regions.

4.2.2 Rod Cluster Control (RCC) Assemblies

The reactor core shall contain 33 RCC assemblies. The control material shall be silver indium cadmium alloy clad with stainless steel as approved by the NRC.

4.0 DESIGN FEATURES

4.3 Fuel Storage

4.3.1 Criticality

- 4.3.1.1 The spent fuel storage racks are designed and shall be maintained with:
- a. Fuel assemblies meeting at least one of the following storage limits may be stored in the spent fuel storage racks:
 1. Fuel assemblies with an enrichment of \leq 4.6 weight percent U-235; or
 2. Fuel assemblies which contain Integral Fuel Burnable Absorber (IFBA) rods in the "acceptable range" of Figure 3.7.12-1.
 - b. $k_{\text{eff}} \leq 0.95$ if fully flooded with unborated water, which includes an allowance for uncertainties as described in Section 9.4 of the FSAR;
 - c. A nominal 9.825 inch center to center distance between fuel assemblies placed in the fuel storage racks.
- 4.3.1.2 The new fuel storage racks are designed and shall be maintained with:
- a. Fuel assemblies having a maximum U-235 enrichment of 5.0 weight percent;
 - b. $k_{\text{eff}} \leq 0.95$ if fully flooded with unborated water, which includes an allowance for uncertainties as described in Section 9.4 of the FSAR;
 - c. $k_{\text{eff}} \leq 0.98$ under optimum moderator density conditions, which includes an allowance for uncertainties as described in Section 9.4 of the FSAR; and
 - d. A nominal 20 inch center to center distance between fuel assemblies placed in the storage racks.

4.0 DESIGN FEATURES

4.3 Fuel Storage (continued)

4.3.2 Drainage

The spent fuel storage pool is designed and shall be maintained to prevent inadvertent draining of the pool below elevation 40 ft 8 in.

4.3.3 Capacity

The spent fuel storage pool is designed and shall be maintained with a storage capacity limited to no more than 1502 fuel assemblies.

5.0 ADMINISTRATIVE CONTROLS

5.1 Responsibility

5.1.1 The Plant Manager shall be responsible for overall facility operation and shall delegate in writing the succession to this responsibility during his absence.

The Plant Manager or his designee shall approve, prior to implementation, each proposed test, experiment or modification to systems or equipment that affect nuclear safety.

5.1.2 The Duty Shift Superintendent (DSS) shall be responsible for the control room command function. During any absence of the DSS from the control room while either unit is in MODE 1, 2, 3, or 4, an individual with an active Senior Reactor Operator (SRO) license shall be designated to assume the control room command function. During any absence of the DSS from the control room while both units are in MODE 5 or 6, an individual with an active SRO license or Reactor Operator license shall be designated to assume the control room command function.

5.0 ADMINISTRATIVE CONTROLS

5.2 Organization

5.2.1 Onsite and Offsite Organizations

Onsite and offsite organizations shall be established for unit operation and corporate management, respectively. The onsite and offsite organizations shall include the positions for activities affecting safety of the nuclear power plant.

- a. Lines of authority, responsibility, and communication shall be defined and established throughout highest management levels, intermediate levels, and all operating organization positions. These relationships shall be documented and updated, as appropriate, in organization charts, functional descriptions of departmental responsibilities and relationships, and job descriptions for key personnel positions, or in equivalent forms of documentation. These requirements, including the plant-specific titles of those personnel fulfilling the responsibilities of the positions delineated in these Technical Specifications, shall be documented in the FSAR;
- b. The Plant Manager shall be responsible for overall safe operation of the plant and shall have control over those onsite activities necessary for safe operation and maintenance of the plant;
- c. A specified corporate officer shall have corporate responsibility for overall plant nuclear safety and shall take any measures needed to ensure acceptable performance of the staff in operating, maintaining, and providing technical support to the plant to ensure nuclear safety; and
- d. The individuals who train the operating staff, carry out health physics, or perform quality assurance functions may report to the appropriate onsite manager; however, these individuals shall have sufficient organizational freedom to ensure their independence from operating pressures.

5.2 Organization

5.2.2 Facility Staff

The facility staff organization shall include the following:

- a. A non-licensed operator shall be assigned to each reactor containing fuel and an additional non-licensed operator shall be assigned when either reactor is operating in MODES 1, 2, 3, or 4.
 - b. Shift crew composition may be less than the minimum requirement of 10 CFR 50.54(m)(2)(i) and 5.2.2.a and 5.2.2.e for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements.
 - c. A radiation protection technician shall be on site when fuel is in either reactor. The position may be vacant for not more than 2 hours, in order to provide for unexpected absence, provided immediate action is taken to fill the required position.
 - d. The Operations Manager or Assistant Operations Manager shall hold an SRO License at Point Beach.
 - e. An individual shall provide advisory technical support to the operations shift crew in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the facility. This individual shall meet the qualifications specified by the Commission Policy Statement on Engineering Expertise on Shift.
-

5.0 ADMINISTRATIVE CONTROLS

5.3 Facility Staff Qualifications

- 5.3.1 Each member of the facility staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971, as supplemented by Regulatory Guide 1.8, Revision 1, September 1975, for comparable positions.
 - 5.3.2 For the purpose of 10 CFR 55.4, a licensed Senior Reactor Operator (SRO) and a licensed reactor operator (RO) are those individuals who, in addition to meeting the requirements of TS 5.3.1, perform the functions described in 10 CFR 50.54(m).
 - 5.3.3 In the event the position of Health Physicist is vacated and the proposed replacement does not meet all the qualifications of TS 5.3.1, but is determined to be otherwise well qualified, the concurrence of NRC shall be sought in approving the qualification of that individual.
-

5.0 ADMINISTRATIVE CONTROLS

5.4 Procedures

- 5.4.1 Written procedures shall be established, implemented, and maintained covering the following activities:
- a. Normal sequences of startup, operation and shutdown of components, systems and overall plant;
 - b. Refueling;
 - c. Specific and foreseen potential malfunctions of systems or components including abnormal reactivity changes;
 - d. Security Plan Implementation;
 - e. The emergency operating procedures required to implement the requirements of NUREG-0737 and to NUREG-0737, Supplement 1, as stated in Generic Letter 82-33;
 - f. Nuclear core testing;
 - g. Surveillance and Testing of safety related equipment;
 - h. Fire Protection Implementation;
 - i. Quality Assurance for effluent and environmental monitoring;
 - j. All programs specified in Specification 5.5.
-

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

The following programs shall be established, implemented, and maintained.

5.5.1 Offsite Dose Calculation Manual (ODCM)

- a. The ODCM shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm and trip setpoints, and in the conduct of the radiological environmental monitoring program; and
- b. The ODCM shall also contain the radioactive effluent controls and radiological environmental monitoring activities, and descriptions of the information that should be included in the Annual Monitoring Report required by Specification 5.6.2.
- c. Licensee initiated changes to the ODCM:
 1. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
 - i. sufficient information to support the change(s) together with the appropriate analyses or evaluations justifying the change(s), and
 - ii. a determination that the change(s) maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50, Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations;
 2. Shall become effective after the approval of the Plant Manager; and
 3. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Annual Monitoring Report for the period of the report in which any change in the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month and year) the change was implemented.

5.5 Programs and Manuals

5.5.2 Primary Coolant Sources Outside Containment

This program provides controls to minimize leakage from those portions of systems outside containment that could contain highly radioactive fluids during a serious transient or accident to levels as low as practicable. The systems include Containment Spray, Safety Injection (High Head) and Safety Injection (Low Head) systems. The program shall include the following:

- a. Preventive maintenance and periodic visual inspection requirements; and
- b. Integrated leak test requirements for each system at refueling cycle intervals or less.

5.5.3 Post Accident Sampling

This program provides controls that ensure the capability to obtain and analyze reactor coolant, radioactive gases, and particulates in plant gaseous effluents and containment atmosphere samples under accident conditions. The program shall include the following:

- a. Training of personnel;
- b. Procedures for sampling and analysis; and
- c. Provisions for maintenance of sampling and analysis equipment.

5.5 Programs and Manuals

5.5.4 Radioactive Effluent Controls Program

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program shall be contained in the ODCM, shall be implemented by procedures, and shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- a. Limitations on the functional capability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM;
- b. Limitations on the concentrations of radioactive material released in liquid effluents to unrestricted areas, conforming to ten times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402;
- c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM;
- d. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to unrestricted areas, conforming to 10 CFR 50, Appendix I;
- e. Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days;
- f. Limitations on the functional capability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2% of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;

5.5 Programs and Manuals

5.5.4 Radioactive Effluent Controls Program (continued)

- g. Limitations on the dose rate resulting from radioactive material released in gaseous effluents from the site to areas at or beyond the site boundary shall be in accordance with the following:
 1. For noble gases: a dose rate \leq 500mrem/yr to the whole body and a dose rate \leq 3000 mrem/yr to the skin, and
 2. For iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days: a dose rate \leq 1500 mrem/yr to any organ;
- h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I;
- i. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives > 8 days in gaseous effluents released from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I; and
- j. Limitations on the annual dose or dose commitment to any member of the public, beyond the site boundary, due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Radioactive Effluent Controls Program surveillance frequency.

5.5 Programs and Manuals

5.5.5 Component Cyclic or Transient Limit

This program provides controls to track the FSAR, Section 4.1, cyclic and transient occurrences to ensure that components are maintained within the design limits.

5.5.6 Reactor Coolant Pump Flywheel Inspection Program

This program shall provide for the inspection of each reactor coolant pump flywheel per the recommendations of Regulatory Position c.4.b of Regulatory Guide 1.14, Revision 1, August 1975.

In lieu of Position c.4.b(1)and c.4.b(2), a qualified in-place UT examination over the volume from the inner bore of the flywheel to the circle one-half of the outer radius or a surface examination (MT and/or PT) of exposed surfaces of the removed flywheels may be conducted at approximately 10 year intervals coinciding with the Inservice Inspection schedule as required by ASME Section XI.

5.5 Programs and Manuals

5.5.7 Inservice Testing Program

This program provides controls for inservice testing of ASME Code Class 1, 2, and 3 pumps and valves. The program shall include the following:

- a. Testing frequencies specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as follows:

<u>ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice testing activities</u>	<u>Required Frequencies for performing inservice testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

- b. The provisions of SR 3.0.2 are applicable to the above required Frequencies for performing inservice testing activities;
- c. The provisions of SR 3.0.3 are applicable to inservice testing activities; and
- d. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any TS.

5.5 Programs and Manuals

5.5.8 Steam Generator (SG) Tube Surveillance Program

This program provides controls for inservice inspection and testing of steam generator tubing.

a. Definitions.

1. **Tube Inspection** – Entry from the hot-leg side with examination from the point of entry completely around the U-bend to the top support of the cold-leg is considered a tube inspection.
2. **Imperfection** - An exception to the dimension, finish, or contour of a tube from that required by fabrication drawings or specifications. Eddy-current testing indications below 20% of the nominal tube wall thickness, if detectable, may be considered as imperfections.
3. **Degradation** – A service induced cracking, wastage, wear or general corrosion occurring on either the inside or outside of a tube.
4. **Degraded Tube** – A tube that contains imperfections caused by degradation greater than 20% of the nominal tube wall thickness.
5. **Defect** – An imperfection of such severity that it exceeds the minimum acceptable tube wall thickness of 50%. A tube containing a defect is defective.
6. **Plugging Limit** – The imperfection depth beyond which the tube must be removed from service or repaired, because the tube may become defective prior to the next scheduled inspection. The plugging limit is 40% of the nominal wall thickness.

5.5 Programs and Manuals

5.5.8 Steam Generator (SG) Tube Surveillance Program (continued)

b. Sample Selection and Testing

Selection and testing of steam generator tubes shall be made on the following basis:

1. One steam generator of each unit may be selected for inspection during inservice inspection in accordance with the following requirements:
 - i. The inservice inspection may be limited to one steam generator on an alternating sequence basis. This examination shall include at least 6% of the tubes if the results of the first or a prior inspection indicate that both generators are performing in a comparable manner.
 - ii. When both steam generators are required to be examined by Table 5.5.8-1 and if the condition of tubes in one steam generator is found to be more severe than in the other steam generator of a unit, the steam generator sampling sequence at the subsequent inservice inspection shall be modified to examine the steam generator with the more severe condition.
2. The minimum sample size, inspection result classification and the associated required action shall be in conformance with the requirements of Table 5.5.8-1. The results of each sampling examination of a steam generator shall be classified in the following three categories:
 - i. Category C-1: Less than 5% of the total tubes examined are degraded but none are defective.
 - ii. Category C-2: Between 5% and 10% of the total number of tubes examined are degraded, but none are defective or one tube to not more than 1% of the sample is defective.
 - iii. Category C-3: More than 10% of the total number of tubes examined are degraded, but none are defective or more than 1% of the sample is defective.

5.5 Programs and Manuals

5.5.8 Steam Generator (SG) Tube Surveillance Program (continued)

If the first sample of a given steam generator during any inservice inspection, degraded tubes not beyond the plugging limit detected by prior examinations in that steam generator shall be included in the above percentage calculations, only if these tubes are demonstrated to have a further wall penetration of greater than 10% of the tube nominal wall thickness.

3. Tubes shall be selected for examination primarily from those areas of the tube bundle where service experience has shown the most severe tube degradation.
4. In addition to the sample size specified in Table 5.5.8-1, the tubes examined in a given steam generator during the first examination of any inservice inspection shall include all non-plugged tubes in that steam generator that from prior examination were degraded.
5. During the second and third sample examinations of any inservice inspection, the tube inspection may be limited to those sections of the tube lengths where imperfections were detected during the prior examination.

c. Examination Method and Requirements.

The examination method shall meet the intent of the requirements in ASME Section XI Appendix IV. This includes equipment, personnel, and procedure requirements, certification and calibration along with records and reports. The actual technique may be the latest industry accepted technique, provided the flaw detection capability is as good or better than the technique endorsed by the code in effect per 10 CFR 50, Section 50.55a(g). This allows the use of improvements in inspection techniques that were not included in the code in effect. However, it means that word-for-word compliance with Appendix IV of ASME Section XI may not be possible.

5.5 Programs and Manuals

5.5.8 Steam Generator (SG) Tube Surveillance Program (continued)

d. Inspection Intervals

1. Inservice inspections shall not be more than 24 calendar months apart.
2. The inservice inspections may be scheduled to be coincident with refueling outages or any plant shutdown, provided the inspection intervals of 5.5.8.d.1 are not exceeded.
3. If two consecutive inservice inspections covering a time span of at least 12 months yield results that fall in C-1 category, the inspection frequency may be extended to 40 month intervals.
4. If the results of the inservice inspection of steam generator tubing conducted in accordance with Table 5.5.8-1 requires that a third sample examination must be performed, and the results of this fall in the category C-3, the inspection frequency shall be reduced to not more than 20 month intervals. The reduction shall apply until a subsequent inspection demonstrates that a third sample examination is not required.
5. Unscheduled inspections shall be conducted in accordance with Specification 5.5.8.b on any steam generator with primary-to-secondary tube leakage exceeding Specification 3.4.13.d. All steam generators shall be inspected in the event of a seismic occurrence greater than an operating basis earthquake, a LOCA requiring actuation of engineered safeguards, or a main steam line or feedwater line break.

e. Corrective Measures

All tubes that leak or have degradation exceeding the plugging limit shall be plugged or repaired by a process such as sleeving prior to return to power from a refueling or inservice inspection condition. Sleeved tubes having sleeve degradation exceeding 40% of the nominal sleeve wall thickness shall be plugged. (Brazed joints shall not be employed.)

Tubes previously subject to explosive plugging shall not be sleeved)

The provisions of SR 3.0.2 are applicable to the SG Tube Surveillance Program test frequencies.

5.5 Programs and Manuals

TABLE 5.5.8-1
STEAM GENERATOR TUBE INSPECTION PER UNIT
POINT BEACH UNITS 1 & 2

		1ST SAMPLE EXAMINATION		2ND SAMPLE EXAMINATION		3RD SAMPLE EXAMINATION	
Sample Size	Result	Action Required	Result	Action Required	Result	Action Required	
A minimum of S tubes per Steam Generator (S.G.)	C-1	Acceptable for continued service	N/A	N/A	N/A	N/A	
S=3(N/n) %	C-2	Plug or repair tubes exceeding the plugging limit and proceed with 2nd sample examination of 2S tubes in same steam generator	C-1	Acceptable for continued service	N/A	N/A	
Where:			C-2	Plug or repair tubes exceeding the plugging limit and proceed with 3rd sample examination of 4S tubes in same steam generator	C-1	Acceptable for continued service	
N is the number of steam generators in the plant = 2					C-2	Plug or repair tubes exceeding plug limit. Acceptable for continued service	
n is the number of steam generators inspected during an examination			C-3	Perform action required under C-3 of 1st sample examination	C-3	Perform action required under C-3 of 1st sample examination	
	C-3	Inspect essentially all tubes in this S.G., plug or repair tubes exceeding the plugging limit and proceed with 2nd sample examination of 2S tubes in the other steam generator. Reportable in accordance with 10 CFR 50.73(a)(2)(ii).	C-1 in other S.G.	Acceptable for continued service	N/A	N/A	
			C-2 in other S.G.	Perform action required under C-2 of 2nd sample examination above	N/A	N/A	
			C-3 in other S.G.	Inspect essentially all tubes in S.G. & plug or repair tubes exceeding the plugging limit. Reportable in accordance with 10 CFR 50.73(a)(2)(ii).	N/A	N/A	

5.5 Programs and Manuals

5.5.9 Secondary Water Chemistry Program

This program provides controls for monitoring secondary water chemistry to inhibit SG tube degradation. The program shall include:

- a. Identification of a sampling schedule for the critical variables and control points for these variables;
- b. Identification of the procedures used to measure the values of the critical variables;
- c. Identification of process sampling points, which shall include monitoring the discharge of the condensate pumps for evidence of condenser in leakage;
- d. Procedures for the recording and management of data;
- e. Procedures defining corrective actions for all off control point chemistry conditions; and
- f. A procedure identifying the authority responsible for the interpretation of the data and the sequence and timing of administrative events, which is required to initiate corrective action.

5.5.10 Ventilation Filter Testing Program (VFTP)

A program shall be established to implement the following required testing of the Control Room Emergency Filtration System (F-16) at the frequencies specified in Regulatory Guide 1.52, Revision 2, and in accordance with ASTM D3803-1989 and the methodology of ANSI N510-1980, as prescribed below.

- a. Demonstrate for the Control Room Emergency Filtration System (F-16) that an inplace test of the high efficiency particulate air (HEPA) filters shows a penetration and system bypass $\leq 1.0\%$ when tested in accordance with the methodology of ANSI N510-1980, Section 10, excluding subsection 10.3, at a system flowrate of 4950 cfm $\pm 10\%$.
- b. Demonstrate for the Control Room Emergency Filtration System (F-16) that an inplace test of the charcoal adsorber shows a penetration and system bypass $\leq 1.0\%$ when tested in accordance with the methodology of ANSI N510-1980, Section 12, excluding subsection 12.3, at a system flowrate of 4950 cfm $\pm 10\%$.

5.5 Programs and Manuals

5.5.10 Ventilation Filter Testing Program (VFTP) (continued)

- c. Demonstrate for the Control Room Emergency Filtration System (F-16) that a laboratory test of a sample of the charcoal adsorber, when obtained in accordance with the methodology of ANSI N510-1980, Section 13, excluding subsection 12.3, shows the methyl iodide penetration $\leq 1.0\%$, when tested in accordance with ASTM D3803-1989 at a temperature of 30°C and a relative humidity of 95%, applying the tolerances of ASTM D3803-1989.
- d. Demonstrate for the Control Room Emergency Filtration System (F-16) that the pressure drop across the combined HEPA filters and the charcoal adsorbers is less than 6 inches of water when tested in accordance with the methodology of ANSI N510-1980, Sections 10 and 12, excluding subsections 10.3 and 12.3, at a system flowrate of 4950 cfm $\pm 10\%$.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the VFTP test frequencies.

5.5.11 Explosive Gas Monitoring Program

This program provides controls for potentially explosive gas mixtures contained in the on-service Gas Decay Tank.

The program shall include a limit for oxygen concentration in the on-service Gas Decay Tank and a surveillance program to ensure the limit is maintained. This limit shall be appropriate to the system's design criteria (i.e., whether or not the system is designed to withstand a hydrogen explosion).

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Explosive Gas Monitoring Program surveillance frequencies.

5.5 Programs and Manuals

5.5.12 Diesel Fuel Oil Testing Program

A diesel fuel oil testing program to implement required testing of both new fuel oil and stored fuel oil shall be established. The program shall include sampling and testing requirements, and acceptance criteria, all in accordance with applicable ASTM Standards. The purpose of the program is to establish the following:

- a. Acceptability of new fuel oil for use prior to addition to storage tanks by determining that the fuel oil has:
 1. an API gravity or an absolute specific gravity within limits,
 2. a flash point and kinematic viscosity within limits for ASTM 2D fuel oil, and
 3. a clear and bright appearance with proper color;
- b. Within 31 days of addition of the new fuel oil to storage tanks verify that the properties of the new fuel oil, other than those addressed in a. above, are within limits for ASTM 2D fuel oil; and
- c. Total particulate concentration of the fuel oil is $\leq 10 \text{ mg/l}$ when tested every 92 days in accordance with the applicable ASTM standard.
- d. The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Diesel Fuel Oil Testing Program test frequencies.

5.5.13 Technical Specifications (TS) Bases Control Program

This program provides a means for processing changes to the Bases of these Technical Specifications.

- a. Changes to the Bases of the TS shall be made under appropriate administrative controls and reviews.
- b. Licensees may make changes to Bases without prior NRC approval provided the changes do not involve either of the following:
 1. a change in the TS incorporated in the license; or
 2. a change to the updated FSAR or Bases that requires NRC approval pursuant to 10 CFR 50.59.

5.5 Programs and Manuals

5.5.13 Technical Specifications (TS) Bases Control Program (continued)

- c. The Bases Control Program shall contain provisions to ensure that the Bases are maintained consistent with the FSAR.
- d. Proposed changes that meet the criteria of Specification 5.5.13b above shall be reviewed and approved by the NRC prior to implementation. Changes to the Bases implemented without prior NRC approval shall be provided to the NRC on a frequency consistent with 10 CFR 50.71(e).

5.5.14 Safety Function Determination Program (SFDP)

This program ensures loss of safety function is detected and appropriate actions taken. Upon entry into LCO 3.0.6, an evaluation shall be made to determine if loss of safety function exists. Additionally, other appropriate actions may be taken as a result of the support system inoperability and corresponding exception to entering supported system Condition and Required Actions. This program implements the requirements of LCO 3.0.6. The SFDP shall contain the following:

- a. Provisions for cross train checks to ensure a loss of the capability to perform the safety function assumed in the accident analysis does not go undetected;
- b. Provisions for ensuring the plant is maintained in a safe condition if a loss of function condition exists;
- c. Provisions to ensure that an inoperable supported system's Completion Time is not inappropriately extended as a result of multiple support system inoperabilities; and
- d. Other appropriate limitations and remedial or compensatory actions.

5.5 Programs and Manuals

5.5.14 Safety Function Determination Program (SFDP) (continued)

A loss of safety function exists when, assuming no concurrent single failure, and assuming no concurrent loss of offsite power or loss of onsite diesel generator(s), a safety function assumed in the accident analysis cannot be performed. For the purpose of this program, a loss of safety function may exist when a support system is inoperable, and:

- a. A required system redundant to the system(s) supported by the inoperable support system is also inoperable; or
- b. A required system redundant to the system(s) in turn supported by the inoperable supported system is also inoperable; or
- c. A required system redundant to the support system(s) for the supported systems (a) and (b) above is also inoperable.

The SFDP identifies where a loss of safety function exists. If a loss of safety function is determined to exist by this program, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

When a loss of safety function is caused by the inoperability of a single Technical Specification support system, the appropriate Conditions and Required Actions to enter are those of the support system.

5.5.15 Containment Leakage Rate Testing Program

- a. A program shall be established to implement the leakage rate testing of the containment as required by 10 CFR 50.54(o) and 10 CFR 50, Appendix J, Option B, as modified by approved exemptions. This program shall be in accordance with the guidelines contained in Regulatory Guide 1.163, "Performance-Based Containment Leak-Test Program," dated September, 1995.
- b. The peak design containment internal accident pressure, P_a , is 60 psig.
- c. The maximum allowable containment leakage rate, L_a at P_a , shall be 0.4% of containment air weight per day.

5.5 Programs and Manuals

5.5.15 Containment Leakage Rate Testing Program (continued)

- d. Leakage rate acceptance criteria are:
 - 1. Containment leakage rate acceptance criterion is $\leq 1.0 L_a$.
 - 2. During the first unit startup following testing in accordance with this program, the leakage rate acceptance are $\leq 0.6 L_a$ for the combined Type B and Type C tests and $\leq 0.75 L_a$ for the Type A tests.
 - 3. Air lock testing acceptance criteria are:
 - i. Overall air lock leakage rate is $\leq 0.05 L_a$ when tested at $\geq P_a$.
 - ii. For each door seal, leakage rate is equivalent to $\leq 0.02 L_a$ at $\geq P_a$ when tested at a differential pressure of ≥ 10 inches of Hg.
- e. The provisions of SR 3.0.2 do not apply to the test frequencies in the Containment Leakage Rate Testing Program.
- f. The provisions of SR 3.0.3 are applicable to the Containment Leakage Rate Testing Program.

5.5 Programs and Manuals

5.5.16 Reactor Coolant System (RCS) Pressure Isolation Valve (PIV) Leakage Program

A program shall be established to verify the leakage from each RCS PIV is within the limits specified below, in accordance with the Event V Order, issued April 20, 1981.

- a. Minimum differential test pressure shall not be less than 150 psid.
- b. Leakage rate acceptance criteria are:
 1. Leakage rates less than or equal to 1.0 gpm are considered acceptable.
 2. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered acceptable if the latest measured rate has not exceeded the rate determined by the previous test by an amount that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
 3. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered unacceptable if the latest measured rate exceeded the rate determined by the previous test by an amount that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
 4. Leakage rates greater than 5.0 gpm are considered unacceptable.

5.5.17 Pre-Stressed Concrete Containment Tendon Surveillance Program

This program provides controls for monitoring any tendon degradation in pre-stressed concrete containments, including effectiveness of its corrosion protection medium, to ensure containment structural integrity. The program shall include baseline measurements prior to initial operations. The Tendon Surveillance Program, inspection frequencies, and acceptance criteria shall be in accordance with Regulatory Guide 1.35, Revision 3, 1989.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Tendon Surveillance Program inspection frequencies.

5.0 ADMINISTRATIVE CONTROLS

5.6 Reporting Requirements

The following reports shall be submitted in accordance with 10 CFR 50.4.

5.6.1 Occupational Radiation Exposure Report

NOTE-----

A single submittal may be made that combines sections common to Units 1 and 2.

A tabulation on an annual basis of the number of station, utility, and other personnel (including contractors), for whom monitoring was performed, receiving an annual deep dose equivalent > 100 mrems and the associated collective deep dose equivalent (reported in person – rem) according to work and job functions (e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling). This tabulation supplements the requirements of 10 CFR 20.2206. The dose assignments to various duty functions may be estimated based on pocket ionization chamber, thermoluminescence dosimeter (TLD), electronic dosimeter, or film badge measurements. Small exposures totaling < 20 percent of the individual total dose need not be accounted for. In the aggregate, at least 80 percent of the total deep dose equivalent received from external sources should be assigned to specific major work functions. The report covering the previous calendar year shall be submitted by April 30 of each year.

5.6.2 Annual Monitoring Report

NOTE-----

A single submittal may be made that combines sections common to Units 1 and 2.

The Annual Monitoring Report covering the operation of the units during the previous calendar year shall be submitted by April 30 of each year. The report shall include summaries, interpretations, and analyses of trends of the results of the radiological environmental monitoring program for the reporting period. The material provided shall be consistent with the objectives outlined in the Offsite Dose Calculation Manual (ODCM), and in 10 CFR 50, Appendix I, Sections IV.B.2, IV.B.3, and IV.C.

5.6 Reporting Requirements

5.6.2 Annual Monitoring Report (continued)

The Annual Monitoring Report shall include the results of analyses of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the table and figures in the ODCM, as well as summarized and tabulated results of these analyses and measurements. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted in a supplementary report as soon as possible.

The Annual Monitoring Report shall also include The Radioactive Effluent Release Report covering the operation of the units in the previous year and submitted in accordance with 10 CFR 50.36a.

The submittal shall combine sections common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the units. The material provided shall be consistent with the objectives outlined in the ODCM and Process Control Program and in conformance with 10 CFR 50.36a and 10 CFR 50, Appendix I, Section IV.B.1.

5.6.3 Monthly Operating Reports

Routine reports of operating statistics and shutdown experience shall be submitted on a monthly basis by the 15th of each month following the calendar month covered by the report.

5.6.4 CORE OPERATING LIMITS REPORT (COLR)

a. Core operating limits shall be established prior to each reload cycle, or prior to any remaining portion of a reload cycle, and shall be documented in the COLR for the following:

- (1) LCO 2.1.1, "Safety Limits (SLs)"
- (2) LCO 3.1.1, "Shutdown Margin (SDM)"
- (3) LCO 3.1.3, "Moderator Temperature Coefficient (MTC)"
- (4) LCO 3.1.5, "Shutdown Bank Insertion Limits"
- (5) LCO 3.1.6, "Control Bank Insertion Limits"
- (6) LCO 3.2.1, "Heat Flux Hot Channel Factor ($F_Q(Z)$)"
- (7) LCO 3.2.2, "Nuclear Enthalpy Rise Hot Channel Factor($F_{\Delta H}^N$)"

5.6 Reporting Requirements

5.6.4 CORE OPERATING LIMITS REPORT (COLR) (continued)

- (8) LCO 3.2.3, "Axial Flux Difference (AFD)"
 - (9) LCO 3.3.1, "Reactor Protection System (RPS) Instrumentation - Overtemperature ΔT "
 - (10) LCO 3.3.1, "Reactor Protection System (RPS) Instrumentation - Overpower ΔT "
 - (11) LCO 3.4.1, "RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits"
 - (12) LCO 3.9.1, "Boron Concentration"
- b. The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:
- (1) WCAP-14449-P-A, "Application of Best Estimate Large Break LOCA Methodology to Westinghouse PWR's with Upper Plenum Injection," Revision 1, October 1999. (cores containing 422V+ fuel)
 - (2) WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.
 - (3) WCAP-11397-P-A, "Revised Thermal Design Procedure," April 1989.
 - (4) WCAP-14787-P, "Westinghouse Revised Thermal Design Procedures Instrument Uncertainty Methodology, Wisconsin Electric Power Company, Point Beach Unit 1 and 2," April 1999 (approved by NRC Safety Evaluation, February 8, 2000).
 - (5) WCAP-10054-P-A, "Westinghouse Small Break ECCS Evaluation Model Using The NOTRUMP Code," August 1985.
 - (6) WCAP-10054-P-A, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code: Safety Injection into the Broken Loop and COSI Condensation Model," Addendum 2, Revision 1, July 1997.
 - (7) WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overttemperature ΔT Trip Functions," September 1986.
 - (8) WCAP-10216-P-A, "Relaxation of Constant Axial Offset Control," Revision 1A, February 1994.
 - (9) WCAP-10924-P-A, "Large Break LOCA Best Estimate Methodology, Volume 2: Application to Two-Loop PWRs Equipped with Upper Plenum Injection," and Addenda, December 1988. (cores not containing 422 V+ fuel)
 - (10) WCAP-10924-P-A, "LBLOCA Best Estimate Methodology: Model Description and Validation: Model Revisions," Volume 1, Addendum 4, August 1990. (cores not containing 422 V+ fuel)

5.6 Reporting Requirements

5.6.4 CORE OPERATING LIMITS REPORT (COLR) (continued)

- c. The core operating limits shall be determined such that all applicable limits (e.g., fuel thermal mechanical limits, core thermal hydraulic limits, Emergency Core Cooling Systems (ECCS) limits, nuclear limits such as SDM, transient analysis limits, and accident analysis limits) of the safety analysis are met.
- d. The COLR, including any midcycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC.

5.6.5 Reactor Coolant System (RCS) PRESSURE AND TEMPERATURE LIMITS REPORT (PTLR)

- a. RCS pressure and temperature limits for heat up, cooldown, low temperature operation, criticality, hydrostatic testing, LTOP enabling, and PORV lift settings as well as heatup and cooldown rates shall be established and documented in the PTLR for the following:
 - (1) LCO 3.4.3, "RCS Pressure and Temperature (P/T) Limits"
 - (2) LCO 3.4.6, "RCS Loops-MODE 4"
 - (3) LCO 3.4.7, "RCS Loops-MODE 5, Loops Filled"
 - (4) LCO 3.4.10, "Pressurizer Safety Valves"
 - (5) LCO 3.4.12, "Low Temperature Overpressure Protection (LTOP)"
- b. The analytical methods used to determine the RCS pressure and temperature limits shall be those previously reviewed and approved by the NRC, specifically those described in the NRC Letters dated October 6, 2000 and July 23, 2001.
- c. The PTLR shall be provided to the NRC upon issuance for each reactor vessel fluence period and for any revision or supplement thereto.

5.6 Reporting Requirements

5.6.6 PAM Report

When a report is required by Condition B or G of LCO 3.3.3, "Post Accident Monitoring (PAM) Instrumentation," a report shall be submitted within the following 14 days. The report shall outline the preplanned alternate method of monitoring, the cause of the inoperability, and the plans and schedule for restoring the instrumentation channels of the Function to OPERABLE status.

5.6.7 Tendon Surveillance Report

Abnormal conditions observed during testing will be evaluated to determine the effect of such conditions on containment structural integrity. This evaluation should be completed within 30 days of the identification of the condition. Any condition which is determined in this evaluation to have a significant adverse effect on containment structural integrity will be considered an abnormal degradation of the containment structure.

Any abnormal degradation of the containment structure identified during the engineering evaluation of abnormal conditions shall be reported to the Nuclear Regulatory Commission pursuant to the requirements of 10 CFR 50.4 within thirty days of that determination. Other conditions that indicate possible effects on the integrity of two or more tendons shall be reportable in the same manner. Such reports shall include a description of the tendon condition, the condition of the concrete (especially at tendon anchorages), the inspection procedure and the corrective action taken.

5.6.8 Steam Generator Tube Inspection Report

- (a) After each inservice examination, the number of tubes plugged or repaired in each steam generator shall be reported to the commission as soon as practicable.
- (b) The complete results of the steam generator tube inservice inspection shall be included in a report for the period in which the inspection was completed.

Reports shall include:

1. Number and extent of tubes inspected.
2. Location and percent of all thickness penetration for each indication.
3. Identification of tubes plugged or repaired.

5.6 Reporting Requirements

5.6.8 Steam Generator Tube Inspection Report (continued)

- (c) Reports required by Table 5.5.8-1, "Steam Generator Tube Inspection," shall provide the information required by Specification 5.6.8.(b) and a description of investigations conducted to determine cause of the tube degradation and corrective measures taken to prevent recurrence. The report shall be submitted to the Commission prior to resumption of plant operation.
-

5.0 ADMINISTRATIVE CONTROLS

5.7 High Radiation Area

As provided in paragraph 20.1601(c) of 10 CFR Part 20, the following controls shall be applied to high radiation areas in place of controls required by paragraph 20.1601(a) and (b) of 10 CFR Part 20:

- 5.7.1 High Radiation Areas with Dose Rates Not Exceeding 1.0 rem/hour at 30 Centimeters from the Radiation Source or from any Surface Penetrated by the Radiation
- a. Each entryway to such an area shall be barricaded and conspicuously posted as a high radiation area. Such barricades may be opened as necessary to permit entry or exit of personnel or equipment.
 - b. Access to, and activities in, each such area shall be controlled by means of Radiation Work Permit (RWP) or equivalent that includes specification of radiation dose rates in the immediate work area(s) and other appropriate radiation protection equipment and measures.
 - c. Individuals qualified in radiation protection procedures and personnel continuously escorted by such individuals may be exempted from the requirement for an RWP or equivalent while performing their assigned duties provided that they are otherwise following plant radiation protection procedures for entry to, exit from, and work in such areas.
 - d. Each individual or group entering such an area shall possess:
 - 1. A radiation monitoring device that continuously displays radiation dose rates in the area; or
 - 2. A radiation monitoring device that continuously integrates the radiation dose rates in the area and alarms when the device's dose alarm setpoint is reached, with an appropriate alarm setpoint, or
 - 3. A radiation monitoring device that continuously transmits dose rate and cumulative dose information to a remote receiver monitored by radiation protection personnel responsible for controlling personnel radiation exposure within the area, or

5.7 High Radiation Area (continued)5.7.1 High Radiation Areas with Dose Rates Not Exceeding 1.0 rem/hour at 30 Centimeters from the Radiation Source or from any Surface Penetrated by the Radiation (continued)

4. A self-reading dosimeter (e.g., pocket ionization chamber or electronic dosimeter) and,
 - (i) Be under the surveillance, as specified in the RWP or equivalent, while in the area, of an individual qualified in radiation protection procedures, equipped with a radiation monitoring device that continuously displays radiation dose rates in the area; who is responsible for controlling personnel exposure within the area, or
 - (ii) Be under the surveillance as specified in the RWP or equivalent, while in the area, by means of closed circuit television, of personnel qualified in radiation protection procedures, responsible for controlling personnel radiation exposure in the area, and with the means to communicate with individuals in the area who are covered by such surveillance.
- e. Except for individuals qualified in radiation protection procedures, or personnel continuously escorted by such individuals, entry into such areas shall be made only after dose rates in the area have been determined and entry personnel are knowledgeable of them. These continuously escorted personnel will receive pre-job briefing prior to entry into such areas. This dose rate determination, knowledge, and pre-job briefing does not require documentation prior to initial entry.

5.7 High Radiation Area (continued)

5.7.2

High Radiation Areas with Dose Rates Greater than 1.0 rem/hour at 30 Centimeters from the Radiation Source or from any Surface Penetrated by the Radiation, but less than 500 rads/hour at 1 Meter from the Radiation Source or from any Surface Penetrated by the Radiation

- a. Each entryway to such an area shall be conspicuously posted as a high radiation area and shall be provided with a locked or continuously guarded door or gate that prevents unauthorized entry, and, in addition:
 1. All such door and gate keys shall be maintained under the administrative control of the shift supervisor, radiation protection manager, or his or her designee.
 2. Doors and gates shall remain locked except during periods of personnel or equipment entry or exit.
- b. Access to, and activities in, each such area shall be controlled by means of an RWP or equivalent that includes specification of radiation dose rates in the immediate work area(s) and other appropriate radiation protection equipment and measures.
- c. Individuals qualified in radiation protection procedures may be exempted from the requirement for an RWP or equivalent while performing radiation surveys in such areas provided that they are otherwise following plant radiation protection procedures for entry to, exit from, and work in such areas.
- d. Each individual or group entering such an area shall possess:
 1. A radiation monitoring device that continuously integrates the radiation rates in the area and alarms when the device's dose alarm setpoint is reached, with an appropriate alarm setpoint, or
 2. A radiation monitoring device that continuously transmits dose rate and cumulative dose information to a remote receiver monitored by radiation protection personnel responsible for controlling personnel radiation exposure within the area with the means to communicate with and control every individual in the area, or

5.7 High Radiation Area (continued)

5.7.2

High Radiation Areas with Dose Rates Greater than 1.0 rem/hour at 30 Centimeters from the Radiation Source or from any Surface Penetrated by the Radiation, but less than 500 rads/hour at 1 Meter from the Radiation Source or from any Surface Penetrated by the Radiation (continued)

3. A self-reading dosimeter (e.g., pocket ionization chamber or electronic dosimeter) and,
 - (i) Be under the surveillance, as specified in the RWP or equivalent, while in the area, of an individual qualified in radiation protection procedures, equipped with a radiation monitoring device that continuously displays radiation dose rates in the area; who is responsible for controlling personnel exposure within the area, or
 - (ii) Be under the surveillance as specified in the RWP or equivalent, while in the area, by means of closed circuit television, of personnel qualified in radiation protection procedures, responsible for controlling personnel radiation exposure in the area, and with the means to communicate with and control every individual in the area.
 4. In those cases where option (2) and (3), above, are impractical or determined to be inconsistent with the "As Low As is Reasonably Achievable" principle, a radiation monitoring device that continuously displays radiation dose rates in the area.
 - e. Except for individuals qualified in radiation protection procedures, or personnel continuously escorted by such individuals, entry into such areas shall be made only after dose rates in the area have been determined and entry personnel are knowledgeable of them. These continuously escorted personnel will receive a pre-job briefing prior to entry into such areas. This dose rate determination, knowledge, and pre-job briefing does not require documentation prior to initial entry.
 - f. Such individual areas that are within a larger area where no enclosure exists for the purpose of locking and where no enclosure can reasonably be constructed around the individual area need not be controlled by a locked door or gate, nor continuously guarded, but shall be barricaded, conspicuously posted, and a clearly visible flashing light shall be activated at the area as a warning device.
-

TABLE OF CONTENTS

B 2.0	SAFETY LIMITS (SLs).....	B 2.1.1-1
B 2.1.1	Reactor Core SLs.....	B 2.1.1-1
B 2.1.2	Reactor Coolant System (RCS) Pressure SL	B 2.1.2-1
B 3.0	LIMITING CONDITION FOR OPERATION (LCO) APPLICABILITY	B 3.0-1
B 3.0	SURVEILLANCE REQUIREMENT (SR) APPLICABILITY.....	B 3.0-10
B 3.1	REACTIVITY CONTROL SYSTEMS.....	B 3.1.1-1
B 3.1.1	SHUTDOWN MARGIN (SDM).....	B 3.1.1-1
B 3.1.2	Core Reactivity.....	B 3.1.2-1
B 3.1.3	Moderator Temperature Coefficient (MTC)	B 3.1.3-1
B 3.1.4	Rod Group Alignment Limits.....	B 3.1.4-1
B 3.1.5	Shutdown Bank Insertion Limits	B 3.1.5-1
B 3.1.6	Control Bank Insertion Limits.....	B 3.1.6-1
B 3.1.7	Rod Position Indication.....	B 3.1.7-1
B 3.1.8	PHYSICS TESTS Exceptions - MODE 2.....	B 3.1.8-1
B 3.2	POWER DISTRIBUTION LIMITS.....	B 3.2.1-1
B 3.2.1	Heat Flux Hot Channel Factor ($F_Q(Z)$) (F_Q Methodology).....	B 3.2.1-1
B 3.2.2	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)	B 3.2.2-1
B 3.2.3	AXIAL FLUX DIFFERENCE (AFD).....	B 3.2.3-1
B 3.2.4	QUADRANT POWER TILT RATIO (QPTR)	B 3.2.4-1
B 3.3	INSTRUMENTATION	B 3.3.1-1
B 3.3.1	Reactor Protection System (RPS) Instrumentation	B 3.3.1-1
B 3.3.2	Engineered Safety Feature Actuation System (ESFAS) Instrumentation.....	B 3.3.2-1
B 3.3.3	Post Accident Monitoring (PAM) Instrumentation	B 3.3.3-1
B 3.3.4	Loss of Power (LOP) Diesel Generator (DG) Start Instrumentation	B 3.3.4-1
B 3.3.5	Control Room Emergency Filtration System (CREFS) Actuation Instrumentation	B 3.3.5-1
B 3.3.6	Boron Dilution Alarm	B 3.3.6-1
B 3.4	REACTOR COOLANT SYSTEM (RCS).....	B 3.4.1-1
B 3.4.1	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits.....	B 3.4.1-1
B 3.4.2	RCS Minimum Temperature for Criticality	B 3.4.2-1
B 3.4.3	RCS Pressure and Temperature (P/T) Limits	B 3.4.3-1
B 3.4.4	RCS Loops - MODES 1 and 2	B 3.4.4-1
B 3.4.5	RCS Loops - MODE 3	B 3.4.5-1
B 3.4.6	RCS Loops - MODE 4	B 3.4.6-1
B 3.4.7	RCS Loops - MODE 5, Loops Filled	B 3.4.7-1
B 3.4.8	RCS Loops - MODE 5, Loops Not Filled.....	B 3.4.8-1
B 3.4.9	Pressurizer	B 3.4.9-1
B 3.4.10	Pressurizer Safety Valves	B 3.4.10-1
B 3.4.11	Pressurizer Power Operated Relief Valves (PORVs).....	B 3.4.11-1

(continued)

TABLE OF CONTENTS

B 3.4.12	Low Temperature Overpressure Protection (LTOP) System.....	B 3.4.12-1
B 3.4.13	RCS Operational LEAKAGE.....	B 3.4.13-1
B 3.4.14	RCS Pressure Isolation Valve (PIV) Leakage.....	B 3.4.14-1
B 3.4.15	RCS Leakage Detection Instrumentation.....	B 3.4.15-1
B 3.4.16	RCS Specific Activity.....	B 3.4.16-1
B 3.5	EMERGENCY CORE COOLING SYSTEMS (ECCS)	B 3.5.1-1
B 3.5.1	Accumulators	B 3.5.1-1
B 3.5.2	ECCS-Operating	B 3.5.2-1
B 3.5.3	ECCS-Shutdown	B 3.5.3-1
B 3.5.4	Refueling Water Storage Tank (RWST).....	B 3.5.4-1
B 3.6	CONTAINMENT SYSTEMS.....	B 3.6.1-1
B 3.6.1	Containment.....	B 3.6.1-1
B 3.6.2	Containment Air Locks	B 3.6.2-1
B 3.6.3	Containment Isolation Valves	B 3.6.3-1
B 3.6.4	Containment Pressure.....	B 3.6.4-1
B 3.6.5	Containment Air Temperature	B 3.6.5-1
B 3.6.6	Containment Spray and Cooling Systems	B 3.6.6-1
B 3.6.7	Spray Additive System	B 3.6.7-1
B 3.7	PLANT SYSTEMS	B 3.7.1-1
B 3.7.1	Main Steam Safety Valves (MSSVs)	B 3.7.1-1
B 3.7.2	Main Steam Isolation Valves (MSIVs)	B 3.7.2-1
B 3.7.3	Main Feedwater Isolation	B 3.7.3-1
B 3.7.4	Atmospheric Dump Valve (ADV) Flowpaths	B 3.7.4-1
B 3.7.5	Auxiliary Feedwater (AFW) System.....	B 3.7.5-1
B 3.7.6	Condensate Storage Tank (CST)	B 3.7.6-1
B 3.7.7	Component Cooling Water (CCW) System.....	B 3.7.7-1
B 3.7.8	Service Water (SW) System.....	B 3.7.8-1
B 3.7.9	Control Room Emergency Filtration System (CREFS).....	B 3.7.9-1
B 3.7.10	Fuel Storage Pool Water Level.....	B 3.7.10-1
B 3.7.11	Fuel Storage Pool Boron Concentration	B 3.7.11-1
B 3.7.12	Spent Fuel Assembly Storage	B 3.7.12-1
B 3.7.13	Secondary Specific Activity	B 3.7.13-1
B 3.8	ELECTRICAL POWER SYSTEMS.....	B 3.8.1-1
B 3.8.1	AC Sources-Operating	B 3.8.1-1
B 3.8.2	AC Sources-Shutdown	B 3.8.2-1
B 3.8.3	Diesel Fuel Oil and Starting Air	B 3.8.3-1
B 3.8.4	DC Sources-Operating	B 3.8.4-1
B 3.8.5	DC Sources-Shutdown	B 3.8.5-1
B 3.8.6	Battery Cell Parameters	B 3.8.6-1
B 3.8.7	Inverters-Operating	B 3.8.7-1
B 3.8.8	Inverters-Shutdown	B 3.8.8-1
B 3.8.9	Distribution Systems-Operating	B 3.8.9-1
B 3.8.10	Distribution Systems-Shutdown.....	B 3.8.10-1

(continued)

TABLE OF CONTENTS

B 3.9	REFUELING OPERATIONS	B 3.9.1-1
B 3.9.1	Boron Concentration	B 3.9.1-1
B 3.9.2	Nuclear Instrumentation	B 3.9.2-1
B 3.9.3	Containment Penetrations.....	B 3.9.3-1
B 3.9.4	Residual Heat Removal (RHR) and Coolant Circulation-High Water Level	B 3.9.4-1
B 3.9.5	Residual Heat Removal (RHR) and Coolant Circulation-Low Water Level	B 3.9.5-1
B 3.9.6	Refueling Cavity Water Level	B 3.9.6-1

B 2.0 SAFETY LIMITS (SLs)

B 2.1.1 Reactor Core SLs

BASES

BACKGROUND

Point Beach design criteria (Ref. 1) requires that specified acceptable fuel design limits are not exceeded during steady state operation, normal operational transients, and anticipated operational occurrences (AOOs). This is accomplished by having a departure from nucleate boiling (DNB) design basis, which corresponds to a 95% probability at a 95% confidence level (the 95/95 DNB criterion) that DNB will not occur and by requiring that fuel centerline temperature stays below the melting temperature.

The restrictions of this SL prevent overheating of the fuel and cladding, as well as possible cladding perforation, that would result in the release of fission products to the reactor coolant. Overheating of the fuel is prevented by maintaining the steady state peak linear heat rate (LHR) below the level at which fuel centerline melting occurs. Overheating of the fuel cladding is prevented by restricting fuel operation to within the nucleate boiling regime, where the heat transfer coefficient is large and the cladding surface temperature is slightly above the coolant saturation temperature.

Fuel centerline melting occurs when the local LHR, or power peaking, in a region of the fuel is high enough to cause the fuel centerline temperature to reach the melting point of the fuel. Expansion of the pellet upon centerline melting may cause the pellet to stress the cladding to the point of failure, allowing an uncontrolled release of activity to the reactor coolant.

Operation above the boundary of the nucleate boiling regime could result in excessive cladding temperature because of the onset of DNB and the resultant sharp reduction in heat transfer coefficient. Inside the steam film, high cladding temperatures are reached, and a cladding water (zirconium water) reaction may take place. This chemical reaction results in oxidation of the fuel cladding to a structurally weaker form. This weaker form may lose its integrity, resulting in an uncontrolled release of activity to the reactor coolant.

The proper functioning of the Reactor Protection System (RPS) and steam generator safety valves prevents violation of the reactor core SLs.

The fuel cladding must not sustain damage as a result of normal operation and AOOs. The reactor core SLs are established to preclude

BASES

APPLICABLE
SAFETY ANALYSES

violation of the following fuel design criteria:

- a. There must be at least 95% probability at a 95% confidence level (the 95/95 DNB criterion) that the hot fuel rod in the core does not experience DNB; and
- b. The hot fuel pellet in the core must not experience centerline fuel melting.

The Reactor Trip System setpoints (Ref. 2), in combination with all the LCCs, are designed to prevent any anticipated combination of transient conditions for Reactor Coolant System (RCS) temperature, pressure, RCS flow, ΔT , and THERMAL POWER level that would result in a departure from nucleate boiling ratio (DNBR) of less than the DNBR limit and preclude the existence of flow instabilities.

Automatic enforcement of these reactor core SLs is provided by the appropriate operation of the RPS and the steam generator safety valves.

The SLs represent a design requirement for establishing the RPS trip setpoints identified previously. LCO 3.4.1, "RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits," or the assumed initial conditions of the safety analyses (as indicated in the FSAR, Ref. 2) provide more restrictive limits to ensure that the SLs are not exceeded.

SAFETY LIMITS

The reactor core SLs are established to preclude violation of the following fuel design criteria:

- a. There must be at least a 95% probability at a 95% confidence level (the 95/95 DNB criterion) that the hot fuel rod in the core does not experience DNB; and
- b. There must be at least a 95% probability at a 95% confidence level that the hot fuel pellet in the core does not experience centerline fuel melting.

The reactor SLs are used to define the various RPS functions such that the above criteria are satisfied during steady state operation, normal operational transients, and anticipated operational occurrences (AOOs). To ensure that the RPS precludes that violation of the above criteria, additional criteria are applied to the Overtemperature and Overpower ΔT reactor trip functions. That is, it must be demonstrated that the

BASES

SAFETY LIMITS (continued)	average enthalpy in the hot leg is less than or equal to the saturation enthalpy and that the core exit quality is within the limits defined by the DNBR correlation. Appropriate functioning of the RPS ensures that for variations in the THERMAL POWER, RCS Pressure, RCS average temperature, RCS flow rate, and ΔI that the reactor core SLs will be satisfied during steady state operation, normal operational transients and AOOs.
APPLICABILITY	SL 2.1.1 only applies in MODES 1 and 2 because these are the only MODES in which the reactor is critical. Automatic protection functions are required to be OPERABLE during MODES 1 and 2 to ensure operation within the reactor core SLs. The steam generator safety valves or automatic protection actions serve to prevent RCS heatup to the reactor core SL conditions or to initiate a reactor trip function, which forces the unit into MODE 3. Setpoints for the reactor trip functions are specified in LCO 3.3.1, "Reactor Trip System (RTS) Instrumentation." In MODES 3, 4, 5, and 6, Applicability is not required since the reactor is not generating significant THERMAL POWER.
SAFETY LIMIT VIOLATIONS	<p>The following SL violation responses are applicable to the reactor core SLs. If SL 2.1.1 is violated, the requirement to go to MODE 3 places the unit in a MODE in which this SL is not applicable.</p> <p>The allowed Completion Time of 1 hour recognizes the importance of bringing the unit to a MODE of operation where this SL is not applicable, and reduces the probability of fuel damage.</p>
REFERENCES	<ol style="list-style-type: none">1. FSAR, Section 3.1.2. FSAR, Section 7.2.

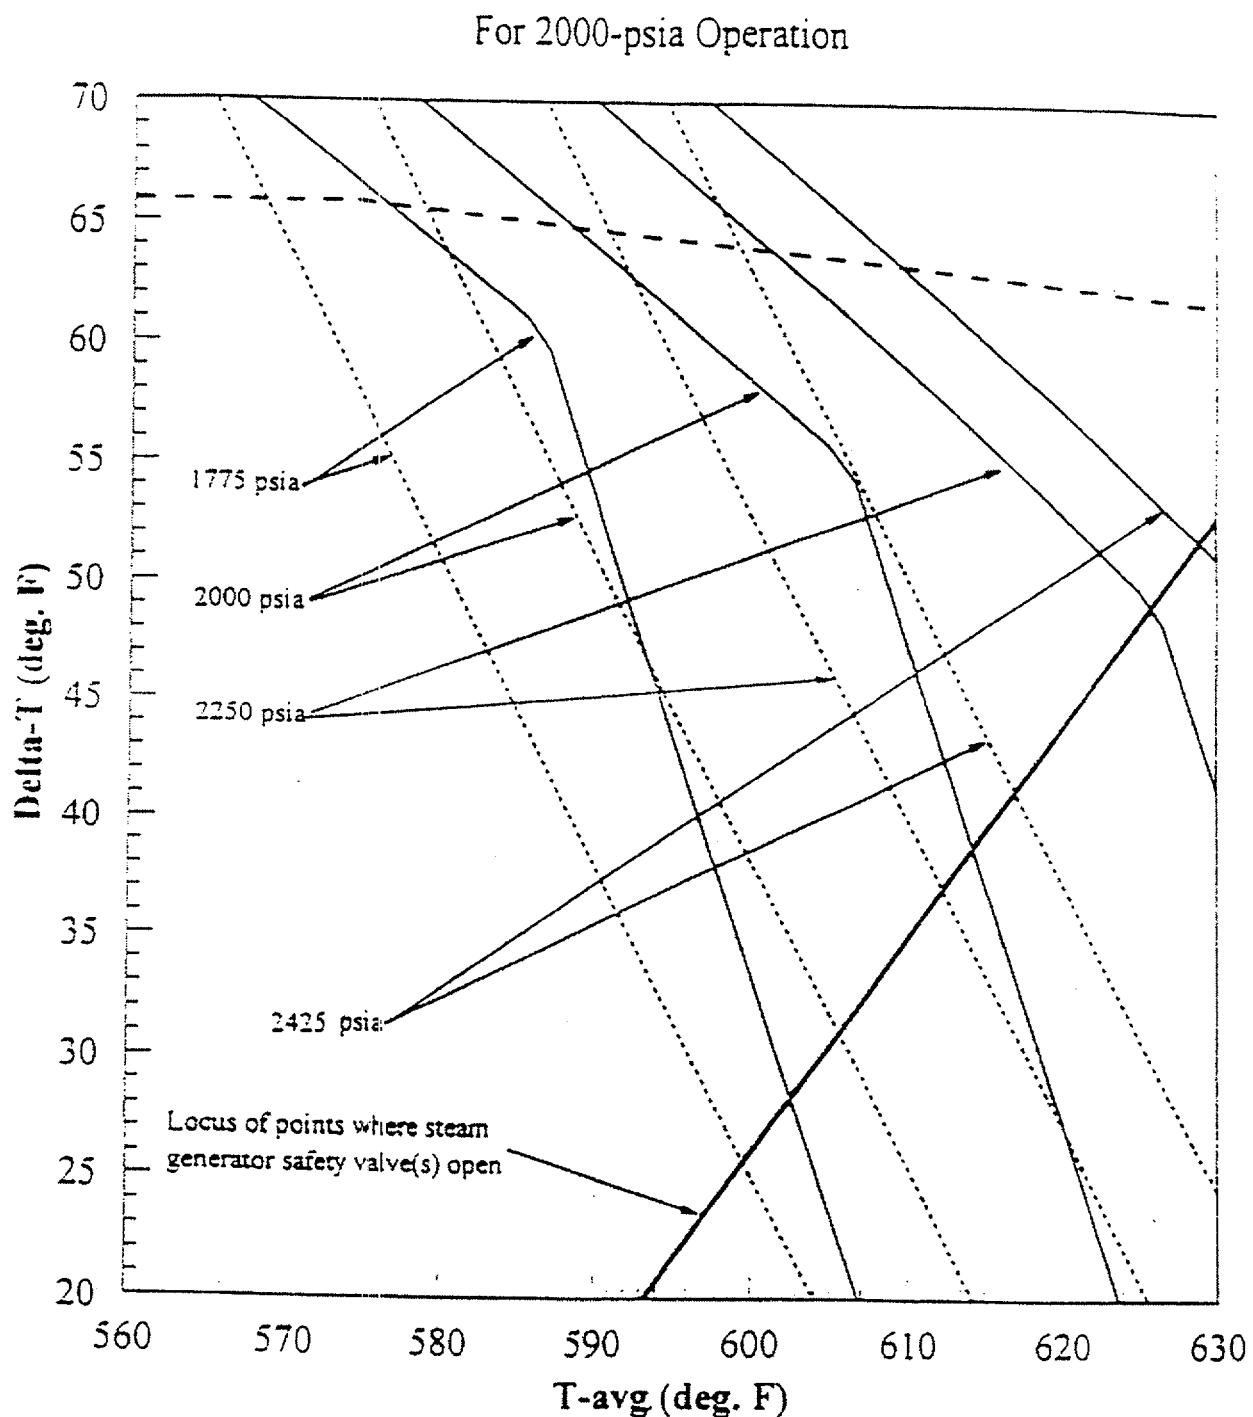


Figure B 2.1.1-1 (page 1 of 2)
Illustration of Overtemperature and Overpower Delta-T Protection
For 2000 psia Operation

For 2250-psia Operation

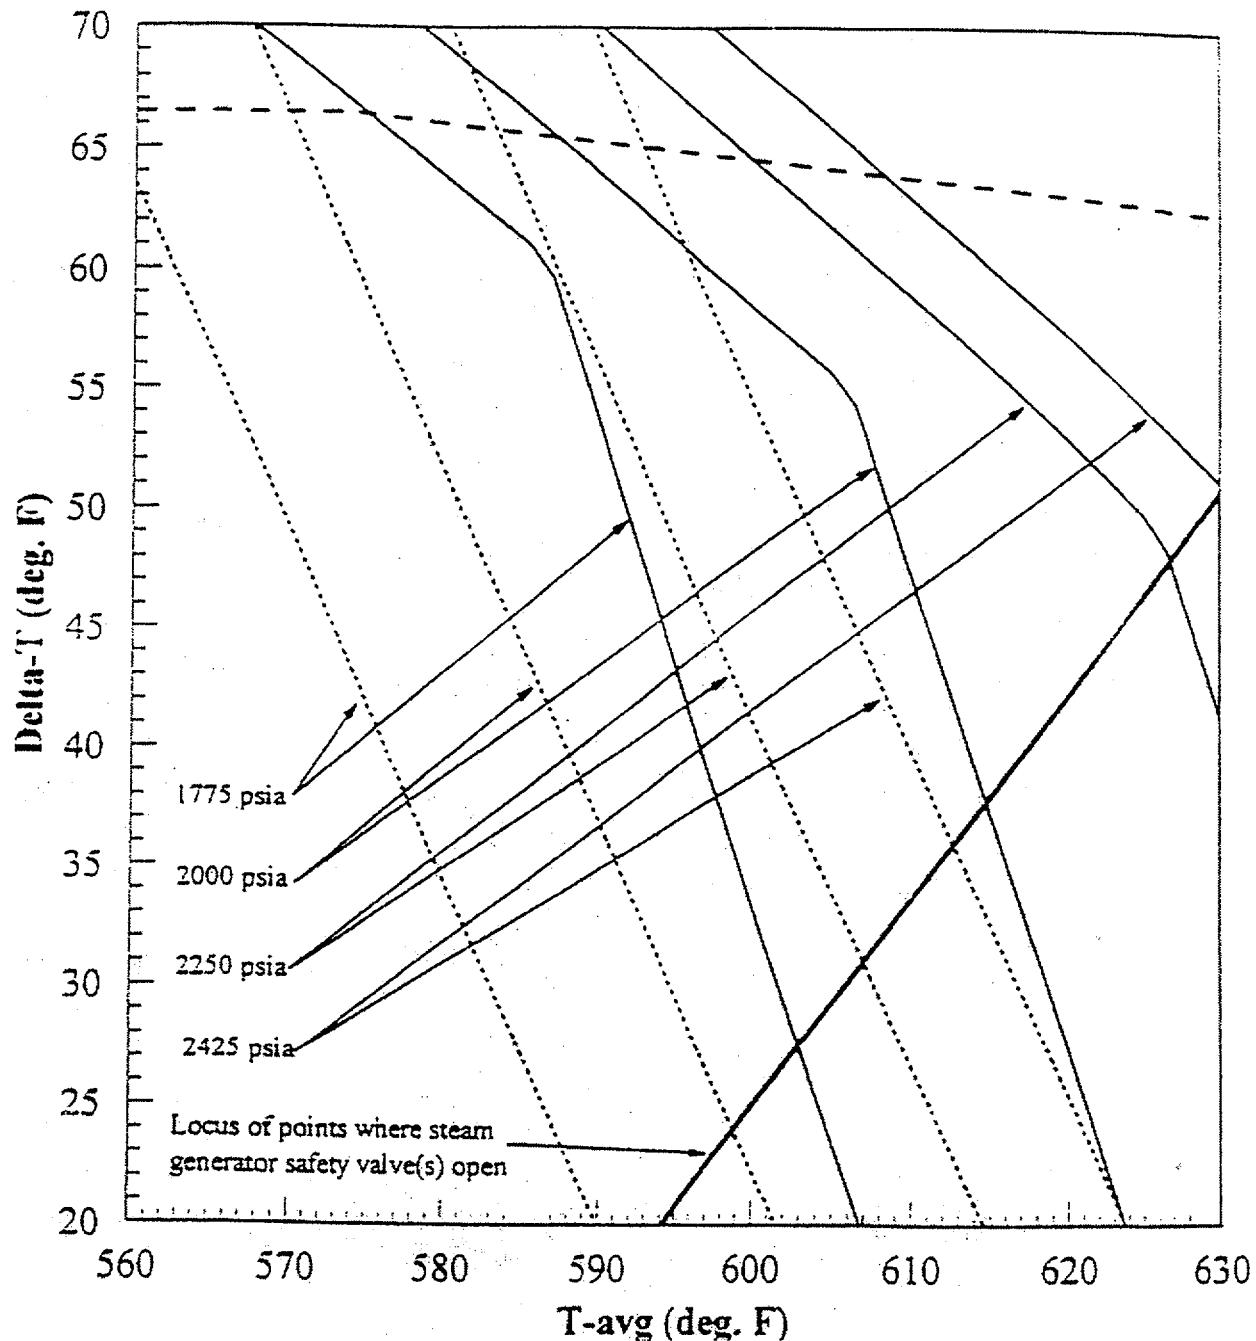


Figure B 2.1.1-1 (page 2 of 2)
Illustration of Overtemperature and Overpower Delta-T Protection
For 2250 psia Operation

B 2.0 SAFETY LIMITS (SLs)

B 2.1.2 Reactor Coolant System (RCS) Pressure SL

BASES

BACKGROUND

The SL on RCS pressure protects the integrity of the RCS against overpressurization. In the event of fuel cladding failure, fission products are released into the reactor coolant. The RCS then serves as the primary barrier in preventing the release of fission products into the atmosphere. By establishing an upper limit on RCS pressure, the continued integrity of the RCS is ensured. According to the Point Beach design criteria (Ref. 1), the reactor pressure coolant boundary (RCPB) design conditions are not to be exceeded during normal operation and anticipated operational occurrences (AOOs). Also, in accordance with the Point Beach design criteria (Ref. 1), reactivity accidents, including rod ejection, do not result in damage to the RCPB greater than limited local yielding.

The design pressure of the RCS is 2500 psia. During normal operation and AOOs, RCS pressure is limited from exceeding the design pressure by more than 10%, in accordance with Section III of the ASME Code (Ref. 2). To ensure system integrity, all RCS components are hydrostatically tested at 125% of design pressure, according to the ASME Code requirements prior to initial operation when there is no fuel in the core. Following inception of unit operation, RCS components shall be pressure tested, in accordance with the requirements of ASME Code, Section XI (Ref. 3).

Overpressurization of the RCS could result in a breach of the RCPB. If such a breach occurs in conjunction with a fuel cladding failure, fission products could enter the containment atmosphere, raising concerns relative to limits on radioactive releases specified in 10 CFR 100, "Reactor Site Criteria" (Ref. 4).

APPLICABLE
SAFETY ANALYSES

The RCS pressurizer safety valves, the main steam safety valves (MSSVs), and the reactor high pressure trip have settings established to ensure that the RCS pressure SL will not be exceeded.

The RCS pressurizer safety valves are sized to prevent system pressure from exceeding the design pressure more than 10%, as specified in Section III of the ASME Code for Nuclear Power Plant Components (Ref. 2). The transient that establishes the required relief capacity, and hence valve size requirements and lift settings, is a complete loss of external load without a direct reactor trip. During the transient, no control actions are assumed, except that the safety valves

BASES

APPLICABLE SAFETY ANALYSES (continued) on the secondary plant are assumed to open when the steam pressure reaches the secondary plant safety valve settings, and nominal feedwater supply is maintained.

The Reactor Trip System setpoints (Ref. 5), together with the settings of the MSSVs, provide pressure protection for normal operation and AOOs. The reactor high pressure trip setpoint is specifically set to provide protection against overpressurization (Ref. 7). The safety analyses for both the high pressure trip and the RCS pressurizer safety valves are performed using conservative assumptions relative to pressure control devices.

More specifically, no credit is taken for operation of the following:

- a. Pressurizer power operated relief valves (PORVs);
 - b. Atmospheric Steam Dumps;
 - c. Condenser Steam Dumps;
 - d. Reactor Control System;
 - e. Pressurizer Level Control System; or
 - f. Pressurizer spray valves.
-

SAFETY LIMITS The maximum transient pressure allowed in the RCS pressure vessel under the ASME Code, Section III, is 110% of design pressure. The maximum transient pressure allowed in the RCS piping, valves, and fittings under USAS, Section B31.1 (Ref. 6) is 120% of design pressure. The most limiting of these two allowances is the 110% of design pressure; therefore, the SL on maximum allowable RCS pressure is 2735 psig.

APPLICABILITY SL 2.1.2 applies in MODES 1, 2, 3, 4, 5, and 6 because this SL could be approached or exceeded in these MODES due to overpressurization events.

SAFETY LIMIT VIOLATIONS If the RCS pressure SL is violated when the reactor is in MODE 1 or 2, the requirement is to restore compliance and be in MODE 3 within 1 hour.

Exceeding the RCS pressure SL may cause immediate RCS failure

BASES

SAFETY LIMIT VIOLATIONS (continued)

and create a potential for radioactive releases in excess of 10 CFR 100, "Reactor Site Criteria," limits (Ref. 4).

The allowable Completion Time of 1 hour recognizes the importance of reducing power level to a MODE of operation where the potential for challenges to safety systems is minimized.

If the RCS pressure SL is exceeded in MODE 3, 4, 5, or 6 RCS pressure must be restored to within the SL value within 5 minutes. Exceeding the RCS pressure SL in MODE 3, 4, 5 or 6 is more severe than exceeding this SL in MODE 1 or 2, since the reactor vessel temperature may be lower and the vessel material, consequently, less ductile. As such, pressure must be reduced to less than the SL within 5 minutes. The action does not require reducing MODES, since this would require reducing temperature, which would compound the problem by adding thermal gradient stresses to the existing pressure stress.

REFERENCES

1. FSAR, Section 4.1.
 2. ASME, Boiler and Pressure Vessel Code, Section III, Article NB-7000.
 3. ASME, Boiler and Pressure Vessel Code, Section XI, Article IWX-5000.
 4. 10 CFR 100.
 5. FSAR, Section 7.2.
 6. USAS B31.1, Standard Code for Pressure Piping, American Society of Mechanical Engineers, 1967.
 7. FSAR, Section 4.2.
-

B 3.0 LIMITING CONDITION FOR OPERATION (LCO) APPLICABILITY

BASES

LCOs	LCO 3.0.1 through LCO 3.0.6 establish the general requirements applicable to all Specifications and apply at all times, unless otherwise stated.
LCO 3.0.1	LCO 3.0.1 establishes the Applicability statement within each individual Specification as the requirement for when the LCO is required to be met (i.e., when the unit is in the MODES or other specified conditions of the Applicability statement of each Specification).
LCO 3.0.2	<p>LCO 3.0.2 establishes that upon discovery of a failure to meet an LCO, the associated ACTIONS shall be met. The Completion Time of each Required Action for an ACTIONS Condition is applicable from the point in time that an ACTIONS Condition is entered. The Required Actions establish those remedial measures that must be taken within specified Completion Times when the requirements of an LCO are not met. This Specification establishes that:</p> <ul style="list-style-type: none">a. Completion of the Required Actions within the specified Completion Times constitutes compliance with a Specification; andb. Completion of the Required Actions is not required when an LCO is met within the specified Completion Time, unless otherwise specified. <p>There are two basic types of Required Actions. The first type of Required Action specifies a time limit in which the LCO must be met. This time limit is the Completion Time to restore an inoperable system or component to OPERABLE status or to restore variables to within specified limits. If this type of Required Action is not completed within the specified Completion Time, a shutdown may be required to place the unit in a MODE or condition in which the Specification is not applicable. (Whether stated as a Required Action or not, correction of the entered Condition is an action that may always be considered upon entering ACTIONS.) The second type of Required Action specifies the remedial measures that permit continued operation of the unit that is not further restricted by the Completion Time. In such cases, compliance with the Required Actions provides an acceptable level of safety for continued operation.</p>

BASES

LCO 3.0.2
(continued)

Completing the Required Actions is not required when an LCO is met or is no longer applicable, unless otherwise stated in the individual Specifications.

The nature of some Required Actions of some Conditions necessitates that, once the Condition is entered, the Required Actions must be completed even though the associated Conditions no longer exist. The individual LCO's ACTIONS specify the Required Actions where this is the case. An example of this is in LCO 3.4.3, "RCS Pressure and Temperature (P/T) Limits."

The Completion Times of the Required Actions are also applicable when a system or component is removed from service intentionally. The reasons for intentionally relying on the ACTIONS include, but are not limited to, performance of Surveillances, preventive maintenance, corrective maintenance, or investigation of operational problems. Entering ACTIONS for these reasons must be done in a manner that does not compromise safety. Intentional entry into ACTIONS should not be made for operational convenience. Additionally, if intentional entry into ACTIONS would result in redundant equipment being inoperable, alternatives should be used instead. Doing so limits the time both subsystems/trains of a safety function are inoperable and limits the time conditions exist which may result in LCO 3.0.3 being entered. Individual Specifications may specify a time limit for performing an SR when equipment is removed from service or bypassed for testing. In such cases, the Completion Times of the Required Actions are applicable when the time limit expires, if the equipment remains removed from service or bypassed.

When a change in MODE or other specified condition is required to comply with Required Actions, the unit may enter a MODE or other specified condition in which another Specification becomes applicable. In this case, the Completion Times of the associated Required Actions would apply from the point in time that the new Specification becomes applicable, and the ACTIONS Condition(s) are entered.

BASES

LCO 3.0.3

LCO 3.0.3 establishes the actions that must be implemented when an LCO is not met and:

- a. An associated Required Action and Completion Time is not met and no other Condition applies; or
- b. The condition of the unit is not specifically addressed by the associated ACTIONS. This means that no combination of Conditions stated in the ACTIONS can be made that exactly corresponds to the actual condition of the unit. Sometimes, possible combinations of Conditions are such that entering LCO 3.0.3 is warranted; in such cases, the ACTIONS specifically state a Condition corresponding to such combinations and also that LCO 3.0.3 be entered immediately.

This Specification delineates the time limits for placing the unit in a safe MODE or other specified condition when operation cannot be maintained within the limits for safe operation as defined by the LCO and its ACTIONS. It is not intended to be used as an operational convenience that permits routine voluntary removal of redundant systems or components from service in lieu of other alternatives that would not result in redundant systems or components being inoperable.

Upon entering LCO 3.0.3, 1 hour is allowed to prepare for an orderly shutdown before initiating a change in unit operation. This includes time to permit the operator to coordinate the reduction in electrical generation with the load dispatcher to ensure the stability and availability of the electrical grid. The time limits specified to reach lower MODES of operation permit the shutdown to proceed in a controlled and orderly manner that is well within the specified maximum cooldown rate and within the capabilities of the unit, assuming that only the minimum required equipment is OPERABLE. This reduces thermal stresses on components of the Reactor Coolant System and the potential for a plant upset that could challenge safety systems under conditions to which this Specification applies. The use and interpretation of specified times to complete the actions of LCO 3.0.3 are consistent with the discussion of Section 1.3, Completion Times.

A unit shutdown required in accordance with LCO 3.0.3 may be terminated and LCO 3.0.3 exited if any of the following occurs:

- a. The LCO is now met.
- b. A Condition exists for which the Required Actions have now been performed.

BASES

LCO 3.0.3
(continued)

- c. ACTIONS exist that do not have expired Completion Times. These Completion Times are applicable from the point in time that the Condition is initially entered and not from the time LCO 3.0.3 is exited.

The time limits of Specification 3.0.3 allow 37 hours for the unit to be in MODE 5 when a shutdown is required during MODE 1 operation. If the unit is in a lower MODE of operation when a shutdown is required, the time limit for reaching the next lower MODE applies. If a lower MODE is reached in less time than allowed, however, the total allowable time to reach MODE 5, or other applicable MODE, is not reduced. For example, if MODE 3 is reached in 2 hours, then the time allowed for reaching MODE 4 is the next 11 hours, because the total time for reaching MODE 4 is not reduced from the allowable limit of 13 hours. Therefore, if remedial measures are completed that would permit a return to MODE 1, a penalty is not incurred by having to reach a lower MODE of operation in less than the total time allowed.

In MODES 1, 2, 3, and 4, LCO 3.0.3 provides actions for Conditions not covered in other Specifications. The requirements of LCO 3.0.3 do not apply in MODES 5 and 6 because the unit is already in the most restrictive Condition required by LCO 3.0.3. The requirements of LCO 3.0.3 do not apply in other specified conditions of the Applicability (unless in MODE 1, 2, 3, or 4) because the ACTIONS of individual Specifications sufficiently define the remedial measures to be taken.

Exceptions to LCO 3.0.3 are provided in instances where requiring a unit shutdown, in accordance with LCO 3.0.3, would not provide appropriate remedial measures for the associated condition of the unit. An example of this is in LCO 3.7.15, "Fuel Storage Pool Water Level." LCO 3.7.15 has an Applicability of "During movement of irradiated fuel assemblies in the fuel storage pool." Therefore, this LCO can be applicable in any or all MODES. If the LCO and the Required Actions of LCO 3.7.15 are not met while in MODE 1, 2, or 3, there is no safety benefit to be gained by placing the unit in a shutdown condition. The Required Action of LCO 3.7.15 of "Suspend movement of irradiated fuel assemblies in the fuel storage pool" is the appropriate Required Action to complete in lieu of the actions of LCO 3.0.3. These exceptions are addressed in the individual Specifications.

BASES

LCO 3.0.4

LCO 3.0.4 establishes limitations on changes in MODES or other specified conditions in the Applicability when an LCO is not met. It precludes placing the unit in a MODE or other specified condition stated in that Applicability (e.g., Applicability desired to be entered) when the following exist:

- a. Unit conditions are such that the requirements of the LCO would not be met in the Applicability desired to be entered; and
- b. Continued noncompliance with the LCO requirements, if the Applicability were entered, would result in the unit being required to exit the Applicability desired to be entered to comply with the Required Actions.

Compliance with Required Actions that permit continued operation of the unit for an unlimited period of time in a MODE or other specified condition provides an acceptable level of safety for continued operation. This is without regard to the status of the unit before or after the MODE change. Therefore, in such cases, entry into a MODE or other specified condition in the Applicability may be made in accordance with the provisions of the Required Actions. The provisions of this Specification should not be interpreted as endorsing the failure to exercise the good practice of restoring systems or components to OPERABLE status before entering an associated MODE or other specified condition in the Applicability.

The provisions of LCO 3.0.4 shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS. In addition, the provisions of LCO 3.0.4 shall not prevent changes in MODES or other specified conditions in the Applicability that result from any unit shutdown.

Exceptions to LCO 3.0.4 are stated in the individual Specifications. The exceptions allow entry into MODES or other specified conditions in the Applicability when the associated ACTIONS to be entered do not provide for continued operation for an unlimited period of time. Exceptions may apply to all the ACTIONS or to a specific Required Action of a Specification.

LCO 3.0.4 is only applicable when entering MODE 4 from MODE 5, MODE 3 from MODE 4, MODE 2 from MODE 3, or MODE 1 from MODE 2. Furthermore, LCO 3.0.4 is applicable when entering any other specified condition in the Applicability only while operating in MODES 1, 2, 3, or 4. The requirements of LCO 3.0.4 do not apply in MODES 5 and 6, or in other specified conditions of the Applicability (unless in MODES 1, 2, 3, or 4) because the ACTIONS of individual

BASES

LCO 3.0.4
(continued)

Specifications sufficiently define the remedial measures to be taken.

In some cases these ACTIONS provide a Note that states "While this LCO is not met, entry into a MODE or other specified condition in the Applicability is not permitted, unless required to comply with ACTIONS." This Note is a requirement explicitly precluding entry into a MODE or other specified condition of the Applicability.

Surveillances do not have to be performed on the associated inoperable equipment (or on variables outside the specified limits), as permitted by SR 3.0.1. Therefore, changing MODES or other specified conditions while in an ACTIONS Condition, in compliance with LCO 3.0.4 or where an exception to LCO 3.0.4 is stated, is not a violation of SR 3.0.1 or SR 3.0.4 for those Surveillances that do not have to be performed due to the associated inoperable equipment. However, SRs must be met to ensure OPERABILITY prior to declaring the associated equipment OPERABLE (or variable within limits) and restoring compliance with the affected LCO.

LCO 3.0.5

LCO 3.0.5 establishes the allowance for restoring equipment to service under administrative controls when it has been removed from service or declared inoperable to comply with ACTIONS. The sole purpose of this Specification is to provide an exception to LCO 3.0.2 (e.g., to not comply with the applicable Required Action(s)) to allow the performance of required testing to demonstrate:

- a. The OPERABILITY of the equipment being returned to service; or
- b. The OPERABILITY of other equipment.

The administrative controls ensure the time the equipment is operated in conflict with the requirements of the ACTIONS is limited to the time absolutely necessary to perform the required testing to demonstrate OPERABILITY. This Specification does not provide time to perform any other preventive or corrective maintenance.

An example of demonstrating the OPERABILITY of the equipment being returned to service is reopening a containment isolation valve that has been closed to comply with Required Actions, but must be reopened to perform the required testing.

An example of demonstrating the OPERABILITY of other equipment is taking an inoperable channel out of the tripped condition during the performance of required testing on another channel to prevent the trip function from occurring. A similar example of demonstrating the

BASES

LCO 3.0.5 (continued)	<p>OPERABILITY of other equipment is taking an inoperable channel or trip system out of the tripped condition to permit the logic to function and indicate the appropriate response during the performance of required testing on another channel in the same trip system.</p>
LCO 3.0.6	<p>LCO 3.0.6 establishes an exception to LCO 3.0.2 for support systems that have an LCO specified in the Technical Specifications (TS). This exception is provided because LCO 3.0.2 would require that the Conditions and Required Actions of the associated inoperable supported system LCO be entered solely due to the inoperability of the support system. This exception is justified because the actions that are required to ensure the unit is maintained in a safe condition are specified in the support system LCO's Required Actions. These Required Actions may include entering the supported system's Conditions and Required Actions or may specify other Required Actions.</p> <p>When a support system is inoperable and there is an LCO specified for it in the TS, the supported system(s) are required to be declared inoperable if determined to be inoperable as a result of the support system inoperability. However, it is not necessary to enter into the supported systems' Conditions and Required Actions unless directed to do so by the support system's Required Actions. The potential confusion and inconsistency of requirements related to the entry into multiple support and supported systems' LCOs' Conditions and Required Actions are eliminated by providing all the actions that are necessary to ensure the unit is maintained in a safe condition in the support system's Required Actions.</p> <p>However, there are instances where a support system's Required Action may either direct a supported system to be declared inoperable or direct entry into Conditions and Required Actions for the supported system. This may occur immediately or after some specified delay to perform some other Required Action. Regardless of whether it is immediate or after some delay, when a support system's Required Action directs a supported system to be declared inoperable or directs entry into Conditions and Required Actions for a supported system, the applicable Conditions and Required Actions shall be entered in accordance with LCO 3.0.2.</p> <p>Specification 5.5.14, "Safety Function Determination Program (SFDP)," ensures loss of safety function is detected and appropriate actions are taken. Upon entry into LCO 3.0.6, an evaluation shall be made to determine if loss of safety function exists. Additionally, other limitations, remedial actions, or compensatory actions may be identified as a result</p>

BASES

LCO 3.0.6
(continued)

of the support system inoperability and corresponding exception to entering supported system Conditions and Required Actions. The SFDP implements the requirements of LCO 3.0.6.

Cross train checks to identify a loss of safety function for those support systems that support multiple and redundant safety systems are required. The cross train check verifies that the supported systems of the redundant OPERABLE support system are OPERABLE, thereby ensuring safety function is retained. If this evaluation determines that a loss of safety function exists, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

This loss of safety function does not require consideration of additional single failures or loss of offsite power. Since operation is being restricted in accordance with the ACTIONS of the support system, this accounts for any temporary loss of redundancy or single failure protection. Similarly, the ACTIONS for inoperable offsite circuit(s) and inoperable diesel generator(s) provide the necessary restriction for cross train inoperabilities. This explicit cross train verification for inoperable AC electrical power sources also acknowledges that supported system(s) are not declared inoperable solely as a result of inoperability of a normal or emergency electrical power source (refer to the definition of OPERABILITY).

When a loss of safety function is determined to exist, and the SFDP requires entry into the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists, consideration must be given to the specific type of function affected. Where a loss of function is solely due to a single Technical Specification support system (e.g., loss of automatic start due to inoperable instrumentation, or loss of pump suction source due to low tank level) the appropriate LCO is the LCO for the support system. The ACTIONS for a support system LCO adequately address the inoperabilities of that system without reliance on entering its supported system LCO. When the loss of function is the result of multiple support systems, the appropriate LCO is the LCO for the supported system.

BASES

LCO 3.0.7

There are certain special tests and operations required to be performed at various times over the life of the unit. These special tests and operations are necessary to demonstrate select unit performance characteristics, to perform special maintenance activities, and to perform special evolutions. Test Exception LCOs allow specified Technical Specification (TS) requirements to be changed to permit performances of these special tests and operations, which otherwise could not be performed if required to comply with the requirements of these TS. Unless otherwise specified, all the other TS requirements remain unchanged. This will ensure all appropriate requirements of the MODE or other specified condition not directly associated with or required to be changed to perform the special test or operation will remain in effect.

The Applicability of a Test Exception LCO represents a condition not necessarily in compliance with the normal requirements of the TS. Compliance with Test Exception LCOs is optional. A special operation may be performed either under the provisions of the appropriate Test Exception LCO or under the other applicable TS requirements. If it is desired to perform the special operation under the provisions of the Test Exception LCO, the requirements of the Test Exception LCO shall be followed.

B 3.0 SURVEILLANCE REQUIREMENT (SR) APPLICABILITY

BASES

SRs SR 3.0.1 through SR 3.0.4 establish the general requirements applicable to all Specifications and apply at all times, unless otherwise stated.

SR 3.0.1 SR 3.0.1 establishes the requirement that SRs must be met during the MODES or other specified conditions in the Applicability for which the requirements of the LCO apply, unless otherwise specified in the individual SRs. This Specification is to ensure that Surveillances are performed to verify the OPERABILITY of systems and components, and that variables are within specified limits. Failure to meet a Surveillance within the specified Frequency, in accordance with SR 3.0.2, constitutes a failure to meet an LCO.

Systems and components are assumed to be OPERABLE when the associated SRs have been met. However, nothing in this Specification is to be construed as implying that systems or components are OPERABLE when:

- a. The systems or components are known to be inoperable, although still meeting the SRs; or
- b. The requirements (acceptance criteria) of the Surveillance(s) are known not to be met between required Surveillance performances.

Surveillances do not have to be performed when the unit is in a MODE or other specified condition for which the requirements of the associated LCO are not applicable, unless otherwise specified. The SRs associated with a test exception are only applicable when the test exception is used as an allowable exception to the requirements of a Specification.

Unplanned events may satisfy the requirements (including applicable acceptance criteria) for a given SR. In this case, the unplanned event may be credited as fulfilling the performance of the SR. This allowance includes those SRs whose performance is normally precluded in a given MODE or other specified condition.

Surveillances, including Surveillances invoked by Required Actions, do not have to be performed on inoperable equipment because the ACTIONS define the remedial measures that apply.

Surveillances have to be met and performed in accordance with

BASES

SR 3.0.1 (continued) SR 3.0.2, prior to returning equipment to OPERABLE status.

Upon completion of maintenance, appropriate post maintenance testing is required to declare equipment OPERABLE. This includes ensuring applicable Surveillances are not failed and their most recent performance is in accordance with SR 3.0.2. Post maintenance testing may not be possible in the current MODE or other specified conditions in the Applicability due to the necessary unit parameters not having been established. In these situations, the equipment may be considered OPERABLE provided testing has been satisfactorily completed to the extent possible and the equipment is not otherwise believed to be incapable of performing its function. This will allow operation to proceed to a MODE or other specified condition where other necessary post maintenance tests can be completed.

SR 3.0.2

SR 3.0.2 establishes the requirements for meeting the specified Frequency for Surveillances and any Required Action with a Completion Time that requires the periodic performance of the Required Action on a "once per ..." interval.

SR 3.0.2 permits a 25% extension of the interval specified in the Frequency. This extension facilitates Surveillance scheduling and considers plant operating conditions that may not be suitable for conducting the Surveillance (e.g., transient conditions or other ongoing Surveillance or maintenance activities).

The 25% extension does not significantly degrade the reliability that results from performing the Surveillance at its specified Frequency. This is based on the recognition that the most probable result of any particular Surveillance being performed is the verification of conformance with the SRs. The exceptions to SR 3.0.2 are those Surveillances for which the 25% extension of the interval specified in the Frequency does not apply. These exceptions are stated in the individual Specifications. An example of where SR 3.0.2 does not apply is the Containment Leakage Rate Testing Program.

As stated in SR 3.0.2, the 25% extension also does not apply to the initial portion of a periodic Completion Time that requires performance on a "once per ..." basis. The 25% extension applies to each performance after the initial performance. The initial performance of the Required Action, whether it is a particular Surveillance or some other remedial action, is considered a single action with a single Completion Time. One reason for not allowing the 25% extension to this Completion Time is that such an action usually verifies that no loss of function has occurred by checking the status of redundant or diverse components

BASES

- SR 3.0.2 (continued) or accomplishes the function of the inoperable equipment in an alternative manner.
- The provisions of SR 3.0.2 are not intended to be used repeatedly merely as an operational convenience to extend Surveillance intervals (other than those consistent with refueling intervals) or periodic Completion Time intervals beyond those specified.
-

- SR 3.0.3 SR 3.0.3 establishes the flexibility to defer declaring affected equipment inoperable or an affected variable outside the specified limits when a Surveillance has not been completed within the specified Frequency. A delay period of up to 24 hours or up to the limit of the specified Frequency, whichever is less, applies from the point in time that it is discovered that the Surveillance has not been performed in accordance with SR 3.0.2, and not at the time that the specified Frequency was not met.

This delay period provides adequate time to complete Surveillances that have been missed. This delay period permits the completion of a Surveillance before complying with Required Actions or other remedial measures that might preclude completion of the Surveillance.

The basis for this delay period includes consideration of unit conditions, adequate planning, availability of personnel, the time required to perform the Surveillance, the safety significance of the delay in completing the required Surveillance, and the recognition that the most probable result of any particular Surveillance being performed is the verification of conformance with the requirements.

When a Surveillance with a Frequency based not on time intervals, but upon specified unit conditions or operational situations, is discovered not to have been performed when specified, SR 3.0.3 allows the full delay period of 24 hours to perform the Surveillance.

SR 3.0.3 also provides a time limit for completion of Surveillances that become applicable as a consequence of MODE changes imposed by Required Actions.

Failure to comply with specified Frequencies for SRs is expected to be an infrequent occurrence. Use of the delay period established by SR 3.0.3 is a flexibility which is not intended to be used as an operational convenience to extend Surveillance intervals.

BASES

SR 3.0.3 (continued) If a Surveillance is not completed within the allowed delay period, then the equipment is considered inoperable or the variable is considered outside the specified limits and the Completion Times of the Required Actions for the applicable LCO Conditions begin immediately upon expiration of the delay period. If a Surveillance is failed within the delay period, then the equipment is inoperable, or the variable is outside the specified limits and the Completion Times of the Required Actions for the applicable LCO Conditions begin immediately upon the failure of the Surveillance.

Completion of the Surveillance within the delay period allowed by this Specification, or within the Completion Time of the ACTIONS, restores compliance with SR 3.0.1.

SR 3.0.4 SR 3.0.4 establishes the requirement that all applicable SRs must be met before entry into a MODE or other specified condition in the Applicability.

This Specification ensures that system and component OPERABILITY requirements and variable limits are met before entry into MODES or other specified conditions in the Applicability for which these systems and components ensure safe operation of the unit.

The provisions of this Specification should not be interpreted as endorsing the failure to exercise the good practice of restoring systems or component to OPERABLE status before entering an associated MODE or other specified condition in the Applicability.

However, in certain circumstances, failing to meet an SR will not result in SR 3.0.4 restricting a MODE change or other specified condition change. When a system, subsystem, division, component, device, or variable is inoperable or outside its specified limits, the associated SR(s) are not required to be performed, per SR 3.0.1, which states that surveillances do not have to be performed on inoperable equipment. When equipment is inoperable, SR 3.0.4 does not apply to the associated SR(s) since the requirement for the SR(s) to be performed is removed. Therefore, failing to perform the Surveillance(s) within the specified Frequency does not result in an SR 3.0.4 restriction to changing MODES or other specified conditions of the Applicability. However, since the LCO is not met in this instance, LCO 3.0.4 will govern any restrictions that may (or may not) apply to MODE or other specified condition changes.

BASES

- SR 3.0.4 (continued) The provisions of SR 3.0.4 shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS. In addition, the provisions of LCO 3.0.4 shall not prevent changes in MODES or other specified conditions in the Applicability that result from any unit shutdown.
- The precise requirements for performance of SRs are specified such that exceptions to SR 3.0.4 are not necessary. The specific time frames and conditions necessary for meeting the SRs are specified in the Frequency, in the Surveillance, or both. This allows performance of Surveillances when the prerequisite condition(s) specified in a Surveillance procedure require entry into the MODE or other specified condition in the Applicability of the associated LCO prior to the performance or completion of a Surveillance. A Surveillance that could not be performed until after entering the LCO Applicability would have its Frequency specified such that it is not "due" until the specific conditions needed are met. Alternately, the Surveillance may be stated in the form of a Note as not required (to be met or performed) until a particular event, condition, or time has been reached. Further discussion of the specific formats of SRs' annotation is found in Section 1.4, Frequency.
- SR 3.0.4 is only applicable when entering MODE 4 from MODE 5, MODE 3 from MODE 4, Mode 2 from MODE 3, or MODE 1 from MODE 2. Furthermore, SR 3.0.4 is applicable when entering any other specified condition in the Applicability only while operating in MODES 1, 2, 3, or 4. The requirements of SR 3.0.4 do not apply in MODES 5 and 6, or in other specified conditions of the Applicability (unless in MODES 1, 2, 3, or 4) because the ACTIONS of individual Specifications sufficiently define the remedial measures to be taken.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.1 SHUTDOWN MARGIN (SDM)

BASES

BACKGROUND

According to the Point Beach Design Criteria (Ref. 1), the reactivity control systems must be redundant and capable of holding the reactor core subcritical when shut down under cold conditions. Maintenance of the SDM ensures that postulated reactivity events will not damage the fuel.

SDM requirements provide sufficient reactivity margin to ensure that acceptable fuel design limits will not be exceeded for normal shutdown and anticipated operational occurrences (AOOs). As such, the SDM defines the degree of subcriticality that would be obtained immediately following the insertion or scram of all shutdown and control rods, assuming that the single rod cluster assembly of highest reactivity worth is fully withdrawn.

The system design requires that two independent reactivity control systems be provided, and that one of these systems be capable of maintaining the core subcritical under cold conditions. These requirements are provided by the use of movable control assemblies and soluble boric acid in the Reactor Coolant System (RCS). The Control Rod System can compensate for the reactivity effects of the fuel and water temperature changes accompanying power level changes over the range from full load to no load. In addition, the Control Rod System, together with the boration system, provides the SDM during power operation and is capable of making the core subcritical rapidly enough to prevent exceeding acceptable fuel damage limits, assuming that the rod of highest reactivity worth remains fully withdrawn. The soluble boron system can compensate for fuel depletion during operation and all xenon burnout reactivity changes and maintain the reactor subcritical under cold conditions.

During power operation, SDM control is ensured by operating with the shutdown banks within the limits of LCO 3.1.5, "Shutdown Bank Insertion Limits," and the control banks within the limits of LCO 3.1.6, "Control Bank Insertion Limits." When the unit is in the shutdown and refueling modes, the SDM requirements are met by means of adjustments to the RCS boron concentration.

BASES

APPLICABLE SAFETY ANALYSES

The minimum required SDM is assumed as an initial condition in safety analyses. The safety analysis (Refs. 2 and 5) establishes an SDM that ensures specified acceptable fuel design limits are not exceeded for normal operation and AOOs, with the assumption of the highest worth rod stuck out on scram. For MODE 5, the primary safety analysis that relies on the SDM limit is the boron dilution analysis.

The acceptance criteria for the SDM requirements are that specified acceptable fuel design limits are maintained. This is done by ensuring that:

- a. The reactor can be made subcritical from all operating conditions, transients, and Design Basis Events;
- b. The reactivity transients associated with postulated accident conditions are controllable within acceptable limits (departure from nucleate boiling ratio (DNBR), fuel centerline temperature limits for AOOs, and ≤ 225 cal/gm energy deposition for unirradiated and ≤ 200 cal/gm energy deposition for irradiated fuel during a rod ejection accident); and
- c. The reactor will be maintained sufficiently subcritical to preclude inadvertent criticality in the shutdown condition.

The most limiting accident for the SDM requirements is based on a main steam line break (MSLB), as described in the accident analysis (Ref. 2). The increased steam flow resulting from a pipe break in the main steam system causes an increased energy removal from the affected steam generator (SG), and consequently the RCS. This results in a reduction of the reactor coolant temperature. The resultant coolant shrinkage causes a reduction in pressure. In the presence of a negative moderator temperature coefficient, this cooldown causes an increase in core reactivity. As RCS temperature decreases, the severity of an MSLB decreases until the MODE 5 value is reached. The most limiting MSLB, with respect to potential fuel damage before a reactor trip occurs, is a guillotine break of a main steam line inside containment initiated at the end of core life. The positive reactivity addition from the moderator temperature decrease will terminate when the affected SG boils dry, thus terminating RCS heat removal and cooldown. Following the MSLB, a post trip return to power may occur; however, no fuel damage occurs as a result of the post trip return to power, and THERMAL POWER does not violate the Safety Limit (SL) requirement of SL 2.1.1.

BASES

APPLICABLE SAFETY ANALYSES (continued)	In addition to the limiting MSLB transient, the SDM requirement must also protect against: <ol style="list-style-type: none">a. Inadvertent boron dilution;b. An uncontrolled rod withdrawal from subcritical or low power condition; andc. Rod ejection.
---	--

Each of these events is discussed below.

In the boron dilution analysis, the required SDM defines the reactivity difference between an initial subcritical boron concentration and the corresponding critical boron concentration. These values, in conjunction with the configuration of the RCS and the assumed dilution flow rate, directly affect the results of the analysis. This event is most limiting at the beginning of core life, when critical boron concentrations are highest.

The uncontrolled rod withdrawal transient is terminated by a high power level trip or an OT ΔT trip. In all cases, power level, RCS pressure, linear heat rate, and the DNBR do not exceed allowable limits.

The ejection of a control rod rapidly adds reactivity to the reactor core, causing both the core power level and heat flux to increase with corresponding increases in reactor coolant temperatures and pressure. The ejection of a rod also produces a time dependent redistribution of core power.

SDM satisfies Criterion 2 of the NRC Policy Statement. Even though it is not directly observed from the control room, SDM is considered an initial condition process variable because it is periodically monitored to ensure that the unit is operating within the bounds of accident analysis assumptions.

LCO	SDM is a core design condition that can be ensured during operation through control rod positioning (control and shutdown banks) and through the soluble boron concentration.
-----	---

The MSLB (Ref. 2) and the boron dilution (Ref. 3) accidents are the most limiting analyses that establish the SDM limit. For MSLB accidents, if the limit is violated, there is a potential to exceed the DNBR limit and to exceed 10 CFR 100, "Reactor Site Criteria," limits (Ref. 4). For the boron dilution accident, if the limit is violated, the

BASES

LCO (continued)	minimum required time assumed for operator action to terminate dilution may no longer be applicable.
APPLICABILITY	In MODE 2 with $k_{eff} < 1.0$ and in MODES 3, 4, and 5, the SDM requirements are applicable to provide sufficient negative reactivity to meet the assumptions of the safety analyses discussed above. In MODE 6, the shutdown reactivity requirements are given in LCO 3.9.1, "Boron Concentration." In MODES 1 and 2 with $k_{eff} \geq 1.0$, SDM is ensured by complying with LCO 3.1.5, "Shutdown Bank Insertion Limits," and LCO 3.1.6.

ACTIONS	<p><u>A.1</u></p> <p>If the SDM requirements are not met, boration must be initiated promptly. A Completion Time of 15 minutes is adequate for an operator to correctly align and start the required systems and components. It is assumed that boration will be continued until the SDM requirements are met.</p> <p>In the determination of the required combination of boration flow rate and boron concentration, there is no unique requirement that must be satisfied. Since it is imperative to raise the boron concentration of the RCS as soon as possible, the boron concentration should be a highly concentrated solution, such as that normally found in the boric acid storage tank, or the refueling water storage tank. The operator should borate with the best source available for the plant conditions.</p> <p>In determining the boration flow rate, the time in core life must be considered. For instance, the most difficult time in core life to increase the RCS boron concentration is at the beginning of cycle when the boron concentration may approach or exceed 2000 ppm. Assuming that a value of 1% $\Delta k/k$ must be recovered and a boration flow rate of 32 gpm, it is possible to increase the boron concentration of the RCS by 100 ppm in approximately 35 minutes. If a boron worth of 10 pcm/ppm is assumed, this combination of parameters will increase the SDM by 1% $\Delta k/k$. These boration parameters of 32 gpm and 3.75% boric acid represent typical values and are provided for the purpose of offering a specific example.</p>
---------	---

BASES

SURVEILLANCE
REQUIREMENTS

SR 3.1.1.1

In MODES 1 and 2 with $k_{\text{eff}} \geq 1.0$, SDM is verified by observing that the requirements of LCO 3.1.5 and LCO 3.1.6 are met. In the event that a rod is known to be untrippable, however, SDM verification must account for the worth of the untrippable rod as well as another rod of maximum worth. In MODE 6, SDM is verified by observing that the requirements of LCO 3.9.1, "Boron Concentration" are met.

In MODE 2 with $k_{\text{eff}} < 1.0$ and MODES 3, 4, and 5, the SDM is verified, considering the listed reactivity effects:

- a. RCS boron concentration;
- b. Control and shutdown bank position;
- c. RCS average temperature;
- d. Fuel burnup based on gross thermal energy generation;
- e. Xenon concentration;
- f. Samarium concentration; and
- g. Isothermal temperature coefficient (ITC).

Using the ITC accounts for Doppler reactivity in this calculation because the reactor is subcritical, and the fuel temperature will be changing at the same rate as the RCS.

The Frequency of 24 hours is based on the generally slow change in required boron concentration and the low probability of an accident occurring without the required SDM. This allows time for the operator to collect the required data, which includes performing a boron concentration analysis, and complete the calculation.

REFERENCES

1. FSAR, Section 3.1.
 2. FSAR, Section 14.2.5.
 3. FSAR, Section 14.1.4.
 4. 10 CFR 100.
 5. FSAR, Sections 14.1.1 and 14.2.6.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.2 Core Reactivity

BASES

BACKGROUND

According to the Point Beach design criteria (Ref. 1), reactivity shall be controllable, such that subcriticality is maintained under cold conditions, and acceptable fuel design limits are not exceeded during normal operation and anticipated operational occurrences. Therefore, reactivity balance is used as a measure of the predicted versus measured core reactivity during power operation. The periodic confirmation of core reactivity is necessary to ensure that Design Basis Accident (DBA) and transient safety analyses remain valid. A large reactivity difference could be the result of unanticipated changes in fuel, control rod worth, or operation at conditions not consistent with those assumed in the predictions of core reactivity, and could potentially result in a loss of SDM or violation of acceptable fuel design limits. Comparing predicted versus measured core reactivity validates the nuclear methods used in the safety analysis and supports the SDM demonstrations (LCO 3.1.1, "SHUTDOWN MARGIN (SDM)") in ensuring the reactor can be brought safely to cold, subcritical conditions.

When the reactor core is critical or in normal power operation, a reactivity balance exists and the net reactivity is zero. A comparison of predicted and measured reactivity is convenient under such a balance, since parameters are being maintained relatively stable under steady state power conditions. The positive reactivity inherent in the core design is balanced by the negative reactivity of the control components, thermal feedback, neutron leakage, and materials in the core that absorb neutrons, such as burnable absorbers producing zero net reactivity. Excess reactivity can be inferred from the boron letdown curve (or critical boron curve), which provides an indication of the soluble boron concentration in the Reactor Coolant System (RCS) versus cycle burnup. Periodic measurement of the RCS boron concentration for comparison with the predicted value with other variables fixed (such as rod height, temperature, pressure, and power), provides a convenient method of ensuring that core reactivity is within design expectations and that the calculational models used to generate the safety analysis are adequate.

In order to achieve the required fuel cycle energy output, the uranium enrichment, in the new fuel loading and in the fuel remaining from the previous cycle, provides excess positive reactivity beyond that required to sustain steady state operation throughout the cycle. When the reactor is critical at RTP and moderator temperature, the excess positive reactivity is compensated by burnable absorbers (if any),

BASES

BACKGROUND (continued)

control rods, whatever neutron poisons (mainly xenon and samarium) are present in the fuel, and the RCS boron concentration.

When the core is producing THERMAL POWER, the fuel is being depleted and excess reactivity is decreasing. As the fuel depletes, the RCS boron concentration is reduced to decrease negative reactivity and maintain constant THERMAL POWER. The boron letdown curve is based on steady state operation at RTP. Therefore, deviations from the predicted boron letdown curve may indicate deficiencies in the design analysis, deficiencies in the calculational models, or abnormal core conditions, and must be evaluated.

APPLICABLE SAFETY ANALYSES

The acceptance criteria for core reactivity are that the reactivity balance limit ensures plant operation is maintained within the assumptions of the safety analyses.

Accurate prediction of core reactivity is either an explicit or implicit assumption in the accident analysis evaluations. Every accident evaluation (Ref. 2) is, therefore, dependent upon accurate evaluation of core reactivity. In particular, SDM and reactivity transients, such as control rod withdrawal accidents or rod ejection accidents, are very sensitive to accurate prediction of core reactivity. These accident analysis evaluations rely on computer codes that have been qualified against available test data, operating plant data, and analytical benchmarks. Monitoring reactivity balance additionally ensures that the nuclear methods provide an accurate representation of the core reactivity.

Design calculations and safety analyses are performed for each fuel cycle for the purpose of predetermining reactivity behavior and the RCS boron concentration requirements for reactivity control during fuel depletion.

The comparison between measured and predicted initial core reactivity provides a normalization for the calculational models used to predict core reactivity. If the measured and predicted RCS boron concentrations for identical core conditions at beginning of cycle (BOC) do not agree, then the assumptions used in the reload cycle design analysis or the calculational models used to predict soluble boron requirements may not be accurate. If reasonable agreement between measured and predicted core reactivity exists at BOC, then the prediction may be normalized to the measured boron concentration. Thereafter, any significant deviations in the measured boron concentration from the predicted boron letdown curve that develop during fuel depletion may be an indication that the calculational model

BASES

APPLICABLE SAFETY ANALYSES (continued) is not adequate for core burnups beyond BOC, or that an unexpected change in core conditions has occurred.

The normalization of predicted RCS boron concentration to the measured value is typically performed after reaching RTP following startup from a refueling outage, with the control rods in their normal positions for power operation. The normalization is performed at BOC conditions, so that core reactivity relative to predicted values can be continually monitored and evaluated as core conditions change during the cycle.

Core reactivity satisfies Criterion 2 of the NRC Policy Statement.

LCO Long term core reactivity behavior is a result of the core physics design and cannot be easily controlled once the core design is fixed. During operation, therefore, the LCO can only be ensured through measurement and tracking, and appropriate actions taken as necessary. Large differences between actual and predicted core reactivity may indicate that the assumptions of the DBA and transient analyses are no longer valid, or that the uncertainties in the Nuclear Design Methodology are larger than expected. A limit on the reactivity balance of $\pm 1\% \Delta k/k$ has been established based on engineering judgment. A 1% deviation in reactivity from that predicted is larger than expected for normal operation and should therefore be evaluated.

When measured core reactivity is within $1\% \Delta k/k$ of the predicted value at steady state thermal conditions, the core is considered to be operating within acceptable design limits. Since deviations from the limit are normally detected by comparing predicted and measured steady state RCS critical boron concentrations, the difference between measured and predicted values would be approximately 100 ppm (depending on the boron worth) before the limit is reached. These values are well within the uncertainty limits for analysis of boron concentration samples, so that spurious violations of the limit due to uncertainty in measuring the RCS boron concentration are unlikely.

APPLICABILITY The limits on core reactivity must be maintained during MODES 1 and 2 because a reactivity balance must exist when the reactor is critical or producing THERMAL POWER. As the fuel depletes, core conditions are changing, and confirmation of the reactivity balance ensures the core is operating as designed. This Specification does not apply in MODES 3, 4, and 5 because the reactor is shut down and the reactivity balance is not changing.

BASES

APPLICABILITY
(continued)

In MODE 6, fuel loading results in a continually changing core reactivity. Boron concentration requirements (LCO 3.9.1, "Boron Concentration") ensure that fuel movements are performed within the bounds of the safety analysis. An SDM demonstration is required during the first startup following operations that could have altered core reactivity (e.g., fuel movement, control rod replacement, control rod shuffling).

ACTIONS	<u>A.1 and A.2</u>
	<p>Should an anomaly develop between measured and predicted core reactivity, an evaluation of the core design and safety analysis must be performed. Core conditions are evaluated to determine their consistency with input to design calculations. Measured core and process parameters (e.g. MTC, control rod worth, fuel depletion, burnable poisons, etc.) are evaluated to determine that they are within the bounds of the safety analysis, and safety analysis calculational models are reviewed to verify that they are adequate for representation of the core conditions. The required Completion Time of 7 days is based on the low probability of a DBA occurring during this period, and allows sufficient time to assess the physical condition of the reactor and complete the evaluation of the core design and safety analysis.</p> <p>Following evaluations of the core design and safety analysis, the cause of the reactivity anomaly may be resolved. If the cause of the reactivity anomaly is a mismatch in core conditions at the time of RCS boron concentration sampling, then a recalculation of the RCS boron concentration requirements may be performed to demonstrate that core reactivity is behaving as expected. If an unexpected physical change in the condition of the core has occurred, it must be evaluated and corrected, if possible. If the cause of the reactivity anomaly is in the calculation technique, then the calculational models must be revised to provide more accurate predictions. If any of these results are demonstrated, and it is concluded that the reactor core is acceptable for continued operation, then the boron letdown curve may be renormalized and power operation may continue. If operational restriction or additional SRs are necessary to ensure the reactor core is acceptable for continued operation, then they must be defined.</p>
	<p>The required Completion Time of 7 days is adequate for preparing whatever operating restrictions or Surveillances that may be required to allow continued reactor operation.</p>

BASES

ACTIONS (continued) B.1

If the core reactivity cannot be restored to within the 1% $\Delta k/k$ limit, the plant must be brought to a MODE in which the LCO does not apply. To achieve this status, the plant must be brought to at least MODE 3 within 6 hours. If the SDM for MODE 3 is not met, then the boration required by SR 3.1.1.1 would occur. The allowed Completion Time is reasonable, based on operating experience, for reaching MODE 2 from full power conditions in an orderly manner and without challenging plant systems.

SURVEILLANCE
REQUIREMENTS

SR 3.1.2.1

Core reactivity is verified by periodic comparisons of measured and predicted RCS boron concentrations. The comparison is made, considering that other core conditions are fixed or stable, including control rod position, moderator temperature, fuel temperature, fuel depletion, xenon concentration, and samarium concentration. The Surveillance is performed prior to entering MODE 1 as an initial check on core conditions and design calculations at BOC. The SR is modified by a Note. The Note indicates that the normalization of predicted core reactivity to the measured value must take place within the first 60 effective full power days (EFPD) after each fuel loading. This allows sufficient time for core conditions to reach steady state, but prevents operation for a large fraction of the fuel cycle without establishing a benchmark for the design calculations. The required subsequent Frequency of 31 EFPD, following the initial 60 EFPD after entering MODE 1, is acceptable, based on the slow rate of core changes due to fuel depletion and the presence of other indicators (QPTR, AFD, etc.) for prompt indication of an anomaly.

REFERENCES

1. FSAR, Section 3.1.
 2. FSAR, Chapter 14.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.3 Moderator Temperature Coefficient (MTC)

BASES

BACKGROUND

According to the Point Beach Design Criteria (Ref. 1), the reactor core and its interaction with the Reactor Coolant System (RCS) must be designed for inherently stable power operation, even in the possible event of an accident. In particular, the net reactivity feedback in the system must compensate for any unintended reactivity increases.

The MTC relates a change in core reactivity to a change in reactor coolant temperature (a positive MTC means that reactivity increases with increasing moderator temperature; conversely, a negative MTC means that reactivity decreases with increasing moderator temperature). The reactor is designed to operate with a negative MTC over the largest possible range of fuel cycle operation. Therefore, a coolant temperature increase will cause a reactivity decrease, so that the coolant temperature tends to return toward its initial value. Reactivity increases that cause a coolant temperature increase will thus be self limiting, and stable power operation will result.

MTC values are predicted at selected burnups during the safety evaluation analysis and are confirmed to be acceptable by measurements. Both initial and reload cores are designed so that the beginning of cycle (BOC) MTC is less than or equal to zero when THERMAL POWER is at RTP. The actual value of the MTC is dependent on core characteristics, such as fuel loading and reactor coolant soluble boron concentration. The core design may require additional fixed distributed poisons to yield an MTC at BOC within the range analyzed in the plant accident analysis. The end of cycle (EOC) MTC is also limited by the requirements of the accident analysis. Fuel cycles that are designed to achieve high burnups or that have changes to other characteristics are evaluated to ensure that the MTC does not exceed the EOC limit.

The limitations on MTC are provided to ensure that the value of this coefficient remains within the limiting conditions assumed in the FSAR accident and transient analyses. If the LCO limits are not met, the unit response during transients may not be as predicted. The departure from nucleate boiling ratio criteria of the approved correlation may be violated, which could lead to a loss of the fuel cladding integrity.

The SR for measurement of the MTC at the beginning of the fuel cycle in combination with SR 3.1.2.1 (periodic core reactivity balance) are

BASES

BACKGROUND (continued) adequate to confirm that the MTC remains within its limits, since this coefficient changes slowly, due principally to changes in RCS boron concentration associated with fuel burnup.

APPLICABLE SAFETY ANALYSES The acceptance criteria for the specified MTC are:

- a. The MTC values must remain within the bounds of those used in the accident analysis (Ref. 2); and
- b. The MTC must be such that inherently stable power operations result during normal operation and accidents, such as overheating and overcooling events.

The FSAR, Chapter 14 (Ref. 2), contains analyses of accidents that result in both overheating and overcooling of the reactor core. MTC is one of the controlling parameters for core reactivity in these accidents. Both the most positive value and most negative value of the MTC are important to safety. The negative MTC limit is a design limit which is verified as part of the reload analysis review. Analyses are performed utilizing the most negative moderator temperature coefficient for the rodded core at end of life. As such the lower limit is considered non-bounding. Values used in the analyses consider worst case conditions to ensure that the accident results are bounding (Ref. 3).

The consequences of accidents that cause core overheating must be evaluated when the MTC is positive. Such accidents include the rod withdrawal transient from either zero (Ref. 2) or RTP, loss of main feedwater flow, and loss of forced reactor coolant flow. The consequences of accidents that cause core overcooling must be evaluated when the MTC is negative. Such accidents include sudden feedwater flow increase and sudden decrease in feedwater temperature. In order to ensure a bounding accident analysis, the MTC is assumed to be its most limiting value for the analysis conditions appropriate to each accident. The bounding value is determined by considering rodded and unrodded conditions, whether the reactor is at full or zero power, and whether it is the BOC or EOC life. The most conservative combination appropriate to the accident is then used for the analysis (Ref. 2). MTC values are bounded in reload safety evaluations assuming steady state conditions at BOC and EOC.

MTC satisfies Criterion 2 of the NRC Policy Statement. Even though it is not directly observed and controlled from the control room, MTC is considered an initial condition process variable because of its dependence on boron concentration.

BASES

LCO

LCO 3.1.3 requires the MTC to be maintained within the limits specified in the COLR, with an absolute limit of $\leq 5 \text{ pcm}/^{\circ}\text{F}$ for power levels $\leq 70\%$ RTP and $\leq 0 \text{ pcm}/^{\circ}\text{F}$ for power levels $> 70\%$ RTP established by the LCO. During the reload core safety evaluation, the MTC is analyzed to determine that its values remain within the bounds of the original accident analysis during operation.

Assumptions made in safety analyses require that the MTC be less positive than a given upper bound and more positive than a given lower bound. The MTC is most positive near beginning of core life with all rods out (ARO) and the reactor at hot zero power conditions. This LCO exists to ensure that the upper bounds are not exceeded.

During operation the conditions of the LCO can only be ensured through measurement. The Surveillance check at BOC on MTC in addition to periodic reactivity balance verifications provide confirmation that the MTC is behaving as anticipated so that the acceptance criteria are met.

The LCO establishes a maximum positive value that cannot be exceeded. The positive MTC limits are contained in the COLR to allow specifying limits for each particular cycle. This permits the unit to take advantage of improved fuel management and changes in unit operating schedule.

APPLICABILITY

In MODE 1, the limits on MTC must be maintained to ensure that any accident initiated from THERMAL POWER operation will not violate the design assumptions of the accident analysis. In MODE 2 with the reactor critical, the upper limit must also be maintained to ensure that startup and subcritical accidents (such as the uncontrolled CONTROL ROD assembly or group withdrawal) will not violate the assumptions of the accident analysis. In MODE 2 with $k_{\text{eff}} < 1.0$, and MODES 3, 4, 5, and 6, this LCO is not applicable, since no Design Basis Accidents using positive MTC as an analysis assumption are initiated from these MODES.

ACTIONS

A.1

If the positive MTC limit determined for an all rods out condition is violated, administrative limits for RCS boron concentration must be established to maintain the MTC within its limits. The MTC becomes more negative with decreased RCS boron concentration. A Completion Time of 24 hours provides enough time for evaluating the MTC measurement and computing the required RCS boron concentration.

BASES

ACTIONS (continued) As cycle burnup is increased, the RCS boron concentration will be reduced. The reduced boron concentration causes the MTC to become more negative. Using physics calculations, the time in cycle life at which the calculated MTC will meet the LCO requirement can be determined. At this point in core life Condition A no longer exists. The unit is no longer in the Required Action, so the administrative concentration limits are no longer in effect.

B.1

If the required administrative concentration limits are not established within 24 hours, the unit must be brought to MODE 2 with $k_{eff} < 1.0$ to prevent operation with an MTC that is more positive than that assumed in safety analyses.

The allowed Completion Time of 6 hours is reasonable, based on operating experience, for reaching the required MODE from full power conditions in an orderly manner and without challenging plant systems.

SURVEILLANCE REQUIREMENTS

SR_3.1.3.1

This SR requires verification of the MTC upper limits prior to entering MODE 1 in order to demonstrate compliance with the MTC limits. Meeting this limit prior to entering MODE 1 ensures that the limit will also be met at higher power levels. Verification of the positive MTC limits is inferred from comparing the beginning of core life isothermal temperature coefficient measurements obtained during physics testing with core design predictions. Reasonable agreement with predicted values provide confirmation that the MTC is behaving as anticipated and is within limits. The periodic reactivity balance verifications required by LCO 3.1.2 provide further confirmation that the MTC is behaving as anticipated.

REFERENCES

1. FSAR, Section 3.1.
 2. FSAR, Chapter 14.
 3. WCAP 9273-NP-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.4 Rod Group Alignment Limits

BASES

BACKGROUND

The OPERABILITY (i.e., trippability) of the shutdown and control rods is an initial assumption in all safety analyses that assume rod insertion upon reactor trip. Maximum rod misalignment is an initial assumption in the safety analysis that directly affects core power distributions and assumptions of available SDM.

The applicable criteria for these reactivity and power distribution design requirements are FSAR Section 3.2, Reactor Design, FSAR Section 1.3.5, Reactivity Control (Ref. 1 and 2), and 10 CFR 50.46, "Acceptance Criteria for Emergency Core Cooling Systems for Light Water Nuclear Power Plants" (Ref. 3).

Mechanical or electrical failures may cause a control or shutdown rod to become inoperable or to become misaligned from its group. Rod inoperability or misalignment may cause increased power peaking, due to the asymmetric reactivity distribution and a reduction in the total available rod worth for reactor shutdown. Therefore, rod alignment and OPERABILITY are related to core operation in design power peaking limits and the core design requirement of a minimum SDM.

Limits on rod alignment have been established, and all rod positions are monitored and controlled during power operation to ensure that the power distribution and reactivity limits defined by the design power peaking and SDM limits are preserved.

Rod cluster control assemblies (RCCAs), or rods, are moved by their control rod drive mechanisms (CRDMs). Each CRDM moves its RCCA one step (approximately 5/8 inch) at a time, but at varying rates (steps per minute) depending on the signal output from the Rod Control System.

The RCCAs are divided among control banks and shutdown banks. Each bank may be further subdivided into two groups to provide for precise reactivity control. A group consists of two or more RCCAs that are electrically paralleled to step simultaneously. A bank of RCCAs may consist of one or two groups. When a bank consists of two groups, the groups are moved in a staggered fashion, but always within one step of each other. Control banks A and C and shutdown bank A consist of two groups each while control banks B and D and shutdown bank B consist of a single group.

BASES

BACKGROUND (continued)

The shutdown banks are maintained either in the fully inserted or fully withdrawn position. The control banks are moved in an overlap pattern, using the following withdrawal sequence: When control bank A reaches a predetermined height in the core, control bank B begins to move out with control bank A. Control bank A stops at the position of maximum withdrawal, and control bank B continues to move out. When control bank B reaches a predetermined height, control bank C begins to move out with control bank B. This sequence continues until control banks A, B, and C are at the fully withdrawn position, and control bank D is approximately halfway withdrawn. The insertion sequence is the opposite of the withdrawal sequence. The control rods are arranged in a radially symmetric pattern, so that control bank motion does not introduce radial asymmetries in the core power distributions.

The axial position of shutdown rods and control rods is indicated by two separate and independent systems, which are the Bank Demand Position Indication System (commonly called group step counters) and the Rod Position Indication (RPI) System.

The Bank Demand Position Indication System counts the pulses from the rod control system that moves the rods. There is one step counter for each group of rods. Individual rods in a group all receive the same signal to move and should, therefore, all be at the same position indicated by the group step counter for that group. The Bank Demand Position Indication System is considered highly precise (± 1 step or $\pm 5/8$ inch). If a rod does not move one step for each demand pulse, the step counter will still count the pulse and incorrectly reflect the position of the rod.

The RPI System provides a highly accurate indication of actual rod position, but at a lower precision than the step counters. The RPI is a linear variable differential transformer (LVDT) consisting of primary and secondary coils stacked alternately on a support tube with the control rod drive shaft acting as the core of the transformer. The primary and secondary coils are series connected with the primary coil supplied with AC power from a constant current source. The position of the control rod drive shaft changes the primary to secondary coil magnetic coupling resulting in a variable secondary voltage which is proportional to the position of the drive shaft (control rod). The RPI channel has an indication accuracy of 5% of span (11.5 steps) therefore, the maximum deviation between actual and demanded indication could be 24 steps or approximately 15 inches.

The specifications ensure that (1) acceptable power distribution limits are maintained, (2) the minimum shutdown margin is maintained, and (3) the potential effects of rod misalignment on associated accident

BASES**BACKGROUND
(continued)**

analyses are limited. Operability of the control rod position indicators is required to determine control rod position and thereby ensure compliance with the control rod alignment and insertion limits.

Permitted control rod misalignments (as indicated by the RPI System within one hour after control rod motion) are; a) ± 12 steps of the bank demand position (if power level is greater than 85 percent of rated power, and b) ± 24 steps of the bank demand position (if the power level is less than or equal to 85 percent of rated power). For power levels less than or equal to 85 percent of rated power, the peaking factor margin does not have to be verified on an explicit basis. This is due to the rate of peaking factor margin increase (due to the peaking factor limit increasing) as the power level decreases being greater than the peaking factor margin loss (due to the increased control rod misalignment). This effect is described in WCAP-15432 Rev. 1. These limits are applicable to all shutdown and control rods (of all banks) over the range of 0 to 230 steps withdrawn inclusive.

Control rods in a single bank move together with no individual rod insertion differing by more than 24 steps from the bank demand position (operation at greater than 85 percent of rated power), nor more than 36 steps (operation at less than or equal to 85 percent of rated power). An indicated misalignment limit of 12 steps precludes a rod misalignment of greater than 24 steps with consideration of instrumentation error; 24 steps indicated misalignment corresponds to 36 steps with instrumentation error.

**APPLICABLE
SAFETY ANALYSES**

Control rod misalignment accidents are analyzed in the safety analysis (Ref. 4). The acceptance criteria for addressing control rod inoperability or misalignment are that:

- a. There be no violations of:
 1. specified acceptable fuel design limits, or
 2. Reactor Coolant System (RCS) pressure boundary integrity; and
- b. The core remains subcritical after accident transients.

Two types of misalignment are distinguished. During movement of a control rod group, one rod may stop moving, while the other rods in the group continue. This condition may cause excessive power peaking. The second type of misalignment occurs if one rod fails to insert upon a reactor trip and remains stuck fully withdrawn. This condition requires an evaluation to determine that sufficient reactivity worth is held in the control rods to meet the SDM requirement, with the maximum worth rod

BASES

APPLICABLE
SAFETY ANALYSES
(continued)

stuck fully withdrawn.

Two types of analysis are performed in regard to static rod misalignment (Ref. 4). With control banks at their insertion limits, one type of analysis considers the case when any one rod is completely inserted into the core. The second type of analysis considers the case of a completely withdrawn single rod from a bank inserted to its insertion limit. Satisfying limits on departure from nucleate boiling ratio in both of these cases bounds the situation when a rod is misaligned from its group by 12 steps.

Another type of misalignment occurs if one RCCA fails to insert upon a reactor trip and remains stuck fully withdrawn. This condition is assumed in the evaluation to determine that the required SDM is met with the maximum worth RCCA also fully withdrawn (Ref. 4).

The Required Actions in this LCO ensure that either deviations from the alignment limits will be corrected or that THERMAL POWER will be adjusted so that excessive local linear heat rates (LHRs) will not occur, and that the requirements on SDM and ejected rod worth are preserved.

Continued operation of the reactor with a misaligned control rod is allowed if the heat flux hot channel factors $F_Q^C(Z)$ and $F_Q^W(Z)$ and the nuclear enthalpy hot channel factor ($F_{\Delta H}^N$) are verified to be within their limits in the COLR and the safety analysis is verified to remain valid. When a control rod is misaligned, the assumptions that are used to determine the rod insertion limits, AFD limits, and quadrant power tilt limits are not preserved. Therefore, the limits may not preserve the design peaking factors, and $F_Q^C(Z)$, $F_Q^W(Z)$, and $F_{\Delta H}^N$ must be verified directly by incore mapping. Bases Section 3.2 (Power Distribution Limits) contains more complete discussions of the relation of $F_Q^C(Z)$, $F_Q^W(Z)$, and $F_{\Delta H}^N$ to the operating limits.

Shutdown and control rod OPERABILITY and alignment are directly related to power distributions and SDM, which are initial conditions assumed in safety analyses. Therefore they satisfy Criterion 2 of the NRC Policy Statement.

LCO

The limits on shutdown or control rod alignments ensure that the assumptions in the safety analysis will remain valid. The requirements on control rod OPERABILITY ensure that upon reactor trip, the assumed reactivity will be available and will be inserted. The control rod OPERABILITY requirement is satisfied provided the control rod will fully insert within the required rod drop time assumed in the safety analysis.

BASES

LCO (continued) Control rod malfunctions that result in the inability to move a control rod (e.g. lift coil and rod control system logic failures), but do not impact the control rod trippability, do not result in control rod inoperability. The LCO requirements also ensure that the RCCAs and banks maintain the correct power distribution and rod alignment.

The requirement to maintain the rod alignment to within plus or minus 12 steps is conservative. The minimum misalignment assumed in safety analysis is 24 steps (15 inches), and in some cases a total misalignment from fully withdrawn to fully inserted is assumed. Failure to meet the requirements of this LCO may produce unacceptable power peaking factors and LHRs, or unacceptable SDMs, all of which may constitute initial conditions inconsistent with the safety analysis.

APPLICABILITY The requirements on RCCA OPERABILITY and alignment are applicable in MODES 1 and 2 because these are the only MODES in which neutron (or fission) power is generated, and the OPERABILITY (i.e., trippability) and alignment of rods have the potential to affect the safety of the plant. In MODES 3, 4, 5, and 6, the alignment limits do not apply because the control rods are bottomed and the reactor is shut down and not producing fission power. In the shutdown MODES, the OPERABILITY of the shutdown and control rods has the potential to affect the required SDM, but this effect can be compensated for by an increase in the boron concentration of the RCS. See LCO 3.1.1, "SHUTDOWN MARGIN (SDM)" for SDM in MODE 2 with $k_{eff} < 1.0$, and MODES 3, 4, and 5 and LCO 3.9.1, "Boron Concentration," for boron concentration requirements during refueling.

ACTIONS The ACTIONS table is modified by a Note indicating that verification of rod operability and the comparison of bank demand position and RPI System may take place at any time up to one hour after rod motion, at any power level. This allows up to one hour of thermal soak time to allow the control rod drive shaft to reach a thermal equilibrium and thus present a consistent position indication.

A.1.1 and A.1.2

When one or more rods are inoperable, there is a possibility that the required SDM may be adversely affected. Under these conditions, it is important to determine the SDM, and if it is less than the required value, initiate boration until the required SDM is recovered. The Completion Time of 1 hour is adequate for determining SDM and, if necessary, for initiating emergency boration and restoring SDM.

BASES

ACTIONS (continued) In this situation, SDM verification must include the worth of the untrippable rod, as well as a rod of maximum worth.

A.2

If the inoperable rod(s) cannot be restored to OPERABLE status, the plant must be brought to a MODE or condition in which the LCO requirements are not applicable. To achieve this status, the unit must be brought to at least MODE 3 within 6 hours.

The allowed Completion Time is reasonable, based on operating experience, for reaching MODE 3 from full power conditions in an orderly manner and without challenging plant systems.

B.1

When a rod becomes misaligned, it can usually be moved and is still trippable. If the rod can be realigned within the Completion Time of 1 hour, local xenon redistribution during this short interval will not be significant, and operation may proceed without further restriction.

An alternative to realigning a single misaligned RCCA to the group average position is to align the remainder of the group to the position of the misaligned RCCA. However, this must be done without violating the bank sequence, overlap, and insertion limits specified in LCO 3.1.5, "Shutdown Bank Insertion Limits," and LCO 3.1.6, "Control Bank Insertion Limits." The Completion Time of 1 hour gives the operator sufficient time to adjust the rod positions in an orderly manner.

B.2.1.1 and B.2.1.2

With a misaligned rod, SDM must be verified to be within limit or boration must be initiated to restore SDM to within limit.

In many cases, realigning the remainder of the group to the misaligned rod may not be desirable. For example, realigning control bank B to a rod that is misaligned 25 steps from the top of the core would require a significant power reduction, since control bank D must be moved fully in and control bank C must be moved in to approximately 100 to 115 steps.

Power operation may continue with one RCCA misaligned, provided that SDM is verified within 1 hour. The Completion Time of 1 hour

BASES

ACTIONS (continued) represents the time necessary for determining the actual unit SDM and, if necessary, aligning and starting the necessary systems and components to initiate boration.

B.2.2, B.2.3, B.2.4, B.2.5, and B.2.6

For continued operation with a misaligned rod, RTP must be reduced, SDM must periodically be verified within limits, hot channel factors ($F_Q^C(Z)$, $F_Q^W(Z)$, and $F_{\Delta H}^N$) must be verified within limits, and the safety analyses must be re-evaluated to confirm continued operation is permissible.

Reduction of power to 75% RTP ensures that local LHR increases due to a misaligned RCCA will not cause the core design criteria to be exceeded (Ref. 4). The Completion Time of 2 hours gives the operator sufficient time to accomplish an orderly power reduction without challenging the Reactor Protection System.

When a rod is known to be misaligned, there is a potential to impact the SDM. Since the core conditions can change with time, periodic verification of SDM is required. A Frequency of 12 hours is sufficient to ensure this requirement continues to be met.

Verifying that $F_Q^C(Z)$, $F_Q^W(Z)$, and $F_{\Delta H}^N$ are within the required limits ensures that current operation at 75% RTP with a rod misaligned is not resulting in power distributions that may invalidate safety analysis assumptions at full power. The Completion Time of 72 hours allows sufficient time to obtain flux maps of the core power distribution using the incore flux mapping system and to calculate $F_Q^C(Z)$, $F_Q^W(Z)$, and $F_{\Delta H}^N$.

Once current conditions have been verified acceptable, time is available to perform evaluations of accident analysis to determine that core limits will not be exceeded during a Design Basis Event for the duration of operation under these conditions. The accident analyses presented in the FSAR Chapter 14 (Ref. 4) that may be adversely affected will be evaluated to ensure that the analysis results remain valid for the duration of continued operation under these conditions. A Completion Time of 5 days is sufficient time to obtain the required input data and to perform the analysis.

C.1

When Required Actions cannot be completed within their Completion Time, the unit must be brought to a MODE or Condition in which the LCO requirements are not applicable. To achieve this status, the unit

BASES

ACTIONS (continued) must be brought to at least MODE 3 within 6 hours, which obviates concerns about the development of undesirable xenon or power distributions. The allowed Completion Time of 6 hours is reasonable, based on operating experience, for reaching MODE 3 from full power conditions in an orderly manner and without challenging the plant systems.

D.1.1 and D.1.2

More than one control rod becoming misaligned from its group average position is not expected, and has the potential to reduce SDM. Therefore, SDM must be evaluated. One hour allows the operator adequate time to determine SDM. Restoration of the required SDM, if necessary, requires increasing the RCS boron concentration to provide negative reactivity, as described in the Bases of LCO 3.1.1. The required Completion Time of 1 hour for initiating boration is reasonable, based on the time required for potential xenon redistribution, the low probability of an accident occurring, and the steps required to complete the action. This allows the operator sufficient time to align the required valves and start the boric acid pumps. Boration will continue until the required SDM is restored.

D.2

If more than one rod is found to be misaligned or becomes misaligned because of bank movement, the unit conditions fall outside of the accident analysis assumptions. Since automatic bank sequencing would continue to cause misalignment, the unit must be brought to a MODE or Condition in which the LCO requirements are not applicable. To achieve this status, the unit must be brought to at least MODE 3 within 6 hours.

The allowed Completion Time is reasonable, based on operating experience, for reaching MODE 3 from full power conditions in an orderly manner and without challenging plant systems.

SURVEILLANCE
REQUIREMENTS

SR 3.1.4.1

Verification that individual rod positions are within alignment limits at a Frequency of 12 hours provides a history that allows the operator to detect a rod that is beginning to deviate from its expected position.

The specified Frequency takes into account other rod position information that is continuously available to the operator in the control

BASES

SURVEILLANCE REQUIREMENTS (continued)

room, so that during actual rod motion, deviations can immediately be detected.

SR 3.1.4.2

Verifying each control rod is OPERABLE would require that each rod be tripped. However, in MODES 1 and 2, tripping each control rod would result in radial or axial power tilts, or oscillations. Exercising each individual control rod every 92 days provides increased confidence that all rods continue to be OPERABLE without exceeding the alignment limit, even if they are not regularly tripped. Moving each control rod by 10 steps will not cause radial or axial power tilts, or oscillations, to occur. The 92 day Frequency takes into consideration other information available to the operator in the control room and SR 3.1.4.1, which is performed more frequently and adds to the determination of OPERABILITY of the rods. Between required performances of SR 3.1.4.2 (determination of control rod OPERABILITY by movement), if a control rod(s) is discovered to be immovable, but remains trippable, the control rod(s) is considered to be OPERABLE. At any time, if a control rod(s) is immovable, a determination of the trippability (OPERABILITY) of the control rod(s) must be made, and appropriate action taken.

SR 3.1.4.3

Verification of rod drop times allows the operator to determine that the maximum rod drop time permitted is consistent with the assumed rod drop time used in the safety analysis. Measuring rod drop times prior to reactor criticality, after reactor vessel head removal, ensures that the reactor internals and rod drive mechanism will not interfere with rod motion or rod drop time, and that no degradation in these systems has occurred that would adversely affect control rod motion or drop time. This testing is performed with all RCPs operating and the average moderator temperature $\geq 500^{\circ}\text{F}$ to simulate a reactor trip under actual conditions.

This Surveillance is performed during a plant outage, due to the plant conditions needed to perform the SR and the potential for an unplanned plant transient if the Surveillance were performed with the reactor at power.

REFERENCES

1. FSAR, Section 3.2.
2. FSAR, Sections 1.3.5.
3. 10 CFR 50.46.

BASES

REFERENCES
(continued)

4. FSAR, Chapter 14.

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.5 Shutdown Bank Insertion Limits

BASES

BACKGROUND

The insertion limits of the shutdown and control rods are initial assumptions in all safety analyses that assume rod insertion upon reactor trip. The insertion limits directly affect core power and fuel burnup distributions and assumptions of available ejected rod worth, SDM and initial reactivity insertion rate.

The design criteria for reactivity and power distribution are found in FSAR Section 3.1, (Ref. 1), and 10 CFR 50.46, "Acceptance Criteria for Emergency Core Cooling Systems for Light Water Nuclear Power Reactors" (Ref. 2). Limits on control rod insertion have been established, and all rod positions are monitored and controlled during power operation to ensure that the power distribution and reactivity limits defined by the design power peaking and SDM limits are preserved.

The rod cluster control assemblies (RCCAs) are divided among control banks and shutdown banks. Each bank may be further subdivided into one or two groups to provide for precise reactivity control. A group consists of two or more RCCAs that are electrically paralleled to step simultaneously. A bank of RCCAs may consist of one or two groups. When a bank consists of two groups, the groups are moved in a staggered fashion, but always within one step of each other. Control banks A and C and shutdown bank A consist of two groups each while control banks B and D and shutdown bank B consist of a single group. See LCO 3.1.4, "Rod Group Alignment Limits," for control and shutdown rod OPERABILITY and alignment requirements, and LCO 3.1.7, "Rod Position Indication," for position indication requirements.

The control banks are used for precise reactivity control of the reactor. The positions of the control banks are normally automatically controlled by the Rod Control System, but they can also be manually controlled. They are capable of adding negative reactivity very quickly (compared to borating). The control banks must be maintained above designed insertion limits and are typically near the fully withdrawn position during normal full power operations.

Hence, they are not capable of adding a large amount of positive reactivity. Boration or dilution of the Reactor Coolant System (RCS) compensates for the reactivity changes associated with large changes in RCS temperature. The design calculations are performed with the

BASES**BACKGROUND
(continued)**

assumption that the shutdown banks are withdrawn first. The shutdown banks can be fully withdrawn without the core going critical. This provides available negative reactivity in the event of boration errors. The shutdown banks are controlled manually by the control room operator. During normal unit operation, the shutdown banks are either fully withdrawn or fully inserted. The shutdown banks must be completely withdrawn from the core, prior to withdrawing any control banks during an approach to criticality. The shutdown banks are then left in this position until the reactor is shut down. They affect core power and burnup distribution, and add negative reactivity to shut down the reactor upon receipt of a reactor trip signal.

**APPLICABLE
SAFETY ANALYSES**

On a reactor trip, all RCCAs (shutdown banks and control banks), except the most reactive RCCA, are assumed to insert into the core. The shutdown banks shall be at or above their insertion limits and available to insert the maximum amount of negative reactivity on a reactor trip signal. The control banks may be partially inserted in the core, as allowed by LCO 3.1.6, "Control Bank Insertion Limits." The shutdown bank and control bank insertion limits are established to ensure that a sufficient amount of negative reactivity is available to shut down the reactor and maintain the required SDM (see LCO 3.1.1, "SHUTDOWN MARGIN (SDM)") following a reactor trip from full power. The combination of control banks and shutdown banks (less the most reactive RCCA, which is assumed to be fully withdrawn) is sufficient to take the reactor from full power conditions at rated temperature to zero power, and to maintain the required SDM at rated no load temperature (Ref. 3). The shutdown bank insertion limit also limits the reactivity worth of an ejected shutdown rod.

The acceptance criteria for addressing shutdown and control rod bank insertion limits and inoperability or misalignment is that:

a. There be no violations of:

1. specified acceptable fuel design limits, or
2. RCS pressure boundary integrity; and

b. The core remains subcritical after accident transients.

As such, the shutdown bank insertion limits affect safety analysis involving core reactivity and SDM (Ref. 4).

The shutdown bank insertion limits preserve an initial condition assumed in the safety analyses and, as such, satisfy Criterion 2 of the NRC Policy Statement.

BASES

LCO The shutdown banks must be within their insertion limits any time the reactor is critical or approaching criticality. This ensures that a sufficient amount of negative reactivity is available to shut down the reactor and maintain the required SDM following a reactor trip.

The shutdown bank insertion limits are defined in the COLR.

APPLICABILITY The shutdown banks must be within their insertion limits, with the reactor in MODES 1 and 2. This ensures that a sufficient amount of negative reactivity is available to shut down the reactor and maintain the required SDM following a reactor trip. The shutdown banks do not have to be within their insertion limits in MODE 3, unless an approach to criticality is being made. In MODE 3, 4, 5, or 6, the shutdown banks are fully inserted in the core and contribute to the SDM. Refer to LCO 3.1.1 for SDM requirements in MODES 3, 4, and 5. LCO 3.9.1, "Boron Concentration," ensures adequate SDM in MODE 6.

The Applicability requirements have been modified by a Note indicating the LCO requirement is suspended during SR 3.1.4.2. This SR verifies the freedom of the rods to move, and requires the shutdown bank to move below the LCO limits, which would normally violate the LCO.

ACTIONS The ACTIONS table is modified by a Note indicating that up to one hour after rod motion is allowed for comparison of the bank insertion limits and the RPI System, at any power level. This allows up to one hour of thermal soak time to allow the control rod drive shaft to reach a thermal equilibrium and thus present a consistent position indication. This comparison is sufficient to verify that the shutdown banks are above the insertion limits and thus assures the presence of sufficient shutdown margin to satisfy the assumptions of the safety analyses.

A.1.1, A.1.2 and A.2

When one or more shutdown banks is not within insertion limits, 2 hours is allowed to restore the shutdown banks to within the insertion limits. This is necessary because the available SDM may be significantly reduced, with one or more of the shutdown banks not within their insertion limits. Also, verification of SDM or initiation of boration within 1 hour is required, since the SDM in MODES 1 and 2 is ensured by adhering to the control and shutdown bank insertion limits (see LCO 3.1.1). If shutdown banks are not within their insertion limits, then SDM will be verified by performing a reactivity balance calculation, considering the following listed reactivity effects:

BASES

- ACTIONS (continued)
- a. RCS boron concentration;
 - b. Control bank position;
 - c. Power defect;
 - d. Fuel burnup;
 - e. Xenon concentration; and
 - f. Samarium concentration.

The allowed Completion Time of 2 hours provides an acceptable time for evaluating and repairing minor problems without allowing the plant to remain in an unacceptable condition for an extended period of time.

B.1

If the shutdown banks cannot be restored to within their insertion limits within 2 hours, the unit must be brought to a MODE where the LCO is not applicable. The allowed Completion Time of 6 hours is reasonable, based on operating experience, for reaching the required MODE from full power conditions in an orderly manner and without challenging plant systems.

SURVEILLANCE
REQUIREMENTS

SR 3.1.5.1

Verification that the shutdown banks are within their insertion limits prior to an approach to criticality ensures that when the reactor is critical, or being taken critical, the shutdown banks will be available to shut down the reactor, and the required SDM will be maintained following a reactor trip. This SR and Frequency ensure that the shutdown banks are withdrawn before the control banks are withdrawn during a unit startup. Typically, the individual rod position indicators are used to confirm shutdown bank insertion limits.

Since the shutdown banks are positioned manually by the control room operator, a verification of shutdown bank position at a Frequency of 12 hours, after the reactor is taken critical, is adequate to ensure that they are within their insertion limits. Also, the 12 hour Frequency takes into account other information available in the control room for the purpose of monitoring the status of shutdown rods.

BASES

REFERENCES

1. FSAR, Section 3.1.
 2. 10 CFR 50.46.
 3. FSAR, Section 3.2.
 4. FSAR, Chapter 14.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.6 Control Bank Insertion Limits

BASES

BACKGROUND

The insertion limits of the shutdown and control rods are initial assumptions in all safety analyses that assume rod insertion upon reactor trip. The insertion limits directly affect core power and fuel burnup distributions and assumptions of available SDM, and initial reactivity insertion rate.

The design criteria for reactivity and power distribution are found in FSAR Section 3.1, (Ref. 1), and 10 CFR 50.46, "Acceptance Criteria for Emergency Core Cooling Systems for Light Water Nuclear Power Reactors" (Ref. 2). Limits on control rod insertion have been established, and all rod positions are monitored and controlled during power operation to ensure that the power distribution and reactivity limits defined by the design power peaking and SDM limits are preserved.

The rod cluster control assemblies (RCCAs) are divided among control banks and shutdown banks. Each bank may be further subdivided into two groups to provide for precise reactivity control. A group consists of two or more RCCAs that are electrically paralleled to step simultaneously. A bank of RCCAs may consist of one or two groups. When a bank consists of two groups, the groups are moved in a staggered fashion, but always within one step of each other. Control banks A and C and shutdown bank A consist of two groups each while control banks B and D and shutdown bank B consist of a single group. See LCO 3.1.4, "Rod Group Alignment Limits," for control and shutdown rod OPERABILITY and alignment requirements, and LCO 3.1.7, "Rod Position Indication," for position indication requirements.

The control bank insertion limits are specified in the COLR. An example is provided for information only in Figure B 3.1.6-1. The control banks are required to be at or above the insertion limit lines.

Figure B 3.1.6-1 also indicates how the control banks are moved in an overlap pattern. Overlap is the distance traveled together by two control banks. The predetermined position of control bank C, at which control bank D will begin to move with bank C on a withdrawal, will be at 125 steps for a fully withdrawn position of 225 steps. The fully withdrawn position is defined in the COLR.

BASES

BACKGROUND
(continued)

The control banks are used for precise reactivity control of the reactor. The positions of the control banks are normally controlled automatically by the Rod Control System, but can also be manually controlled. They are capable of adding reactivity very quickly (compared to borating or diluting).

The power density at any point in the core must be limited, so that the fuel design criteria are maintained. Together, LCO 3.1.4, LCO 3.1.5, "Shutdown Bank Insertion Limits," LCO 3.1.6, LCO 3.2.3, "AXIAL FLUX DIFFERENCE (AFD)," and LCO 3.2.4, "QUADRANT POWER TILT RATIO (QPTR)," provide limits on control component operation and on monitored process variables, which ensure that the core operates within the fuel design criteria.

The shutdown and control bank insertion and alignment limits, AFD, and QPTR are process variables that together characterize and control the three dimensional power distribution of the reactor core.

Additionally, the control bank insertion limits control the reactivity that could be added in the event of a rod ejection accident, and the shutdown and control bank insertion limits ensure the required SDM is maintained.

Operation within the subject LCO limits will prevent fuel cladding failures that would breach the primary fission product barrier and release fission products to the reactor coolant in the event of a loss of coolant accident (LOCA), loss of flow, ejected rod, or other accident requiring termination by a Reactor Trip System (RTS) trip function.

APPLICABLE
SAFETY ANALYSES

The shutdown and control bank insertion limits, AFD, and QPTR LCOs are required to prevent power distributions that could result in fuel cladding failures in the event of a LOCA, loss of flow, ejected rod, or other accident requiring termination by an RTS trip function. The acceptance criteria for addressing shutdown and control bank insertion limits and inoperability or misalignment are that:

- a. There be no violations of:
 1. specified acceptable fuel design limits, or
 2. Reactor Coolant System pressure boundary integrity; and
- b. The core remains subcritical after accident transients.

As such, the shutdown and control bank insertion limits affect safety analyses involving core reactivity and power distributions (Ref. 3).

BASES

APPLICABLE
SAFETY ANALYSES
(continued)

The SDM requirement is ensured by limiting the control and shutdown bank insertion limits so that allowable inserted worth of the RCCAs is such that sufficient reactivity is available in the rods to shut down the reactor to hot zero power with a reactivity margin that assumes the maximum worth RCCA remains fully withdrawn upon trip (Ref. 3).

Operation at the insertion limits or AFD limits may approach the maximum allowable linear heat generation rate or peaking factor with the allowed QPTR present. Operation at the insertion limit may also indicate the maximum ejected RCCA worth could be equal to the limiting value in fuel cycles that have sufficiently high ejected RCCA worths.

The control and shutdown bank insertion limits ensure that safety analyses assumptions for SDM, ejected rod worth, and power distribution peaking factors are preserved (Ref. 3).

The insertion limits satisfy Criterion 2 of the NRC Policy Statement, in that they are initial conditions assumed in the safety analysis.

LCO

The limits on control banks sequence, overlap, and physical insertion, as defined in the COLR, must be maintained because they serve the function of preserving power distribution, ensuring that the SDM is maintained, ensuring that ejected rod worth is maintained, and ensuring adequate negative reactivity insertion is available on trip. The overlap between control banks provides more uniform rates of reactivity insertion and withdrawal and is imposed to maintain acceptable power peaking during control bank motion.

APPLICABILITY

The control bank sequence, overlap, and physical insertion limits shall be maintained with the reactor in MODES 1 and 2 with $k_{eff} \geq 1.0$. These limits must be maintained, since they preserve the assumed power distribution, ejected rod worth, SDM, and reactivity rate insertion assumptions. Applicability in MODE 2 with $K_{eff} < 1.0$ and MODES 3, 4, and 5 is not required, since neither the power distribution nor ejected rod worth assumptions would be exceeded in these MODES.

The applicability requirements have been modified by a Note indicating the LCO requirements are suspended during the performance of SR 3.1.4.2. This SR verifies the freedom of the rods to move, and requires the control bank to move below the LCO limits, which would violate the LCO.

BASES

ACTIONS

The ACTIONS table is modified by a Note indicating that up to one hour after rod motion is allowed for comparison of the bank insertion limits and the RPI System, at any power level. This allows up to one hour of thermal soak time to allow the control rod drive shaft to reach a thermal equilibrium and thus present a consistent position indication. This comparison is sufficient to verify that the control banks are above the insertion limits and thus assures the presence of sufficient shutdown margin to satisfy the assumptions of the safety analyses.

A.1.1, A.1.2, A.2, B.1.1, B.1.2, and B.2

When the control banks are outside the acceptable insertion limits, they must be restored to within those limits. This restoration can occur in two ways:

- a. Reducing power to be consistent with rod position; or
- b. Moving rods to be consistent with power.

Also, verification of SDM or initiation of boration to regain SDM is required within 1 hour, since the SDM in MODES 1 and 2 with $K_{eff} \geq 1.0$ is normally ensured by adhering to the control and shutdown bank insertion limits (see LCO 3.1.1, "SHUTDOWN MARGIN (SDM)") has been upset. If control banks are not within their insertion limits, then SDM will be verified by performing a reactivity balance calculation, considering the following listed reactivity effects:

- a. RCS boron concentration;
- b. Control bank position;
- c. Power defect;
- d. Fuel burnup;
- e. Xenon concentration; and
- f. Samarium concentration.

Similarly, if the control banks are found to be out of sequence or in the wrong overlap configuration, they must be restored to meet the limits.

BASES

ACTIONS (continued) Operation beyond the LCO limits is allowed for a short time period in order to take conservative action because the simultaneous occurrence of either a LOCA, loss of flow accident, ejected rod accident, or other accident during this short time period, together with an inadequate power distribution or reactivity capability, has an acceptably low probability.

The allowed Completion Time of 2 hours for restoring the banks to within the insertion, sequence, and overlaps limits provides an acceptable time for evaluating and repairing minor problems without allowing the plant to remain in an unacceptable condition for an extended period of time.

C.1

If Required Actions A.1 and A.2, or B.1 and B.2 cannot be completed within the associated Completion Times, the plant must be brought to MODE 2 with $K_{eff} < 1.0$, where the LCO is not applicable. The allowed Completion Time of 6 hours is reasonable, based on operating experience, for reaching the required MODE from full power conditions in an orderly manner and without challenging plant systems.

SURVEILLANCE REQUIREMENTS

SR 3.1.6.1

This Surveillance is required to ensure that the reactor does not achieve criticality with the control banks below their insertion limits.

The estimated critical position (ECP) depends upon a number of factors, one of which is xenon concentration. If the ECP was calculated long before criticality, xenon concentration could change to make the ECP substantially in error. Conversely, determining the ECP immediately before criticality could be an unnecessary burden. There are a number of unit parameters requiring operator attention at that point. Performing the ECP calculation within 4 hours prior to criticality avoids a large error from changes in xenon concentration, but allows the operator some flexibility to schedule the ECP calculation with other startup activities.

SR 3.1.6.2

Verification of the control bank insertion limits at a Frequency of 12 hours is sufficient to detect control banks that may be approaching the insertion limits since, normally, very little rod motion occurs in 12 hours.

BASES


SURVEILLANCE
REQUIREMENTS
(continued)

SR 3.1.6.3

When control banks are maintained within their insertion limits as checked by SR 3.1.6.2 above, it is unlikely that their sequence and overlap will not be in accordance with requirements provided in the COLR. A Frequency of 12 hours is consistent with the insertion limit check above in SR 3.1.6.2. Control banks which are fully withdrawn from the core as specified in the COLR, do not have to be verified. In the fully withdrawn position, sequence and overlap can no longer be verified.

REFERENCES

1. FSAR, Section 3.1.
 2. 10 CFR 50.46.
 3. FSAR, Chapter 14.
-

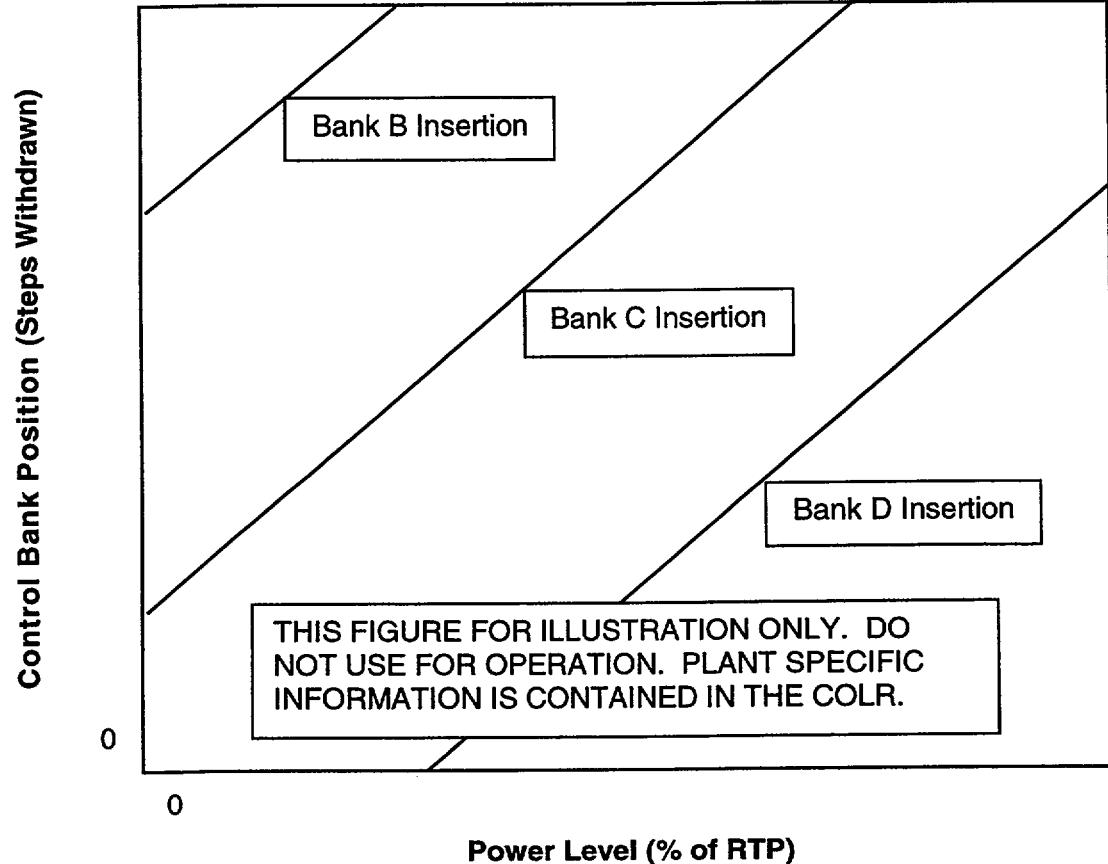

**Figure B 3.1.6-1 (Page 1 of 1)
Control Bank Insertion vs. Percent RTP**

B 3.1 REACTIVITY CONTROL SYSTEM

B 3.1.7 Rod Position Indication

BASES

BACKGROUND

According to the Point Beach Design Criteria (Ref. 1), instrumentation to monitor variables and systems over their operating ranges during normal operation, anticipated operational occurrences, and accident conditions must be OPERABLE. LCO 3.1.7 is required to ensure OPERABILITY of the control rod position indicators to determine control rod positions and thereby ensure compliance with the control rod alignment and insertion limits.

The OPERABILITY, including position indication, of the shutdown and control rods is an initial assumption in all safety analyses that assume rod insertion upon reactor trip. Maximum rod misalignment is an initial assumption in the safety analysis that directly affects core power distributions and assumptions of available SDM. Rod position indication is required to assess OPERABILITY and misalignment.

Mechanical or electrical failures may cause a control rod to become inoperable or to become misaligned from its group. Control rod inoperability or misalignment may cause increased power peaking, due to the asymmetric reactivity distribution and a reduction in the total available rod worth for reactor shutdown. Therefore, control rod alignment and OPERABILITY are related to core operation in design power peaking limits and the core design requirement of a minimum SDM.

Limits on control rod alignment and OPERABILITY have been established, and all rod positions are monitored and controlled during power operation to ensure that the power distribution and reactivity limits defined by the design power peaking and SDM limits are preserved.

Rod cluster control assemblies (RCCAs), or rods, are moved out of the core (up or withdrawn) or into the core (down or inserted) by their control rod drive mechanisms. The RCCAs are divided among control banks and shutdown banks. Each bank may be further subdivided into two groups to provide for precise reactivity control.

The axial position of shutdown rods and control rods are determined by two separate and independent systems: the Bank Demand Position Indication System (commonly called bank demand step counters) and the individual analog Rod Position Indication (RPI) System.

BASES

BACKGROUND (continued)

The Bank Demand Position Indication System counts the pulses from the Rod Control System that move the rods. There is one step counter for each group of rods. Individual rods in a group all receive the same signal to move and should, therefore, all be at the same position indicated by the group step counter for that group. The Bank Demand Position Indication System is considered highly precise (± 1 step or $\pm 5/8$ inch). If a rod does not move one step for each demand pulse, the step counter will still count the pulse and incorrectly reflect the position of the rod.

The individual rod position indication system consists of three separate control room readouts; analog meters, digital displays, and the plant process computer. The position indication signal to each of these readouts is supplied by a linear variable differential transmitter (LVDT) which uses the control rod drive shaft to vary the amount of magnetic coupling between primary and secondary windings of the transformer. This generates an analog output signal proportional to actual control rod position. The analog display meters and the digital displays, provide position readouts in direct proportion to the output signal from the LVDT signal conditioning circuit. The process computer applies a polynomial to compensate for non-linearities in the LVDT system, providing for a more accurate position readout. Any one of these three readouts can be used for the purpose of verifying control rod position and alignment. The RPI system has an indication accuracy of 5% of span (11.5 steps); therefore, the maximum deviation between actual and demanded indication could be 24 steps or approximately 15 inches.

APPLICABLE SAFETY ANALYSES

Control and shutdown rod position accuracy is essential during power operation. Power peaking, ejected rod worth, or SDM limits may be violated in the event of a Design Basis Accident (Ref. 2), with control or shutdown rods operating outside their limits undetected. Therefore, the acceptance criteria for rod position indication is that rod positions must be known with sufficient accuracy in order to verify the core is operating within the group sequence, overlap, design peaking limits, ejected rod worth, and with minimum SDM (LCO 3.1.5, "Shutdown Bank Insertion Limits," and LCO 3.1.6, "Control Bank Insertion Limits"). The rod positions must also be known in order to verify the alignment limits are preserved (LCO 3.1.4, "Rod Group Alignment Limits"). Control rod positions are continuously monitored to provide operators with information that ensures the plant is operating within the bounds of the accident analysis assumptions.

BASES

APPLICABLE SAFETY ANALYSES (continued) The control rod position indicator channels satisfy Criterion 2 of the NRC Policy Statement. The control rod position indicators monitor control rod position, which is an initial condition of the accident.

LCO LCO 3.1.7 specifies that one RPI System and one Bank Demand Position Indication System be OPERABLE for each control rod.

OPERABILITY of the position indicator channels ensures that inoperable, misaligned, or mispositioned control rods can be detected. Therefore, power peaking, ejected rod worth, and SDM can be controlled within acceptable limits.

A deviation of less than the allowable limit, given in LCO 3.1.4, in position indication for a single control rod, ensures high confidence that the position uncertainty of the corresponding control rod group is within the assumed values used in the analysis (that specified control rod group insertion limits).

The comparison of bank demand position and RPI System may take place at any time up to one hour after rod motion, at any power level. This allows up to one hour of thermal soak time to allow the control rod drive shaft to reach a thermal equilibrium and thus present a consistent position indication. A similar time period (up to one hour after rod motion) is allowed for comparison of the bank insertion limits and the RPI System. Based on this allowance, position indication may be considered OPERABLE during the thermal soak time to allow for position indication to stabilize.

These requirements ensure that control rod position indication during power operation and PHYSICS TESTS is accurate, and that design assumptions are not challenged.

APPLICABILITY The requirements on the RPI and step counters are only applicable in MODES 1 and 2 (consistent with LCO 3.1.4, LCO 3.1.5, and LCO 3.1.6), because these are the only MODES in which power is generated, and the OPERABILITY and alignment of rods have the potential to affect the safety of the plant. In the shutdown MODES, the OPERABILITY of the shutdown and control banks has the potential to affect the required SDM, but this effect can be compensated for by an increase in the boron concentration of the Reactor Coolant System.

BASES

ACTIONS

The ACTIONS table is modified by a Note indicating that a separate Condition entry is allowed for each inoperable rod position indicator per group and each demand position indicator per bank. This is acceptable because the Required Actions for each Condition provide appropriate compensatory actions for each inoperable position indicator.

A.1.1

When one or more RPI channel(s) per group fails, the position of the rod can still be determined by use of the incore movable detectors (the incore is not effective for determining rod position until the power level is above approximately 5% RTP). By determining the non-indicating rod's position initially through use of the incore movable detectors, actual rod position is established with a high degree of certainty. Initial verification of RCCA position within the Completion Time of 8 hours is adequate for continued power operation above 50% of RTP, based on meeting the alignment requirements for the controls rod(s) prior to the individual position indicator becoming inoperable and the probability of a control rod becoming significantly out of position coincident with an event sensitive to that rod position is small.

A.1.2

After the initial position determination performed in Required Action A.1.1 above, Required Action A.1.2 requires periodic position verifications for control rods with inoperable individual position indicators once every 8 hours. Position verification can be performed by use of thermocouples, excore instrumentation, or the movable incore detectors. Based on experience, normal power operation does not require excessive movement of banks. If a bank has been significantly moved, Required Action B.1 below is required. Therefore, verification of RCCA position once every 8 hours is adequate for allowing continued power operation above 50% of RTP, since the probability of undetected rod misalignment and an event sensitive to that rod position is small.

A.2

Reduction of THERMAL POWER to $\leq 50\%$ RTP puts the core into a condition where rod position is not significantly affecting core peaking factors.

The allowed Completion Time of 8 hours is reasonable, based on operating experience, for reducing power to $\leq 50\%$ RTP from full power conditions without challenging plant systems and allowing for rod position determination by Required Actions A.1.1 and A.1.2 above.

BASES

ACTIONS (continued) B.1 and B.2

These Required Actions clarify that when one or more rods with inoperable position indicators have been moved in excess of 24 steps in one direction, since the position was last determined, the Required Actions of A.1.1, A.1.2 and A.2 are still appropriate but must be initiated promptly under Required Action B.1 to begin verifying that these rods are still properly positioned, relative to their group positions.

If, within 4 hours, the rod positions have not been determined, THERMAL POWER must be reduced to $\leq 50\%$ RTP within 8 hours to avoid undesirable power distributions that could result from continued operation $> 50\%$ RTP, if one or more rods are misaligned by more than 24 steps. The allowed Completion Time of 4 hours provides an acceptable period of time to verify the rod positions.

C.1.1 and C.1.2

With one or more demand position indicator(s) per bank inoperable, the rod positions can be determined by the RPI System. Since normal power operation does not require excessive movement of rods, verification by administrative means that the rod position indicators are OPERABLE and the most withdrawn rod and the least withdrawn rod are: ≤ 12 steps apart when RTP is > 85 percent, and ≤ 24 steps apart when RTP is ≤ 85 percent within the allowed Completion Time of once every 8 hours is adequate.

C.2

Reduction of THERMAL POWER to $\leq 50\%$ RTP puts the core into a condition where rod position is not significantly affecting core peaking factor limits. The allowed Completion Time of 8 hours provides an acceptable period of time to verify the rod positions per Required Actions C.1.1 and C.1.2 or reduce power to $\leq 50\%$ RTP.

D.1

If the Required Actions cannot be completed within the associated Completion Time, the plant must be brought to a MODE in which the requirement does not apply. To achieve this status, the plant must be brought to at least MODE 3 within 6 hours. The allowed Completion Time is reasonable, based on operating experience, for reaching the required MODE from full power conditions in an orderly manner and without challenging plant systems.

BASES

SURVEILLANCE
REQUIREMENTS

SR 3.1.7.1

A CHANNEL CALIBRATION of the individual rod position indicators is performed to ensure that the rod position indicators respond within the necessary range and accuracy.

This surveillance is performed prior to reactor criticality after each removal of the reactor head as there is potential for unnecessary plant transients if the SR were performed with the reactor at power.

REFERENCES

1. FSAR. Section 7.1.2.
 2. FSAR. Chapter 14.
-

B 3.1 REACTIVITY CONTROL SYSTEMS

B 3.1.8 PHYSICS TESTS Exceptions - MODE 2

BASES

BACKGROUND

The primary purpose of the MODE 2 PHYSICS TESTS exceptions is to permit relaxations of existing LCOs to allow certain PHYSICS TESTS to be performed.

Section XI of 10 CFR 50, Appendix B (Ref. 1), requires that a test program be established to ensure that structures, systems, and components will perform satisfactorily in service. All functions necessary to ensure that the specified design conditions are not exceeded during normal operation and anticipated operational occurrences must be tested. This testing is an integral part of the design, construction, and operation of the plant. Requirements for notification of the NRC, for the purpose of conducting tests and experiments, are specified in 10 CFR 50.59 (Ref. 2).

The key objectives of a test program are to (Ref. 3):

- a. Ensure that the facility has been adequately designed;
- b. Validate the analytical models used in the design and analysis;
- c. Verify the assumptions used to predict unit response;
- d. Ensure that installation of equipment in the facility has been accomplished in accordance with the design; and
- e. Verify that the operating and emergency procedures are adequate.

To accomplish these objectives, testing is performed prior to initial criticality, during startup, during low power operations, during power ascension, at high power, and after each refueling. The PHYSICS TESTS requirements for reload fuel cycles ensure that the operating characteristics of the core are consistent with the design predictions and that the core can be operated as designed (Ref. 4).

PHYSICS TESTS procedures are written and approved in accordance with established formats. The procedures include all information necessary to permit a detailed execution of the testing required to ensure that the design intent is met. PHYSICS TESTS are performed in accordance with these procedures and test results are approved prior to continued power escalation and long term power operation.

BASES

BACKGROUND
(continued)

The PHYSICS TESTS required for reload fuel cycles (Ref. 4) in MODE 2 are listed below:

- a. Critical Boron Concentration — Control Rods Withdrawn;
- b. Critical Boron Concentration — Control Rods Inserted;
- c. Control Rod Worth;
- d. Isothermal Temperature Coefficient (ITC); and
- e. Neutron Flux Symmetry.

The first four tests are performed in MODE 2, and the last test can be performed in either MODE 1 or 2. These and other supplementary tests may be required to calibrate the nuclear instrumentation or to diagnose operational problems. These tests may cause the operating controls and process variables to deviate from their LCO requirements during their performance.

- a. The Critical Boron Concentration — Control Rods Withdrawn Test measures the critical boron concentration at hot zero power (HZP). With all rods out, the lead control bank is at or near its fully withdrawn position. HZP is where the core is critical ($k_{eff} = 1.0$), and the Reactor Coolant System (RCS) is at design temperature and pressure for zero power. Performance of this test should not violate any of the referenced LCOs.
- b. The Critical Boron Concentration — Control Rods Inserted Test measures the critical boron concentration at HZP, with a bank having a worth of at least 1% $\Delta k/k$ when fully inserted into the core. This test is used to measure the boron reactivity coefficient. With the core at HZP and all banks fully withdrawn, the boron concentration of the reactor coolant is gradually lowered in a continuous manner. The selected bank is then inserted to make up for the decreasing boron concentration until the selected bank has been moved over its entire range of travel. The reactivity resulting from each incremental bank movement is measured with a reactivity computer. The difference between the measured critical boron concentration with all rods fully withdrawn and with the bank inserted is determined. The boron reactivity coefficient is determined by dividing the measured bank worth by the measured boron concentration difference. Performance of this test could violate LCO 3.1.4, "Rod Group Alignment Limits"; LCO 3.1.5, "Shutdown Bank Insertion Limit"; or LCO 3.1.6, "Control Bank Insertion Limits." When the control rod worth test is performed

BASES

BACKGROUND
(continued)

- using the Dynamic Rod Worth Measurement Technique, it is not necessary to determine Critical Boron Concentration – Control Rods Inserted as it is not used for design validation per the ANS-19.6.1 requirements.
- c. The Control Rod Worth Test is used to measure the reactivity worth of selected control banks. This test is performed at HZP and has four alternative methods of performance. The first method, the Boron Exchange Method, varies the reactor coolant boron concentration and moves the selected control bank in response to the changing boron concentration. The reactivity changes are measured with a reactivity computer. This sequence is repeated for the remaining control rod banks. The second method, the Rod Swap Method, measures the worth of a predetermined reference bank using the Boron Exchange Method above. The reference bank is then nearly fully inserted into the core. The selected bank is then inserted into the core as the reference bank is withdrawn. The HZP critical conditions are then determined with the selected bank fully inserted into the core. The worth of the selected bank is inferred, based on the position of the reference bank with respect to the selected bank. This sequence is repeated as necessary for the remaining control rod banks. The third method, the Boron Endpoint Method, moves the selected control bank over its entire length of travel and then varies the reactor coolant boron concentration to achieve HZP criticality again. The difference in boron concentration is the worth of the selected control bank. This sequence is repeated for the remaining control rod banks. The fourth method, the Westinghouse Dynamic Rod Worth Measurement Technique (Ref. 7), is accomplished by inserting and withdrawing the bank at the maximum stepping speed, without changing boron concentration, and recording the signals on the excore detectors. The recorded signals are processed on a reactivity computer, which solves the inverse point kinetics equation with proper analytical compensation for spatial effects. Performance of this test could violate LCO 3.1.4, LCO 3.1.5, or LCO 3.1.6.
- d. The ITC Test measures the ITC of the reactor. This test is performed at HZP and has two methods of performance. The first method, the Slope Method, varies RCS temperature in a slow and continuous manner. The reactivity change is measured with a reactivity computer as a function of the temperature change. The ITC is the slope of the reactivity versus the temperature plot. The test is repeated by reversing the direction of the temperature change, and the final ITC is the average of the two calculated ITCs. The second method, the Endpoint Method, changes the RCS temperature and measures the reactivity at the beginning and end

BASES

BACKGROUND
(continued)

of the temperature change. The ITC is the total reactivity change divided by the total temperature change. The test is repeated by reversing the direction of the temperature change, and the final ITC is the average of the two calculated ITCs. Performance of this test could violate LCO 3.4.2, "RCS Minimum Temperature for Criticality."

- e. The Flux Symmetry Test measures the degree of azimuthal symmetry of the neutron flux at as low a power level as practical, depending on the test method employed. This test can be performed at HZP (Control Rod Worth Symmetry Method) or at $\leq 30\%$ RTP (Flux Distribution Method). The Control Rod Worth Symmetry Method inserts a control bank, which can then be withdrawn to compensate for the insertion of a single control rod from a symmetric set. The symmetric rods of each set are then tested to evaluate the symmetry of the control rod worth and neutron flux (power distribution). A reactivity computer is used to measure the control rod worths. Performance of this test could violate LCO 3.1.4, LCO 3.1.5, or LCO 3.1.6. The Flux Distribution Method uses the incore flux detectors to measure the azimuthal flux distribution at selected locations with the core at $\leq 30\%$ RTP.
-

APPLICABLE
SAFETY ANALYSES

The fuel is protected by LCOs that preserve the initial conditions of the core assumed during the safety analyses. The methods for development of the LCOs that are excepted by this LCO are described in the Westinghouse Reload Safety Evaluation Methodology Report (Ref. 5). The above mentioned PHYSICS TESTS, and other tests that may be required to calibrate nuclear instrumentation or to diagnose operational problems, may require the operating control or process variables to deviate from their LCO limitations.

The FSAR defines requirements for initial testing of the facility, including PHYSICS TESTS. Table 13.2.2-1 summarize the zero, low power, and power tests. Requirements for reload fuel cycle PHYSICS TESTS are defined in ANSI/ANS-19.6.1-1985 (Ref. 4). Although these PHYSICS TESTS are generally accomplished within the limits for all LCOs, conditions may occur when one or more LCOs must be suspended to make completion of PHYSICS TESTS possible or practical. This is acceptable as long as the fuel design criteria are not violated. When one or more of the requirements specified in LCO 3.1.3, "Moderator Temperature Coefficient (MTC)," LCO 3.1.4, LCO 3.1.5, LCO 3.1.6, and LCO 3.4.2 are suspended for PHYSICS TESTS, the fuel design criteria are preserved as long as the power level is limited to $\leq 5\%$ RTP, the reactor coolant temperature is kept $\geq 530^{\circ}\text{F}$, and SDM is within the limits provided in the COLR.

BASES

APPLICABLE
SAFETY ANALYSES
(continued)

The PHYSICS TESTS include measurement of core nuclear parameters or the exercise of control components that affect process variables. Among the process variables involved are AFD and QPTR, which represent initial conditions of the unit safety analyses. Also involved are the movable control components (control and shutdown rods), which are required to shut down the reactor. The limits for these variables are specified for each fuel cycle in the COLR. As described in LCO 3.0.7, compliance with Test Exception LCOs is optional, and therefore no criteria of the NRC Policy Statement apply. Test Exception LCOs provide flexibility to perform certain operations by appropriately modifying requirements of other LCOs. A discussion of the criteria satisfied for the other LCOs is provided in their respective bases.

Reference 6 allows special test exceptions (STEs) to be included as part of the LCO that they affect. It was decided, however, to retain this STE as a separate LCO because it was less cumbersome and provided additional clarity.

LCO

This LCO allows the reactor parameters of MTC and minimum temperature for criticality to be outside their specified limits. In addition, it allows selected control and shutdown rods to be positioned outside of their specified alignment and insertion limits. One Power Range Neutron Flux channel may be bypassed, reducing the number of required channels from "4" to "3". Operation beyond specified limits is permitted for the purpose of performing PHYSICS TESTS and poses no threat to fuel integrity, provided the SRs are met.

The requirements of LCO 3.1.3, LCO 3.1.4, LCO 3.1.5, LCO 3.1.6, and LCO 3.4.2 may be suspended and the number of required channels for LCO 3.3.1, "RTS Instrumentation," Functions 2, 5, and 17.d, may be reduced to "3" required channels, during the performance of PHYSICS TESTS provided:

- a. RCS lowest loop average temperature is $\geq 530^{\circ}\text{F}$;
 - b. SDM is within the limits provided in the COLR; and
 - c. THERMAL POWER is $\leq 5\%$ RTP.
-

APPLICABILITY

This LCO is applicable when performing low power PHYSICS TESTS. The Applicability is stated as "during PHYSICS TESTS initiated in MODE 2" to ensure that the 5% RTP maximum power level is not exceeded. Should the THERMAL POWER exceed 5% RTP, and

BASES

APPLICABILITY
(continued) consequently the unit enter MODE 1, the applicability statement prevents exiting this Specification and its Required Actions.

ACTIONS A.1 and A.2

If the SDM requirement is not met, boration must be initiated promptly. A Completion Time of 15 minutes is adequate for an operator to correctly align and start the required systems and components. The operator should begin boration with the best source available for the plant conditions. Boration will be continued until SDM is within limit.

Suspension of PHYSICS TESTS exceptions requires restoration of each of the applicable LCOs to within specification.

B.1

When THERMAL POWER is > 5% RTP, the only acceptable action is to open the reactor trip breakers (RTBs) to prevent operation of the reactor beyond its design limits. Immediately opening the RTBs will shut down the reactor and prevent operation of the reactor outside of its design limits.

C.1

When the RCS lowest T_{avg} is < 530°F, the appropriate action is to restore T_{avg} to within its specified limit. The allowed Completion Time of 15 minutes provides time for restoring T_{avg} to within limits without allowing the plant to remain in an unacceptable condition for an extended period of time. Operation with the reactor critical and with temperature below 530°F could violate the assumptions for accidents analyzed in the safety analyses.

D.1

If the Required Actions cannot be completed within the associated Completion Time, the plant must be brought to a MODE in which the requirement does not apply. To achieve this status, the plant must be brought to at least MODE 3 within an additional 15 minutes. The Completion Time of 15 additional minutes is reasonable, based on operating experience, for reaching MODE 3 in an orderly manner and without challenging plant systems.

BASES

SURVEILLANCE
REQUIREMENTS

SR 3.1.8.1

Verification that the RCS lowest loop T_{avg} is $\geq 530^{\circ}\text{F}$ will ensure that the unit is not operating in a condition that could invalidate the safety analyses. Verification of the RCS temperature at a Frequency of 30 minutes during the performance of the PHYSICS TESTS will ensure that the initial conditions of the safety analyses are not violated.

SR 3.1.8.2

Verification that THERMAL POWER is $\leq 5\%$ RTP will ensure that the plant is not operating in a condition that could invalidate the safety analyses. Verification of THERMAL POWER at a Frequency of 30 minutes during the performance of PHYSICS TESTS will ensure that the initial conditions of the safety analyses are not violated.

SR 3.1.8.3

The SDM is verified by performing a reactivity balance calculation, considering the following reactivity effects:

- a. RCS boron concentration;
- b. Control bank position;
- c. RCS average temperature;
- d. Fuel burnup based on gross thermal energy generation;
- e. Xenon concentration;
- f. Samarium concentration;
- g. Isothermal temperature coefficient (ITC), when below the Point of Adding Heat (POAH);
- h. Moderator Defect, when above the POAH; and
- i. Doppler Defect, when above the POAH.

Using the ITC accounts for Doppler reactivity in this calculation when the reactor is subcritical, or critical but below the POAH, and the fuel temperature will be changing at the same rate as the RCS.

BASES

SURVEILLANCE REQUIREMENTS (continued) The Frequency of 24 hours is based on the generally slow change in required boron concentration and on the low probability of an accident occurring without the required SDM.

- REFERENCES
1. 10 CFR 50, Appendix B, Section XI.
 2. 10 CFR 50.59.
 3. Regulatory Guide 1.68, Revision 2, August, 1978.
 4. ANSI/ANS-19.6.1-1985, December 13, 1985.
 5. WCAP-9273-NP-A, "Westinghouse Reload Safety Evaluation Methodology Report," July 1985.
 6. WCAP-11618, including Addendum 1, April 1989.
 7. WCAP-13360-P-A, "Westinghouse Dynamic Rod Worth Measurement Technique," January 1996.
-

B 3.2 POWER DISTRIBUTION LIMITS

B 3.2.1 Heat Flux Hot Channel Factor ($F_Q(Z)$)

BASES

BACKGROUND

The purpose of the limits on the values of $F_Q(Z)$ is to limit the local (i.e., pellet) peak power density. The value of $F_Q(Z)$ varies along the axial height (Z) of the core.

$F_Q(Z)$ is defined as the maximum local fuel rod linear power density divided by the average fuel rod linear power density, assuming nominal fuel pellet and fuel rod dimensions. Therefore, $F_Q(Z)$ is a measure of the peak fuel pellet power within the reactor core.

During power operation, the global power distribution is limited by LCO 3.2.3, "AXIAL FLUX DIFFERENCE (AFD)," and LCO 3.2.4, "QUADRANT POWER TILT RATIO (QPTR)," which are directly and continuously measured process variables. These LCOs, along with LCO 3.1.6, "Control Bank Insertion Limits," maintain the core limits on power distributions on a continuous basis.

$F_Q(Z)$ varies with fuel loading patterns, control bank insertion, fuel burnup, and changes in axial power distribution.

$F_Q(Z)$ is measured periodically using the incore detector system. These measurements are generally taken with the core at or near equilibrium conditions.

Using the measured three dimensional power distributions, it is possible to derive a measured value for $F_Q(Z)$. However, because this value represents an equilibrium condition, it does not include the variations in the value of $F_Q(Z)$ which are present during non-equilibrium situations, such as load following or power ascension.

To account for these possible variations, the equilibrium value of $F_Q(Z)$ is adjusted as $F_Q^W(Z)$ by an elevation dependent factor ($W(Z)$) that accounts for the calculated worst case transient conditions.

Core monitoring and control under non-equilibrium conditions are accomplished by operating the core within the limits of the appropriate LCOs, including the limits on AFD, QPTR, and control rod insertion.

BASES

APPLICABLE SAFETY ANALYSES

This LCO precludes core power distributions that violate the following fuel design criteria:

- a. During a large break loss of coolant accident (LOCA), the peak cladding temperature must not exceed 2200°F (Ref. 1);
- b. During a loss of forced reactor coolant flow accident, there must be at least 95% probability at the 95% confidence level (the 95/95 DNB criterion) that the hot fuel rod in the core does not experience a departure from nucleate boiling (DNB) condition;
- c. During an ejected rod accident, the energy deposition to the fuel must not exceed 225 cal/gm for unirradiated fuel and 200 cal/gm for irradiated fuel (Ref. 2); and
- d. The control rods must be capable of shutting down the reactor with a minimum required SDM with the highest worth control rod stuck fully withdrawn (Ref. 3).

Limits on $F_Q(Z)$ ensure that the value of the initial total peaking factor assumed in the accident analyses remains valid. Other criteria must also be met (e.g., maximum cladding oxidation, maximum hydrogen generation, coolable geometry, and long term cooling). However, the peak cladding temperature is typically most limiting.

$F_Q(Z)$ limits assumed in the LOCA analysis are typically limiting relative to (i.e., lower than) the $F_Q(Z)$ limit assumed in safety analyses for other postulated accidents. Therefore, this LCO provides conservative limits for other postulated accidents.

$F_Q(Z)$ satisfies Criterion 2 of the NRC Policy Statement.

BASES

LCO

The Heat Flux Hot Channel Factor, $F_Q(Z)$, shall be limited by the following relationships:

$$F_Q(Z) \leq \frac{CF_Q}{P} K(Z) \quad \text{for } P > 0.5$$

$$F_Q(Z) \leq \frac{CF_Q}{0.5} K(Z) \quad \text{for } P \leq 0.5$$

where: CF_Q is the $F_Q(Z)$ limit at RTP provided in the COLR,

$K(Z)$ is the normalized $F_Q(Z)$ as a function of core height provided in the COLR, and

$$P = \frac{\text{THERMAL POWER}}{\text{RTP}}$$

For this facility, the actual values of CF_Q and $K(Z)$ are given in the COLR; however, CF_Q is normally a number on the order of 2.50, and $K(Z)$ is a function that looks like the one provided in Figure B 3.2.1-1.

For Relaxed Axial Offset Control operation, $F_Q(Z)$ is approximated by $F_Q^C(Z)$ and $F_Q^W(Z)$. Thus, both $F_Q^C(Z)$ and $F_Q^W(Z)$ must meet the preceding limits on $F_Q(Z)$.

An $F_Q^C(Z)$ evaluation requires obtaining an incore flux map in MODE 1. From the incore flux map results we obtain the measured value ($F_Q^M(Z)$) of $F_Q(Z)$. Then,

$$F_Q^C(Z) = F_Q^M(Z) 1.08$$

where 1.08 is a factor that accounts for fuel manufacturing tolerances and flux map measurement uncertainty.

$F_Q^C(Z)$ is an excellent approximation for $F_Q(Z)$ when the reactor is at the steady state power at which the incore flux map was taken.

The expression for $F_Q^W(Z)$ is: $F_Q^W(Z) = F_Q^C(Z) W(Z)$

where $W(Z)$ is a cycle dependent function that accounts for power distribution transients encountered during normal operation. $W(Z)$ is included in the COLR. The $F_Q(Z)$ is calculated at equilibrium conditions.

The $F_Q(Z)$ limits define limiting values for core power peaking that precludes peak cladding temperatures above 2200°F during either a large or small break LOCA.

BASES

LCO (continued)	<p>This LCO requires operation within the bounds assumed in the safety analyses. Calculations are performed in the core design process to confirm that the core can be controlled in such a manner during operation that it can stay within the LOCA $F_Q(Z)$ limits. If $F_Q^C(Z)$ cannot be maintained within the LCO limits, reduction of the core power is required and if $F_Q^W(Z)$ cannot be maintained within the LCO limits, reduction of the AFD limits is required. Note that sufficient reduction of the AFD limits will result in a reduction of the core power.</p> <p>Violating the LCO limits for $F_Q(Z)$ produces unacceptable consequences if a design basis event occurs while $F_Q(Z)$ is outside its specified limits.</p>
APPLICABILITY	<p>The $F_Q(Z)$ limits must be maintained in MODE 1 to prevent core power distributions from exceeding the limits assumed in the safety analyses. Applicability in other MODES is not required because there is either insufficient stored energy in the fuel or insufficient energy being transferred to the reactor coolant to require a limit on the distribution of core power.</p>
ACTIONS	<p><u>A.1</u></p> <p>Reducing THERMAL POWER by $\geq 1\%$ RTP for each 1% by which $F_Q^C(Z)$ exceeds its limit, maintains an acceptable absolute power density. $F_Q^C(Z)$ is $F_Q^M(Z)$ multiplied by a factor accounting for manufacturing tolerances and measurement uncertainties. $F_Q^M(Z)$ is the measured value of $F_Q(Z)$. The Completion Time of 15 minutes provides an acceptable time to reduce power in an orderly manner and without allowing the plant to remain in an unacceptable condition for an extended period of time. The maximum allowable power level initially determined by Required Action A.1 may be affected by subsequent determinations of $F_Q^C(Z)$ and would require power reductions within 15 minutes of the $F_Q^C(Z)$ determination if necessary to comply with the decreased maximum allowable power level. Decreases in $F_Q^C(Z)$ would allow increasing the maximum allowable power level and increasing power up to this revised limit.</p> <p><u>A.2</u></p> <p>A reduction of the Power Range Neutron Flux—High trip setpoints by $\geq 1\%$ for each 1% by which $F_Q^C(Z)$ exceeds its limit, is a conservative action for protection against the consequences of severe transients with unanalyzed power distributions. The Completion Time of 72 hours is</p>

BASES

ACTIONS (continued) sufficient considering the small likelihood of a severe transient in this time period and the preceding prompt reduction in THERMAL POWER in accordance with Required Action A.1. The maximum allowable Power Range Neutron Flux-High trip setpoints initially determined by required action A.2 may be affected by subsequent determinations of $F_Q^C(Z)$ and would require Power Range Neutron Flux-High trip setpoint reductions within 8 hours of the $F_Q^C(Z)$ determination, if necessary to comply with the decreased maximum allowable Power Range Neutron Flux-High trip setpoints. Decreases in $F_Q^C(Z)$ would allow increasing the maximum allowable Power Range Neutron Flux-High trip setpoints.

A.3

Reduction in the Overpower ΔT trip setpoints (value of K_4) by $\geq 1\%$ for each 1% by which $F_Q^C(Z)$ exceeds its limit, is a conservative action for protection against the consequences of severe transients with unanalyzed power distributions. The Completion Time of 72 hours is sufficient considering the small likelihood of a severe transient in this time period, and the preceding prompt reduction in THERMAL POWER in accordance with Required Action A.1. The maximum allowable Overpower ΔT trip setpoints initially determined by Required Action A.3 may be affected by subsequent determinations of $F_Q^C(Z)$ and would require Overpower ΔT trip setpoint reductions within 72 hours of the $F_Q^C(Z)$ determination, if necessary to comply with the decreased maximum allowable Overpower ΔT trip setpoints. Decreases in $F_Q^C(Z)$ would allow increasing the maximum Overpower ΔT trip setpoints.

A.4

Verification that $F_Q^C(Z)$ has been restored to within its limit, by performing SR 3.2.1.1 and SR 3.2.1.2 prior to increasing THERMAL POWER above the limit imposed by Required Action A.1, and prior to increasing any reactor trip setpoint which had been reduced in accordance with Action A.2 or A.3, ensures that core conditions during operation at higher power levels and future operation are consistent with safety analyses assumptions.

Condition A is modified by a Note that requires Required Action A.4 to be performed whenever the Condition is entered. This ensures that SR 3.2.1.1 and SR 3.2.1.2 will be performed prior to increasing THERMAL POWER above the limit of Required Action A.1 even when Condition A is exited prior to performing Required Action A.4. Performance of SR 3.2.1.1 and SR 3.2.1.2 are necessary to assure $F_Q(Z)$ is properly evaluated prior to increasing THERMAL POWER.

BASES

ACTIONS (continued) B.1

If it is found that the maximum calculated value of $F_Q(Z)$ that can occur during normal maneuvers, $F_Q^W(Z)$, exceeds its specified limits, there exists a potential for $F_Q^C(Z)$ to become excessively high if a normal operational transient occurs. Reducing the AFD limit by $\geq 1\%$ for each 1% by which $F_Q^W(Z)$ exceeds its limit within the allowed Completion Time of 4 hours, restricts the axial flux distribution such that even if a transient occurred, core peaking factors are not exceeded. For example, if the $F_Q^W(Z)$ limit is exceeded by 2% at 90% of RTP and the COLR AFD limits are -8 and +9 at 90% RTP, the new AFD limits would become -6 and +7 at 90% RTP.

The implicit assumption is that if $W(Z)$ values were recalculated (consistent with reduced AFD limits), then $F_Q^C(Z)$ times the recalculated $W(Z)$ values would meet the $F_Q(Z)$ limit. Note that complying with this action (of reducing AFD limits) may also result in a power reduction. Hence the need for B.2, B.3 and B.4.

B.2

A reduction of the Power Range Neutron Flux-High trip setpoints by $\geq 1\%$ for each 1% by which the maximum allowable power is reduced, is a conservative action for protection against the consequences of severe transients with unanalyzed power distributions. The Completion Time of 72 hours is sufficient considering the small likelihood of a severe transient in this time period and the preceding prompt reduction in THERMAL POWER as a result of reducing AFD limits in accordance with Required Action B.1.

B.3

Reduction in the Overpower ΔT trip setpoint value of K_4 by $\geq 1\%$ for each 1% by which the maximum allowable power is reduced, is a conservative action for protection against the consequences of severe transients with unanalyzed power distributions. The Completion Time of 72 hours is sufficient considering the small likelihood of a severe transient in this time period, and the preceding prompt reduction in THERMAL POWER as a result of reducing AFD limits in accordance with Action B.1.

BASES

ACTIONS (continued) B.4

Verification of $F_Q^W(Z)$ has been restored to within its limit, by performing SR 3.2.1.1 and SR 3.2.1.2 prior to increasing THERMAL POWER above the maximum allowable limit imposed by Required Action B.1 ensures that core conditions during operation at higher power levels and future operation are consistent with safety analyses assumptions.

Condition B is modified by a Note that requires Required Action B.4 to be performed whenever the Condition is entered. This ensures that SR 3.2.1.1 and SR 3.2.1.2 will be performed prior to increasing THERMAL POWER above the limit of Required Action B.1, even when Condition B is exited prior to performing Required Action B.4.

Performance of SR 3.2.1.1 and SR 3.2.1.2 are necessary to assure $F_Q(Z)$ is properly evaluated prior to increasing THERMAL POWER.

C.1

If Required Actions A.1 through A.4 or B.1 through B.4 are not met within their associated Completion Times, the plant must be placed in a mode or condition in which the LCO requirements are not applicable. This is done by placing the plant in at least MODE 2 within 6 hours.

This allowed Completion Time is reasonable based on operating experience regarding the amount of time it takes to reach MODE 2 from full power operation in an orderly manner and without challenging plant systems.

SURVEILLANCE REQUIREMENTS

SR 3.2.1.1 and SR 3.2.1.2 are modified by a Note. The Note applies during the first power ascension after a refueling. It states that THERMAL POWER may be increased until an equilibrium power level has been achieved at which a power distribution map can be obtained. This allowance is modified, however, by one of the Frequency conditions that requires verification that $F_Q^C(Z)$ and $F_Q^W(Z)$ are within their specified limits after a power rise of more than 10% RTP over the THERMAL POWER at which they were last verified to be within specified limits. Because $F_Q^C(Z)$ and $F_Q^W(Z)$ could not have previously been measured in this reload core, there is a second Frequency condition, applicable only for reload cores, that requires determination of these parameters before exceeding 75% RTP. This ensures that some determination of $F_Q^C(Z)$ and $F_Q^W(Z)$ are made at a lower power level at which adequate margin is available before going to 100% RTP. Also, this Frequency condition, together with the Frequency condition requiring verification of $F_Q^C(Z)$ and $F_Q^W(Z)$ following a power increase of more than 10%, ensures that they are verified as soon as RTP (or any

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

other level for extended operation) is achieved. In the absence of these Frequency conditions, it is possible to increase power to RTP and operate for 31 days without verification of $F_Q^C(Z)$ and $F_Q^W(Z)$. The Frequency condition is not intended to require verification of these parameters after every 10% increase in power level above the last verification. It only requires verification after a power level is achieved for extended operation that is 10% higher than that power at which $F_Q(Z)$ was last measured.

SR 3.2.1.1

Verification that $F_Q^C(Z)$ is within its specified limits involves increasing $F_Q^M(Z)$ to allow for manufacturing tolerance and measurement uncertainties in order to obtain $F_Q^C(Z)$. Specifically, $F_Q^M(Z)$ is the measured value of $F_Q(Z)$ obtained from incore flux map results and $F_Q^C(Z) = F_Q^M(Z) \cdot 1.08$ (Ref. 4). $F_Q^C(Z)$ is then compared to its specified limits.

The limit with which $F_Q^C(Z)$ is compared varies inversely with power above 50% RTP and directly with a function called $K(Z)$ provided in the COLR.

Performing this Surveillance in MODE 1 prior to exceeding 75% RTP ensures that the $F_Q^C(Z)$ limit is met when RTP is achieved, because peaking factors generally decrease as power level is increased.

If THERMAL POWER has been increased by $\geq 10\%$ RTP since the last determination of $F_Q^C(Z)$, another evaluation of this factor is required 12 hours after achieving equilibrium conditions at this higher power level (to ensure that $F_Q^C(Z)$ values are being reduced sufficiently with power increase to stay within the LCO limits).

The Frequency of 31 EFPD is adequate to monitor the change of power distribution with core burnup because such changes are slow and well controlled when the plant is operated in accordance with the Technical Specifications (TS).

SR 3.2.1.2

The nuclear design process includes calculations performed to determine that the core can be operated within the $F_Q(Z)$ limits. Because flux maps are taken in steady state conditions, the variations in power distribution resulting from normal operational maneuvers are not present in the flux map data. These variations are, however, conservatively calculated by considering a wide range of unit

BASES

SURVEILLANCE REQUIREMENTS (continued)

maneuvers in normal operation. The maximum peaking factor increase over steady state values, calculated as a function of core elevation, Z , is called $W(Z)$. Multiplying the measured total peaking factor, $F_Q^C(Z)$, by $W(Z)$ gives the maximum $F_Q(Z)$ calculated to occur in normal operation, $F_Q^W(Z)$.

The limit with which $F_Q^W(Z)$ is compared varies inversely with power above 50% RTP and directly with the function $K(Z)$ provided in the COLR.

The $W(Z)$ curve is provided in the COLR for discrete core elevations. Flux map data are typically taken for 30 to 75 core elevations. $F_Q^W(Z)$ evaluations are not applicable for the following axial core regions, measured in percent of core height:

- a. Lower core region, from 0 to 15% inclusive; and
- b. Upper core region, from 85 to 100% inclusive.

The top and bottom 15% of the core are excluded from the evaluation because of the low probability that these regions would be more limiting in the safety analyses and because of the difficulty of making a precise measurement in these regions.

This Surveillance has been modified by a Note that may require that more frequent surveillances be performed. If $F_Q^W(Z)$ is evaluated, an evaluation of the expression below is required to account for any increase to $F_Q^M(Z)$ that may occur and cause the $F_Q(Z)$ limit to be exceeded before the next required $F_Q(Z)$ evaluation.

If the two most recent $F_Q(Z)$ evaluations show an increase in the expression

$$\text{maximum over } z \left[\frac{F_Q^C(Z)}{K(Z)} \right]$$

it is required to meet the $F_Q(Z)$ limit with the last $F_Q^W(Z)$ increased by the greater of a factor of 1.02, or by an appropriate factor specified in the COLR (Ref. 5), or to evaluate $F_Q(Z)$ more frequently, each 7 EFPD. These alternative requirements prevent $F_Q(Z)$ from exceeding its limit for any significant period of time without detection.

BASES

SURVEILLANCE REQUIREMENTS (continued) Performing the Surveillance in MODE 1 prior to exceeding 75% RTP ensures that the $F_Q(Z)$ limit is met when RTP is achieved, because peaking factors are generally decreased as power level is increased.

$F_Q(Z)$ is verified at power levels $\geq 10\%$ RTP above the THERMAL POWER of its last verification, 12 hours after achieving equilibrium conditions to ensure that $F_Q(Z)$ is within its limit at higher power levels.

The Surveillance Frequency of 31 EFPD is adequate to monitor the change of power distribution with core burnup. The Surveillance may be done more frequently if required by the results of $F_Q(Z)$ evaluations.

The Frequency of 31 EFPD is adequate to monitor the change of power distribution because such a change is sufficiently slow, when the plant is operated in accordance with the TS, to preclude adverse peaking factors between 31 day surveillances.

REFERENCES

1. 10 CFR 50.46, 1974.
 2. FSAR, Section 14.2.6.
 3. FSAR, Chapter 3.
 4. WCAP - 7308-L-P-A, "Evaluation of Nuclear Hot Channel Factor Uncertainties," June 1988.
 5. WCAP - 10216-P-A, Rev. 1A, "Relaxation of Constant Axial Offset Control (and) FQ Surveillance Technical Specification," February 1994.
-

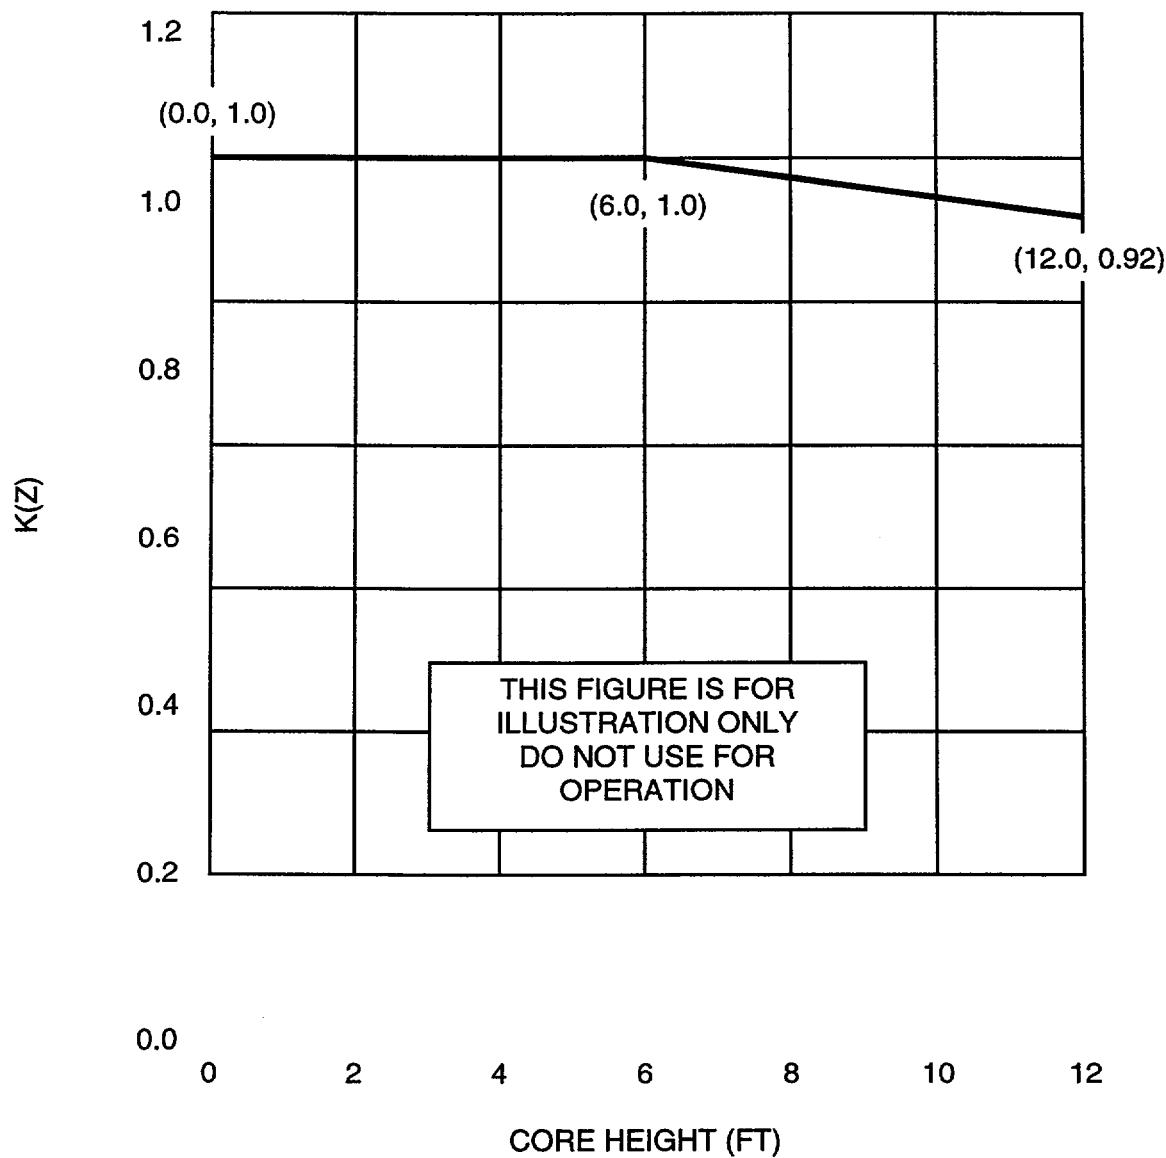


Figure B 3.2.1-1 (page 1 of 1)
 $K(Z)$ - Normalized $F_Q(Z)$ as a Function of Core Height

B 3.2 POWER DISTRIBUTION LIMITS

B 3.2.2 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)

BASES

BACKGROUND

The purpose of this LCO is to establish limits on the power density at any point in the core so that the fuel design criteria are not exceeded and the accident analysis assumptions remain valid. The design limits on local (pellet) and integrated fuel rod peak power density are expressed in terms of hot channel factors. Control of the core power distribution with respect to these factors ensures that local conditions in the fuel rods and coolant channels do not challenge core integrity at any location during either normal operation or a postulated accident analyzed in the safety analyses.

$F_{\Delta H}^N$ is defined as the ratio of the integral of the linear power along the fuel rod with the highest integrated power to the average integrated fuel rod power. Therefore, $F_{\Delta H}^N$ is a measure of the maximum total power produced in a fuel rod.

$F_{\Delta H}^N$ is sensitive to fuel loading patterns, bank insertion, and fuel burnup. $F_{\Delta H}^N$ typically increases with control bank insertion and typically decreases with fuel burnup.

$F_{\Delta H}^N$ is not directly measurable but is inferred from a power distribution map obtained with the movable incore detector system. Specifically, the results of the three dimensional power distribution map are analyzed by a computer to determine $F_{\Delta H}^N$. This factor is calculated at least every 31 EFPD. However, during power operation, the global power distribution is monitored by LCO 3.2.3, "AXIAL FLUX DIFFERENCE (AFD)," and LCO 3.2.4, "QUADRANT POWER TILT RATIO (QPTR)," which address directly and continuously measured process variables.

The COLR provides peaking factor limits that ensure that the design basis value of the departure from nucleate boiling (DNB) is met for normal operation, operational transients, and any transient condition arising from events of moderate frequency. The DNB design basis precludes DNB and is met by limiting the minimum local DNB heat flux ratio to 1.3 using the WRB-1 or W-3 CHF correlations. All DNB limited transient events are assumed to begin with an $F_{\Delta H}^N$ value that satisfies the LCO requirements. Operation outside the LCO limits may produce unacceptable consequences if a DNB limiting event occurs. The DNB design basis ensures that there is no overheating of the fuel that results

BASES

BACKGROUND (continued)	in possible cladding perforation with the release of fission products to the reactor coolant.
APPLICABLE SAFETY ANALYSES	<p>Limits on $F_{\Delta H}^N$ preclude core power distributions that exceed the following fuel design limits:</p> <ul style="list-style-type: none"> a. There must be at least 95% probability at the 95% confidence level (the 95/95 DNB criterion) that the hottest fuel rod in the core does not experience a DNB condition; b. During a large break loss of coolant accident (LOCA), peak cladding temperature (PCT) must not exceed 2200°F; c. During an ejected rod accident, the energy deposition to the fuel must not exceed 225 cal/gm for unirradiated and 200 cal/gm for irradiated fuel (Ref. 1); and d. Fuel design limits required by FSAR, Chapter 3 (Ref. 2) for the condition when control rods must be capable of shutting down the reactor with a minimum required SDM with the highest worth control rod stuck fully withdrawn.

For transients that may be DNB limited, the Reactor Coolant System flow and $F_{\Delta H}^N$ are the core parameters of most importance. The limits on $F_{\Delta H}^N$ ensure that the DNB design basis is met for normal operation, operational transients, and any transients arising from events of moderate frequency. The DNB design basis is met by limiting the minimum DNBR to the 95/95 DNB criterion of 1.3 using the WRB-1 or W-3 CHF correlations. This value provides a high degree of assurance that the hottest fuel rod in the core does not experience a DNB.

The allowable $F_{\Delta H}^N$ limit increases with decreasing power level. This functionality in $F_{\Delta H}^N$ is included in the analyses that provide the Reactor Core Safety Limits (SLs) of SL 2.1.1. Therefore, any DNB events in which the calculation of the core limits is modeled implicitly use this variable value of $F_{\Delta H}^N$ in the analyses. Likewise, all transients that may be DNB limited are assumed to begin with an initial $F_{\Delta H}^N$ as a function of power level defined by the COLR limit equation.

The LOCA safety analysis indirectly models $F_{\Delta H}^N$ as an input parameter. The Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$) and the axial peaking factors are inserted directly into the LOCA safety analyses that verify the acceptability of the resulting peak cladding temperature (Ref. 3).

BASES

APPLICABLE SAFETY ANALYSES (continued) The fuel is protected in part by Technical Specifications, which ensure that the initial conditions assumed in the safety and accident analyses remain valid. The following LCOs ensure this: LCO 3.2.3, "AXIAL FLUX DIFFERENCE (AFD)," LCO 3.2.4, "QUADRANT POWER TILT RATIO (QPTR)," LCO 3.1.6, "Control Bank Insertion Limits," LCO 3.2.2, "Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)," and LCO 3.2.1, "Heat Flux Hot Channel Factor ($F_Q(Z)$)."

$F_{\Delta H}^N$ and $F_Q(Z)$ are measured periodically using the movable incore detector system. Measurements are generally taken with the core at, or near, steady state conditions. Core monitoring and control under transient conditions (Condition 1 events) are accomplished by operating the core within the limits of the LCOs on AFD, QPTR, and Bank Insertion Limits.

$F_{\Delta H}^N$ satisfies Criterion 2 of the NRC Policy Statement.

LCO $F_{\Delta H}^N$ shall be maintained within the limits of the relationship provided in the COLR.
The $F_{\Delta H}^N$ limit identifies the coolant flow channel with the maximum enthalpy rise. This channel has the least heat removal capability and thus the highest probability for a DNB.
The limiting value of $F_{\Delta H}^N$, described by the equation contained in the COLR, is the design radial peaking factor used in the unit safety analyses.
A power multiplication factor in this equation includes an additional margin for higher radial peaking from reduced thermal feedback and greater control rod insertion at low power levels. The limiting value of $F_{\Delta H}^N$ is allowed to increase 0.3% for every 1% RTP reduction in THERMAL POWER.

APPLICABILITY The $F_{\Delta H}^N$ limits must be maintained in MODE 1 to preclude core power distributions from exceeding the fuel design limits for DNBR and PCT. Applicability in other modes is not required because there is either insufficient stored energy in the fuel or insufficient energy being transferred to the coolant to require a limit on the distribution of core power. Specifically, the design bases events that are sensitive to $F_{\Delta H}^N$ in other modes (MODES 2 through 5) have significant margin to DNB, and therefore, there is no need to restrict $F_{\Delta H}^N$ in these modes.

BASES

ACTIONS

A.1.1

With $F_{\Delta H}^N$ exceeding its limit, the unit is allowed 4 hours to restore $F_{\Delta H}^N$ to within its limits. This restoration may, for example, involve realigning any misaligned rods or reducing power enough to bring $F_{\Delta H}^N$ within its power dependent limit. When the $F_{\Delta H}^N$ limit is exceeded, the DNBR limit is not likely violated in steady state operation, because events that could significantly perturb the $F_{\Delta H}^N$ value (e.g., static control rod misalignment) are considered in the safety analyses. However, the DNBR limit may be violated if a DNB limiting event occurs. Thus, the allowed Completion Time of 4 hours provides an acceptable time to restore $F_{\Delta H}^N$ to within its limits without allowing the plant to remain in an unacceptable condition for an extended period of time.

Condition A is modified by a Note that requires that Required Actions A.2 and A.3 must be completed whenever Condition A is entered. Thus, if power is not reduced because this Required Action is completed within the 4 hour time period, Required Action A.2 nevertheless requires another measurement and calculation of $F_{\Delta H}^N$ within 24 hours in accordance with SR 3.2.2.1.

However, if power is reduced below 50% RTP, Required Action A.3 requires that another determination of $F_{\Delta H}^N$ must be done prior to exceeding 50% RTP, prior to exceeding 75% RTP, and within 24 hours after reaching or exceeding 95% RTP. In addition, Required Action A.2 is performed if power ascension is delayed past 24 hours.

A.1.2.1 and A.1.2.2

If the value of $F_{\Delta H}^N$ is not restored to within its specified limit either by adjusting a misaligned rod or by reducing THERMAL POWER, the alternative option is to reduce THERMAL POWER to < 50% RTP in accordance with Required Action A.1.2.1 and reduce the Power Range Neutron Flux - High to $\leq 55\%$ RTP in accordance with Required Action A.1.2.2. Reducing RTP to < 50% RTP increases the DNB margin and does not likely cause the DNBR limit to be violated in steady state operation. The reduction in trip setpoints ensures that continuing operation remains at an acceptable low power level with adequate DNBR margin. The allowed Completion Time of 4 hours for Required Action A.1.2.1 is consistent with those allowed for in Required Action A.1.1 and provides an acceptable time to reach the required power level from full power operation without allowing the plant to remain in an unacceptable condition for an extended period of time. The Completion Times of 4 hours for Required Actions A.1.1 and A.1.2.1 are not additive.

BASES

ACTIONS (continued) The allowed Completion Time of 72 hours to reset the trip setpoints per Required Action A.1.2.2 recognizes that, once power is reduced, the safety analysis assumptions are satisfied and there is no urgent need to reduce the trip setpoints. This is a sensitive operation that may inadvertently trip the Reactor Protection System.

A.2

Once the power level has been reduced to < 50% RTP per Required Action A.1.2.1, an incore flux map (SR 3.2.2.1) must be obtained and the measured value of $F_{\Delta H}^N$ verified not to exceed the allowed limit at the lower power level. The unit is provided 20 additional hours to perform this task over and above the 4 hours allowed by either Action A.1.1 or Action A.1.2.1. The Completion Time of 24 hours is acceptable because of the increase in the DNB margin, which is obtained at lower power levels, and the low probability of having a DNB limiting event within this 24 hour period. Additionally, operating experience has indicated that this Completion Time is sufficient to obtain the incore flux map, perform the required calculations, and evaluate $F_{\Delta H}^N$.

A.3

Verification that $F_{\Delta H}^N$ is within its specified limits after an out of limit occurrence ensures that the cause that led to the $F_{\Delta H}^N$ exceeding its limit is corrected, and that subsequent operation proceeds within the LCO limit. This Action demonstrates that the $F_{\Delta H}^N$ limit is within the LCO limits prior to exceeding 50% RTP, again prior to exceeding 75% RTP, and within 24 hours after THERMAL POWER is \geq 95% RTP.

This Required Action is modified by a Note that states that THERMAL POWER does not have to be reduced prior to performing this Action.

B.1

When Required Actions A.1.1 through A.3 cannot be completed within their required Completion Times, the plant must be placed in a MODE in which the LCO requirements are not applicable. This is done by placing the plant in at least MODE 2 within 6 hours. The allowed Completion Time of 6 hours is reasonable, based on operating experience regarding the time required to reach MODE 2 from full power conditions in an orderly manner and without challenging plant systems.

BASES

SURVEILLANCE
REQUIREMENTSSR 3.2.2.1

The value of $F_{\Delta H}^N$ is determined by using the movable incore detector system to obtain a flux distribution map. A data reduction computer program then calculates the maximum value of $F_{\Delta H}^N$ from the measured flux distributions. The measured value of $F_{\Delta H}^N$ must be multiplied by 1.04 to account for measurement uncertainty before making comparisons to the $F_{\Delta H}^N$ limit.

After each refueling, $F_{\Delta H}^N$ must be determined in MODE 1 prior to exceeding 75% RTP. This requirement ensures that $F_{\Delta H}^N$ limits are met at the beginning of each fuel cycle.

The 31 EPPD Frequency is acceptable because the power distribution changes relatively slowly over this amount of fuel burnup. Accordingly, this Frequency is short enough that the $F_{\Delta H}^N$ limit cannot be exceeded for any significant period of operation.

REFERENCES

1. FSAR, Section 14.2.6.
 2. FSAR, Chapter 3.
 3. 10 CFR 50.46.
-

B 3.2 POWER DISTRIBUTION LIMITS

B 3.2.3 AXIAL FLUX DIFFERENCE (AFD)

BASES

BACKGROUND

The purpose of this LCO is to establish limits on the values of the AFD in order to limit the amount of axial power distribution skewing to either the top or bottom of the core. By limiting the amount of power distribution skewing, core peaking factors are consistent with the assumptions used in the safety analyses. Limiting power distribution skewing over time also minimizes the xenon distribution skewing, which is a significant factor in axial power distribution control.

RAOC is a calculational procedure that defines the allowed operational space of the AFD versus THERMAL POWER. The AFD limits are selected by considering a range of axial xenon distributions that may occur as a result of large variations of the AFD. Subsequently, power peaking factors and power distributions are examined to ensure that the loss of coolant accident (LOCA), loss of flow accident, and anticipated transient limits are met. Violation of the AFD limits invalidate the conclusions of the accident and transient analyses with regard to fuel cladding integrity.

The AFD is monitored on an automatic basis using the unit process computer, which has an AFD monitor alarm. The computer determines the 1 minute average of each of the OPERABLE excore detector outputs and provides an alarm message immediately if the AFD for two or more OPERABLE excore channels is outside its specified limits.

Although the RAOC defines limits that must be met to satisfy safety analyses, typically an operating scheme, Constant Axial Offset Control (CAOC), is used to control axial power distribution in day to day operation (Ref. 1). CAOC requires that the AFD be controlled within a narrow tolerance band around a burnup dependent target to minimize the variation of axial peaking factors and axial xenon distribution during unit maneuvers.

The CAOC operating space is typically smaller and lies within the RAOC operating space. Control within the CAOC operating space constrains the variation of axial xenon distributions and axial power distributions. RAOC calculations assume a wide range of xenon distributions and then confirm that the resulting power distributions satisfy the requirements of the accident analyses.

BASES

APPLICABLE SAFETY ANALYSES

The AFD is a measure of the axial power distribution skewing to either the top or bottom half of the core. The AFD is sensitive to many core related parameters such as control bank positions, core power level, axial burnup, axial xenon distribution, and, to a lesser extent, reactor coolant temperature and boron concentration.

The allowed range of the AFD is used in the nuclear design process to confirm that operation within these limits produces core peaking factors and axial power distributions that meet safety analysis requirements.

The RAOC methodology (Ref. 2) establishes a xenon distribution library with tentatively wide AFD limits. One dimensional axial power distribution calculations are then performed to demonstrate that normal operation power shapes are acceptable for the LOCA and loss of flow accident, and for initial conditions of anticipated transients. The tentative limits are adjusted as necessary to meet the safety analysis requirements.

The limits on the AFD ensure that the Heat Flux Hot Channel Factor ($F_{\alpha}(Z)$) is not exceeded during either normal operation or in the event of xenon redistribution following power changes. The limits on the AFD also restrict the range of power distributions that are used as initial conditions in the analyses of Condition 2, 3, or 4 events. This ensures that the fuel cladding integrity is maintained for these postulated accidents. The most important Condition 4 event is the LOCA. The most important Condition 3 event is the loss of flow accident. The most important Condition 2 events are uncontrolled bank withdrawal and boration or dilution accidents. Condition 2 accidents simulated to begin from within the AFD limits are used to confirm the adequacy of the Overpower ΔT and Overtemperature ΔT trip setpoints.

The limits on the AFD satisfy Criterion 2 of the NRC Policy Statement.

LCO

The AFD limits are provided in the COLR. Figure B 3.2.3B-1 shows typical RAOC AFD limits. The AFD limits for RAOC do not depend on the target flux difference. However, the target flux difference may be used to minimize changes in the axial power distribution.

Violating this LCO on the AFD could produce unacceptable consequences if a Condition 2, 3, or 4 event occurs while the AFD is outside its specified limits.

BASES

APPLICABILITY	<p>The AFD requirements are applicable in MODE 1 greater than or equal to 50% RTP when the combination of THERMAL POWER and core peaking factors are of primary importance in safety analysis.</p> <p>For AFD limits developed using RAOC methodology, the value of the AFD does not affect the limiting accident consequences with THERMAL POWER < 50% RTP and for lower operating power MODES.</p>
---------------	---

ACTIONS	<p><u>A.1</u></p> <p>As an alternative to restoring the AFD to within its specified limits, Required Action A.1 requires a THERMAL POWER reduction to < 50% RTP. This places the core in a condition for which the value of the AFD is not important in the applicable safety analyses. A Completion Time of three hours is reasonable, based on operating experience, to reach 50% RTP without challenging plant systems.</p>
---------	---

SURVEILLANCE REQUIREMENTS	<p><u>SR 3.2.3.1</u></p> <p>This Surveillance verifies that the AFD, as indicated by the NIS excore channel, is within its specified limits. The Surveillance Frequency of 7 days is adequate considering that the AFD is monitored by a computer and any deviation from requirements is alarmed.</p>
---------------------------	---

REFERENCES	<ol style="list-style-type: none">1. WCAP-8403 (nonproprietary), "Power Distribution Control and Load Following Procedures," Westinghouse Electric Corporation, September 1974.2. R. W. Miller et al., "Relaxation of Constant Axial Offset Control: F_Q Surveillance Technical Specification," WCAP-10217(NP), June 1983.3. FSAR, Chapter 14.
------------	---

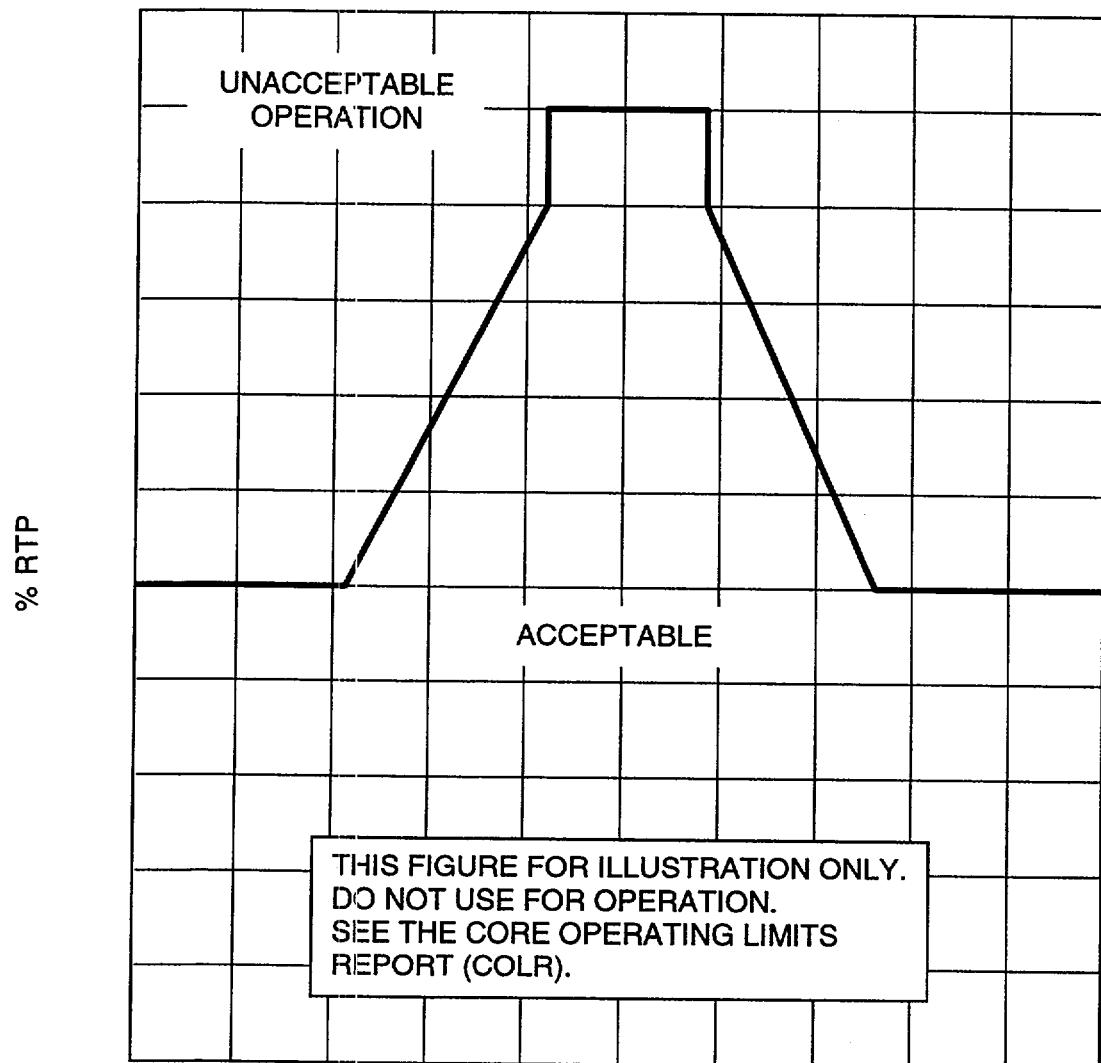


Figure B 3.2.3-1 (page 1 of 1)
AXIAL FLUX DIFFERENCE Acceptable Operation Limits
as a Function of RATED THERMAL POWER

B 3.2 POWER DISTRIBUTION LIMITS

B 3.2.4 QUADRANT POWER TILT RATIO (QPTR)

BASES

BACKGROUND	<p>The QPTR limit ensures that the gross radial power distribution remains consistent with the design values used in the safety analyses. Precise radial power distribution measurements are made during startup testing, after refueling, and periodically during power operation.</p> <p>The power density at any point in the core must be limited so that the fuel design criteria are maintained. Together, LCO 3.2.3, "AXIAL FLUX DIFFERENCE (AFD)," LCO 3.2.4, and LCO 3.1.6, "Control Rod Insertion Limits," provide limits on process variables that characterize and control the three dimensional power distribution of the reactor core. Control of these variables ensures that the core operates within the fuel design criteria and that the power distribution remains within the bounds used in the safety analyses.</p>
APPLICABLE SAFETY ANALYSES	<p>This LCO precludes core power distributions that violate the following fuel design criteria:</p> <ul style="list-style-type: none">a. During a large break loss of coolant accident, the peak cladding temperature must not exceed 2200°F (Ref. 1);b. During a loss of forced reactor coolant flow accident, there must be at least 95% probability at the 95% confidence level (the 95/95 departure from nucleate boiling (DNB) criterion) that the hot fuel rod in the core does not experience a DNB condition;c. During an ejected rod accident, the energy deposition to the fuel must not exceed 225 cal/gm for unirradiated and 200 cal/gm for irradiated fuel (Ref. 2); andd. The control rods must be capable of shutting down the reactor with a minimum required SDM with the highest worth control rod stuck fully withdrawn (Ref. 3). <p>The LCO limits on the AFD, the QPTR, the Heat Flux Hot Channel Factor ($F_Q(Z)$), the Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$), and control bank insertion are established to preclude core power distributions that exceed the safety analyses limits.</p>

BASES

APPLICABLE SAFETY ANALYSES (continued) The QPTR limits ensure that $F_{\Delta H}^N$ and $F_Q(Z)$ remain below their limiting values by preventing an undetected change in the gross radial power distribution.

In MODE 1, the $F_{\Delta H}^N$ and $F_Q(Z)$ limits must be maintained to preclude core power distributions from exceeding design limits assumed in the safety analyses.

The QPTR satisfies Criterion 2 of the NRC Policy Statement.

LCO The QPTR limit of 1.02, at which corrective action is required, provides a margin of protection for both the DNB ratio and linear heat generation rate contributing to excessive power peaks resulting from X-Y plane power tilts. A limiting QPTR of 1.02 can be tolerated before the margin for uncertainty in $F_Q(Z)$ and $F_{\Delta H}^N$ is possibly challenged.

APPLICABILITY The QPTR limit must be maintained in MODE 1 with THERMAL POWER > 50% RTP to prevent core power distributions from exceeding the design limits.

Applicability in MODE 1 ≤ 50% RTP and in other MODES is not required because there is either insufficient stored energy in the fuel or insufficient energy being transferred to the reactor coolant to require the implementation of a QPTR limit on the distribution of core power. The QPTR limit in these conditions is, therefore, not important. Note that the $F_{\Delta H}^N$ and $F_Q(Z)$ LCOs still apply, but allow progressively higher peaking factors at 50% RTP or lower.

ACTIONS A.1

With the QPTR exceeding its limit, a power level reduction of 3% RTP for each 1% by which the QPTR exceeds 1.00 is a conservative tradeoff of total core power with peak linear power. The Completion Time of 2 hours allows sufficient time to identify the cause and correct the tilt. Note that the power reduction itself may cause a change in the tilted condition. The maximum allowable power level initially determined by Required Action A.1 may be affected by subsequent determinations of QPTR. Increases in QPTR would require power reductions within 2 hours of QPTR determination, if necessary to comply with the decreased maximum allowable power level. Decreases in QPTR would allow increasing the maximum allowable power level and increasing power up to the revised limit.

BASES

ACTIONS (continued) A.2

After completion of Required Action A.1, the QPTR alarm may still be in its alarmed state. As such, any additional changes in the QPTR are detected by requiring a check of the QPTR once per 12 hours thereafter. A 12 hour Completion Time is sufficient because any additional change in QPTR would be relatively slow.

A.3

The peaking factors $F_{\Delta H}^N$ and $F_Q(Z)$, as approximated by $F_Q^C(Z)$ and $F_Q^W(Z)$, are of primary importance in ensuring that the power distribution remains consistent with the initial conditions used in the safety analyses. Performing SRs on $F_{\Delta H}^N$ and $F_Q(Z)$ within the Completion Time of 24 hours after achieving equilibrium conditions from a thermal power reduction per Required Action A.1 ensures that these primary indicators of power distribution are within their respective limits. Equilibrium conditions are achieved when the core is sufficiently stable at intended operating conditions to support flux mapping. A Completion Time of 24 hours after achieving equilibrium conditions from a thermal power reduction per Required Action A.1 takes into consideration the rate at which peaking factors are likely to change, and the time required to stabilize the plant and perform a flux map. If these peaking factors are not within their limits, the Required Actions of these Surveillances provide an appropriate response for the abnormal condition. If the QPTR remains above its specified limit, the peaking factor surveillances are required each 7 days thereafter to evaluate $F_{\Delta H}^N$ and $F_Q(Z)$ with changes in power distribution. Relatively small changes are expected due to either burnup and xenon redistribution or correction of the cause for exceeding the QPTR limit.

A.4

Although $F_{\Delta H}^N$ and $F_Q(Z)$ are of primary importance as initial conditions in the safety analyses, other changes in the power distribution may occur as the QPTR limit is exceeded and may have an impact on the validity of the safety analysis. A change in the power distribution can affect such reactor parameters as bank worths and peaking factors for rod malfunction accidents. When the QPTR exceeds its limit, it does not necessarily mean a safety concern exists. It does mean that there is an indication of a change in the gross radial power distribution that requires an investigation and evaluation that is accomplished by examining the incore power distribution. Specifically, the core peaking factors and the quadrant tilt must be evaluated because they are the factors that best characterize the core power distribution.

BASES

ACTIONS (continued) This re-evaluation is required to ensure that, before increasing THERMAL POWER to above the limit of Required Action A.1, the reactor core conditions are consistent with the assumptions in the safety analyses.

A.5

If the QPTR has exceeded the 1.02 limit and a re-evaluation of the safety analysis is completed and shows that safety requirements are met, the excore detectors are normalized to restore QPTR to within limits prior to increasing THERMAL POWER to above the limit of Required Action A.1. Normalization is accomplished in such a manner that the indicated QPTR following normalization is near 1.00. This is done to detect any subsequent significant changes in QPTR.

Required Action A.5 is modified by two Notes. Note 1 states that the QPT is not restored to within limits until after the re-evaluation of the safety analysis has determined that core conditions at RTP are within the safety analysis assumptions (i.e., Required Action A.4). Note 2 states that if required Action A.5 is performed, then required Action A.6 shall be performed. Required Action A.5 normalizes the excore detectors to restore QPTR to within limits, which restores compliance with LCO 3.2.4. Thus, Note 2 prevents exiting the Actions prior to completing flux mapping to verify peaking factors, per Required Action A.6. These Notes are intended to prevent any ambiguity about the required sequence of actions.

A.6

Once the flux tilt is restored to within limits (i.e., Required Action A.5 is performed), it is acceptable to return to full power operation. However, as an added check that the core power distribution is consistent with the safety analysis assumptions, Required Action A.6 requires verification that $F_Q(Z)$, as approximated by $F_Q^C(Z)$ and $F_Q^W(Z)$, and F_{AH}^N are within their specified limits within 24 hours of achieving equilibrium conditions at RTP. As an added precaution, if the core power does not reach equilibrium conditions at RTP within 24 hours, but is increased slowly, then the peaking factor surveillances must be performed within 48 hours after increasing thermal power above the limit of Required Action A.1. These Completion Times are intended to allow adequate time to increase THERMAL POWER to above the limit of Required Action A.1, while not permitting the core to remain with unconfirmed power distributions for extended periods of time.

BASES

ACTIONS (continued) Required Action A.6 is modified by a Note that states that the peaking factor surveillances may only be done after the excore detectors have been normalized to restore QPTR to within limits (i.e., Required Action A.5). The intent of this Note is to have the peaking factor surveillances performed at operating power levels, which can only be accomplished after the excore detectors are normalized to restore QPTR to within limits and the core returned to power.

B.1

If Required Actions A.1 through A.6 are not completed within their associated Completion Times, the unit must be brought to a MODE or condition in which the requirements do not apply. To achieve this status, THERMAL POWER must be reduced to < 50% RTP within 4 hours. The allowed Completion Time of 4 hours is reasonable, based on operating experience regarding the amount of time required to reach the reduced power level without challenging plant systems.

SURVEILLANCE REQUIREMENTS

SR 3.2.4.1

SR 3.2.4.1 is modified by two Notes. Note 1 allows QPTR to be calculated with three power range channels if THERMAL POWER is ≤ 75% RTP and the input from one Power Range Neutron Flux channel is inoperable. Note 2 allows performance of SR 3.2.4.2 in lieu of SR 3.2.4.1.

This Surveillance verifies that the QPTR, as indicated by the Nuclear Instrumentation System (NIS) excore channels, is within its limits. The Frequency of 7 days takes into account other information and alarms available to the operator in the control room.

For those causes of QPT that occur quickly (e.g., a dropped rod), there typically are other indications of abnormality that prompt a verification of core power tilt.

SR 3.2.4.2

This Surveillance is modified by a Note, which states that it is not required until 12 hours after the input from one or more Power Range Neutron Flux channels are inoperable and the THERMAL POWER is > 75% RTP.

BASES

SURVEILLANCE REQUIREMENTS (continued)

With an NIS power range channel inoperable, tilt monitoring for a portion of the reactor core becomes degraded. Large tilts are likely detected with the remaining channels, but the capability for detection of small power tilts in some quadrants is decreased. Performing SR 3.2.4.2 at a Frequency of 12 hours provides an accurate alternative means for ensuring that any tilt remains within its limits.

For purposes of monitoring the QPTR when one power range channel is inoperable, the moveable incore detectors are used to confirm that the normalized symmetric power distribution is consistent with the indicated QPTR and any previous data indicating a tilt. The incore detector monitoring is performed with a full incore flux map or three sets of four thimble locations with quarter core symmetry. The three sets of four symmetric thimbles is one of two sets of twelve unique detector locations. These locations are M7, G6, G4, G11, J10, E10, J3, H3, B6, L4, F12, F8, or M7, I7, D5, G11, G9, E10, J12, C3, C8, L9, H1, and F8.

The symmetric thimble flux map can be used to generate symmetric thimble "tilt." This can be compared to a reference symmetric thimble tilt, from the most recent full core flux map, to generate an incore QPTR. Therefore, incore monitoring of QPTR can be used to confirm that QPTR is within limits.

With one NIS channel inoperable, the indicated tilt may be changed from the value indicated with all four channels OPERABLE. To confirm that no change in tilt has actually occurred, which might cause the QPTR limit to be exceeded, the incore result may be compared against previous flux maps either using the symmetric thimbles as described above or a complete flux map. Nominally, quadrant tilt from the Surveillance should be within 2% of the tilt shown by the most recent flux map data.

REFERENCES

1. 10 CFR 50.46.
 2. FSAR, Section 14.2.6.
 3. FSAR, Chapter 3.
-

B 3.3 INSTRUMENTATION

B 3.3.1 Reactor Protection System (RPS) Instrumentation

BASES

BACKGROUND The RPS initiates a unit shutdown, based on the values of selected unit parameters, to protect against violating the core fuel design limits and Reactor Coolant System (RCS) pressure boundary during anticipated operational occurrences (AOOs) and to assist the Engineered Safety Features (ESF) Systems in mitigating accidents.

The protection and monitoring systems have been designed to assure safe operation of the reactor. This is achieved by specifying limiting safety system settings (LSSS) in terms of parameters directly monitored by the RPS, as well as specifying LCO's on other reactor system parameters and equipment performance.

The LSSS, defined in this specification as the Allowable Value Setpoints, in conjunction with the LCOs, establish the threshold for protective system action to prevent exceeding acceptable limits during Design Basis Accidents (DBAs).

During AOOs, which are those events expected to occur one or more times during the unit life, the acceptable limits are:

1. The Departure from Nucleate Boiling Ratio (DNBR) shall be maintained above the Safety Limit (SL) value to prevent departure from nucleate boiling (DNB);
2. Fuel centerline melt shall not occur; and
3. The RCS pressure SL of 2750 psia shall not be exceeded.

Operation within the SLs of Specification 2.0, "Safety Limits (SLs)," also maintains the above values and assures that offsite dose will be within the 10 CFR 50 and 10 CFR 100 criteria during AOOs.

Accidents are events that are analyzed even though they are not expected to occur during the unit life. The acceptable limit during accidents is that offsite dose shall be maintained within an acceptable fraction of 10 CFR 100 limits. Different accident categories are allowed a different fraction of these limits, based on probability of occurrence. Meeting the acceptable dose limit for an accident category is considered having acceptable consequences for that event.

BASES

BACKGROUND
(continued)

The RPS instrumentation is segmented into four distinct but interconnected modules as identified below:

1. Field transmitters or process sensors: provide a measurable electronic signal based upon the physical characteristics of the parameter being measured;
2. Signal Process Control and Protection System, including Analog Protection System, Nuclear Instrumentation System (NIS), field contacts, and protection channel sets: provides signal conditioning, compatible electrical signal output to protection system devices, and control board/control room/miscellaneous indications;
3. Relay Logic System, including input, logic, and output devices: initiates proper unit shutdown in accordance with the defined logic, which is based on bistable, setpoint comparators, or contact outputs from the signal process control and protection systems; and
4. Reactor trip switchgear, including reactor trip breakers (RTBs) and bypass breakers: provides the means to interrupt power to the control rod drive mechanisms (CRDMs) and allows the rod cluster control assemblies (RCCAs), or "rods," to fall into the core and shut down the reactor. The bypass breakers allow testing of the RTBs at power.

Field Transmitters or Sensors

To meet the design demands for redundancy and reliability, more than one, and often as many as four, field transmitters or sensors are used to measure unit parameters. To account for the calibration tolerances and instrument drift, which are assumed to occur between calibrations, statistical allowances are provided in the Allowable Values. The OPERABILITY of each transmitter or sensor can be evaluated when its "as found" calibration data are compared against its documented acceptance criteria.

Signal Process Control and Protection System

Generally, three or four channels of process control equipment are used for the signal processing of unit parameters measured by the field instruments. The process control equipment provides signal conditioning, comparable output signals for instruments located on the main control board, and comparison of measured input signals with setpoints established by safety analyses. If the measured value of a unit parameter exceeds the predetermined setpoint, an output from a bistable is forwarded to the logic relays.

BASES

BACKGROUND (continued)

Generally, if a parameter is used only for input to the protection circuits, three channels with a two-out-of-three logic are sufficient to provide the required reliability and redundancy. If one channel fails in a direction that would not result in a partial Function trip, the Function is still OPERABLE with a two-out-of-two logic. If one channel fails, such that a partial Function trip occurs, a trip will not occur and the Function is still OPERABLE with a one-out-of-two logic.

Generally, if a parameter is used for input to the relay logic system and a control function, four channels with a two-out-of-four logic are sufficient to provide the required reliability and redundancy. The circuit must be able to withstand both an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation. Again, a single failure will neither cause nor prevent the protection function actuation. These requirements are described in IEEE-279-1968 (Ref. 3). The actual number of channels required for each unit parameter is specified in Reference 1.

Two logic channels are required to ensure no single random failure of a logic channel will disable the RPS. The logic channels are designed such that testing required while the reactor is at power may be accomplished without causing trip. Provisions to allow removing logic channels from service during maintenance are unnecessary because of the logic system's designed reliability.

Allowable Values

To allow for calibration tolerances, instrumentation uncertainties, instrument drift, and severe environment errors for those RPS channels that must function in harsh environments as defined by 10 CFR 50.49 (Ref. 4), the Allowable Values specified in Table 3.3.1-1 in the accompanying LCO are conservatively adjusted with respect to the analytical limits. A detailed description of the methodology used to calculate the Trip Setpoints, including their explicit uncertainties, is provided in DGI-01, "Instrument Setpoint Methodology" (Ref. 5). The actual nominal Trip Setpoint entered into the bistable is more conservative than that specified by the Allowable Value to account for changes in random measurement errors detectable by a COT. One example of such a change in measurement error is drift during the surveillance interval. If the measured setpoint does not exceed the Allowable Value, the bistable is considered OPERABLE.

Setpoints in accordance with the Allowable Value ensure that SLs are not violated during AOOs (and that the consequences of DBAs will be acceptable, providing the unit is operated from within the LCOs at the

BASES

BACKGROUND (continued)

onset of the AOO or DBA and the equipment functions as designed). Note that in the accompanying LCO 3.3.1, the Allowable Values of Table 3.3.1-1 are the LSSS.

Each channel of the process control equipment can be tested on line to verify that the signal or setpoint accuracy is within the specified allowance requirements. Once a designated channel is taken out of service for testing, a simulated signal is injected in place of the field instrument signal. The process equipment for the channel in test is then tested, verified, and calibrated. SRs for the channels are specified in the SRs section.

The Allowable Values listed in Table 3.3.1-1 are based on the methodology described in Reference 5, which incorporates all of the known uncertainties applicable for each channel. The magnitudes of these uncertainties are factored into the determination of each Allowable Value. All field sensors and signal processing equipment for these channels are assumed to operate within the allowances of these uncertainty magnitudes.

Relay Logic System

The Relay Logic System equipment is used for the decision logic processing of outputs from the signal processing equipment bistables. To meet the redundancy requirements, two trains of Relay Logic System, each performing the same functions, are provided. If one train is taken out of service for maintenance or test purposes, the second train will provide reactor trip for the unit. Each train is packaged in its own cabinet for physical and electrical separation to satisfy separation and independence requirements. The system has been designed to trip in the event of a loss of power, directing the unit to a safe shutdown condition.

The Relay Logic System performs the decision logic for actuating a reactor trip, generates the electrical output signal that will initiate the required trip, and provides the status, permissive, and annunciator output signals to the main control room of the unit.

The bistable outputs from the signal processing equipment are sensed by the Relay Logic System equipment and combined into logic matrices that represent combinations indicative of various unit upset and accident transients. If a required logic matrix combination is completed, the system will initiate a reactor trip. Examples are given in the Applicable Safety Analyses, LCO, and Applicability sections of this Bases.

BASES

BACKGROUND
(continued)

Reactor Trip Switchgear

The RTBs are in the electrical power supply line from the control rod drive motor generator set power supply to the CRDMs. Opening of the RTBs interrupts power to the CRDMs, which allows the shutdown rods and control rods to fall into the core by gravity. Each RTB is equipped with a bypass breaker to allow testing of the RTB while the unit is at power. During normal operation the output from the relay logic system is a voltage signal that energizes the undervoltage coils in the RTBs and bypass breakers, if in use. When the required logic matrix combination is completed, the relay logic system output voltage signal is removed, the undervoltage coils are de-energized, the breaker trip lever is actuated by the de-energized undervoltage coil, and the RTBs and bypass breakers are tripped open. This allows the shutdown rods and control rods to fall into the core. In addition to the de-energization of the undervoltage coils, each RTB is also equipped with a shunt trip device that is energized to trip the breaker open upon receipt of a reactor trip signal from the relay logic system. Either the undervoltage coil or the shunt trip mechanism is sufficient by itself, thus providing a diverse trip mechanism.

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY

The RPS functions to maintain the SLs during all AOOs and mitigates the consequences of DBAs in all MODES in which the RTBs are closed.

Each of the analyzed accidents and transients can be detected by one or more RPS Functions. The accident analysis described in Reference 2 takes credit for most RPS trip Functions. RPS trip Functions not specifically credited in the accident analysis are qualitatively credited in the safety analysis and the NRC staff approved licensing basis for the unit. These RPS trip Functions may provide protection for conditions that do not require dynamic transient analysis to demonstrate Function performance. They may also serve as backups to RPS trip Functions that were credited in the accident analysis.

The LCO requires all instrumentation performing an RPS Function, listed in Table 3.3.1-1 in the accompanying LCO, to be OPERABLE. Failure of any instrument renders the affected channel(s) inoperable and reduces the reliability of the affected Functions.

The LCO generally requires OPERABILITY of four or three channels in each instrumentation Function, one channel of Manual Reactor Trip in each logic Function, and two trains in each Automatic Trip Logic Function. Four OPERABLE instrumentation channels in a two-out-of-

BASES

**APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)**

four configuration are generally required when one RPS channel is also used as a control system input. This configuration accounts for the possibility of the shared channel failing in such a manner that it creates a transient that requires RPS action. In this case, the RPS will still provide protection, even with random failure of one of the other three protection channels. Three OPERABLE instrumentation channels in a two-out-of-three configuration are generally required when there is no potential for control system and protection system interaction that could simultaneously create a need for RPS trip and disable one RPS channel. The two-out-of-three and two-out-of-four configurations allow one channel to be tripped during maintenance or testing without causing a reactor trip. Specific exceptions to the above general philosophy exist and are discussed below.

Reactor Protection System Functions

The safety analyses and OPERABILITY requirements applicable to each RPS Function are discussed below:

1. Manual Reactor Trip

The Manual Reactor Trip ensures that the control room operator can initiate a reactor trip at any time by using one of four reactor trip switches in the control room. A Manual Reactor Trip accomplishes the same results as any one of the automatic trip Functions. It is used by the reactor operator to shut down the reactor whenever any parameter is rapidly trending toward its Allowable Value.

The LCO requires two Manual Reactor Trip channels to be OPERABLE. Each channel consists of two reactor trip switches (one in each train). Each channel activates the reactor trip breaker in both trains. Two independent channels are required to be OPERABLE so that no single random failure will disable the Manual Reactor Trip Function.

In MODE 1 or 2, manual initiation of a reactor trip must be OPERABLE. These are the MODES in which the shutdown rods and/or control rods are partially or fully withdrawn from the core. In MODE 3, 4, or 5, the manual initiation Function must also be OPERABLE with the RTBs closed and the Rod Control System capable of rod withdrawal. In this condition, inadvertent control rod withdrawal is possible. In MODE 3, 4, or 5, manual initiation of a reactor trip does not have to be OPERABLE if the Rod Control System is not capable of withdrawing the shutdown rods or control rods. If the rods cannot be withdrawn from the core or all of the rods are inserted, there is no need to be able to trip the reactor. In MODE 6, neither the

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

shutdown rods nor the control rods are permitted to be withdrawn and the CRDMs are disconnected from the control rods and shutdown rods. Therefore, the manual initiation Function is not required.

2. Power Range Neutron Flux

The NIS power range detectors are located external to the reactor vessel and measure neutrons leaking from the core. The NIS power range detectors provide input to the Rod Control System. Therefore, the actuation logic must be able to withstand an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation. Note that this Function also provides a signal to prevent automatic and manual rod withdrawal prior to initiating a reactor trip. Limiting further rod withdrawal may terminate the transient and eliminate the need to trip the reactor.

a. Power Range Neutron Flux-High

The Power Range Neutron Flux-High trip Function ensures that protection is provided, from all power levels, against a positive reactivity excursion leading to DNB during power operations. These can be caused by rod withdrawal or reductions in RCS temperature.

The LCO requires all four of the Power Range Neutron Flux-High channels to be OPERABLE.

In MODE 1 or 2, the Power Range Neutron Flux-High trip must be OPERABLE. This Function will terminate the reactivity excursion and shut down the reactor prior to reaching a power level that could damage the fuel. In MODE 3, 4, 5, or 6, the NIS power range detectors cannot detect neutron levels in this range. In these MODES, the Power Range Neutron Flux - High does not have to be OPERABLE because the reactor is shut down and reactivity excursions into the power range are extremely unlikely. Other RTS Functions and administrative controls provide protection against reactivity additions when in MODE 3, 4, 5, or 6.

b. Power Range Neutron Flux-Low

The LCO requirement for the Power Range Neutron Flux-Low trip Function ensures that protection is provided against a

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

positive reactivity excursion from low power or subcritical conditions.

The LCO requires all four of the Power Range Neutron Flux-Low channels to be OPERABLE.

In MODE 1, below the Power Range Neutron Flux (P-10 setpoint), and in MODE 2, the Power Range Neutron Flux-Low trip must be OPERABLE. This Function may be manually blocked by the operator when two out of four power range channels are greater than approximately 10% RTP (P-10 setpoint). This Function is automatically unblocked when three out of four power range channels are below the P-10 setpoint. Above the P-10 setpoint, positive reactivity additions are mitigated by the Power Range Neutron Flux-High trip Function.

In MODE 3, 4, 5, or 6, the Power Range Neutron Flux - Low trip Function does not have to be OPERABLE because the reactor is shut down and the NIS power range detectors cannot detect neutron levels in this range. Other RPS trip Functions and administrative controls provide protection against positive reactivity additions or power excursions in MODE 3, 4, 5, or 6.

3. Intermediate Range Neutron Flux

The Intermediate Range Neutron Flux trip Function ensures that protection is provided against an uncontrolled RCCA bank rod withdrawal accident from a subcritical condition during startup. This trip Function provides redundant protection to the Power Range Neutron Flux-Low Setpoint trip Function. The NIS intermediate range detectors are located external to the reactor vessel and measure neutrons leaking from the core. The NIS intermediate range detectors do not provide any input to control systems.

The LCO requires two channels of Intermediate Range Neutron Flux to be OPERABLE. Two OPERABLE channels are sufficient to ensure no single random failure will disable this trip Function.

Because this trip Function is important only during startup, there is generally no need to disable channels for testing while the Function is required to be OPERABLE. Therefore, a third channel is unnecessary.

In MODE 1 below the P-10 setpoint, and in MODE 2, when there is a potential for an uncontrolled RCCA bank rod withdrawal accident during reactor startup, the Intermediate Range Neutron Flux trip

BASES

**APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)**

must be OPERABLE. Above the P-10 setpoint, the Power Range Neutron Flux-High Setpoint trip provides core protection for a rod withdrawal accident. In MODE 3, 4, or 5, Intermediate Range Neutron Flux trip does not have to be OPERABLE because the control rods must be fully inserted and only the shutdown rods may be withdrawn. The reactor cannot be started up in this condition. The core also has the required SDM to mitigate the consequences of a positive reactivity addition accident. In MODE 6, all rods are fully inserted and the core has a required increased SDM. Also, the NIS intermediate range detectors cannot detect neutron levels present in this MODE.

4. Source Range Neutron Flux

The LCO requirement for the Source Range Neutron Flux trip Function ensures that protection is provided against an uncontrolled RCCA bank rod withdrawal accident from a subcritical condition during startup.

This trip Function provides redundant protection to the Power Range Neutron Flux-Low trip Function. In MODES 3, 4, and 5, administrative controls also prevent the uncontrolled withdrawal of rods. The NIS source range detectors are located external to the reactor vessel and measure neutrons leaking from the core. The NIS source range detectors do not provide any inputs to control systems. The source range trip is the only RPS automatic protection function required in MODES 3, 4, and 5. Therefore, the functional capability at the specified Trip Setpoint is assumed to be available.

The LCO requires two channels of Source Range Neutron Flux to be OPERABLE. Two operable channels are sufficient to ensure no single random failure will disable this trip function.

The Source Range Neutron Flux Function provides protection for control rod withdrawal from subcritical and control rod ejection events.

In MODE 2 when below the P-6 setpoint, and in MODES 3, 4 and 5 when there is a potential for an uncontrolled RCCA bank rod withdrawal accident, the Source Range Neutron Flux trip must be OPERABLE. Above the P-6 setpoint, the Intermediate Range Neutron Flux trip and the Power Range Neutron Flux-Low Setpoint trip will provide core protection for reactivity accidents. Above the P-6 setpoint, the NIS source range detectors are de-energized.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

In MODES 3, 4 and 5 with the Rod Control System not capable of rod withdrawal, and in MODE 6, this Function is not required to be OPERABLE. The requirements for the NIS source range detectors to monitor core neutron levels and provide indication of reactivity changes that may occur as a result of events like a boron dilution are addressed in LCO 3.9.2, "Nuclear Instrumentation," for MODE 6.

5. Overtemperature ΔT

The Overtemperature ΔT trip Function is provided to ensure that the design limit DNBR is met. This trip Function also limits the range over which the Overpower ΔT trip Function must provide protection. The inputs to the Overtemperature ΔT trip include all pressure, coolant temperature, axial power distribution, and reactor power as indicated by loop ΔT assuming full reactor coolant flow. Protection from violating the DNBR limit is assured for those transients that are slow with respect to delays from the core to the measurement system. The Function monitors both variation in power and flow since a decrease in flow has the same effect on ΔT as a power increase. The Overtemperature ΔT trip Function uses each loop's ΔT as a measure of reactor power and is compared with a setpoint that is automatically varied with the following parameters:

- reactor coolant average temperature—the Trip Setpoint is varied to correct for changes in coolant density and specific heat capacity with changes in coolant temperature;
- pressurizer pressure—the Trip Setpoint is varied to correct for changes in system pressure; and
- axial power distribution — $f(\Delta l)$, the Trip Setpoint is varied to account for imbalances in the axial power distribution as detected by the NIS upper and lower power range detectors. If axial peaks are greater than the design limit, as indicated by the difference between the upper and lower NIS power range detectors, the Trip Setpoint is reduced in accordance with Note 1 of Table 3.3.1-1.

The Overtemperature ΔT trip Function is calculated for each channel as described in Note 1 of Table 3.3.1-1. Reactor Trip occurs if Overtemperature ΔT is indicated in two channels. Because the pressure and temperature signals are used for other control functions, the actuation logic must be able to withstand an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation. Note that this Function

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

also provides a signal to generate a turbine runback prior to reaching the Trip Setpoint. A turbine runback will reduce turbine power and reactor power. A reduction in power will normally alleviate the Overtemperature ΔT condition and may prevent a reactor trip.

The LCO requires all four channels of the Overtemperature ΔT trip Function to be OPERABLE. Note that the Overtemperature ΔT Function receives input from channels shared with other RPS Functions. Failures that affect multiple Functions require entry into the Conditions applicable to all affected Functions.

In MODE 1 or 2, the Overtemperature ΔT trip must be OPERABLE to prevent DNB. In MODE 3, 4, 5, or 6, this trip Function does not have to be OPERABLE because the reactor is not operating and there is insufficient heat production to be concerned about DNB.

6. Overpower ΔT

The Overpower ΔT trip Function ensures that protection is provided to ensure the integrity of the fuel (i.e., no fuel pellet melting and less than 1% cladding strain) under all possible overpower conditions. This trip Function also limits the required range of the Overtemperature ΔT trip Function and provides a backup to the Power Range Neutron Flux-High Setpoint trip. The Overpower ΔT trip Function ensures that the allowable heat generation rate (kW/ft) of the fuel is not exceeded. It uses the ΔT of each loop as a measure of reactor power with a setpoint that is automatically varied with the following parameters:

- reactor coolant average temperature — the Trip Setpoint is varied to correct for changes in coolant density and specific heat capacity with changes in coolant temperature; and
- rate of change of reactor coolant average temperature.

The Overpower ΔT trip Function is calculated for each channel as per Note 2 of Table 3.3.1-1. Trip occurs if Overpower ΔT is indicated in two channels. The temperature signals are used for other control functions. The actuation logic must be able to withstand an input failure to the control system, which may then require the protection function actuation and a single failure in the remaining channels providing the protection function actuation. Note that this Function also provides a signal to generate a turbine runback prior to reaching the Allowable Value. A turbine runback will reduce turbine power and reactor power. A reduction in power

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

The LCO requires four channels of the Overpower ΔT trip Function to be OPERABLE. Note that the Overpower ΔT trip Function receives input from channels shared with other RPS Functions. Failures that affect multiple Functions require entry into the Conditions applicable to all affected Functions.

In MODE 1 or 2, the Overpower ΔT trip Function must be OPERABLE. These are the only times that enough heat is generated in the fuel to be concerned about the heat generation rates and overheating of the fuel. In MODE 3, 4, 5, or 6, this trip Function does not have to be OPERABLE because the reactor is not operating and there is insufficient heat production to be concerned about fuel overheating and fuel damage.

7. Pressurizer Pressure

The same sensors provide input to the Pressurizer Pressure-High and -Low trips and the Overtemperature ΔT trip. The Pressurizer Pressure channels are also used to provide input to the Pressurizer Pressure Control System. The actuation logic must be able to withstand an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation.

a. Pressurizer Pressure-Low

The Pressurizer Pressure-Low trip Function ensures that protection is provided against violating the DNBR limit due to low pressure.

The LCO requires four channels of Pressurizer Pressure-Low to be OPERABLE.

In MODE 1, when DNB is a major concern, the Pressurizer Pressure-Low trip must be OPERABLE. This trip Function is automatically enabled on increasing power by the P-7 interlock (NIS power range P-10 or turbine impulse pressure greater than approximately 10% of full power equivalent). On decreasing power, this trip Function is automatically blocked below P-7. Below the P-7 interlock, no conceivable power distributions can occur that would cause DNB concerns.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

b. Pressurizer Pressure-High

The Pressurizer Pressure-High trip Function ensures that protection is provided against overpressurizing the RCS. This trip Function operates in conjunction with the pressurizer relief and safety valves to prevent RCS overpressure conditions.

The LCO requires three channels of the Pressurizer Pressure-High to be OPERABLE.

For operation at 2250 psia, the Pressurizer Pressure-High LSSS is selected to be below the pressurizer safety valve actuation pressure and above the power operated relief valve (PORV) setting. This setting minimizes challenges to safety valves while avoiding unnecessary reactor trip for those pressure increases that can be controlled by the PORVs.

For operation at 2000 psia, a 50% load rejection with steam dump results in a peak pressure below the Pressurizer Pressure-High LSSS. Therefore, even though the PORV setting is above the reactor trip, the transient will not result in PORV actuation or a reactor trip on high Pressurizer Pressure.

In MODE 1 or 2, the Pressurizer Pressure-High trip must be OPERABLE to help prevent RCS overpressurization and minimize challenges to the relief and safety valves. In MODE 3, 4, 5, or 6, the Pressurizer Pressure-High trip Function does not have to be OPERABLE because transients that could cause an overpressure condition will be slow to occur. Therefore, the operator will have sufficient time to evaluate unit conditions and take corrective actions. Additionally, low temperature overpressure protection systems provide overpressure protection when below MODE 4.

8. Pressurizer Water Level—High

The Pressurizer Water Level-High trip Function provides a backup signal for the Pressurizer Pressure-High trip and also provides protection against water relief through the pressurizer safety valves. These valves are designed to pass steam in order to achieve their design energy removal rate. A reactor trip is actuated prior to the pressurizer becoming water solid. The LCO requires three channels of Pressurizer Water Level-High to be OPERABLE. The pressurizer level channels are used as input to the Pressurizer Level Control System. A fourth channel is not required to address control/protection interaction concerns. The level channels do not

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

actuate the safety valves, and the high pressure reactor trip is set below the safety valve setting. Therefore, with the slow rate of charging available, pressure overshoot due to level channel failure cannot cause the safety valve to lift before reactor high pressure trip.

In MODE 1, when there is a potential for overfilling the pressurizer, the Pressurizer Water Level-High trip must be OPERABLE. This trip Function is automatically enabled on increasing power by the P-7 interlock. On decreasing power, this trip Function is automatically blocked below P-7. Below the P-7 interlock, transients that could raise the pressurizer water level will be slow and the operator will have sufficient time to evaluate unit conditions and take corrective actions.

9. Reactor Coolant Flow-Low

a. Reactor Coolant Flow-Low (Single Loop)

The Reactor Coolant Flow—Low (Single Loop) trip Function ensures that protection is provided against violating the DNBR limit due to low flow in one or more RCS loops, while avoiding reactor trips due to normal variations in loop flow. Above the P-8 setpoint, which is approximately 50% RTP, a loss of flow in any RCS loop will actuate a reactor trip. Each RCS loop has three flow detectors to monitor flow. The flow signals are not used for any control system input.

The LCO requires three Reactor Coolant Flow-Low channels per loop to be OPERABLE in MODE 1 above P-8.

In MODE 1 above the P-8 setpoint, a loss of flow in one RCS loop could result in DNB conditions in the core. In MODE 1 below the P-8 setpoint, a loss of flow in two loops is required to actuate a reactor trip (Function 9.b) because of the lower power level and the greater margin to the design limit DNBR.

b. Reactor Coolant Flow-Low (Two Loops)

The Reactor Coolant Flow-Low (Two Loops) trip Function ensures that protection is provided against violating the DNBR limit due to low flow in two or more RCS loops while avoiding reactor trips due to normal variations in loop flow.

BASES

**APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)**

Above the P-7 interlock and below the P-8 setpoint, a loss of flow in two loops will initiate a reactor trip. Each loop has three flow detectors to monitor flow. The flow signals are not used for any control system input.

The LCO requires three Reactor Coolant Flow-Low channels per loop to be OPERABLE.

In MODE 1 above the P-7 interlock and below the P-8 setpoint, the Reactor Coolant Flow-Low (Two Loops) trip must be OPERABLE. Below the P-7 interlock, all reactor trips on low flow are automatically blocked since no conceivable power distributions could occur that would cause a DNB concern at this low power level. Above the P-7 interlock, the reactor trip on low flow in two RCS loops is automatically enabled. Above the P-8 setpoint, a loss of flow in any one loop will actuate a reactor trip because of the higher power level and the reduced margin to the design limit DNBR.

10. Reactor Coolant Pump (RCP) Breaker Position

Both RCP Breaker Position trip Functions operate together on two sets of auxiliary contacts, with one set on each RCP breaker. These Functions anticipate the Reactor Coolant Flow-Low trips to avoid RCS heatup that would occur before the low flow trip actuates.

a. Reactor Coolant Pump Breaker Position (Single Loop)

The RCP Breaker Position (Single Loop) trip Function ensures that protection is provided against violating the DNBR limit due to a loss of flow in one RCS loop. The position of each RCP breaker is monitored. If one RCP breaker is open above the P-8 setpoint, a reactor trip is initiated. This trip Function will generate a reactor trip before the Reactor Coolant Flow-Low (Single Loop) Trip Setpoint is reached.

The LCO requires one RCP Breaker Position channel per RCP to be OPERABLE. A channel consists of the RCP Breaker auxiliary contact and the associated RCP Loss of Power Trip Matrix Relay. One OPERABLE channel is sufficient for this trip Function because the RCS Flow-Low trip alone provides sufficient protection of unit SLs for loss of flow events. The RCP Breaker Position trip serves only to anticipate the low flow trip, minimizing the thermal transient associated with loss of a pump.

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

This Function measures only the discrete position (open or closed) of the RCP breaker, using a position switch. Therefore, the Function has no adjustable trip setpoint with which to associate an LSSS.

In MODE 1 above the P-8 setpoint, when a loss of flow in any RCS loop could result in DNB conditions in the core, the RCP Breaker Position (Single Loop) trip must be OPERABLE. In MODE 1 below the P-8 setpoint, a loss of flow in two loops is required to actuate a reactor trip because of the lower power level and the greater margin to the design limit DNBR.

b. Reactor Coolant Pump Breaker Position (Two Loops)

The RCP Breaker Position (Two Loops) trip Function ensures that protection is provided against violating the DNBR limit due to a loss of flow in two RCS loops. The position of each RCP breaker is monitored. Above the P-7 interlock and below the P-8 setpoint, a loss of flow in two loops will initiate a reactor trip. This trip Function will generate a reactor trip before the Reactor Coolant Flow—Low (Two Loops) Trip Setpoint is reached.

The LCO requires one RCP Breaker Position channel per RCP to be OPERABLE. A channel consists of the RCP Breaker auxiliary contact and the associated RCP Loss of Power Trip Matrix Relay. One OPERABLE channel is sufficient for this Function because the RCS Flow—Low trip alone provides sufficient protection of unit SLs for loss of flow events. The RCP Breaker Position trip serves only to anticipate the low flow trip, minimizing the thermal transient associated with loss of an RCP.

This Function measures only the discrete position (open or closed) of the RCP breaker, using a position switch. Therefore, the Function has no adjustable trip setpoint with which to associate an LSSS.

In MODE 1 above the P-7 interlock and below the P-8 setpoint, the RCP Breaker Position (Two Loops) trip must be OPERABLE. Below the P-7 interlock, all reactor trips on loss of flow are automatically blocked since no conceivable power distributions could occur that would cause a DNB concern at this low power level. Above the P-7 interlock, the reactor trip on loss of flow in two RCS loops is automatically enabled. Above the P-8 setpoint, a loss of flow in any one loop will actuate a reactor trip because of the higher power level and the reduced margin to the design limit DNBR.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

11. Undervoltage Bus A01 and A02

The Undervoltage Bus A01 and A02 reactor trip Function ensures that protection is provided against violating the DNBR limit due to a loss of flow in both RCS loops. The voltage to Bus A01 and A02 is monitored. Above the P-7 interlock, a loss of voltage detected on both buses will initiate a reactor trip. This trip Function will generate a reactor trip before the Reactor Coolant Flow—Low (Two Loops) Trip Setpoint is reached. Time delays are incorporated into the Undervoltage Bus A01 and A02 channels to prevent reactor trips due to momentary electrical power transients.

The LCO requires two Undervoltage channels per bus to be OPERABLE. An Undervoltage channel consists of the A01/A02 Bus Undervoltage Relay and the associated Bus Undervoltage Matrix Relay.

In MODE 1 above the P-7 interlock, the Undervoltage Bus A01 and A02 trip must be OPERABLE. Below the P-7 interlock, all reactor trips on loss of flow are automatically blocked since no conceivable power distributions could occur that would cause a DNB concern at this low power level. Above the P-7 interlock, the reactor trip on loss of flow in both RCS loops is automatically enabled.

12. Underfrequency Bus A01 and A02

The Underfrequency Bus A01 and A02 RCP breaker trip Function ensures that protection is provided against violating the DNBR limit due to a loss of flow in two RCS loops from a major network frequency disturbance. An underfrequency condition will slow down the pumps, thereby reducing their coastdown time following a pump trip. The proper coastdown time is required so that reactor heat can be removed immediately after reactor trip. The frequency of each RCP bus is monitored. Above the P-7 interlock, a loss of frequency detected on two RCP buses will trip both RCP breakers. Tripping both RCP breakers will generate a reactor trip before the Reactor Coolant Flow—Low (Two Loops) Trip Setpoint is reached. Time delays are incorporated into the Underfrequency Bus A01 and A02 channels to prevent reactor trips due to momentary electrical power transients.

The LCO requires two Underfrequency Bus A01 channels and two Underfrequency Bus A02 channels to be OPERABLE.

In MODE 1 above the P-7 interlock, the Underfrequency Bus A01 and A02 RCP breaker trip must be OPERABLE. Below the P-7

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

interlock, this trip and all reactor trips on loss of flow are automatically blocked, because no conceivable power distributions could occur that would cause a DNB concern at this low power level. Above the P-7 interlock, the Underfrequency Bus A01 and A02 RCP breaker trip is automatically enabled.

13. Steam Generator Water Level—Low Low

The SG Water Level—Low Low trip Function ensures that protection is provided against a loss of heat sink and actuates the AFW System prior to uncovering the SG tubes. The SGs are the heat sink for the reactor. In order to act as a heat sink, the SGs must contain a minimum amount of water. A narrow range low low level in any SG is indicative of a loss of heat sink for the reactor. The level transmitters provide input to the SG Level Control System. Therefore, the actuation logic must be able to withstand an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation. This Function also performs the ESFAS function of starting the AFW pumps on low low SG level.

The LCO requires three channels of SG Water Level—Low Low per SG to be OPERABLE.

In MODE 1 or 2, when the reactor requires a heat sink, the SG Water Level—Low Low trip must be OPERABLE. The normal source of water for the SGs is the Main Feedwater (MFW) System (not safety related). The MFW System is only in operation in MODE 1 or 2. The AFW System is the safety related backup source of water to ensure that the SGs remain the heat sink for the reactor. During normal startups and shutdowns, the AFW System provides feedwater to maintain SG level. In MODE 3, 4, 5, or 6, the SG Water Level—Low Low Function does not have to be OPERABLE because the MFW System is not in operation and the reactor is not operating or even critical. Decay heat removal is accomplished by the AFW System in MODE 3 and by the Residual Heat Removal (RHR) System in MODE 4, 5, or 6.

14. Steam Generator Water Level—Low, Coincident With Steam Flow/Feedwater Flow Mismatch

SG Water Level-Low, in conjunction with the Steam Flow/Feedwater Flow Mismatch, ensures that protection is provided against a loss of heat sink. In addition to a decreasing water level in the SG, the difference between feedwater flow and steam flow is evaluated to

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

determine if feedwater flow is significantly less than steam flow.

With less feedwater flow than steam flow, SG level will decrease at a rate dependent upon the magnitude of the difference in flow rates. There are two SG level channels and two Steam Flow/Feedwater Flow Mismatch channels per SG. One narrow range level channel sensing a low level coincident with one Steam Flow/ Feedwater Flow Mismatch channel sensing flow mismatch (steam flow greater than feed flow) will actuate a reactor trip.

Table 3.3.1-1 identifies the Technical Specification Allowable Value for this trip function as not applicable (NA), because LCO 3.3.1, Function 13, Steam Generator Water Level-Low Low, is used to bound the analysis for a loss of feedwater event. The nominal setting required for the Steam Generator Water Level-Low trip function is 30% of span. This nominal setting was developed outside of the setpoint methodology and has been provided by the NSSS supplier.

The LCO requires two channels of SG Water Level-Low coincident with Steam Flow/Feedwater Flow Mismatch per SG.

In MODE 1 or 2, when the reactor requires a heat sink, the SG Water Level-Low coincident with Steam Flow/Feedwater Flow Mismatch trip must be OPERABLE. The normal source of water for the SGs is the MFW System (not safety related). The MFW System is only in operation in MODE 1 or 2. The AFW System is the safety related backup source of water to ensure that the SGs remain the heat sink for the reactor. During normal startups and shutdowns, the AFW System provides feedwater to maintain SG level. In MODE 3, 4, 5, or 6, the SG Water Level-Low coincident with Steam Flow/Feedwater Flow Mismatch Function does not have to be OPERABLE because the MFW System is not in operation and the reactor is not operating or even critical. Decay heat removal is accomplished by the AFW System in MODE 3 and by the RHR System in MODE 4, 5, or 6. The MFW System is in operation only in MODE 1 or 2 and, therefore, this trip Function need only be OPERABLE in these MODES.

15. Turbine Trip

a. Turbine Trip-Low Autostop Oil Pressure

The Turbine Trip-Low Autostop Oil Pressure trip Function anticipates the loss of heat removal capabilities of the secondary system following a turbine trip. This trip Function acts to

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

minimize the pressure/temperature transient on the reactor. Any turbine trip from a power level below the P-9 setpoint (approximately 50% power, with at least one circulating water pump breaker closed, and condenser vacuum not high, will not actuate a reactor trip. Three pressure switches monitor the control oil pressure in the Turbine Electrohydraulic Control System. A low pressure condition sensed by two-out-of-three pressure switches will actuate a reactor trip. These pressure switches do not provide any input to the control system. The unit is designed to withstand a complete loss of load and not sustain core damage or challenge the RCS pressure limitations. Core protection is provided by the Pressurizer Pressure-High trip Function and RCS integrity is ensured by the pressurizer safety valves.

Table 3.3.1-1 identifies the Technical Specification Allowable Value for this trip function as not applicable (NA). No Analytical Value is assumed in the accident analysis for this function. The nominal setting required for the Turbine Trip – Low Autostop Oil Pressure trip function is 45 psig. This nominal setting was developed outside of the setpoint methodology and has been provided by the NSSS supplier.

The LCO requires three channels of Turbine Trip-Low Autostop Oil Pressure to be OPERABLE in MODE 1 above P-9.

Below the P-9 setpoint, a turbine trip does not actuate a reactor trip. In MODE 2, 3, 4, 5, or 6, there is no potential for a turbine trip, and the Turbine Trip-Low Autostop Oil Pressure trip Function does not need to be OPERABLE.

b. Turbine Trip-Turbine Stop Valve Closure

The Turbine Trip-Turbine Stop Valve Closure trip Function anticipates the loss of heat removal capabilities of the secondary system following a turbine trip. Any turbine trip with from a power level below the P-9 setpoint, approximately 50% power, with at least one circulating water pump breaker closed, and condenser vacuum not high, will not actuate a reactor trip. The trip Function anticipates the loss of secondary heat removal capability that occurs when the stop valves close. Tripping the reactor in anticipation of loss of secondary heat removal acts to minimize the pressure and temperature transient on the reactor. This trip Function will not and is not required to operate in the presence of a single channel failure. The unit is designed to withstand a complete loss of load and not sustain core damage

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

or challenge the RCS pressure limitations. Core protection is provided by the Pressurizer Pressure-High trip Function, and RCS integrity is ensured by the pressurizer safety valves. This trip Function is diverse to the Turbine Trip-Low Autostop Oil Pressure trip Function. Each turbine stop valve is equipped with one limit switch that inputs to the RPS. If both limit switches indicate that the stop valves are all closed, a reactor trip is initiated.

No analytical value is assumed in the accident analyses for this function. The LCO requires two Turbine Trip-Turbine Stop Valve Closure channels, one per valve, to be OPERABLE in MODE 1 above P-9. Both channels must trip to cause reactor trip.

Below the P-9 setpoint, a load rejection can be accommodated by the Steam Dump System. In MODE 2, 3, 4, 5, or 6, there is no potential for a load rejection, and the Turbine Trip-Stop Valve Closure trip Function does not need to be OPERABLE.

16. Safety Injection Input from Engineered Safety Feature Actuation System

The SI Input from ESFAS ensures that if a reactor trip has not already been generated by the RPS, the ESFAS automatic actuation logic will initiate a reactor trip upon any signal that initiates SI. This is a condition of acceptability for the LOCA. However, other transients and accidents take credit for varying levels of ESF performance and rely upon rod insertion, except for the most reactive rod that is assumed to be fully withdrawn, to ensure reactor shutdown. Therefore, a reactor trip is initiated every time an SI signal is present.

Allowable Values are not applicable to this Function. The SI Input is provided by relay in the ESFAS. Therefore, there is no measurement signal with which to associate an LSSS.

The LCO requires two trains of SI Input from ESFAS to be OPERABLE in MODE 1 or 2.

A reactor trip is initiated every time an SI signal is present. Therefore, this trip Function must be OPERABLE in MODE 1 or 2, when the reactor is critical, and must be shut down in the event of an accident. In MODE 3, 4, 5, or 6, the reactor is not critical, and this trip Function does not need to be OPERABLE.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

17. Reactor Protection System Interlocks

Reactor protection interlocks are provided to ensure reactor trips are in the correct configuration for the current unit status. They back up operator actions to ensure protection system Functions are not bypassed during unit conditions under which the safety analysis assumes the Functions are not bypassed. Therefore, the interlock Functions do not need to be OPERABLE when the associated reactor trip functions are outside the applicable MODES. These are:

a. Intermediate Range Neutron Flux, P-6

The Intermediate Range Neutron Flux, P-6 interlock is actuated when any NIS intermediate range channel goes approximately one decade above the minimum channel reading. If both channels drop below the setpoint, the permissive will automatically be defeated. The LCO requirement for the P-6 interlock ensures that the following Functions are performed:

- on increasing power, the P-6 interlock allows the manual block of the NIS Source Range, Neutron Flux reactor trip. This prevents a premature block of the source range trip and allows the operator to ensure that the intermediate range is OPERABLE prior to leaving the source range. When the source range trip is blocked, the high voltage to the detectors is also removed; and
- on decreasing power, the P-6 interlock automatically energizes the NIS source range detectors and enables the NIS Source Range Neutron Flux reactor trip.

The LCO requires two channels of Intermediate Range Neutron Flux, P-6 interlock to be OPERABLE in MODE 2 when below the P-6 interlock setpoint.

Above the P-6 interlock setpoint, the NIS Source Range Neutron Flux reactor trip will be blocked, and this Function will no longer be necessary.

b. Low Power Reactor Trips Block, P-7

The Low Power Reactor Trips Block, P-7 interlock is actuated by input from either Power Range Neutron Flux or Turbine Impulse Pressure. The LCO requirement for the P-7 interlock ensures that the following Functions are performed:

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

(1) on increasing power, the P-7 interlock automatically enables reactor trips on the following Functions:

- Pressurizer Pressure - Low;
- Pressurizer Water Level - High;
- Reactor Coolant Flow - Low (Two Loops);
- RCP Breaker Open (Two Loops);
- Undervoltage Bus A01 and A02; and
- Underfrequency Bus A01 and A02.

These reactor trips are only required when operating above the P-7 setpoint (approximately 10% power). The reactor trips provide protection against violating the DNBR limit. Below the P-7 setpoint, the RCS is capable of providing sufficient natural circulation without any RCP running.

(2) on decreasing power, the P-7 interlock automatically blocks reactor trips on the following Functions:

- Pressurizer Pressure - Low;
- Pressurizer Water Level - High;
- Reactor Coolant Flow - Low (Two Loops);
- RCP Breaker Position (Two Loops);
- Undervoltage Bus A01 and A02; and
- Underfrequency Bus A01 and A02.

The low power trips are blocked below the P-7 setpoint and unblocked above the P-7 setpoint. In MODE 2, 3, 4, 5 or 6, this Function does not have to be OPERABLE because the interlock performs its Function when power level drops below 10% power, which is in MODE 1.

Power Range Neutron Flux

Power Range Neutron Flux is actuated by two-out-of-four NIS power range channels. The LCO requirement for this Function ensures that this input to the P-7 interlock is available.

The LCO requires four channels of Power Range Neutron Flux to be OPERABLE in MODE 1.

OPERABILITY in MODE 1 ensures the Function is available to perform its increasing power Functions.

BASES**APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)****Turbine Impulse Pressure**

The Turbine Impulse Pressure interlock is actuated when the pressure in the first stage of the high pressure turbine is greater than approximately 10% of the rated full power pressure. This is determined by one-out-of-two pressure detectors. The LCO requirement for this Function ensures that one of the inputs to the P-7 interlock is available.

The LCO requires two channels of Turbine Impulse Pressure interlock to be OPERABLE in MODE 1.

The Turbine Impulse Chamber Pressure interlock must be OPERABLE when the turbine generator is operating. The interlock Function is not required OPERABLE in MODE 2, 3, 4, 5, or 6 because the turbine generator is not operating.

c. Power Range Neutron Flux, P-8

The Power Range Neutron Flux, P-8 interlock is actuated at approximately 50% power as determined by two-out-of-four NIS power range detectors.

The P-8 interlock automatically enables the Reactor Coolant Flow-Low (Single Loop) and RCP Breaker Position (Single Loop) reactor trips on increasing power. The LCO requirement for this trip Function ensures that protection is provided against a loss of flow in any RCS loop that could result in DNB conditions in the core when greater than approximately 50% power. On decreasing power, the reactor trip on low flow in any loop is automatically blocked.

The LCO requires four channels of Power Range Neutron Flux, P-8 interlock to be OPERABLE in MODE 1.

In MODE 1, a loss of flow in one RCS loop could result in DNB conditions, so the Power Range Neutron Flux, P-8 interlock must be OPERABLE. In MODE 2, 3, 4, 5, or 6, this Function does not have to be OPERABLE because the core is not producing sufficient power to be concerned about DNB conditions.

d. Power Range Neutron Flux, P-9

The Power Range Neutron Flux, P-9 interlock, is actuated at approximately 50% power, as determined by two-out-of-four NIS

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

power range detectors, if the Steam Dump System is available. The LCO requirement for this Function ensures that the Turbine Trip-Low Autostop Oil Pressure and Turbine Trip-Turbine Stop Valve Closure reactor trips are enabled above the P-9 setpoint. Above the P-9 setpoint, a turbine trip will cause a load rejection beyond the capacity of the Steam Dump System. A reactor trip is automatically initiated on a turbine trip when it is above the P-9 setpoint to minimize the transient on the reactor.

The LCO requires four channels of Power Range Neutron Flux, P-9 interlock, to be OPERABLE in MODE 1 with one of two circulating water pump breakers closed and condenser vacuum greater than or equal to 22 "Hg.

In MODE 1, a turbine trip could cause a load rejection beyond the capacity of the Steam Dump System, so the Power Range Neutron Flux interlock must be OPERABLE. In MODE 2, 3, 4, 5, or 6, this Function does not have to be OPERABLE because the reactor is not at a power level sufficient to have a load rejection beyond the capacity of the Steam Dump System.

e. Power Range Neutron Flux, P-10

The Power Range Neutron Flux, P-10 interlock is actuated at approximately 10% power, as determined by two-out-of-four NIS power range detectors. If power level falls below 10% RTP on 3 of 4 channels, the nuclear instrument trips will be automatically unblocked. The LCO requirement for the P-10 interlock ensures that the following Functions are performed:

- on increasing power, the P-10 interlock allows the operator to manually block the Intermediate Range Neutron Flux reactor trip;
- on increasing power, the P-10 interlock allows the operator to manually block the Power Range Neutron Flux-Low reactor trip;
- on increasing power, the P-10 interlock automatically provides a backup signal to block the Source Range Neutron Flux reactor trip, and also to de-energize the NIS source range detectors;
- on decreasing power, the P-10 interlock automatically enables the Power Range Neutron Flux-Low reactor trip and the Intermediate Range Neutron Flux reactor trip.

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

The LCO requires four channels of Power Range Neutron Flux, P-10 interlock to be OPERABLE in MODE 1 or 2.

OPERABILITY in MODE 1 ensures the Function is available to perform its decreasing power Functions in the event of a reactor shutdown. This Function must be OPERABLE in MODE 2 to ensure that core protection is provided during a startup or shutdown by the Power Range Neutron Flux-Low and Intermediate Range Neutron Flux reactor trips. In MODE 3, 4, 5, or 6, this Function does not have to be OPERABLE because the reactor is not at power and the Source Range Neutron Flux reactor trip provides core protection.

18. Reactor Trip Breakers

This trip Function applies to the RTBs exclusive of individual trip mechanisms. The LCO requires two OPERABLE RTBs. Two OPERABLE RTBs ensure no single random failure can disable the RPS trip capability. These trip Functions must be OPERABLE in MODE 1 or 2 when the reactor is critical. In MODE 3, 4, or 5, these RPS trip Functions must be OPERABLE when the RTBs are closed and the Rod Control System is capable of rod withdrawal.

19. Reactor Trip Breaker Undervoltage and Shunt Trip Mechanisms

The LCO requires both the Undervoltage and Shunt Trip Mechanisms to be OPERABLE for each RTB that is in service. The trip mechanisms are not required to be OPERABLE for trip breakers that are open, racked out, incapable of supplying power to the Rod Control System, or declared inoperable under Function 18 above. OPERABILITY of both trip mechanisms on each breaker ensures that no single trip mechanism failure will prevent opening any breaker on a valid signal.

These trip Functions must be OPERABLE in MODE 1 or 2 when the reactor is critical. In MODE 3, 4, or 5, these RPS trip Functions must be OPERABLE when the RTBs are closed and the Rod Control System is capable of rod withdrawal.

20. Reactor Trip Bypass Breaker and associated Undervoltage Trip Mechanism

The LCO requires the Reactor Trip Bypass Breaker and its associated Undervoltage Trip Mechanism to be OPERABLE when the Reactor Trip Bypass Breaker is racked in and closed. The bypass breaker and its associated trip mechanism are not required

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

to be OPERABLE when the bypass breaker is open or racked out.

These trip Functions must be OPERABLE in MODE 1 or 2 when a Reactor Trip Bypass Breaker is racked in and closed. In MODE 3, 4, or 5, this RPS trip Function must be OPERABLE when a Reactor Trip Bypass Breaker is racked in and closed and the Rod Control System is capable of rod withdrawal.

21. Automatic Trip Logic

The LCO requirement for the RTBs (Functions 18 and 19) and Automatic Trip Logic (Function 21) ensures that means are provided to interrupt the power to allow the rods to fall into the reactor core. Each RTB is equipped with an undervoltage coil and a shunt trip coil to trip the breaker open when needed. Each RTB is equipped with a bypass breaker to allow testing of the trip breaker while the unit is at power. The reactor trip signals generated by the RPS Automatic Trip Logic cause the RTBs and associated bypass breakers to open and shut down the reactor.

The LCO requires two trains of RPS Automatic Trip Logic to be OPERABLE. Having two OPERABLE channels ensures that random failure of a single logic channel will not prevent reactor trip. These trip Functions must be OPERABLE in MODE 1 or 2 when the reactor is critical. In MODE 3, 4, or 5, these RPS trip Functions must be OPERABLE when the RTBs are closed and the Rod Control System is capable of rod withdrawal.

The RPS instrumentation satisfies Criterion 3 of the NRC Policy Statement.

ACTIONS

A Note has been added to the ACTIONS to clarify the application of Completion Time rules. The Conditions of this Specification may be entered independently for each Function listed in Table 3.3.1-1.

In the event a channel's Trip Setpoint is found nonconservative with respect to the Allowable Value, or the transmitter, instrument loop, signal processing electronics, or bistable is found inoperable, then all affected Functions provided by that channel must be declared inoperable and the LCO Condition(s) entered for the protection Function(s) affected.

When the number of inoperable channels in a trip Function exceed those specified in one or other related Conditions associated with a trip Function, then the unit is outside the safety analysis. Therefore,

BASES

ACTIONS (continued) LCO 3.0.3 must be immediately entered if applicable in the current MODE of operation.

A.1

Condition A applies to all RPS protection Functions. Condition A addresses the situation where one or more required channels or trains for one or more Functions are inoperable at the same time. The Required Action is to refer to Table 3.3.1-1 and to take the Required Actions for the protection functions affected. The Completion Times are those from the referenced Conditions and Required Actions.

B.1 and B.2

Condition B applies to the Manual Reactor Trip in MODE 1 or 2. With one channel inoperable, the inoperable channel must be restored to OPERABLE status within 48 hours. In this condition, the remaining OPERABLE channel is adequate to perform the safety function.

The Completion Time of 48 hours is reasonable considering that there are two automatic actuation trains and another manual initiation channel OPERABLE, and the low probability of an event occurring during this interval.

If the Manual Reactor Trip Function cannot be restored to OPERABLE status within the allowed 48 hour Completion Time, the unit must be brought to a MODE in which the requirement does not apply. To achieve this status, the unit must be brought to at least MODE 3 within 6 additional hours. The 6 additional hours to reach MODE 3 is reasonable, based on operating experience, to reach MODE 3 from full power operation in an orderly manner and without challenging unit systems. With the unit in MODE 3, this trip Function is no longer required to be OPERABLE.

C.1 and C.2

Condition C applies to the Manual Reactor Trip Function in MODE 3, 4, or 5 with the RTBs closed and the Rod Control System capable of rod withdrawal.

- With one channel inoperable, the inoperable channel must be restored to OPERABLE status within 48 hours. If the Reactor Manual Trip channel cannot be restored to OPERABLE status within the allowed 48 hour Completion Time, the unit must be placed in a MODE in which the requirement does not apply. To achieve this status, the RTBs must be opened within the next hour.

BASES

ACTIONS (continued) The additional hour provides sufficient time to accomplish the action in an orderly manner. With the RTBs open, the Manual Reactor Trip Function is no longer required.

D.1 and D.2

Condition D applies to the following reactor trip Functions:

- Power Range Neutron Flux-High;
- Power Range Neutron Flux-Low;
- Overtemperature ΔT ;
- Overpower ΔT ;
- Pressurizer Pressure-High;
- SG Water Level-Low Low; and
- SG Water Level - Low coincident with Steam Flow/Feedwater Flow Mismatch.

A known inoperable channel must be placed in the tripped condition within 6 hours. Placing the channel in the tripped condition results in a partial trip condition requiring only one-out-of-two logic for actuation of the two-out-of-three trips and one-out-of-three logic for actuation of the two-out-of-four trips.

If the inoperable channel cannot be placed in the tripped condition within the specified Completion Time, the unit must be placed in a MODE where these Functions are not required OPERABLE. An additional 6 hours is allowed to place the unit in MODE 3. Six hours is a reasonable time, based on operating experience, to place the unit in MODE 3 from full power in an orderly manner and without challenging unit systems.

E.1 and E.2

Condition E applies to the Underfrequency Bus A01 and A02 trip function. With one channel inoperable, the inoperable channel must be placed in the tripped condition within 6 hours. Placing the channel in the tripped condition results in a partial trip condition requiring only one additional channel to initiate a reactor trip above the P-7 setpoint. The 6 hours to place the channel in the tripped condition is necessary due to plant design requiring maintenance personnel to effect the trip of the

BASES

ACTIONS (continued) channel outside of the Control Room. An additional 6 hours is allowed to reduce THERMAL POWER to below P-7 if the inoperable channel cannot be restored to OPERABLE status or placed in trip within the specified Completion Time.

Allowance of this time interval takes into consideration the redundant capability provided by the remaining redundant OPERABLE channel and the low probability of occurrence of an event during this period that may require the protection afforded by this trip function.

F.1 and F.2

Condition F applies to the Intermediate Range Neutron Flux trip when THERMAL POWER is above the P-6 setpoint and below the P-10 setpoint and one channel is inoperable. Above the P-6 setpoint and below the P-10 setpoint, the NIS intermediate range detector performs the monitoring Functions. If THERMAL POWER is greater than the P-6 setpoint but less than the P-10 setpoint, 24 hours is allowed to reduce THERMAL POWER below the P-6 setpoint or increase to THERMAL POWER above the P-10 setpoint. The NIS Intermediate Range Neutron Flux channels must be OPERABLE when the power level is above the capability of the source range, P-6, and below the capability of the power range, P-10. If THERMAL POWER is greater than the P-10 setpoint, the NIS power range detectors perform the monitoring and protection functions and the intermediate range is not required. The Completion Times allow for a slow and controlled power adjustment above P-10 or below P-6 and take into account the redundant capability afforded by the redundant OPERABLE channel, and the low probability of its failure during this period. This action does not require the inoperable channel to be tripped because the Function uses one-out-of-two logic. Tripping one channel would trip the reactor. Thus, the Required Actions specified in this Condition are only applicable when channel failure does not result in reactor trip.

G.1 and G.2

Condition G applies to two inoperable Intermediate Range Neutron Flux trip channels in MODE 2 when THERMAL POWER is above the P-6 setpoint and below the P-10 setpoint. Required Actions specified in this Condition are only applicable when channel failures do not result in reactor trip. Above the P-6 setpoint and below the P-10 setpoint, the NIS intermediate range detector performs the monitoring Functions. With no intermediate range channels OPERABLE, the Required Actions are to suspend operations involving positive reactivity additions immediately. This will preclude any power level increase since there are no OPERABLE Intermediate Range Neutron Flux channels. The

BASES

ACTIONS (continued) operator must also reduce THERMAL POWER below the P-6 setpoint within two hours. Below P-6, the Source Range Neutron Flux channels will be able to monitor the core power level. The Completion Time of 2 hours will allow a slow and controlled power reduction to less than the P-6 setpoint and takes into account the low probability of occurrence of an event during this period that may require the protection afforded by the NIS Intermediate Range Neutron Flux trip.

H.1

Condition H applies to one inoperable Source Range Neutron Flux trip channel when in MODE 2, below the P-6 setpoint, and performing a reactor startup. With the unit in this Condition, below P-6, the NIS source range performs the monitoring and protection functions. With one of the two channels inoperable, operations involving positive reactivity additions shall be suspended immediately.

This will preclude any power escalation. With only one source range channel OPERABLE, core protection is severely reduced and any actions that add positive reactivity to the core must be suspended immediately.

I.1

Condition I applies to two inoperable Source Range Neutron Flux trip channels when in MODE 2, below the P-6 setpoint and performing a reactor startup, or in MODE 3, 4, or 5 with the RTBs closed and the Rod Control System capable of rod withdrawal. With the unit in this Condition, below P-6, the NIS source range perform the monitoring and protection functions. With both source range channels inoperable, the RTBs must be opened immediately. With the RTBs open, the core is in a more stable condition.

J.1 and J.2

Condition J applies to one inoperable source range channel in MODE 3, 4, or 5 with the RTBs closed and the Rod Control System capable of rod withdrawal. With the unit in this Condition, below P-6, the NIS source range performs the monitoring and protection functions. With one of the source range channels inoperable, 48 hours is allowed to restore it to an OPERABLE status. If the channel cannot be returned to an OPERABLE status, 1 additional hour is allowed to open the RTBs. Once the RTBs are open, the core is in a more stable condition.

BASES

ACTIONS (continued) K.1 and K.2

Condition K applies to the following reactor trip Functions:

- Pressurizer Pressure-Low;
- Pressurizer Water Level-High;
- Reactor Coolant Flow-Low (Two Loops);
- Undervoltage Bus A01 and A02.

With one channel inoperable, the inoperable channel must be placed in the tripped condition within 1 hour. Placing the channel in the tripped condition results in a partial trip condition requiring only one additional channel to initiate a reactor trip above the P-7 interlock and below the P-8 setpoint. These Functions do not have to be OPERABLE below the P-7 interlock because there are no loss of flow trips below the P-7 interlock. An additional 6 hours is allowed to reduce THERMAL POWER to below P-7 if the inoperable channel cannot be restored to OPERABLE status or placed in trip within the specified Completion Time.

Allowance of this time interval takes into consideration the redundant capability provided by the remaining redundant OPERABLE channel, and the low probability of occurrence of an event during this period that may require the protection afforded by the Functions associated with Condition K.

L.1 and L.2

Condition L applies to the Reactor Coolant Flow-Low (Single Loop) reactor trip Function. With one channel inoperable, the inoperable channel must be placed in the tripped condition within 1 hour. If the channel cannot be restored to OPERABLE status or the channel placed in trip within the 1 hour, then THERMAL POWER must be reduced below the P-8 setpoint within the next 4 hours. This places the unit in a MODE where the LCO is no longer applicable. This trip Function does not have to be OPERABLE below the P-8 setpoint because other RPS trip Functions provide core protection below the P-8 setpoint.

M.1 and M.2

Condition M applies to the RCP Breaker Position (Single Loop) reactor trip Function. There is one breaker position device per RCP breaker. With one channel inoperable, the inoperable channel(s) must be

BASES

ACTIONS (continued) restored to OPERABLE status within 1 hour. If the channel cannot be restored to OPERABLE status within the 1 hour, then THERMAL POWER must be reduced below the P-8 setpoint within the next 4 hours.

This places the unit in a MODE where the LCO is no longer applicable. This Function does not have to be OPERABLE below the P-8 setpoint because other RPS Functions provide core protection below the P-8 setpoint.

N.1 and N.2

Condition N applies to the RCP Breaker Position (Two Loop) reactor trip Function. With one channel inoperable, the inoperable channel must be restored to OPERABLE status within 1 hour. If the channel cannot be restored to OPERABLE status in 1 hour, then THERMAL POWER must be reduced below the P-7 interlock within the next 6 hours. This places the unit in a MODE where the LCO is no longer applicable. This function does not have to be OPERABLE below the P-7 interlock because there are no loss of flow trips below the P-7 interlock. The Completion Time of 6 hours is reasonable, based on operating experience, to reduce THERMAL POWER to below the P-7 interlock from full power in an orderly manner without challenging unit systems.

O.1 and O.2

Condition O applies to Turbine Trip on Low Autostop Oil Pressure or on Turbine Stop Valve Closure. With one channel inoperable, the inoperable channel must be placed in the trip condition within 1 hour. If placed in the tripped condition, this results in a partial trip condition requiring only one additional channel to initiate a reactor trip. If the channel cannot be restored to OPERABLE status or placed in the trip condition, then power must be reduced below the P-9 setpoint within the next 4 hours.

P.1 and P.2

Condition P applies to the SI Input from ESFAS reactor trip and the RPS Automatic Trip Logic in MODES 1 and 2. These actions address the train orientation of the RPS for these Functions. With one train inoperable, 6 hours are allowed to restore the train to OPERABLE status (Required Action P.1) or the unit must be placed in MODE 3 within the next 6 hours. The Completion Time of 6 hours (Required Action P.1) is reasonable considering that in this Condition, the remaining OPERABLE train is adequate to perform the safety function

BASES

ACTIONS (continued) and given the low probability of an event during this interval. The Completion Time of 6 hours (Required Action P.2) is reasonable, based on operating experience, to reach MODE 3 from full power in an orderly manner and without challenging unit systems.

The Required Actions have been modified by a Note that allows bypassing one train for up to 8 hours for surveillance testing, provided the other train is OPERABLE.

Q.1 and Q.2

Condition Q applies to the RTBs in MODES 1 and 2. With one RTB inoperable, 1 hour is allowed to restore the RTB to OPERABLE status or the unit must be placed in MODE 3 within the next 6 hours. The Completion Time of 6 hours is reasonable, based on operating experience, to reach MODE 3 from full power in an orderly manner and without challenging unit systems. The 1 hour and 6 hour Completion Times are equal to the time allowed by LCO 3.0.3 for shutdown actions in the event of a complete loss of RPS Function. Placing the unit in MODE 3 removes the requirement for this particular Function.

The Required Actions have been modified by a Note allowing one channel to be bypassed for up to 8 hours provided the other channel is OPERABLE.

R.1 and R.2

Condition R applies to the P-6 interlock (in MODE 2) and the P-10 interlock. With one or more channels inoperable for one-out-of-two or two-out-of-four coincidence logic, the associated interlock must be verified to be in its required state for the existing unit condition within 1 hour or the unit must be placed in MODE 3 within the next 6 hours. Verifying the interlock status manually accomplishes the interlock's Function. The Completion Time of 1 hour is based on operating experience and the minimum amount of time allowed for manual operator actions. The Completion Time of 6 hours is reasonable, based on operating experience, to reach MODE 3 from full power in an orderly manner and without challenging unit systems. The 1 hour and 6 hour Completion Times are equal to the time allowed by LCO 3.0.3 for shutdown actions in the event of a complete loss of RPS Function.

S.1 and S.2

Condition S applies to the P-7, P-8, and P-9 interlocks. With one or more channels inoperable for one-out-of-two or two-out-of-four coincidence logic, the associated interlock must be verified to be in its

BASES

ACTIONS (continued) required state for the existing unit condition within 1 hour or the unit must be placed in MODE 2 within the next 6 hours. These actions are conservative for the case where power level is being raised. Verifying the interlock status manually accomplishes the interlock's Function. The Completion Time of 1 hour is based on operating experience and the minimum amount of time allowed for manual operator actions. The Completion Time of 6 hours is reasonable, based on operating experience, to reach MODE 2 from full power in an orderly manner and without challenging unit systems.

T.1 and T.2

Condition T applies to the RTBs and the RTB Undervoltage and Shunt Trip Mechanisms in MODES 3, 4, or 5 with the RTBs closed and the Rod Control System capable of rod withdrawal.

With one trip mechanism or RTB inoperable, the inoperable trip mechanism or RTB must be restored to OPERABLE status within 48 hours. The Completion Time is reasonable considering that the remaining OPERABLE trip mechanism or RTB is adequate to perform the safety function, and given the low probability of an event occurring during this interval.

If the RTB or trip mechanism cannot be restored to OPERABLE status within 48 hours, the unit must be placed in a MODE in which the requirement does not apply. This is accomplished by opening the RTBs within the next hour (49 hours total time). The Completion Time of 1 hour provides sufficient time to accomplish this action in an orderly manner and takes into account the low probability of an event occurring in this interval.

U.1 and U.2

Condition U applies to the RTB Undervoltage and Shunt Trip Mechanisms, or diverse trip features, in MODES 1 and 2. With one of the diverse trip features inoperable, it must be restored to an OPERABLE status within 48 hours or the unit must be placed in a MODE where the requirement does not apply. This is accomplished by placing the unit in MODE 3 within the next 6 hours (54 hours total time). The Completion Time of 6 hours is a reasonable time, based on operating experience, to reach MODE 3 from full power in an orderly manner and without challenging unit systems.

With the unit in MODE 3, Condition T would apply to any inoperable RTB trip mechanisms. The affected RTB shall not be bypassed while one of the diverse features is inoperable except for the time required to

BASES

ACTIONS (continued) perform maintenance to one of the diverse features. The allowable time for performing maintenance of the diverse features is 8 hours for the reasons stated under Condition Q.

The Completion Time of 48 hours is reasonable considering that in this Condition there is one remaining diverse feature for the affected RTB, and one OPERABLE RTB capable of performing the safety function and given the low probability of an event occurring during this interval.

V.1 and V.2

Condition V applies to the Reactor Trip Bypass Breaker (RTBB) and associated Undervoltage Trip Mechanism in MODE 1 or 2, when the RTBB is racked in and closed. With the required RTBB inoperable, 1 hour is allowed to restore the RTBB to OPERABLE status or the unit must be placed in MODE 3 within the next 6 hours. The Completion Time of 6 hours is reasonable, based on operating experience, to reach MODE 3 from full power in an orderly manner and without challenging unit systems. The 1 hour and 6 hour completion times are equal to the time allowed by LCO 3.0.3 for shutdown action in the event of a complete loss of RPS Function. Placing the unit in MODE 3 removes the requirement for this particular Function.

W.1 and W.2

Condition W applies to the Reactor Trip Bypass Breaker (RTBB) and associated Undervoltage Trip Mechanism in MODES 3, 4, or 5, when an RTBB is racked in and closed and the Rod Control System is capable of rod withdrawal. With the required RTBB inoperable, 48 hours is allowed to restore the RTBB to OPERABLE status or the unit must be placed in a MODE in which the requirement does not apply. To achieve this status, the RTBs and RTBBs must be opened within the next 1 hour (49 hours total time). The Completion Time of 1 hour provides sufficient time to accomplish the action in an orderly manner. With the RTBs and RTBBs open, this Function is no longer required.

X.1 and X.2

Condition X applies to the RPS Automatic Trip Logic in MODES 3, 4 or 5 with the RTBs closed and the Rod Control System capable of rod withdrawal. With one train inoperable, 48 hours are allowed to restore the train to an OPERABLE status. The Completion Time of 48 hours is reasonable considering that in this condition, the remaining OPERABLE train is adequate to perform the safety function, and given the low probability of an event occurring in this interval.

BASES

ACTIONS (continued) If the RPS Automatic Trip Logic cannot be restored to OPERABLE status within 48 hours, the unit must be placed in a MODE where this Function is not required to be OPERABLE. To achieve this status, the RTBs must be opened within the next 1 hour (49 hours total time). The additional hour provides sufficient time to accomplish the action in an orderly manner. With the RTBs open, the Automatic Trip Logic is no longer required.

SURVEILLANCE REQUIREMENTS The SRs for each RPS Function are identified by the SRs column of Table 3.3.1-1 for that Function.

A Note has been added to the SR Table stating that Table 3.3.1-1 determines which SRs apply to which RPS Functions.

Note that each channel of process protection supplies both trains of the RPS. When testing Channel I, Train A and Train B must be examined. Similarly, Train A and Train B must be examined when testing Channel II, Channel III, and Channel IV (if applicable). The CHANNEL CALIBRATION and COTs are performed in a manner that is consistent with the assumptions used in analytically calculating the required channel accuracies.

SR 3.3.1.1

Performance of the CHANNEL CHECK once every 12 hours ensures that gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the two instrument channels could be an indication of excessive instrument drift in one of the channels or of something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying that the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the unit staff based on a combination of the channel instrument uncertainties, including indication and readability. If a channel is outside the criteria, it may be an indication that the sensor or the signal processing equipment has drifted outside its limit.

The Frequency is based on operating experience that demonstrates channel failure is rare. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

operational use of the displays associated with the LCO required channels.

SR 3.3.1.2

SR 3.3.1.2 compares the calorimetric heat balance calculation to the NIS channel output every 24 hours. If the calorimetric exceeds the NIS channel output by > 2% RTP, the NIS is not declared inoperable, but must be adjusted. If the NIS channel output cannot be properly adjusted, the channel is declared inoperable.

Two Notes modify SR 3.3.1.2. The first Note indicates that the NIS channel output shall be adjusted consistent with the calorimetric results if the absolute difference between the NIS channel output and the calorimetric is > 2% RTP. The second Note clarifies that this Surveillance is required only if reactor power is $\geq 15\%$ RTP and that 12 hour is allowed for performing the first Surveillance after reaching 15% RTP. At lower power levels, calorimetric data are inaccurate. The Frequency of every 24 hours is adequate. It is based on unit operating experience, considering instrument reliability and operating history data for instrument drift. Together these factors demonstrate the change in the absolute difference between NIS and heat balance calculated powers rarely exceeds 2% in any 24 hour period.

In addition, control room operators periodically monitor redundant indications and alarms to detect deviations in channel outputs.

SR 3.3.1.3

SR 3.3.1.3 compares the incore system to the NIS channel output every 31 EFPD. SR 3.3.1.3 is performed by means of the moveable incore detection system. If the absolute difference is $\geq 3\%$, the NIS channel is still OPERABLE, but must be readjusted.

If the NIS channel cannot be properly readjusted, the channel is declared inoperable. This Surveillance is performed to verify the $f(\Delta I)$ input to the overtemperature ΔT Function.

Two Notes modify SR 3.3.1.3. Note 1 indicates that the excore NIS channel shall be adjusted if the absolute difference between the incore and excore AFD is $\geq 3\%$.

Note 2 clarifies that the Surveillance is required only if reactor power is $\geq 50\%$ RTP and that 24 hours is allowed for performing the first Surveillance after reaching 50% RTP.

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

The Frequency of every 31 EFPD is adequate. It is based on unit operating experience, considering instrument reliability and operating history data for instrument drift. Also, the slow changes in neutron flux during the fuel cycle can be detected during this interval.

SR 3.3.1.4

SR 3.3.1.4 is the performance of a TADOT every 31 days on a STAGGERED TEST BASIS. This test shall verify OPERABILITY by actuation of the end devices.

The RTB test shall include separate verification of the undervoltage and shunt trip mechanisms. The independent test for bypass breakers is included in SR 3.3.1.13. The bypass breaker test shall include an undervoltage trip. A Note has been added to SR 3.3.1.4 to indicate that this test must be performed on the bypass breaker prior to placing it in service.

The Frequency of every 31 days on a STAGGERED TEST BASIS is adequate. It is based on industry operating experience, considering instrument reliability and operating history data.

SR 3.3.1.5

SR 3.3.1.5 is the performance of an ACTUATION LOGIC TEST, every 31 days on a STAGGERED TEST BASIS. The train being tested is placed in the bypass condition, thus preventing inadvertent actuation. All possible logic combinations, with and without applicable permissives, are tested for each protection function. The Frequency of every 31 days on a STAGGERED TEST BASIS is adequate. It is based on industry operating experience, considering instrument reliability and operating history data.

SR 3.3.1.5 is modified by two Notes. Note 1 provides an 8 hour delay in the requirement to perform this Surveillance for the Source Range Neutron Flux trip function instrumentation when power is reduced to below P-6. This Note allows a normal shutdown to proceed without a delay for testing in MODE 2 and for a short time in MODE 3 until the RTBs are open and SR 3.3.1.5 is no longer required to be performed. If the unit is to be in MODE 2 below P-6 for > 8 hours, this Surveillance must be performed prior to 8 hours after reducing power below P-6.

Note 2 excludes the RCP Breaker Position (Two Loop), Reactor Coolant Flow-Low (Two Loop) and Underfrequency Bus A01 and A02 Trip Functions, and the P-6, P-7, P-8, P-9 and P-10 Interlocks. These functions/interlocks are tested at an 18 month frequency via SR 3.3.1.15.

BASES

SURVEILLANCE REQUIREMENTS (continued)

SR 3.3.1.6

SR 3.3.1.6 is a calibration of the excore channels to the incore channels. If the measurements do not agree, the excore channels are not declared inoperable but must be calibrated to agree with the incore detector measurements. If the excore channels cannot be adjusted, the channels are declared inoperable. This Surveillance is performed to verify the $f(\Delta I)$ input to the overtemperature ΔT Function.

A Note modifies SR 3.3.1.6. The Note states that this Surveillance is required only if reactor power is > 50% RTP and that 24 hours is allowed for performing the first surveillance after reaching 50% RTP.

The Frequency of 92 EFPD is adequate. It is based on industry operating experience, considering instrument reliability and operating history data for instrument drift.

SR 3.3.1.7

SR 3.3.1.7 is the performance of a COT every 92 days.

A COT is performed on each required channel to ensure the entire channel will perform the intended Function.

Setpoints must be within the Allowable Values specified in Table 3.3.1-1.

The difference between the current "as found" values and the previous test "as left" values must be consistent with the drift allowance used in the setpoint methodology. The setpoint shall be left set consistent with the assumptions of the current unit specific setpoint methodology.

The "as found" and "as left" values must also be recorded and verified to be within the required limits.

SR 3.3.1.7 is modified by a Note that provides a 4 hour delay in the requirement to perform this Surveillance for source range instrumentation when entering MODE 3 from MODE 2. This Note allows a normal shutdown to proceed without a delay for testing in MODE 2 and for a short time in MODE 3 until the RTBs are open and SR 3.3.1.7 is no longer required to be performed. If the unit is to be in MODE 3 with the RTBs closed for > 4 hours this Surveillance must be performed prior to 4 hours after entry into MODE 3.

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

SR 3.3.1.8

SR 3.3.1.8 is the performance of a COT as described in SR 3.3.1.7, except it is modified by a Note that this test shall include verification that the P-6 and P-10 interlocks are in their required state for the existing unit condition. The Frequency is modified by a Note that allows this surveillance to be satisfied if it has been performed within 92 days of the Frequencies prior to reactor startup and four hours after reducing power below P-10 and P-6. The Frequency of "prior to startup" ensures this surveillance is performed prior to critical operations and applies to the source, intermediate and power range low instrument channels.

The Frequency of "4 hours after reducing power below P-10" (applicable to intermediate and power range low channels) and "4 hours after reducing power below P-6" (applicable to source range channels) allows a normal shutdown to be completed and the unit removed from the MODE of Applicability for this surveillance without a delay to perform the testing required by this surveillance. The Frequency of every 92 days thereafter applies if the plant remains in the MODE of Applicability after the initial performances of prior to reactor startup and four hours after reducing power below P-10 or P-6. The MODE of Applicability for this surveillance is < P-10 for the power range low and intermediate range channels and < P-6 for the source range channels. Once the unit is in MODE 3, this surveillance is no longer required. If power is to be maintained < P-10 or < P-6 for more than 4 hours, then the testing required by this surveillance must be performed prior to the expiration of the 4 hour limit. Four hours is a reasonable time to complete the required testing or place the unit in a MODE where this surveillance is no longer required. This test ensures that the NIS source, intermediate, and power range low channels are OPERABLE prior to taking the reactor critical and after reducing power into the applicable MODE (< P-10 or < P-6) for periods > 4 hours.

SR 3.3.1.9

SR 3.3.1.9 is the performance of a TADOT and is performed every 31 days.

SR 3.3.1.10

A CHANNEL CALIBRATION is performed every 18 months, or approximately at every refueling. CHANNEL CALIBRATION is a complete check of the instrument loop, including the sensor. The test verifies that the channel responds to a measured parameter within the necessary range and accuracy.

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

CHANNEL CALIBRATIONS must be performed consistent with the assumptions of the unit specific setpoint methodology. The difference between the current "as found" values and the previous test "as left" values must be consistent with the drift allowance used in the setpoint methodology.

The Frequency of 18 months is based on the assumption of an 18 month calibration interval in the determination of the magnitude of equipment drift in the setpoint methodology.

SR 3.3.1.10 is modified by a Note stating that this test shall include verification that the time delays are adjusted to the prescribed values where applicable.

SR 3.3.1.11

SR 3.3.1.11 is the performance of a CHANNEL CALIBRATION, as described in SR 3.3.1.10, every 18 months. This SR is modified by a Note stating that neutron detectors are excluded from the CHANNEL CALIBRATION. The CHANNEL CALIBRATION for the power range neutron detectors consists of a normalization of the detectors based on a power calorimetric and flux map performed above 15% RTP. The CHANNEL CALIBRATION for the source range and intermediate range neutron detectors consists of obtaining the detector plateau or preamp discriminator curves, evaluating those curves, and comparing the curves to the manufacturer's data. This Surveillance is not required for the NIS power range detectors for entry into MODE 2 or 1, and is not required for the NIS intermediate range detectors for entry into MODE 2, because the unit must be in at least MODE 2 to perform the test for the intermediate range detectors and MODE 1 for the power range detectors. The 18 month Frequency is based on the need to perform this Surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the Surveillance were performed with the reactor at power. Operating experience has shown these components usually pass the Surveillance when performed on the 18 month Frequency.

SR 3.3.1.12

SR 3.3.1.12 is the performance of a COT of RPS interlocks every 18 months.

The Frequency is based on the known reliability of the interlocks and the multichannel redundancy available, and has been shown to be acceptable through operating experience.

BASES

SURVEILLANCE REQUIREMENTS (continued)

SR 3.3.1.13

SR 3.3.1.13 is the performance of a TADOT of the Manual Reactor Trip, RCP Breaker Position, SI Input from ESFAS, and the Condenser Pressure-High and Circulating Water Pump Breaker Position inputs to the P-9 Interlock. This TADOT is performed every 18 months. The test shall independently verify the OPERABILITY of the undervoltage and shunt trip circuits for the Manual Reactor Trip Function for the Reactor Trip Breakers and the undervoltage trip circuits for the Reactor Trip Bypass Breakers.

The Frequency is based on the known reliability of the Functions and the multichannel redundancy available, and has been shown to be acceptable through operating experience.

SR 3.3.1.14

SR 3.3.1.14 is the performance of a TADOT of Turbine Trip Functions. This TADOT is as described in SR 3.3.1.4, except that this test is performed prior to exceeding the P-9 interlock whenever the unit has been in MODE 3. This Surveillance is not required if it has been performed within the previous 31 days. Performance of this test will ensure that the turbine trip Function is OPERABLE prior to exceeding the P-9 interlock.

SR 3.3.1.15

SR 3.3.1.15 is the performance of an ACTUATION LOGIC TEST on the RCP Breaker Position (Two Loop), Reactor Coolant Flow-Low (Two Loop) and Underfrequency Bus A01 and A02 Trip Functions, and P-6, P-7, P-8, P-9 and P-10 Interlocks every 18 months.

The 18 month frequency is based on the need to perform this surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the surveillance were performed with the reactor at power.

REFERENCES

1. FSAR, Chapter 7.
2. FSAR, Chapter 14.
3. IEEE-279-1968.
4. 10 CFR 50.49.
5. DG-I01, Instrument Setpoint Methodology.

B 3.3 INSTRUMENTATION

B 3.3.2 Engineered Safety Feature Actuation System (ESFAS) Instrumentation

BASES

BACKGROUND

The ESFAS initiates necessary safety systems, based on the values of selected unit parameters, to protect against violating core design limits and the Reactor Coolant System (RCS) pressure boundary, and to mitigate accidents.

The ESFAS instrumentation is segmented into three distinct but interconnected modules as identified below:

- Field transmitters or process sensors and instrumentation: provide a measurable electronic signal based on the physical characteristics of the parameter being measured;
- Signal processing equipment including analog protection system, field contacts, and protection channel sets: provide signal conditioning, compatible electrical signal output to protection system devices, and control board/control room/miscellaneous indications; and
- Relay Logic Racks including input, logic and output devices: initiates proper Engineered Safety Feature (ESF) actuation in accordance with the defined logic and based on the bistable outputs from the signal process control and protection system.

Field Transmitters or Sensors

To meet the design demands for redundancy and reliability, more than one, and often as many as four, field transmitters or sensors are used to measure unit parameters. In many cases, field transmitters or sensors that input to the ESFAS are shared with the Reactor Protection System (RPS). In some cases, the same channels also provide control system inputs. To account for calibration tolerances and instrument drift, which are assumed to occur between calibrations, statistical allowances are provided in the Allowable Values. The OPERABILITY of each transmitter or sensor can be evaluated when its "as found" calibration data are compared against its documented acceptance criteria.

BASES**BACKGROUND
(continued)****Signal Processing Equipment**

Generally, three or four channels of process control equipment are used for the signal processing of unit parameters measured by the field instruments. The process control equipment provides signal conditioning, comparable output signals for instruments located on the main control board, and comparison of measured input signals with setpoints established by safety analyses. If the measured value of a unit parameter exceeds the predetermined setpoint, an output from a bistable is forwarded to the logic relays.

Generally, if a parameter is used only for input to the protection circuits, three channels with a two-out-of-three logic are sufficient to provide the required reliability and redundancy. If one channel fails in a direction that would not result in a partial Function trip, the Function is still OPERABLE with a two-out-of-two logic. If one channel fails such that a partial Function trip occurs, a trip will not occur and the Function is still OPERABLE with a one-out-of-two logic.

Generally, if a parameter is used for input to the Relay Logic Racks and a control function, four channels with a two-out-of-four logic are sufficient to provide the required reliability and redundancy. The circuit must be able to withstand both an input failure to the control system, which may then require the protection function actuation, and a single failure in the other channels providing the protection function actuation. Again, a single failure will neither cause nor prevent the protection function actuation.

These requirements are described in IEEE-279-1968 (Ref. 2).

Allowable Values

To allow for calibration tolerances, instrumentation uncertainties and instrument drift, the Allowable Values specified in Table 3.3.2-1 in the accompanying LCO are conservatively adjusted with respect to the analytical limits. A detailed description of the methodology used to calculate the Allowable Values, including their explicit uncertainties, is provided in DGI-01, Instrument Setpoint Methodology (Ref. 4). The actual nominal Trip Setpoint entered into the bistable is more conservative than that specified by the Allowable Value to account for changes in random measurement errors detectable by a COT. If the measured setpoint does not exceed the Allowable Value, the bistable is considered OPERABLE.

Setpoints in accordance with the Allowable Value ensure that the consequences of Design Basis Accidents (DBAs) will be acceptable,

BASES

BACKGROUND (continued)

providing the unit is operated from within the LCOs at the onset of the DBA and the equipment functions as designed.

Each channel can be tested on line to verify that the signal processing equipment and setpoint accuracy is within the specified allowance requirements. Once a designated channel is taken out of service for testing, a simulated signal is injected in place of the field instrument signal. The process equipment for the channel in test is then tested, verified, and calibrated. SRs for the channels are specified in the SR section.

The Allowable Values listed in Table 3.3.2-1 are based on the methodology described in Reference 4, which incorporates all of the known uncertainties applicable for each channel. The magnitudes of these uncertainties are factored into the determination of each Allowable Value. All field sensors and signal processing equipment for these channels are assumed to operate within the allowances of these uncertainty magnitudes.

Relay Logic Racks

The Relay Logic Rack equipment is used for the decision logic processing of outputs from the signal processing equipment bistables. To meet the redundancy requirements, two trains of Relay Logic Racks, each performing the same functions, are provided.

The Relay Logic Racks perform the decision logic for most ESF equipment actuation; generates the electrical output signals that initiate the required actuation; and provides the status, permissive, and annunciator output signals to the main control room of the unit.

The bistable outputs from the signal processing equipment are sensed by the Relay Logic Rack equipment and combined into logic matrices that represent combinations indicative of various transients. If a required logic matrix combination is completed, the system will send actuation signals via master and slave relays to those components whose aggregate Function best serves to alleviate the condition and restore the unit to a safe condition. Examples are given in the Applicable Safety Analyses, LCO, and Applicability sections of this Bases.

The actuation of ESF components is accomplished through master and slave relays. The Relay Logic Racks energize the master relays appropriate for the condition of the unit. Each master relay then energizes one or more slave relays, which then cause actuation of the end devices.

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY Each of the analyzed accidents can be detected by one or more ESFAS Functions. One of the ESFAS Functions is the primary actuation signal for that accident. An ESFAS Function may be the primary actuation signal for more than one type of accident. An ESFAS Function may also be a secondary, or backup, actuation signal for one or more other accidents. For example, Pressurizer Pressure-Low is a primary actuation signal for small loss of coolant accidents (LOCAs) and a backup actuation signal for steam line breaks (SLBs) outside containment. Functions such as manual initiation, not specifically credited in the accident safety analysis, are qualitatively credited in the safety analysis and the NRC staff approved licensing basis for the unit. These Functions may provide protection for conditions that do not require dynamic transient analysis to demonstrate Function performance. These Functions may also serve as backups to Functions that were credited in the accident analysis (Ref. 1).

The LCO requires all instrumentation performing an ESFAS Function to be OPERABLE. Failure of any instrument renders the affected channel(s) inoperable and reduces the reliability of the affected Functions.

The LCO generally requires OPERABILITY of four or three channels in each instrumentation function and two channels in each logic function. The two-out-of-three and the two-out-of-four configurations allow one channel to be tripped during maintenance or testing without causing an ESFAS initiation. Two logic channels are required to ensure no single random failure disables the ESFAS.

The required channels of ESFAS instrumentation provide unit protection in the event of any of the analyzed accidents. ESFAS protection functions are as follows:

1. Safety Injection

Safety Injection (SI) provides two primary functions:

1. Primary side water addition to ensure maintenance or recovery of reactor vessel water level (coverage of the active fuel for heat removal, clad integrity, and for limiting peak clad temperature to < 2200°F); and
2. Boration to ensure recovery and maintenance of SDM ($k_{eff} < 1.0$).

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY (continued)

These functions are necessary to mitigate the effects of high energy line breaks (HELBs) both inside and outside of containment. The SI signal is also used to initiate other Functions such as:

- Containment Isolation;
- Containment Ventilation Isolation;
- Reactor Trip;
- Feedwater Isolation;
- Start of motor driven auxiliary feedwater (AFW) pumps; and
- Control room ventilation isolation.

These other functions ensure:

- Isolation of nonessential systems through containment penetrations;
- Trip of the reactor to limit power generation;
- Isolation of main feedwater (MFW) to limit secondary side mass losses;
- Start of AFW to ensure secondary side cooling capability; and
- Isolation of the control room to ensure habitability.

a. Safety Injection-Manual Initiation

The LCO requires one channel per train to be OPERABLE. The operator can initiate SI at any time by using either of two switches in the control room. This action will cause actuation of all components in the same manner as any of the automatic actuation signals with the exception of Containment Isolation.

The LCO for the Manual Initiation Function ensures the proper amount of redundancy is maintained in the manual ESFAS actuation circuitry to ensure the operator has manual ESFAS initiation capability.

Each channel consists of one push button and the interconnecting wiring to the actuation logic cabinet. Each push button actuates both trains. This configuration does not allow testing at power.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

b. Safety Injection-Automatic Actuation Logic and Actuation Relays

This LCO requires two trains to be OPERABLE. Actuation logic consists of all circuitry housed within the actuation subsystems, including the initiating relay contacts responsible for actuating the ESF equipment.

Manual and automatic initiation of SI must be OPERABLE in MODES 1, 2, and 3. In these MODES, there is sufficient energy in the primary and secondary systems to warrant automatic initiation of ESF systems. Manual Initiation is also required in MODE 4 even though automatic actuation is not required. In this MODE, adequate time is available to manually actuate required components in the event of a DBA, but because of the large number of components actuated on a SI, actuation is simplified by the use of the manual actuation push buttons. Automatic actuation logic and actuation relays must be OPERABLE in MODE 4 to support system level manual initiation.

These Functions are not required to be OPERABLE in MODES 5 and 6 because there is adequate time for the operator to evaluate unit conditions and respond by manually starting individual systems, pumps, and other equipment to mitigate the consequences of an abnormal condition or accident. Unit pressure and temperature are very low and many ESF components are administratively locked out or otherwise prevented from actuating to prevent inadvertent overpressurization of unit systems.

c. Safety Injection-Containment Pressure-High

This signal provides protection against the following accidents:

- SLB inside containment; and
- LOCA.

Containment Pressure-High provides no input to any control functions. Thus, three OPERABLE channels are sufficient to satisfy protective requirements with a two-out-of-three logic. The transmitters and electronics are located outside of containment with the sensing lines passing through containment penetrations to sense the containment atmosphere in three different locations.

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

Thus, the high pressure Function will not experience any adverse environmental conditions and the Allowable Value reflects only steady state instrument uncertainties.

Containment Pressure-High must be OPERABLE in MODES 1, 2, and 3 when there is sufficient energy in the primary and secondary systems to pressurize the containment following a pipe break. In MODES 4, 5, and 6, there is insufficient energy in the primary or secondary systems to pressurize the containment.

d. Safety Injection-Pressurizer Pressure-Low

This signal provides protection against the following accidents:

- Inadvertent opening of a steam generator (SG) relief or safety valve;
- SLB;
- A spectrum of rod cluster control assembly ejection accidents (rod ejection);
- Inadvertent opening of a pressurizer relief or safety valve;
- LOCAs; and
- SG Tube Rupture.

Pressurizer pressure provides both control and protection functions: input to the Pressurizer Pressure Control System, reactor trip, and SI. However, two independent PORV open signals must be present before a PORV can open. Therefore, a single pressure channel failing high will not fail a PORV open and trigger a depressurization/SI event. Additionally, in the event of a failed open spray valve, RCS depressurization would be slow enough to be recognized by the operator and mitigated through manual actions to close the spray valve and energize the pressurizer heaters prior to reaching saturated conditions in the RCS. Therefore, there would be no uncontrolled loss of RCS inventory and no need for boron injection. Therefore, only three protection channels are necessary to satisfy the protective requirements.

BASES

APPLICABLE SAFETY ANALYSES, LCO AND APPLICABILITY (continued)

This Function must be OPERABLE in MODES 1, 2, and 3 (above the Pressurizer Pressure interlock) to mitigate the consequences of an HELB inside containment. This signal may be manually blocked by the operator below the Pressurizer Pressure interlock. Automatic SI actuation below this pressure setpoint is then performed by the Containment Pressure-High signal.

This Function is not required to be OPERABLE in MODE 3 below the Pressurizer Pressure interlock. Other ESF functions are used to detect accident conditions and actuate the ESF systems in this MODE. In MODES 4, 5, and 6, this Function is not needed for accident detection and mitigation.

e. Safety Injection-Steam Line Pressure-Low

Steam Line Pressure-Low provides protection against the following accidents:

- SLB;
- Feed line break; and
- Inadvertent opening of an SG relief or an SG safety valve.

Steam Line Pressure-Low provides a signal for control of the main steam atmospheric steam dump valves. However, a failure in a steam line pressure channel will not create a control failure that would result in a low steamline pressure SI event. Thus, three OPERABLE channels on each steam line are sufficient to satisfy the protective requirements with a two-out-of-three logic on each steam line.

With the transmitters located in the fan rooms and in the fuel pool area, it is possible for them to experience adverse environmental conditions during a secondary side break. Therefore, the Allowable Value reflects both steady state and adverse environmental instrument uncertainties.

This Function is anticipatory in nature and has a lead/lag ratio of 12/2.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

Steam Line Pressure-Low must be OPERABLE in MODES 1, 2, and 3 (above the Pressurizer Pressure interlock) when a secondary side break or stuck open valve could result in the rapid depressurization of the steam lines. This signal may be manually blocked by the operator below the Pressurizer Pressure interlock. This Function is not required to be OPERABLE in MODE 4, 5, or 6 because there is insufficient energy in the secondary side of the unit to cause an accident.

2. Containment Spray

Containment Spray provides three primary functions:

1. Lowers containment pressure and temperature after an HELB in containment;
2. Reduces the amount of radioactive iodine in the containment atmosphere; and
3. Adjusts the pH of the water in the containment recirculation sump after a large break LOCA.

These functions are necessary to:

- Ensure the pressure boundary integrity of the containment structure;
- Limit the release of radioactive iodine to the environment in the event of a failure of the containment structure; and
- Minimize corrosion of the components and systems inside containment following a LOCA.

The containment spray actuation signal starts the containment spray pumps and aligns the discharge of the pumps to the containment spray nozzle headers in the upper levels of containment. Water is initially drawn from the RWST by the containment spray pumps and mixed with a sodium hydroxide solution from the spray additive tank. When the RWST reaches the low low level setpoint, the spray pump suctions are shifted to the containment sump if continued containment spray is required. Containment spray is actuated automatically by Containment Pressure-High High.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

a. Containment Spray-Manual Initiation

The operator can initiate containment spray at any time from the control room by simultaneously depressing two containment spray actuation pushbuttons. Because an inadvertent actuation of containment spray could have such serious consequences, two pushbuttons must be pushed simultaneously to initiate both trains of containment spray.

The LCO requires two channels to be OPERABLE. Each channel consists of one pushbutton and two sets of contacts, with one set of contacts in each train. Therefore an inoperable channel fails both trains of manual initiation.

b. Containment Spray-Automatic Actuation Logic and
Actuation Relays

Automatic actuation logic and actuation relays consist of the same features and operate in the same manner as described for ESFAS Function 1.b. Manual and automatic initiation of containment spray must be OPERABLE in MODES 1, 2, and 3 when there is a potential for an accident to occur, and sufficient energy in the primary or secondary systems to pose a threat to containment integrity due to overpressure conditions. Manual initiation is also required in MODE 4, even though automatic actuation is not required. In this MODE, adequate time is available to manually actuate required components in the event of a DBA. However, because of the large number of components actuated on a containment spray, actuation is simplified by the use of the manual actuation push buttons. Automatic actuation logic and actuation relays must be OPERABLE in MODE 4 to support system level manual initiation. In MODES 5 and 6, there is insufficient energy in the primary and secondary systems to result in containment overpressure. In MODES 5 and 6, there is also adequate time for the operators to evaluate unit conditions and respond, to mitigate the consequences of abnormal conditions by manually starting individual components.

c. Containment Spray-Containment Pressure-High High

This signal provides protection against a LOCA or an SLB inside containment. The transmitters are located outside of containment with the sensing lines passing through containment penetrations to sense the containment atmosphere in three different locations. The transmitters and electronics are located

BASES

**APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)**

outside of containment. Thus, they will not experience any adverse environmental conditions and the Trip Setpoint reflects only steady state instrument uncertainties.

This is one of the only Functions that requires the bistable output to energize to perform its required action. It is not desirable to have a loss of power actuate containment spray, since the consequences of an inadvertent actuation of containment spray could be serious.

The Containment Pressure-High High Function consists of two sets with three channels in each set. Each set is a two-out-of-three logic where the outputs are combined so that both sets tripped initiates Containment Spray. Since containment pressure is not used for control, this arrangement exceeds the minimum redundancy requirements. Additional redundancy is warranted because this Function is energize to trip. Containment Pressure-High High must be OPERABLE in MODES 1, 2, and 3 when there is sufficient energy in the primary and secondary sides to pressurize the containment following a pipe break. In MODES 4, 5, and 6, there is insufficient energy in the primary and secondary sides to pressurize the containment and reach the Containment Pressure-High High setpoints.

3. Containment Isolation

Containment Isolation provides isolation of the containment atmosphere from the environment. This Function is necessary to prevent or limit the release of radioactivity to the environment in the event of a large break LOCA.

Containment Isolation signals isolate all automatically isolable process lines, except component cooling water (CCW), main feedwater lines and main steam lines. The main feedwater and main steam lines are isolated by other functions because forced circulation cooling using the reactor coolant pumps (RCPs) and SGs is the preferred (but not required) method of decay heat removal. Since CCW is required to support RCP operation, not isolating CCW enhances unit safety by allowing operators to use forced RCS circulation to cool the unit. Isolating CCW may force the use of feed and bleed cooling, which could prove more difficult to control.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO AND
APPLICABILITY
(continued)

a. Containment Isolation

(1) Containment Isolation-Manual Initiation

The LCO requires two channels to be OPERABLE. A channel consists of one pushbutton and two sets of contacts, with one set of contacts in each train.

Manual Containment Isolation is actuated by either of two switches in the control room. Either switch actuates both trains. Note that manual initiation of Containment Isolation also actuates Containment Ventilation Isolation.

(2) Containment Isolation-Automatic Actuation

Logic and Actuation Relays

Automatic Actuation Logic and Actuation Relays consist of the same features and operate in the same manner as described for ESFAS Function 1.b.

Manual and automatic initiation of Containment Isolation must be OPERABLE in MODES 1, 2, and 3, when there is a potential for an accident to occur. Manual initiation is also required in MODE 4 even though automatic actuation is not required. In this MODE, adequate time is available to manually actuate required components in the event of a DBA, but because of the large number of components actuated on a Containment Isolation, actuation is simplified by the use of the manual actuation push buttons. Automatic actuation logic and actuation relays must be OPERABLE in MODE 4 to support system level manual initiation. In MODES 5 and 6, there is insufficient energy in the primary or secondary systems to pressurize the containment to require Containment Isolation. There also is adequate time for the operator to evaluate unit conditions and manually actuate individual isolation valves in response to abnormal or accident conditions.

(3) Containment Isolation-Safety Injection

Containment Isolation is also initiated by all Functions that initiate SI except Manual SI initiation. The Containment Isolation requirements for these Functions are the same as the requirements for their SI function. Therefore, the requirements are not repeated in Table 3.3.2-1. Instead, Function 1, SI, is referenced for all initiating Functions and requirements.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

4. Steam Line Isolation

Isolation of the main steam lines provides protection in the event of an SLB inside or outside containment. Rapid isolation of the steam lines will limit the steam break accident to the blowdown from one SG, at most. For an SLB upstream of the main steam isolation valves (MSIVs), inside or outside of containment, closure of the MSIVs limits the accident to the blowdown from only the affected SG. For an SLB downstream of the MSIVs, closure of the MSIVs terminates the accident as soon as the steam lines depressurize. Steam Line Isolation also mitigates the effects of a feed line break and ensures a source of steam for the turbine driven AFW pump during a feed line break.

a. Steam Line Isolation-Manual Initiation

The LCO requires one channel per loop to be OPERABLE. A channel consists of the control switch and two sets of contacts, with one set of contacts in each train.

Manual initiation of Steam Line Isolation can be accomplished from the control room. There are two switches in the control room, one for each MSIV.

b. Steam Line Isolation-Automatic Actuation Logic and Actuation Relays

The LCO requires two trains to be OPERABLE. Actuation logic consists of two trains, with each train providing output to each MSIV through individual relays.

Manual and automatic initiation of steam line isolation must be OPERABLE in MODES 1, 2, and 3 when there is sufficient energy in the RCS and SGs to have an SLB or other accident. This could result in the release of significant quantities of energy and cause a cooldown of the primary system. The Steam Line Isolation Function is required in MODES 2 and 3 unless all MSIVs are closed and de-activated. In MODES 4, 5, and 6, there is insufficient energy in the RCS and SGs to experience an SLB or other accident releasing significant quantities of energy.

c. Steam Line Isolation-Containment Pressure-High High

This Function actuates closure of the MSIVs in the event of a LOCA or an SLB inside containment to maintain at least one unfaulted SG as a heat sink for the reactor, and to limit the mass

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY (continued)

and energy release to containment. The transmitters are located outside containment with the sensing lines passing through containment penetrations to sense the containment atmosphere in three different locations. Containment Pressure-High High provides no input to any control functions. Thus, three OPERABLE channels are sufficient to satisfy protective requirements with two-out-of-three logic. The transmitters and electronics are located outside of containment. Thus, they will not experience any adverse environmental conditions, and the Allowable Value reflects only steady state instrument uncertainties.

Containment Pressure-High High must be OPERABLE in MODES 1, 2, and 3, when there is sufficient energy in the primary and secondary side to pressurize the containment following a pipe break. This would cause a significant increase in the containment pressure, thus allowing detection and closure of the MSIVs. The Steam Line Isolation Function remains OPERABLE in MODES 2 and 3 unless all MSIVs are closed and de-activated. In MODES 4, 5, and 6, there is not enough energy in the primary and secondary sides to pressurize the containment to the Containment Pressure-High High setpoint.

d. Steam Line Isolation-High Steam Flow Coincident With Safety Injection and Coincident With T_{avg}-Low

This Function provides closure of the MSIVs during an SLB or inadvertent opening of an SG relief or safety valve to maintain at least one unfaulted SG as a heat sink for the reactor, and to limit the mass and energy release to containment.

Two steam line flow channels per steam line are required OPERABLE for this Function. These are combined in a one-out-of-two logic to indicate high steam flow in one steam line. The steam flow transmitters provide control inputs, but the control function cannot cause the events that the function must protect against. Therefore, two channels are sufficient to satisfy redundancy requirements. The one-out-of-two configuration allows online testing because trip of one high steam flow channel is not sufficient to cause initiation.

The High Steam Flow Allowable Value is a ΔP corresponding to 20% of full steam flow at no load steam pressure.

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY (continued)

With the transmitters (d/p cells) located inside containment, it is possible for them to experience adverse environmental conditions during an SLB event. Therefore, the Allowable Values reflect both steady state and adverse environmental instrument uncertainties.

The main steam line isolates only if the high steam flow signal occurs coincident with an SI and low RCS average temperature. The Main Steam Line Isolation Function requirements for the SI Functions are the same as the requirements for their SI function. Therefore, the requirements are not repeated in Table 3.3.2-1. Instead, Function 1, SI, is referenced for all initiating functions and requirements.

The T_{avg} -Low Function consists of four channels (two in each loop), providing input to both trains in a two-out-of-four logic configuration. Three channels of T_{avg} are required to be OPERABLE. The accidents that this Function protects against cause reduction of T_{avg} in the entire primary system. Therefore, the provision of three OPERABLE channels ensures no single random failure disables the T_{avg} -Low Function. The T_{avg} channels provide control inputs, but the control function cannot initiate events that the Function acts to mitigate. Therefore, additional channels are not required to address control protection interaction issues.

With the T_{avg} resistance temperature detectors (RTDs) located inside the containment, it is possible for them to experience adverse environmental conditions during an SLB event. Therefore, the Trip Setpoint reflects both steady state and adverse environmental instrumental uncertainties.

This Function must be OPERABLE in MODES 1 and 2, and in MODE 3, when a secondary side break or stuck open valve could result in rapid depressurization of the steam lines. The Steam Line Isolation Function is required to be OPERABLE in MODES 2 and 3 unless all MSIVs are closed and de-activated. This Function is not required to be OPERABLE in MODES 4, 5, and 6 because there is insufficient energy in the secondary side of the unit to have an accident.

e. Steam Line Isolation-High High Steam Flow Coincident
With Safety Injection

This Function provides closure of the MSIVs during a steam line break (or inadvertent opening of a relief or safety valve) to

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY (continued)

maintain at least one unfaulted SG as a heat sink for the reactor, and to limit the mass and energy release to containment.

Two steam line flow channels per steam line are required to be OPERABLE for this Function. These are combined in a one-out-of-two logic to indicate high steam flow in one steam line. The steam flow transmitters provide control inputs, but the control function cannot cause the events that the Function must protect against. Therefore, two channels are sufficient to satisfy redundancy requirements.

The Allowable Value for high steam flow is a ΔP , corresponding to 120% of full steam flow at full steam pressure.

With the transmitters located inside containment, it is possible for them to experience adverse environmental conditions during an SLB event. Therefore, the Allowable Value reflects both steady state and adverse environmental instrument uncertainties.

The main steam lines isolate only if the high steam flow signal occurs coincident with an SI signal. The Main Steam Line Isolation Function requirements for the SI Functions are the same as the requirements for their SI function. Therefore, the requirements are not repeated in Table 3.3.2-1. Instead, Function 1, SI, is referenced for all initiating functions and requirements.

This Function must be OPERABLE in MODES 1, 2, and 3 when a secondary side break or stuck open valve could result in rapid depressurization of the steam lines unless all MSIVs are closed and de-activated. This Function is not required to be OPERABLE in MODES 4, 5, and 6 because there is insufficient energy in the secondary side of the unit to have an accident.

5. Feedwater Isolation

The primary function of the Feedwater Isolation signal is to stop the excessive flow of feedwater into the SGs. This Function is necessary to mitigate the effects of a high water level in the SGs, which could result in carryover of water into the steam lines and excessive cooldown of the primary system. The SG high water level is due to excessive feedwater flows.

BASES

APPLICABLE SAFETY ANALYSES, LCO, AND APPLICABILITY (continued)

The Function is actuated on an SI signal, or when the level in either SG exceeds the high setpoint.

An SI signal results in the following actions:

- MFW pumps trip (causes subsequent closure of the MFW pump discharge valves); and
- MFRVs and the bypass regulating valves close.

A SG Water Level-High in either SG results in the closure of the MFRVs and the bypass regulating valves.

a. Feedwater Isolation-Automatic Actuation Logic and Actuation Relays

Automatic Actuation Logic and Actuation Relays consist of the same features and operate in the same manner as described for ESFAS Function 1.b.

b. Feedwater Isolation-Steam Generator Water Level-High

This signal provides protection against excessive feedwater flow. The ESFAS SG water level instruments provide input to the SG Water Level Control System. If this input to the SG Water Level Control System fails low, it would cause a control action to open the Feedwater Control Valves for the affected SG. The remaining channels, in a two-out-of-two configuration, would be required to detect a high SG Water Level condition and initiate a Feedwater Isolation to prevent an overfill condition. Therefore this configuration does not meet the single failure criteria of Reference 1. However, justification for a two-out-of-three Feedwater Isolation-SG Water Level-High Function is provided in NUREG-1218, Reference 5.

Table 3.3.2-1 identifies the Technical Specification Allowable Value for the Feedwater Isolation – SG Water Level – High function as not applicable (NA). No Analytical Value is assumed in the accident analysis for this function. The nominal setting required for the Feedwater Isolation – SG Water Level – High function is 78% of span. This nominal setting was developed outside of the setpoint methodology and has been provided by the NSSS supplier.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

c. Feedwater Isolation-Safety Injection

Feedwater Isolation is also initiated by all Functions that initiate SI. The Feedwater Isolation Function requirements for these Functions are the same as the requirements for their SI function.

Therefore, the requirements are not repeated in Table 3.3.2-1. Instead Function 1, SI, is referenced for all initiating functions and requirements.

Feedwater Isolation Functions must be OPERABLE in MODES 1 and 2 and 3 except when all MFRVs, and associated bypass valves are closed and de-activated. In MODES 4, 5, and 6, the MFW System is not in service and this Function is not required to be OPERABLE.

6. Auxiliary Feedwater

The AFW System is designed to provide a secondary side heat sink for the reactor in the event that the MFW System is not available. The system has two motor driven pumps and a turbine driven pump, making it available during normal unit operation, during a loss of AC power, a loss of MFW, and during a Feedwater System pipe break. The normal source of water for the AFW System is the condensate storage tank (CST) (not safety related). Upon a low level in the CST, the operators can manually realign the pump suctions to the Service Water System, which is the safety related water source. The AFW System is aligned so that upon a pump start, flow is initiated to the respective SGs immediately.

a. Auxiliary Feedwater-Automatic Actuation Logic and Actuation Relays

Automatic actuation logic and actuation relays consist of the same features and operate in the same manner as described for ESFAS Function 1.b.

b. Auxiliary Feedwater-Steam Generator Water Level-Low Low

SG Water Level-Low Low provides protection against a loss of heat sink. A loss of MFW would result in a loss of SG water level. SG Water Level-Low Low in either SG will cause both motor driven pumps to start. The system is aligned so that upon start of the pumps, water immediately begins to flow to the SGs. SG Water Level-Low Low in both SGs will cause the turbine driven AFW pump to start.

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

With the transmitters (d/p cells) located inside containment and thus possibly experiencing adverse environmental conditions (feed line break), the Allowable Value reflects the inclusion of both steady state and adverse environmental instrument uncertainties.

c. Auxiliary Feedwater-Safety Injection

An SI signal starts the motor driven AFW pumps. The AFW initiation functions are the same as the requirements for their SI function. Therefore, the requirements are not repeated in Table 3.3.2-1. Instead, Function 1, SI, is referenced for all initiating functions and requirements.

Functions 6.a through 6.c must be OPERABLE in MODES 1, 2, and 3 to ensure that the SGs remain the heat sink for the reactor. SG Water Level-Low Low in any operating SG will cause the motor driven AFW pumps to start. The system is aligned so that upon a start of the pump, water immediately begins to flow to the SGs. SG Water Level-Low Low in both SGs will cause the turbine driven pump to start. These Functions do not have to be OPERABLE in MODES 5 and 6 because there is not enough heat being generated in the reactor to require the SGs as a heat sink. In MODE 4, AFW actuation does not need to be OPERABLE because either AFW or residual heat removal (RHR) will already be in operation to remove decay heat or sufficient time is available to manually place either system in operation.

d. Auxiliary Feedwater-Undervoltage Bus A01 and A02

The LCO requires two channels per bus to be OPERABLE. A channel consists of an undervoltage relay and one set of associated contacts.

A loss of power on the A01 and A02 buses provides indication of a pending loss of both Main Feedwater pumps and the subsequent need for some method of decay heat removal. A loss of power to Buses A01 and A02 will start the turbine driven AFW pump to ensure that at least one SG contains enough water to serve as the heat sink for reactor decay heat and sensible heat removal following the reactor trip.

Function 6.d must be OPERABLE in MODES 1 and 2. This ensures that at least one SG is provided with water to serve as the heat sink to remove reactor decay heat and sensible heat in

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

the event of an accident. In MODES 3, 4, and 5, the MFV pumps may be normally shut down, and thus a pump trip is not indicative of a condition requiring automatic AFW initiation.

7. Condensate Isolation

The Condensate Isolation Function serves as a backup protection function in the event of a Main Steam Line Break inside containment with a failure of the Main Feedwater lines to isolate. An evaluation of IE Bulletin 80-04 showed that a single failure of a MFRV to close on a SI signal could allow feedwater addition to the faulted SG, leading to containment overpressure.

a. Containment Pressure-Condensate Isolation (CPCI)

The Condensate Isolation Function is actuated when containment pressure exceeds the high setpoint, and performs the following functions:

- Trips the condensate pumps; and
- Trips the heater drain pumps.

The Condensate Isolation Function must be OPERABLE in MODES 1, 2 and 3, except when all MFRVs and associated bypass valves are closed and de-activated. This Function is not required to be OPERABLE in MODES 4, 5 and 6, because there is insufficient energy in the secondary side of the unit to have an accident.

b. Condensate Isolation - Automatic Actuation Logic and Actuation Relays

Automatic Actuation logic and actuation relays consist of the same features and operate in the same manner as described for ESFAS Function 1.b.

8. Pressurizer Pressure Safety Injection Block

To allow some flexibility in unit operations, the Pressurizer Pressure SI Block is included as part of the ESFAS.

The block permits a normal unit cooldown and depressurization without actuation of SI. With two-out-of-three pressurizer pressure channels (discussed previously) less than the setpoint, the operator can manually block the Pressurizer Pressure-Low and Steam Line

BASES

APPLICABLE
SAFETY ANALYSES,
LCO, AND
APPLICABILITY
(continued)

Pressure-Low SI signals. With two-out-of-three pressurizer pressure channels above the setpoint, the Pressurizer Pressure-Low and Steam Line Pressure-Low SI signals are automatically enabled. The operator can also enable these trips by use of the respective manual reset buttons. The Allowable Value reflects only steady state instrument uncertainties.

This Function must be OPERABLE in MODES 1, 2, and 3 to allow automatic initiation of SI actuation on Pressurizer Pressure-Low or Steam Line Pressure-Low signals. This Function does not have to be OPERABLE in MODE 4, 5, or 6 because system pressure must already be below the setpoint for the requirements of the heatup and cooldown curves to be met.

The ESFAS instrumentation satisfies Criterion 3 of the NRC Policy Statement.

ACTIONS

A Note has been added in the ACTIONS to clarify the application of Completion Time rules. The Conditions of this Specification may be entered independently for each Function listed on Table 3.3.2-1.

In the event a channel's Trip Setpoint is found nonconservative with respect to the Allowable Value, or the transmitter, instrument Loop, signal processing electronics, or bistable is found inoperable, then all affected Functions provided by that channel must be declared inoperable and the LCO Condition(s) entered for the protection Function(s) affected. When the Required Channels in Table 3.3.2-1 are specified (e.g., on a per steam line, per loop, per SG, etc., basis), then the Condition may be entered separately for each steam line, loop, SG, etc., as appropriate.

When the number of inoperable channels in a trip function exceed those specified in one or other related Conditions associated with a trip function, then the unit is outside the safety analysis. Therefore, LCO 3.0.3 should be immediately entered if applicable in the current MODE of operation.

A.1

Condition A applies to all ESFAS protection functions.

Condition A addresses the situation where one or more channels or trains for one or more Functions are inoperable at the same time. The Required Action is to refer to Table 3.3.2-1 and to take the Required

BASES

ACTIONS (continued) Actions for the protection functions affected. The Completion Times are those from the referenced Conditions and Required Actions.

B.1, B.2.1 and B.2.2

Condition B applies to manual initiation of:

- SI; and
- Containment Isolation.

If a channel is inoperable, 48 hours are allowed to return it to OPERABLE status. The specified Completion Time is reasonable considering that there are two automatic actuation trains and another manual initiation train OPERABLE for each Function, and the low probability of an event occurring during this interval. If the channel cannot be restored to OPERABLE status, the unit must be placed in a MODE in which the LCO does not apply. This is done by placing the unit in at least MODE 3 within an additional 6 hours (54 hours total time) and in MODE 5 within an additional 30 hours (84 hours total time). The allowable Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

C.1, C.2.1 and C.2.2

Condition C applies to the automatic actuation logic and actuation relays for the following functions:

- SI;
- Containment Spray; and
- Containment Isolation.

If one train is inoperable, 6 hours are allowed to restore the train to OPERABLE status. The specified Completion Time is reasonable considering that there is another train OPERABLE, and the low probability of an event occurring during this interval. If the train cannot be restored to OPERABLE status, the unit must be placed in a MODE in which the LCO does not apply. This is done by placing the unit in at least MODE 3 within an additional 6 hours (12 hours total time) and in MODE 5 within an additional 30 hours (42 hours total time). The Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

BASES**ACTIONS (continued) D.1, D.2.1 and D.2.2**

Condition D applies to:

- Containment Pressure-High;
- Pressurizer Pressure-Low;
- Steam Line Pressure-Low;
- Containment Pressure-High High;
- High Steam Flow Coincident With Safety Injection Coincident With T_{avg} -Low;
- High High Steam Flow Coincident With Safety Injection;
- SG Water level-Low Low; and
- SG Water level-High.

If one channel is inoperable, 1 hour is allowed to restore the channel to OPERABLE status or to place it in the tripped condition. Placing the channel in the tripped condition is necessary to maintain a logic configuration that satisfies redundancy requirements.

Failure to restore the inoperable channel to OPERABLE status or place it in the tripped condition within 1 hour requires the unit be placed in MODE 3 within the following 6 hours and MODE 4 within the next 6 hours.

The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems. In MODE 4, these Functions are no longer required OPERABLE.

E.1, E.2.1, and E.2.2

Condition E applies to manual initiation of Containment Spray. If one or both channels are inoperable, 1 hour is allowed to return the inoperable channel(s) to OPERABLE status. The Completion Time of one hour is reasonable considering that there are OPERABLE automatic actuation functions credited to perform the safety function and the low probability of an event occurring during this interval. If the inoperable channel(s) cannot be restored to OPERABLE status, the unit must be placed in a MODE in which the LCO does not apply. This is done by placing the

BASES

ACTIONS (continued) unit in at least MODE 3 within an additional 6 hours (7 hours total time) and in MODE 5 within an additional 30 hours (37 hours total time). The allowable Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

F.1, F.2.1, and F.2.2

Condition F applies to Manual Initiation of Steam Line Isolation.

If a channel is inoperable, 1 hour is allowed to return it to an OPERABLE status. The Completion Time of one hour is reasonable considering the low probability of an event occurring during this interval. If the Function cannot be returned to OPERABLE status, the unit must be placed in MODE 3 within the next 6 hours and MODE 4 within the following 6 hours. The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power in an orderly manner and without challenging unit systems. In MODE 4, the unit does not have any analyzed transients or conditions that require the explicit use of the protection functions noted above.

G.1, G.2.1 and G.2.2

Condition G applies to the automatic actuation logic and actuation relays for the Steam Line Isolation, Feedwater Isolation, Condensate Isolation and AFW actuation Functions.

If one train is inoperable, 6 hours are allowed to restore the train to OPERABLE status. The Completion Time for restoring a train to OPERABLE status is reasonable considering that there is another train OPERABLE, and the low probability of an event occurring during this interval. If the train cannot be returned to OPERABLE status, the unit must be brought to MODE 3 within the next 6 hours and MODE 4 within the following 6 hours. The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems. Placing the unit in MODE 4 removes all requirements for OPERABILITY of the protection channels and actuation functions. In this MODE, the unit does not have analyzed transients or conditions that require the explicit use of the protection functions noted above.

BASES

ACTIONS (continued) H.1 and H.2

Condition H applies to the Undervoltage Bus A01 and A02 Function.

If one channel is inoperable, 6 hours are allowed to restore one channel to OPERABLE status or place it in the tripped condition. If placed in the tripped condition, this Function is then in a partial trip condition where one-out-of-two logic will result in actuation. The 6 hours to place the channel in the tripped condition is necessary due to plant design requiring maintenance personnel to effect the trip of the channel outside of the control room. Failure to restore the inoperable channel to OPERABLE status or place it in the tripped condition within 6 hours requires the unit to be placed in MODE 3 within the following 6 hours. The allowed Completion Time of 6 hours is reasonable, based on operating experience, to reach MODE 3 from full power conditions in an orderly manner and without challenging unit systems. In MODE 3, this Function is no longer required OPERABLE.

I.1, I.2.1 and I.2.2

Condition I applies to the Pressurizer Pressure SI Block.

With one or more channels inoperable, the operator must verify that the interlock is in the required state for the existing unit condition. This action manually accomplishes the function of the block. Determination must be made within 1 hour. The 1 hour Completion Time is equal to the time allowed by LCO 3.0.3 to initiate shutdown actions in the event of a complete loss of ESFAS function. If the block is not in the required state (or placed in the required state) for the existing unit condition, the unit must be placed in MODE 3 within the next 6 hours and MODE 4 within the following 6 hours. The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems. Placing the unit in MODE 4 removes all requirements for OPERABILITY of the Pressurizer Pressure SI block.

SURVEILLANCE REQUIREMENTS

The SRs for each ESFAS Function are identified by the SRs column of Table 3.3.2-1.

A Note has been added to the SR Table to clarify that Table 3.3.2-1 determines which SRs apply to which ESFAS Functions.

Note that each channel of process protection supplies both trains of the ESFAS. When testing channel I, train A and train B must be examined. Similarly, train A and train B must be examined when testing channel II,

BASES

SURVEILLANCE REQUIREMENTS (continued)

channel III, and channel IV (if applicable). The CHANNEL CALIBRATION and COTs are performed in a manner that is consistent with the assumptions used in analytically calculating the required channel accuracies.

SR 3.3.2.1

Performance of the CHANNEL CHECK once every 12 hours ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the two instrument channels could be an indication of excessive instrument drift in one of the channels or of something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the unit staff, based on a combination of the channel instrument uncertainties, including indication and reliability. If a channel is outside the criteria, it may be an indication that the sensor or the signal processing equipment has drifted outside its limit.

The Frequency is based on operating experience that demonstrates channel failure is rare. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the LCO required channels.

SR 3.3.2.2

SR 3.3.2.2 is the performance of an ACTUATION LOGIC TEST on all ESFAS Automatic Actuation Logic every 31 days on a STAGGERED TEST BASIS. This test includes the application of various simulated or actual input combinations in conjunction with each possible interlock state and verification of the required logic output. The Frequency of every 31 days on a STAGGERED TEST BASIS is adequate. It is based on industry operating experience, considering instrument reliability and operating history data.

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

SR 3.3.2.3

SR 3.3.2.3 is the performance of a COT.

A COT is performed on each required channel to ensure the entire channel will perform the intended Function. Setpoints must be found within the Allowable Values specified in Table 3.3.2-1.

The difference between the current "as found" values and the previous test "as left" values must be consistent with the drift allowance used in the setpoint methodology. The setpoint shall be left set consistent with the assumptions of the current unit specific setpoint methodology.

The "as found" and "as left" values must also be recorded and reviewed for consistency with the assumptions of the surveillance interval extension analysis (Ref. 4) when applicable.

The Frequency of 92 days is justified in Reference 4.

SR 3.3.2.4

SR 3.3.2.4 is the performance of a MASTER RELAY TEST. The MASTER RELAY TEST is the energizing of the master relay and verifying contact operation. This test is performed every 18 months.

SR 3.3.2.5

SR 3.3.2.5 is the performance of a SLAVE RELAY TEST. The SLAVE RELAY TEST is the energizing of the slave relays. Contact operation is verified in one of two ways. Actuation equipment that may be operated in the design mitigation MODE is either allowed to function, or is placed in a condition where the relay contact operation can be verified without operation of the equipment. This test is performed every 18 months.

SR 3.3.2.6

SR 3.3.2.6 is the performance of a TADOT every 31 days. This test is a check of the Undervoltage Bus A01 and A02 Function.

The Frequency is adequate. It is based on industry operating experience, considering instrument reliability and operating history data.

SR 3.3.2.7

SR 3.3.2.7 is the performance of a TADOT. This test is a check of the Manual Actuation Functions. It is performed every 18 months. The

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

Frequency is adequate, based on industry operating experience and is consistent with the typical refueling cycle.

SR 3.3.2.8

SR 3.3.2.8 is the performance of a CHANNEL CALIBRATION.

A CHANNEL CALIBRATION is performed every 18 months, or approximately at every refueling. CHANNEL CALIBRATION is a complete check of the instrument loop, including the sensor. The test verifies that the channel responds to measured parameter within the necessary range and accuracy.

CHANNEL CALIBRATIONS must be performed consistent with the assumptions of the setpoint methodology. The difference between the current "as found" values and the previous test "as left" values must be consistent with the drift allowance used in the setpoint methodology.

The Frequency of 18 months is based on the assumption of an 18 month calibration interval in the determination of the magnitude of equipment drift in the setpoint methodology.

This SR is modified by a Note stating that this test should include verification that the time constants are adjusted to the prescribed values where applicable.

REFERENCES

1. FSAR, Chapter 14.
 2. IEEE-279-1968.
 3. 10 CFR 50.49.
 4. DGI-01, Instrument Setpoint Methodology.
 5. NUREG-1218, April 1988.
-

B 3.3 INSTRUMENTATION

B 3.3.3 Post Accident Monitoring (PAM) Instrumentation

BASES

BACKGROUND

The primary purpose of the PAM instrumentation is to display unit variables that provide information required by the control room operators during accident situations. This information provides the necessary support for the operator to take the manual actions for which no automatic control is provided and that are required for safety systems to accomplish their safety functions for Design Basis Accidents (DBAs).

The OPERABILITY of the accident monitoring instrumentation ensures that there is sufficient information available on selected unit parameters to monitor and to assess unit status and behavior following an accident.

The availability of accident monitoring instrumentation is important so that responses to corrective actions can be observed and the need for, and magnitude of, further actions can be determined. These essential instruments identified in Reference 1 address the recommendations of Regulatory Guide 1.97 (Ref. 2) as required by Supplement 1 to NUREG-0737 (Ref. 3).

The instrument channels required to be OPERABLE by this LCO include two classes of parameters identified during unit specific implementation of Regulatory Guide 1.97 as Type A and Category I variables.

Type A variables are included in this LCO because they provide the primary information required for the control room operator to take specific manually controlled actions for which no automatic control is provided, and that are required for safety systems to accomplish their safety functions for DBAs.

Category I variables are the key variables deemed risk significant because they are needed to:

- Determine whether other systems important to safety are performing their intended functions;
- Provide information to the operators that will enable them to determine the likelihood of a gross breach of the barriers to radioactivity release; and

BASES

BACKGROUND (continued)

- Provide information regarding the release of radioactive materials to allow for early indication of the need to initiate action necessary to protect the public, and to estimate the magnitude of any impending threat.

These key variables are identified by the Regulatory Guide 1.97 analyses (Ref. 1). These analyses identify the unit specific Type A and Category I variables and provide justification for deviating from the NRC proposed list of Category I variables.

The specific instrument Functions listed in Table 3.3.3-1 are discussed in the LCO section.

APPLICABLE SAFETY ANALYSES

The PAM instrumentation ensures the operability of Regulatory Guide 1.97 Type A and Category I variables so that the control room operating staff can:

- Perform the diagnosis specified in the emergency operating procedures (these variables are restricted to preplanned actions for the primary success path of DBAs), e.g., loss of coolant accident (LOCA);
- Take the specified, pre-planned, manually controlled actions, for which no automatic control is provided, and that are required for safety systems to accomplish their safety function;
- Determine whether systems important to safety are performing their intended functions;
- Determine the likelihood of a gross breach of the barriers to radioactivity release;
- Determine if a gross breach of a barrier has occurred; and
- Initiate action necessary to protect the public and to estimate the magnitude of any impending threat.

PAM instrumentation that meets the definition of Type A in Regulatory Guide 1.97 satisfies Criterion 3 of the NRC Policy Statement. Category I, non-Type A, instrumentation must be retained in TS because it is intended to assist operators in minimizing the consequences of accidents. Therefore, Category I, non-Type A, variables are important for reducing public risk.

BASES

LCO

The PAM instrumentation LCO provides OPERABILITY requirements for Regulatory Guide 1.97 Type A monitors, which provide information required by the control room operators to perform certain manual actions specified in the unit Emergency Operating Procedures. These manual actions ensure that a system can accomplish its safety function, and are credited in the safety analyses. Additionally, this LCO addresses Regulatory Guide 1.97 instruments that have been designated Category I, non-Type A.

The OPERABILITY of the PAM instrumentation ensures there is sufficient information available on selected unit parameters to monitor and assess unit status following an accident. This capability is consistent with the recommendations of Reference 2.

LCO 3.3.3 requires two OPERABLE channels for most Functions. Two OPERABLE channels ensure no single failure prevents operators from getting the information necessary for them to determine the safety status of the unit, and to bring the unit to and maintain it in a safe condition following an accident.

Furthermore, OPERABILITY of two channels allows a CHANNEL CHECK during the post accident phase to confirm the validity of displayed information.

One exception to the two channel requirement is Containment Isolation Valve (CIV) Position. In this case, the important information is the status of the containment penetrations. The LCO requires one position indicator for each active CIV. This is sufficient to redundantly verify the isolation status of each isolable penetration either via indicated status of the active valve and prior knowledge of a passive valve, or via system boundary status. If a normally active CIV is known to be closed and deactivated, position indication is not needed to determine status. Therefore, the position indication for valves in this state is not required to be OPERABLE.

Another exception to the two channel requirement is AFW flow, because it is a backup indication to Steam Generator Water Level (Narrow Range).

Table 3.3.3-1 provides a list of variables identified by the Regulatory Guide 1.97 (Ref. 1) analyses. Table 3.3.3-1 lists all Type A and Category I variables identified by the Regulatory Guide 1.97 analyses, as amended by the NRC's SER.

BASES

LCO (continued)

Type A and Category I variables are required to meet Regulatory Guide 1.97 Category I (Ref. 2) design and qualification requirements for seismic and environmental qualification, single failure criterion, utilization of emergency standby power, immediately accessible display, continuous readout, and recording of display.

Listed below are discussions of the specified instrument Functions listed in Table 3.3.3-1.

1. Reactor Coolant System (RCS) Subcooling Monitor

RCS Subcooling Monitor is a Type A variable provided for verification of core cooling and long term surveillance of RCS integrity. The RCS Subcooling Monitor is used to provide information to the operator on subcooling, derived from RCS Hot Leg Temperature or Core Exit Thermocouples, and RCS pressure. RCS Subcooling margin is used to determine whether to terminate SI, if still in progress, or to reinitiate SI if it has stopped. RCS Subcooling margin is also used for plant stabilization and cooldown control.

2, 3. Reactor Coolant System (RCS) Hot and Cold Leg Temperatures (Wide Range)

RCS Hot and Cold Leg Temperatures (Wide Range) are Category I variables provided for verification of core cooling and long term surveillance.

RCS hot and cold leg temperatures are used to determine RCS subcooling margin and verify adequate core cooling. RCS subcooling margin will allow termination of safety injection (SI), if still in progress, or reinitiation of SI if it has been stopped. RCS subcooling margin is also used for unit stabilization and cooldown control.

In addition, RCS cold leg temperature is used in conjunction with RCS hot leg temperature to verify the unit conditions necessary to establish natural circulation in the RCS.

Temperature inputs are provided by two independent temperature resistance elements and associated transmitters in each loop. The channels provide indication over a range of 50°F to 750°F.

BASES

LCO (continued)

4, 5. Reactor Coolant System Pressure (Wide and Narrow Range)

RCS narrow range pressure is a Category I variable provided for verification of core cooling and RCS integrity long term surveillance.

RCS wide range pressure is a Type A variable used to select high-head or low-head Safety Injection for recirculation.

RCS pressure is used to verify delivery of SI flow to RCS from at least one train when the RCS pressure is below the pump shutoff head. RCS pressure is also used to verify closure of manually closed spray line valves and pressurizer power operated relief valves (PORVs).

In addition to these verifications, RCS pressure is used for determining RCS subcooling margin. RCS subcooling margin will allow termination of SI, if still in progress, or reinitiation of SI if it has been stopped. RCS pressure can also be used:

- to determine whether to terminate actuated SI or to reinitiate stopped SI;
- to determine when to reset SI and shut off low head SI;
- to manually restart low head SI;
- as reactor coolant pump (RCP) trip criteria; and
- to make a determination on the nature of the accident in progress and where to go next in the procedure.

RCS subcooling margin is also used for unit stabilization and cooldown control.

RCS pressure is also related to three decisions about depressurization. They are:

- to determine whether to proceed with primary system depressurization;
- to verify termination of depressurization; and
- to determine whether to close accumulator isolation valves during a controlled cooldown/depressurization.

BASES

LCO (continued)

A final use of RCS pressure is to determine whether to operate the pressurizer heaters.

RCS pressure is a Type A variable because the operator uses this indication to monitor the cooldown of the RCS following a steam generator tube rupture (SGTR) or small break LOCA. Operator actions to maintain a controlled cooldown, such as adjusting steam generator (SG) pressure or level, would use this indication. Furthermore, RCS pressure is one factor that may be used in decisions to terminate RCP operation.

6, 7. Reactor Vessel Water Level

Reactor Vessel Water Level is provided for verification and long term surveillance of core cooling. It is also used for accident diagnosis and to determine reactor coolant inventory adequacy.

The Reactor Vessel Water Level Monitoring System provides a direct measurement of the collapsed liquid level above the fuel alignment plate. The collapsed level represents the amount of liquid mass that is in the reactor vessel above the core. Measurement of the collapsed water level is selected because it is a direct indication of the water inventory.

8. Containment Sump B Water Level

Containment Sump B Water Level is provided for verification and long term surveillance of RCS integrity.

Containment Sump B Water Level is used to determine:

- containment sump B level accident diagnosis;
- when to begin the recirculation procedure; and
- whether to terminate SI, if still in progress.

9, 10, 11. Containment Pressure (Wide, Intermediate and Low Range)

Containment pressure is a Type A variable used to correct RCS pressure in a post LOCA condition.

Containment Pressure is also provided for verification of RCS and containment OPERABILITY.

BASES

LCO (continued)

12. Containment Isolation Valve Position

CIV Position is provided for verification of Containment OPERABILITY, and Containment isolation.

When used to verify Containment isolation, the important information is the isolation status of the containment penetrations. The LCO requires one channel of valve position indication in the control room to be OPERABLE for each active CIV in a containment penetration flow path, i.e., two total channels of CIV position indication for a penetration flow path with two active valves. For containment penetrations with only one active CIV having control room indication, Note (b) requires a single channel of valve position indication to be OPERABLE. This is sufficient to redundantly verify the isolation status of each isolable penetration either via indicated status of the active valve, as applicable, and prior knowledge of a passive valve, or via system boundary status. If a normally active CIV is known to be closed and deactivated, position indication is not needed to determine status. Therefore, the position indication for valves in this state is not required to be OPERABLE. Note (a) to the Required Channels states that the Function is not required for isolation valves whose associated penetration is isolated by at least one closed and deactivated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.

13. Containment Area Radiation (High Range)

Containment Area Radiation is provided to monitor for the potential of significant radiation releases and to provide release assessment for use by operators in determining the need to invoke site emergency plans. Containment radiation level is used to determine if a high energy line break (HELB) has occurred, and whether the event is inside or outside of containment.

14. Hydrogen Monitors

Hydrogen Monitors are provided to detect high hydrogen concentration conditions that represent a potential for containment breach from a hydrogen explosion. This variable is also important in verifying the adequacy of mitigating actions.

There are a total of four hydrogen monitors, two powered from the white instrument bus and two powered from the yellow instrument bus. The LCO requires two hydrogen monitors to be OPERABLE, powered from independent power supplies. Therefore, one hydrogen monitor powered from the white instrument bus and one

BASES

LCO (continued)

hydrogen monitor powered from the yellow instrument bus are required to be OPERABLE.

15. Pressurizer Level

Pressurizer Level is used to determine whether to terminate SI, if still in progress, or to reinitiate SI if it has been stopped. Knowledge of pressurizer water level is also used to verify the unit conditions necessary to establish natural circulation in the RCS and to verify that the unit is maintained in a safe shutdown condition.

16. Steam Generator Water Level (Wide Range)

SG Water Level is provided to monitor operation of decay heat removal via the SGs. The Category I indication of SG level is the wide range level instrumentation. The wide range level covers a span of 0 inches to 520 inches above the lower tubesheet. The measured differential pressure is displayed in inches of water at 68°F. Redundant monitoring capability is provided by two trains of instrumentation. The level signal is input to the unit computer, a control room indicator, and an indicator in the AFW Pump Room.

17. Steam Generator Water Level (Narrow Range)

Steam Generator Water Level (Narrow Range) is a Type A variable provided to aid operators in the control of AFW Flow to maintain the SGs as a heat sink.

18. Steam Generator Pressure

Steam Generator Pressure is a Type A variable provided to detect and mitigate a SGTR event. The signals from transmitters are calibrated for a range of 0 psig to 1400 psig. Redundant monitoring capability is provided by three available trains of instrumentation for each steam generator.

19. Condensate Storage Tank (CST) Level

CST Level is provided to ensure water supply for auxiliary feedwater (AFW). The CST consists of two identical tanks connected by a common outlet header. Inventory is monitored by two 0 foot to 21.5 foot level indicators per tank. CST Level is displayed on a control room indicator, strip chart recorder, and unit computer. In addition, a control room annunciator alarms on low level.

BASES**LCO (continued)**

The DBAs that require AFW are the loss of electric power, loss of normal feedwater, steam line break (SLB), and small break LOCA.

The CST is the initial source of water for the AFW System. However, as the CST is depleted, manual operator action is necessary to replenish the CST or align suction to the AFW pumps from Service Water.

20, 21, 22, 23. Core Exit Temperature

Core Exit Temperature is provided for verification and long term surveillance of core cooling.

An evaluation was made of the minimum number of valid core exit thermocouples (CET) necessary for measuring core cooling. The evaluation determined the reduced complement of CETs necessary to detect initial core recovery and trend the ensuing core heatup. Based on these evaluations, adequate core cooling is ensured with two valid Core Exit Temperature channels per quadrant. Core Exit Temperature is used to control RCS pressure and temperature in the mitigation of a SGTR event.

Two OPERABLE channels of Core Exit Temperature are required in each quadrant to provide indication of radial distribution of the coolant temperature rise across representative regions of the core.

24. Auxiliary Feedwater Flow

AFW Flow is provided to monitor operation of decay heat removal via the SGs.

The AFW Flow to each SG is determined from a differential pressure measurement calibrated for a range of 0 gpm to 500 gpm. Each differential pressure transmitter provides an input to a control room indicator and the unit computer. Since the primary indication used by the operator during an accident is the control room indicator, the PAM specification deals specifically with this portion of the instrument channel.

AFW flow is used three ways:

- to verify delivery of AFW flow to the SGs and verify AFW flow is isolated to a faulted SG;
- to determine whether to terminate SI if still in progress, in conjunction with SG water level (narrow range); and

BASES

LCO (continued)

- to regulate AFW flow so that the SG tubes remain covered.

AFW flow is a Type A variable because operator action is required to throttle flow during an SLB accident to prevent the AFW pumps from operating in runout conditions. AFW flow is also used by the operator to verify that the AFW System is delivering the correct flow to each SG. However, the primary indication used by the operator to ensure an adequate inventory is SG level.

25. Refueling Water Storage Tank (RWST) Level

RWST Level is a Type A variable provided for verifying a water source to the SI System during the injection phase of a LOCA, and to indicate when manual switchover to recirculation is required on decreasing level. The RWST Level accuracy is established to allow an adequate supply of water to the SI pumps during the switchover to the recirculation phase of an accident. A high degree of accuracy is required to maximize the time available to the operator to complete the switchover to the sump recirculation phase and ensure sufficient water is available to maintain adequate net positive suction head (NPSH) to operating pumps.

APPLICABILITY

The PAM instrumentation LCO is applicable in MODES 1, 2, and 3. These variables are related to the diagnosis and pre-planned actions required to mitigate DBAs. The applicable DBAs are assumed to occur in MODES 1, 2, and 3. In MODES 4, 5, and 6, unit conditions are such that the likelihood of an event that would require PAM instrumentation is low; therefore, the PAM instrumentation is not required to be OPERABLE in these MODES.

ACTIONS

Note 1 has been added in the ACTIONS to exclude the MODE change restriction of LCO 3.0.4. This exception allows entry into the applicable MODE while relying on the ACTIONS even though the ACTIONS may eventually require unit shutdown. This exception is acceptable due to the passive function of the instruments, the operator's ability to respond to an accident using alternate instruments and methods, and the low probability of an event requiring these instruments.

Note 2 has been added in the ACTIONS to clarify the application of Completion Time rules. The Conditions of this Specification may be entered independently for each Function listed on Table 3.3.3-1. The Completion Time(s) of the inoperable channel(s) of a Function will be tracked separately for each Function starting from the time the Condition was entered for that Function.

BASES

ACTIONS (continued) A.1

Condition A applies when one or more Functions have one required channel that is inoperable. Required Action A.1 requires restoring the inoperable channel to OPERABLE status within 30 days. The 30 day Completion Time is based on operating experience and takes into account the remaining OPERABLE channel (or in the case of a Function that has only one required channel, other non-Regulatory Guide 1.97 instrument channels to monitor the Function), the passive nature of the instrument (no critical automatic action is assumed to occur from these instruments), and the low probability of an event requiring PAM instrumentation during this interval.

B.1

Condition B applies when the Required Action and associated Completion Time for Condition A are not met. This Required Action specifies initiation of actions in Specification 5.6.6, which requires a written report to be submitted to the NRC immediately. This report discusses the results of the root cause evaluation of the inoperability and identifies proposed restorative actions. This action is appropriate in lieu of a shutdown requirement since alternative actions are identified before loss of functional capability, and given the likelihood of unit conditions that would require information provided by this instrumentation.

C.1

Condition C applies when one or more Functions have two inoperable required channels (i.e., two channels inoperable in the same Function). Required Action C.1 requires restoring one channel in the Function(s) to OPERABLE status within 7 days. The Completion Time of 7 days is based on the relatively low probability of an event requiring PAM instrument operation and the availability of alternate means to obtain the required information. Continuous operation with two required channels inoperable in a Function is not acceptable because the alternate indications may not fully meet all performance qualification requirements applied to the PAM instrumentation. Therefore, requiring restoration of one inoperable channel of the Function limits the risk that the PAM Function will be in a degraded condition should an accident occur. Condition C is modified by a Note that excludes hydrogen monitor channels.

BASES

ACTIONS (continued) D.1

Condition D applies when two hydrogen monitor channels are inoperable. Required Action D.1 requires restoring one hydrogen monitor channel to OPERABLE status within 72 hours. The 72 hour Completion Time is reasonable based on the backup capability of the Post Accident Sampling System to monitor the hydrogen concentration for evaluation of core damage and to provide information for operator decisions. Also, it is unlikely that a LOCA (which would cause core damage) would occur during this time.

E.1

Condition E applies when the Required Action and associated Completion Time of Condition C or D are not met. Required Action E.1 requires entering the appropriate Condition referenced in Table 3.3.3-1 for the channel immediately. The applicable Condition referenced in the Table is Function dependent. Each time an inoperable channel has not met any Required Action of Condition C or D, and the associated Completion Time has expired, Condition E is entered for that channel and provides for transfer to the appropriate subsequent Condition.

F.1 and F.2

If the Required Action and associated Completion Time of Conditions C or D are not met and Table 3.3.3-1 directs entry into Condition F, the unit must be brought to a MODE where the requirements of this LCO do not apply. To achieve this status, the unit must be brought to at least MODE 3 within 6 hours and MODE 4 within 12 hours.

The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

G.1

Alternate means of monitoring Containment Area Radiation have been developed and tested. These alternate means may be used if the normal PAM channel cannot be restored to OPERABLE status within the allotted time. If these alternate means are used, the Required Action is not to shut down the unit but rather to follow the directions of Specification 5.6.6, in the Administrative Controls section of the TS. The report provided to the NRC should discuss the alternate means used, describe the degree to which the alternate means are equivalent to the installed PAM channels, justify the areas in which they are not equivalent, and provide a schedule for restoring the normal PAM channels.

BASES

SURVEILLANCE
REQUIREMENTS

A Note has been added to the SR Table to clarify that SR 3.3.3.1 applies to each PAM instrumentation Function in Table 3.3.3-1. SR 3.3.3.2 applies to Function 14 only. SR 3.3.3.3 applies to each PAM instrumentation Function in Table 3.3.3-1, except Function 12. SR 3.3.3.4 applies to Function 12 only.

SR 3.3.3.1

Performance of the CHANNEL CHECK once every 31 days ensures that a gross instrumentation failure has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the two instrument channels could be an indication of excessive instrument drift in one of the channels or of something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION. The high radiation instrumentation should be compared to similar unit instruments located throughout the unit.

Agreement criteria are determined by the unit staff, based on a combination of the channel instrument uncertainties, including isolation, indication, and readability. If a channel is outside the criteria, it may be an indication that the sensor or the signal processing equipment has drifted outside its limit. If the channels are within the criteria, it is an indication that the channels are OPERABLE.

As specified in the SR, a CHANNEL CHECK is only required for those channels that are normally energized.

The Frequency of 31 days is based on operating experience that demonstrates that channel failure is rare. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the LCO required channels.

SR 3.3.3.2

SR 3.3.3.2 requires calibration of the gas portion of the hydrogen monitors every 92 days. The calibration shall consist of a verification of the monitors response to a known concentration of hydrogen gas. The Frequency of 92 days is reasonable based on operating experience to ensure the OPERABILITY of the monitors.

BASES

SURVEILLANCE REQUIREMENTS (continued)

SR 3.3.3.3

A CHANNEL CALIBRATION is performed every 18 months, or approximately at every refueling. CHANNEL CALIBRATION is a complete check of the instrument loop, including the sensor. The test verifies that the channel responds to measured parameter with the necessary range and accuracy. This SR is modified by a Note that specifies the CHANNEL CALIBRATION of the Containment Area Radiation (High Range) detectors shall consist of a verification of a response to a source. Whenever a sensing element is replaced, the next required CHANNEL CALIBRATION of the Core Exit thermocouple sensors is accomplished by an in-place cross calibration that compares the other sensing elements with the recently installed sensing element. The Frequency is based on operating experience and consistency with the typical industry refueling cycle.

SR 3.3.3.4

SR 3.3.3.4 is the performance of a TADOT of Containment Isolation Valve Position Indication. This TADOT is performed every 18 months. The test shall independently verify the OPERABILITY of containment isolation valve position indication against the actual position of the valves.

The Frequency is based on the known reliability of the Functions and has been shown to be acceptable through operating experience.

REFERENCES

1. NRC SER Letter, "Conformance to Regulatory Guide 1.97 for the Point Beach Nuclear Plant Units 1 and 2," July 11, 1986.
 2. Regulatory Guide 1.97, Revision 2, December 1980.
 3. NUREG-0737, Supplement 1, "TMI Action Items."
-

B 3.3 INSTRUMENTATION

B 3.3.4 Loss of Power (LOP) Diesel Generator (DG) Start and Load Sequence Instrumentation

BASES

BACKGROUND

The DGs provide a source of emergency power when offsite power is either unavailable or is insufficiently stable to allow safe unit operation. Undervoltage protection will generate an LOP start if a loss of voltage or degraded voltage condition occurs on the safeguards bus. There are two LOP start signals, one for each train.

Three undervoltage relays with inverse time characteristics are provided on each 4160 Class 1E instrument bus for detecting a sustained degraded voltage condition or a loss of bus voltage. The relays are combined in a two-out-of-three logic to generate an LOP signal if the voltage is below 75% for a short time or below 90% for a long time. The LOP start actuation is described in FSAR, Section 8.8 (Ref. 1).

During a loss of voltage to the safety-related 480 V buses, protective relays initiate load shedding and block automatic SI load sequencing until voltage returns to the buses. This function is necessary to prevent overloading the DGs.

Three undervoltage relays are provided on each safety-related 480 V bus for detecting a loss of voltage. The relays are arranged in a two-out-of-three logic to generate load sequencing signals for the associated 480 V bus.

Allowable Values

The Allowable Values used in the relays are based on the analytical limits presented in FSAR, Chapter 14 (Ref. 2). The selection of these Allowable Values is such that adequate protection is provided when all sensor and processing time delays are taken into account.

The actual nominal Trip Setpoint entered into the relays is normally still more conservative than that required by the Allowable Value. If the measured setpoint does not exceed the Allowable Value, the relay is considered OPERABLE.

Setpoints adjusted in accordance with the Allowable Value ensure that the consequences of accidents will be acceptable, providing the unit is operated from within the LCOs at the onset of the accident and that the equipment functions as designed. Allowable Values are specified for each Function in the LCO. Nominal Trip Setpoints are also specified in

BASES

BACKGROUND
(continued)

the unit specific setpoint calculations. The nominal setpoints are selected to ensure that the setpoint measured by the surveillance procedure does not exceed the Allowable Value if the relay is performing as required. If the measured setpoint does not exceed the Allowable Value, the relay is considered OPERABLE. Operation with a Trip Setpoint less conservative than the nominal Trip Setpoint, but within the Allowable Value, is acceptable provided that operation and testing is consistent with the assumptions of the unit specific setpoint calculation. Each Allowable Value specified is more conservative than the analytical limit assumed in the transient and accident analyses in order to account for instrument uncertainties appropriate to the trip function.

APPLICABLE
SAFETY ANALYSES

The LOP DG start and load sequence instrumentation is required for the Engineered Safety Features (ESF) Systems to function in any accident with a loss of offsite power. Its design basis is that of the ESF Actuation System (ESFAS).

Accident analyses credit the loading of the DG based on the loss of offsite power during a loss of coolant accident (LOCA). The actual DG start has historically been associated with the ESFAS actuation. The DG loading has been included in the delay time associated with each safety system component requiring DG supplied power following a loss of offsite power. The analyses assume a non-mechanistic DG loading, which does not explicitly account for each individual component of loss of power detection and subsequent actions.

The required channels of LOP DG start and load sequence instrumentation, in conjunction with the ESF systems powered from the DGs, provide unit protection in the event of any of the analyzed accidents discussed in Reference 2, in which a loss of offsite power is assumed.

The delay times assumed in the safety analysis for the ESF equipment include the 10 second DG start delay, and the appropriate sequencing delay, if applicable. The response times for ESFAS actuated equipment in LCO 3.3.2, "Engineered Safety Feature Actuation System (ESFAS) Instrumentation," include the appropriate DG loading and sequencing delay.

The LOP DG start and load sequence instrumentation channels satisfy Criterion 3 of the NRC Policy Statement.

BASES

LCO	<p>The LCO for LOP DG start and load sequence instrumentation requires that three channels per bus of the 480 V loss of voltage Function and three channels per bus of the 4.16 KV loss of voltage and degraded voltage Functions shall be OPERABLE in MODES 1, 2, 3, and 4 when the LOP DG start and load sequence instrumentation supports safety systems associated with the ESFAS. In MODES 5 and 6, the three channels must be OPERABLE whenever the associated DG is required to be OPERABLE to ensure that the automatic start of the DG is available when needed. Loss of the LOP DG Start and Load Sequence Instrumentation Function could result in the delay of safety systems initiation when required. This could lead to unacceptable consequences during accidents. During the loss of offsite power the DG powers the motor driven auxiliary feedwater pumps. Failure of these pumps to start would leave only one turbine driven pump, as well as an increased potential for a loss of decay heat removal through the secondary system.</p>
APPLICABILITY	<p>The LOP DG Start and Load Sequence Instrumentation Functions are required in MODES 1, 2, 3, and 4 because ESF Functions are designed to provide protection in these MODES. Actuation in MODE 5 or 6 is required whenever the required DG must be OPERABLE so that it can perform its function on an LOP or degraded power to the vital bus.</p>
ACTIONS	<p>In the event a channel's Trip Setpoint is found nonconservative with respect to the Allowable Value, or the channel is found inoperable, then the function that channel provides must be declared inoperable and the LCO Condition entered for the particular protection function affected.</p> <p>Because the required channels are specified on a per bus basis, the Condition may be entered separately for each bus as appropriate.</p> <p>A Note has been added in the ACTIONS to clarify the application of Completion Time rules. The Conditions of this Specification may be entered independently for each Function listed in the LCO. The Completion Time(s) of the inoperable channel(s) of a Function will be tracked separately for each Function starting from the time the Condition was entered for that Function.</p>

A.1

Condition A applies to the LOP DG start and load sequence Function with one loss of voltage or degraded voltage channel per bus inoperable.

BASES

ACTIONS (continued) If one channel is inoperable, Required Action A.1 requires that channel to be placed in trip within 1 hour. With a channel in trip, the LOP DG start and load sequence instrumentation channels are configured to provide a one-out-of-two logic to initiate a trip of the incoming offsite power.

The specified Completion Time is reasonable considering the Function remains fully OPERABLE on every bus and the low probability of an event occurring during these intervals.

B.1

Condition B applies when more than one 4.16 kV loss of voltage or more than one 4.16 kV degraded voltage channel on a single bus is inoperable.

Required Action B.1 requires restoring all but one channel to OPERABLE status. The 1 hour Completion Time should allow ample time to repair most failures and takes into account the low probability of an event requiring an LOP start occurring during this interval.

C.1

Condition C applies when the Required Action and associated Completion Time for Condition A for 4.16 kV Functions or Condition B are not met.

In these circumstances the Conditions specified in LCO 3.8.1, "AC Sources-Operating," or LCO 3.8.2, "AC Sources-Shutdown," for the standby emergency power source made inoperable by failure of the LOP DG start instrumentation are required to be entered immediately. The actions of those LCOs provide for adequate compensatory actions to assure unit safety.

D.1

Condition D applies when more than one 480 V loss of voltage channel on a single bus is inoperable.

Required Action D.1 requires restoring all but one channel to OPERABLE status. The 1 hour Completion Time should allow ample time to repair most failures and takes into account the low probability of an event requiring an LOP start and load sequence during this interval.

BASES

ACTIONS (continued) E.1 and E.2

If the Required Action and associated Completion Time of Condition A for the 480 V loss of voltage Function or Condition D are not met, the unit must be placed in a MODE in which the LCO does not apply. This is done by placing the unit in at least MODE 3 in 6 hours and in MODE 5 in 36 hours. The Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

SURVEILLANCE
REQUIREMENTS

SR 3.3.4.1

Performance of the CHANNEL CHECK once every 12 hours ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the two instrument channels could be an indication of excessive instrument drift in one of the channels or of something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying that the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the unit staff, based on a combination of the channel instrument uncertainties, including indication and readability. If a channel is outside the criteria, it may be an indication that the sensor or the signal processing equipment has drifted outside its limit.

The Frequency is based on operating experience that demonstrates channel failure is rare. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the LCO required channels.

SR 3.3.4.2

SR 3.3.4.2 is the performance of a TADOT. This test is performed every 31 days. The test checks trip devices that provide actuation signals directly, bypassing the analog process control equipment. The Frequency is based on the known reliability of the relays and controls and the multichannel redundancy available, and has been shown to be acceptable through operating experience.

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

SR 3.3.4.3

SR 3.3.4.3 is the performance of a CHANNEL CALIBRATION.

The setpoints, as well as the response to a loss of voltage and a degraded voltage test, shall include a single point verification that the trip occurs within the required time delay, as shown in Reference 1.

A CHANNEL CALIBRATION is performed every 18 months, or approximately at every refueling. CHANNEL CALIBRATION is a complete check of the instrument loop, including the sensor. The test verifies that the channel responds to a measured parameter within the necessary range and accuracy.

The Frequency of 18 months is based on operating experience and consistency with the typical industry refueling cycle and is justified by the assumption of an 18 month calibration interval in the determination of the magnitude of equipment drift in the setpoint analysis.

REFERENCES

1. FSAR, Section 8.8.
 2. FSAR, Chapter 14.
-

B 3.3 INSTRUMENTATION

B 3.3.5 Control Room Emergency Filtration System (CREFS) Actuation Instrumentation

BASES

BACKGROUND

The CREFS provides an enclosed control room environment from which the unit can be operated following an uncontrolled release of radioactivity. The control room ventilation system normally operates in the normal operating mode (Mode 1). Upon receipt of an actuation signal, the CREFS initiates the emergency make-up (Mode 4) mode of operation. The control room ventilation system and its operating modes are described in the Bases for LCO 3.7.9, "Control Room Emergency Filtration System."

The actuation instrumentation consists of containment isolation, noble gas radiation monitor in the air intake and control room area radiation monitor. A containment isolation signal or high radiation signal from either of these detectors will initiate the emergency make-up mode of operation (Mode 4) of the CREFS.

APPLICABLE SAFETY ANALYSES

The CREFS provides airborne radiological protection for control room personnel, as demonstrated by the limiting control room dose analyses for the design basis large break loss of coolant accident. Control room dose analysis assumptions are presented in the FSAR, Section 14.3.5 (Ref. 1).

In MODES 1, 2, 3, and 4, a containment isolation signal or the CREFS radiation monitor actuation signal will provide automatic initiation of CREFS in the emergency make-up mode of operation (Mode 4) during design basis events which result in significant radiological releases to the environs (e.g. large break loss of coolant accident, steam generator tube rupture, reactor coolant pump locked rotor, etc;).

The CREFS radiation monitor actuation signal also provides automatic initiation of CREFS, in the emergency make-up mode of operation (Mode 4), to assure control room habitability in the event of a fuel handling during movement of irradiated fuel, and CORE ALTERATIONS.

Further Applicable Safety Analysis information for CREFS is contained in the Bases for LCO 3.7.9, "Control Room Emergency Filtration System."

The CREFS actuation instrumentation satisfies Criterion 3 of the NRC Policy Statement.

BASES

LCO

The LCO requirements ensure that instrumentation necessary to initiate the CREFS is OPERABLE.

1. Control Room Radiation

The LCO requires the control room area (RE-101) and the control room air intake noble gas monitor (RE-235) to be OPERABLE, to ensure that the instrumentation necessary to initiate the CREFS emergency make-up mode (Mode 4) is OPERABLE.

Table 3.3.5-1 identifies the Technical Specification Trip Setpoint for the Control Room Area Monitor and Control Room Air Intakes as not applicable (NA). No Analytical Value is assumed in the accident analysis for these functions. The nominal setting required for the Control Room Area Monitor is 5 mr/hr and the nominal setting for the Control Room Air Intakes is 5E-5 μ Ci/cc. These nominal settings were developed outside of the setpoint methodology.

2. Containment Isolation

Refer to LCO 3.3.2, Function 3, for all initiating Functions and requirements.

APPLICABILITY

The CREFS Functions must be OPERABLE in MODES 1, 2, 3, 4, and during CORE ALTERATIONS and movement of irradiated fuel assemblies.

The Applicability for the CREFS actuation on the ESFAS Safety Injection Functions are specified in LCO 3.3.2. Refer to the Bases for LCO 3.3.2 for discussion of the Safety Injection Function Applicability.

ACTIONS

A Note has been added to the ACTIONS indicating that separate Condition entry is allowed for each Function. The Conditions of this Specification may be entered independently for each Function listed in Table 3.3.5-1 in the accompanying LCO. The Completion Time(s) of the inoperable Function will be tracked separately for each Function starting from the time the Condition was entered for that Function.

A.1

Condition A applies to the containment isolation signal, control room area radiation monitor (RE-101) and the control room intake noble gas monitor (RE-235).

BASES

ACTIONS (continued) If a Function is inoperable, 7 days is permitted to restore the Function to OPERABLE status from the time the Condition was entered for that Function. The 7 day Completion Time is the same as for inoperable CREFS. The basis for this Completion Time is the same as provided in LCO 3.7.9. If the Function cannot be restored to OPERABLE status, CREFS must be placed in the emergency make-up mode of operation (MODE 4). Placing CREFS in the emergency make-up mode of operation accomplishes the actuation instrumentation's safety function.

B.1, B.2, B.3, and B.4

Condition B applies when the Required Action and associated Completion Time for Condition A have not been met. If Movement of irradiated fuel assemblies or CORE ALTERATIONS are in progress, these activities must be suspended immediately to reduce the risk of accidents that would require CREFS actuation. In addition, if any unit is in MODE 1, 2, 3, or 4, the unit must be brought to a MODE in which the LCO requirements are not applicable. To achieve this status, the unit must be brought to MODE 3 within 6 hours and MODE 5 within 36 hours. The allowed Completion Times are reasonable, based on operating experience, to reach the required unit conditions from full power conditions in an orderly manner and without challenging unit systems.

The Required Actions for Condition B are modified by a Note that states that Required Actions B.1 and B.2 are not applicable for inoperability of the Containment Isolation actuation function. This note is necessary because the Applicability for the Containment Isolation actuation function is Modes 1, 2, 3, and 4. The Containment Isolation actuation function is not used for mitigation of accidents involving the movement of irradiated fuel assemblies.

SURVEILLANCE REQUIREMENTS

A Note has been added to the SR Table to clarify that Table 3.3.5-1 determines which SRs apply to which CREFS Actuation Functions.

SR 3.3.5.1

Performance of the CHANNEL CHECK once every 12 hours ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. However, in the case of the control room area and control room intake noble gas monitors, no independent instrument channel exist, therefore, the CHANNEL CHECK for these monitors will consist of a qualitative assessment of expected channel behavior, based on current plant and

BASES

SURVEILLANCE
REQUIREMENTS
(continued)

control room conditions. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION. The Frequency is based on operating experience that demonstrates channel failure is rare.

SR 3.3.5.2

A COT is performed once every 92 days on each required channel to ensure the entire channel will perform the intended function. This test verifies the capability of the instrumentation to provide the CREFS actuation. The setpoints shall be left consistent with the unit specific calibration procedure tolerance. The Frequency is based on the known reliability of the monitoring equipment and has been shown to be acceptable through operating experience.

SR 3.3.5.3

A CHANNEL CALIBRATION is performed every 18 months, or approximately at every refueling. CHANNEL CALIBRATION is a complete check of the instrument loop, including the sensor. The test verifies that the channel responds to a measured parameter within the necessary range and accuracy.

The Frequency is based on operating experience and is consistent with the typical industry refueling cycle.

REFERENCES

FSAR. Section 14.3.5.

B 3.3 INSTRUMENTATION

B 3.3.6 Boron Dilution Alarm

BASES

BACKGROUND	The primary purpose of the Boron Dilution Alarm is to alert the operator to the potential for an inadvertent addition of unborated primary grade water into the Reactor Coolant System (RCS) when the reactor is in the cold shutdown condition (i.e., MODE 5).
APPLICABLE SAFETY ANALYSES	The Boron Dilution Alarm is actuated when the reactor water makeup pump discharge valve is not shut. The accident analyses require operator action within 15 minutes of the initiation of reactor coolant dilution to prevent a loss of shutdown margin. The Boron Dilution Alarm is necessary to ensure operator awareness of the potential for an inadvertent boron dilution event.
LCO	LCO 3.3.6 provides the requirements for OPERABILITY of the Boron Dilution Alarm.
APPLICABILITY	The Boron Dilution Alarm must be OPERABLE in MODE 5, because the safety analysis identifies the alarm as the primary means of alerting the operator to the potential for an inadvertent boron dilution of the RCS with the unit in this condition.
ACTIONS	<u>A.1</u> With the Boron Dilution Alarm inoperable, Required Action A.1 requires the closure of isolation valve(s) to prevent the flow of unborated water through FCV-111, Reactor Makeup Water To Boric Acid Blender Flow Control Valve, into the RCS. This Required Action can be satisfied by closure of FCV-111. The Completion Time of 1 hour is adequate to secure the valve(s).
SURVEILLANCE REQUIREMENTS	<u>SR 3.3.6.1</u> SR 3.3.6.1 requires the performance of a TADOT every 18 months, to ensure the Boron Dilution Alarm is operational. The Frequency of 18 months is consistent with the typical industry refueling cycle.
REFERENCES	1. FSAR, Chapter 14.
