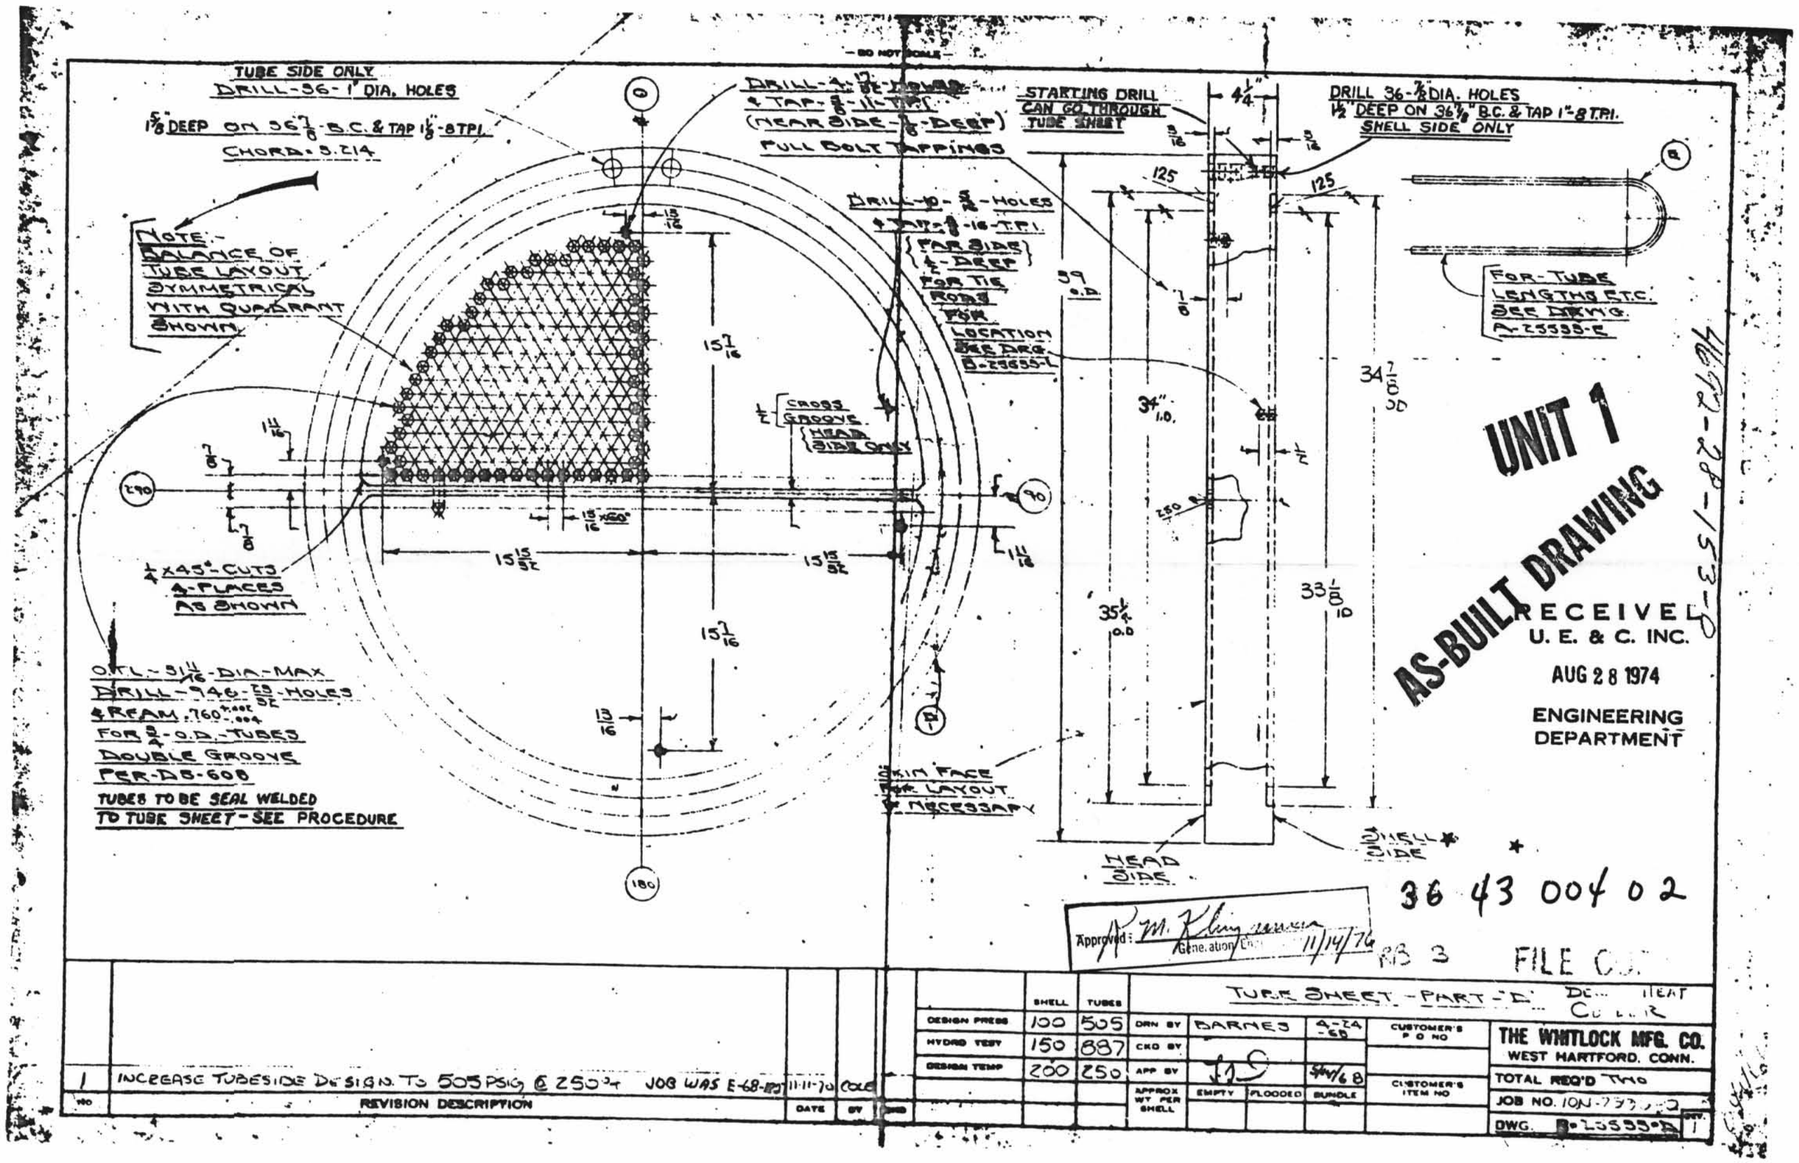

NO	REVISION DESCRIPTION	DATE	BY	CHKD
1	INCREASE TUBESIDE DESIGN TO 505 PSIG @ 250°F JOB WAS E-68-[illegible]	11-11-70	COLE	

	SHELL	TUBES
DESIGN PRESS	100	505
HYDRO TEST	150	887
DESIGN TEMP	200	250

TUBE SHEET - PART "D" DE... HEAT CO...

DRN BY	BARNES	4-24-68	CUSTOMER'S P O NO
CKD BY			
APP BY	[illegible]	5/4/68	CUSTOMER'S ITEM NO
APPROX WT PER SHELL	EMPTY	FLOODED	BUNDLE

THE WHITLOCK MFG. CO.
WEST HARTFORD, CONN.
TOTAL REQ'D TWO
JOB NO. 10N-[illegible]
DWG. B-25555-D REV. 1

D-6