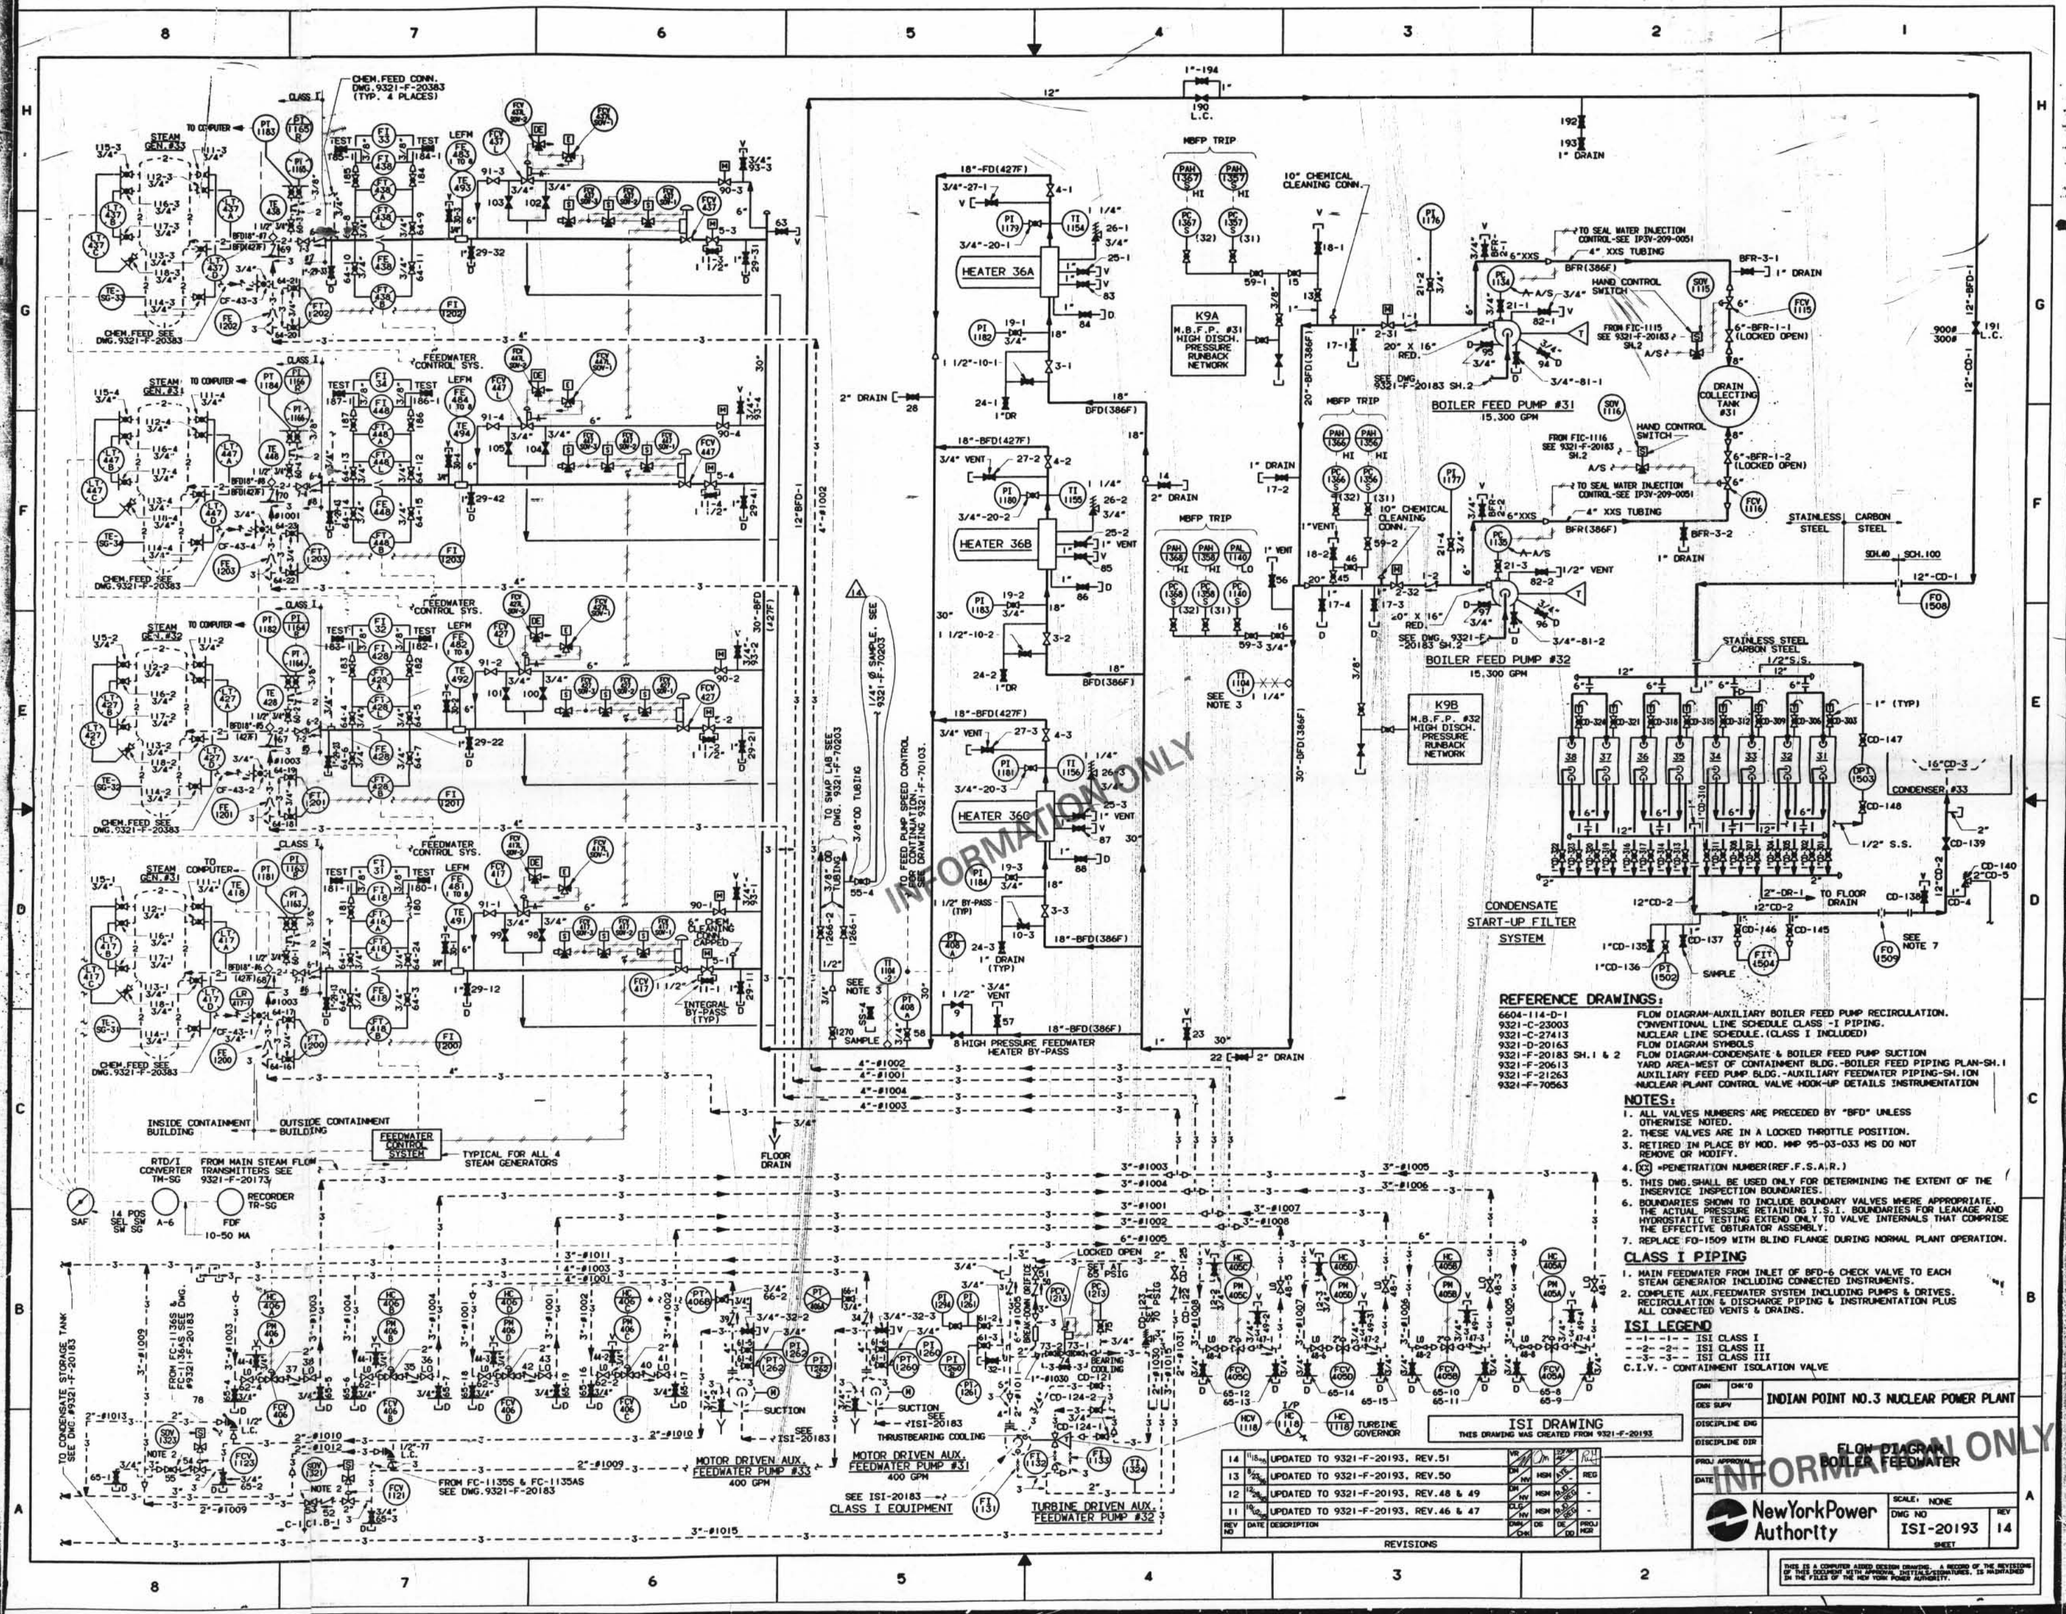

REFERENCE DRAWINGS:

6604-114-D-1	FLOW DIAGRAM-AUXILIARY BOILER FEED PUMP RECIRCULATION.
9321-C-23003	CONVENTIONAL LINE SCHEDULE CLASS -I PIPING.
9321-C-27413	NUCLEAR LINE SCHEDULE.(CLASS I INCLUDED)
9321-D-20163	FLOW DIAGRAM SYMBOLS
9321-F-20183 SH.1 & 2	FLOW DIAGRAM-CONDENSATE & BOILER FEED PUMP SUCTION
9321-F-20613	YARD AREA-WEST OF CONTAINMENT BLDG.-BOILER FEED PIPING PLAN-SH.1
9321-F-21263	AUXILIARY FEED PUMP BLDG.-AUXILIARY FEEDWATER PIPING-SH.1ON
9321-F-70563	NUCLEAR PLANT CONTROL VALVE HOOK-UP DETAILS INSTRUMENTATION

NOTES:

1. ALL VALVES NUMBERS ARE PRECEDED BY "BFD" UNLESS OTHERWISE NOTED.
2. THESE VALVES ARE IN A LOCKED THROTTLE POSITION.
3. RETIRED IN PLACE BY MOD. MMP 95-03-033 MS DO NOT REMOVE OR MODIFY.
4. (XX) =PENETRATION NUMBER(REF.F.S.A.R.)
5. THIS DWG.SHALL BE USED ONLY FOR DETERMINING THE EXTENT OF THE INSERVICE INSPECTION BOUNDARIES.
6. BOUNDARIES SHOWN TO INCLUDE BOUNDARY VALVES WHERE APPROPRIATE. THE ACTUAL PRESSURE RETAINING I.S.I. BOUNDARIES FOR LEAKAGE AND HYDROSTATIC TESTING EXTEND ONLY TO VALVE INTERNALS THAT COMPRISE THE EFFECTIVE OBTURATOR ASSEMBLY.
7. REPLACE FO-1509 WITH BLIND FLANGE DURING NORMAL PLANT OPERATION.

CLASS I PIPING

1. MAIN FEEDWATER FROM INLET OF BFD-6 CHECK VALVE TO EACH STEAM GENERATOR INCLUDING CONNECTED INSTRUMENTS.
2. COMPLETE AUX.FEEDWATER SYSTEM INCLUDING PUMPS & DRIVES. RECIRCULATION & DISCHARGE PIPING & INSTRUMENTATION PLUS ALL CONNECTED VENTS & DRAINS.

ISI LEGEND

--1--1-- ISI CLASS I
--2--2-- ISI CLASS II
--3--3-- ISI CLASS III
C.I.V. - CONTAINMENT ISOLATION VALVE

INFORMATION ONLY

THIS IS A COMPUTER AIDED DESIGN DRAWING. A RECORD OF THE REVISIONS OF THIS DOCUMENT WITH APPROVAL INITIALS/SIGNATURES, IS MAINTAINED ON THE FILES OF THE NEW YORK POWER AUTHORITY.