

September 21, 1989

Docket Nos. 50-369
50-370

Mr. H. B. Tucker, Vice President
Nuclear Production Department
Duke Power Company
422 South Church Street
Charlotte, North Carolina 28242

Dear Mr. Tucker:

SUBJECT: CORRECTION TO OPERATING LICENSE AMENDMENTS (TACS 71963/71964)

My July 18, 1989, letter forwarded Amendments 100 and 82 to Facility Operating Licenses NPF-9 and NPF-17 to the McGuire Nuclear Station, Units 1 and 2. The amendments included revised Technical Specification pages. Please replace page 3/4 4-33 included with that letter with the enclosed corrected page.

Sincerely,

/s/

Darl S. Hood, Project Manager
Project Directorate II-3
Division of Reactor Projects - I/II

Enclosure:
As stated

cc w/encl:
See next page

DF01
1/1

DISTRIBUTION

| | | | |
|----------------|---------|------------------------|-----------|
| Docket File | | M. Rood | 14-H-25 |
| NRC PDR | | D. Hood | 14-H-25 |
| Local PDR | | OGC (For inform. Only) | 15-B-18 |
| PDII-3 Reading | | E. Jordan | MNBB-3302 |
| S. Varga | 14-E-4 | B. Grimes | 9-A-2 |
| G. Lainas | 14-H-3 | ACRS (10) | P-315 |
| D. Matthews | 14-H-25 | [McGuire Plant File] | |

| | | | | | | | |
|------|------------------|------------------|--------------------|---|---|---|---|
| OFC | : PDII-3 | : PDII-3 | : PDII-3 <i>MM</i> | : | : | : | : |
| NAME | : <i>MRood</i> | : DHood | : DMatthews | : | : | : | : |
| DATE | : <i>9/15/89</i> | : <i>9/18/89</i> | : <i>9/19/89</i> | : | : | : | : |

OFFICIAL RECORD COPY
Document Name: TUCKER LTR 9/15

8909260017 890921
PDR ADDCK 05000369
P PNU

DF1



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

September 21, 1989

Docket Nos. 50-369
50-370

Mr. H. B. Tucker, Vice President
Nuclear Production Department
Duke Power Company
422 South Church Street
Charlotte, North Carolina 28242

Dear Mr. Tucker:

SUBJECT: CORRECTION TO OPERATING LICENSE AMENDMENTS (TACS 71963/71964)

My July 18, 1989, letter forwarded Amendments 100 and 82 to Facility Operating Licenses NPF-9 and NPF-17 to the McGuire Nuclear Station, Units 1 and 2. The amendments included revised Technical Specification pages. Please replace page 3/4 4-33 included with that letter with the enclosed corrected page.

Sincerely,

Darl S. Hood, Project Manager
Project Directorate II-3
Division of Reactor Projects - I/II

Enclosure:
As stated

cc w/encl:
See next page

Mr. H. B. Tucker
Duke Power Company

McGuire Nuclear Station

cc:

Mr. A.V. Carr, Esq.
Duke Power Company
P. O. Box 33189
422 South Church Street
Charlotte, North Carolina 28242

Dr. John M. Barry
Department of Environmental Health
Mecklenburg County
1200 Blythe Boulevard
Charlotte, North Carolina 28203

County Manager of Mecklenburg County
720 East Fourth Street
Charlotte, North Carolina 28202

Mr. Dayne H. Brown, Chief
Radiation Protection Branch
Division of Facility Services
Department of Human Resources
701 Barbour Drive
Raleigh, North Carolina 27603-2008

Mr. J. S. Warren
Duke Power Company
Nuclear Production Department
P. O. Box 33189
Charlotte, North Carolina 28242

Mr. Alan R. Herdt, Chief
Project Branch #3
U.S. Nuclear Regulatory Commission
101 Marietta Street, NW, Suite 2900
Atlanta, Georgia 30323


J. Michael McGarry, III, Esq.
Bishop, Cook, Purcell and Reynolds
1400 L Street, N.W.
Washington, D. C. 20005

Ms. Karen E. Long
Assistant Attorney General
N. C. Department of Justice
P.O. Box 629
Raleigh, North Carolina 27602

Senior Resident Inspector
c/o U.S. Nuclear Regulatory Commission
Route 4, Box 529
Huntersville, North Carolina 28078

Regional Administrator, Region II
U.S. Nuclear Regulatory Commission
101 Marietta Street, N.W., Suite 2900
Atlanta, Georgia 30323

Ms. S. S. Kilborn
Area Manager, Mid-South Area
ESSD Projects
Westinghouse Electric Corporation
MNC West Tower - Bay 239
P. O. Box 355
Pittsburgh, Pennsylvania 15230

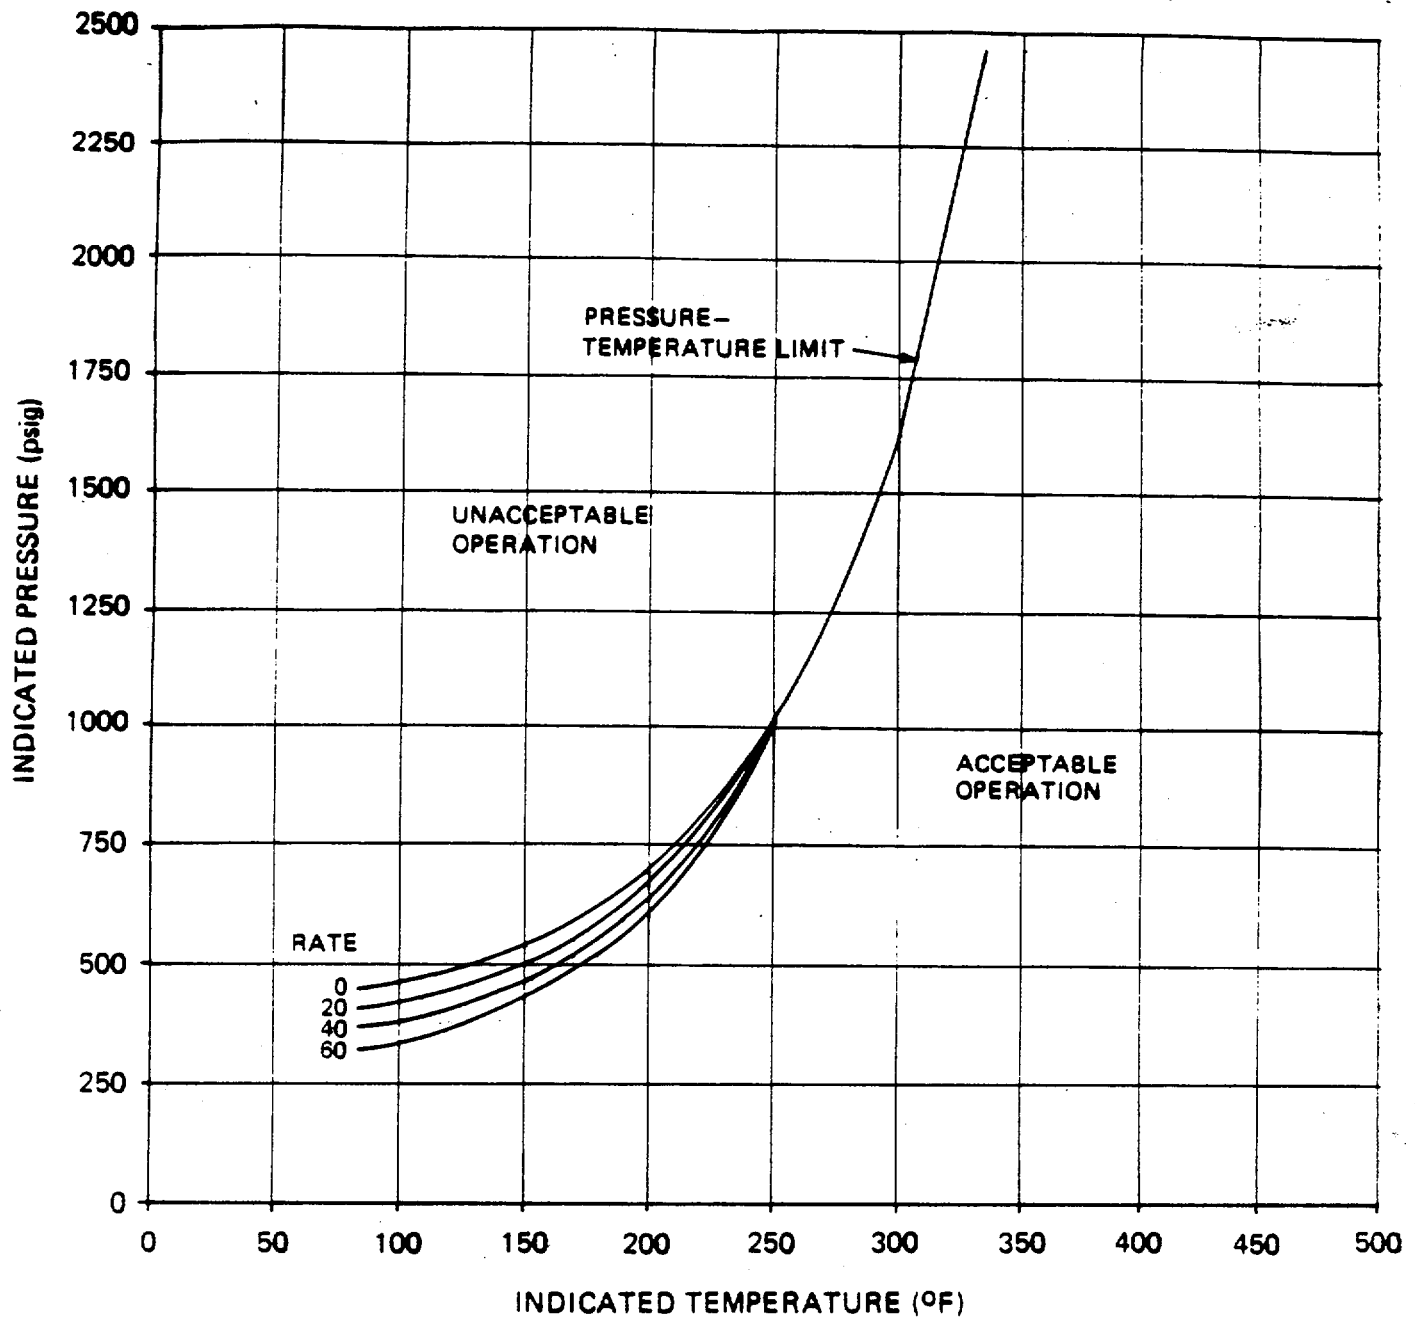

CURVES APPLICABLE FOR COOLDOWN RATES UP TO 60°F/HR FOR THE SERVICE PERIOD UP TO 10 EFPY CONTAINS MARGIN FOR POSSIBLE INSTRUMENT ERRORS.

MATERIAL BASIS
 CONTROLLING MATERIAL - WELD METAL
 COPPER CONTENT - 0.30wt%
 PHOSPHORUS CONTENT - 0.013wt%
 RT_{NDT} INITIAL - 0°F 1/4T, 165.5°F
 RT_{NDT} AFTER 10 EFPY 3/4T, 113°F

FIGURE 3.4-4 MCGUIRE UNIT 1, REACTOR COOLANT SYSTEM, COOLDOWN LIMITATIONS NRC RG 1.99 REV 2 APPLICABLE FOR THE FIRST 10 EFPY