

October 3, 1994

Mr. Oliver D. Kingsley, Jr.
President, TVA Nuclear and
Chief Nuclear Officer
Tennessee Valley Authority
6A Lookout Place
1101 Market Street
Chattanooga, TN 37402-2801

SUBJECT: CORRECTION TO AMENDMENT NOS. 167 AND 157
(TAC NOS. M83068 AND M83069) (TS 92-01)

Dear Mr. Kingsley:

By letter dated April 28, 1993, the Commission issued Amendment No. 167 to Facility Operating License No. DPR-77 and Amendment No. 157 to Facility Operating License No. DPR-79 for the Sequoyah Nuclear Plant, Units 1 and 2, respectively. This was in response to your amendment request dated March 27, 1992.

By letter dated September 26, 1994, you indicated that a typographical error had been found in Figure 5.6-3 of the submittal. The mathematical sign in front of the third term of the equation defining the Domain II Boundary fuel burn-up should be negative rather than positive. The correct equation is shown on Technical Specifications page 5-5, Design Features Section 5.6.1.1.c.3, which is the equation that was used to generate the curve in Figure 5.6-3. Enclosed is the corrected page to the Technical Specifications for Sequoyah Nuclear Plant Units 1 and 2.

Sincerely,

Original signed by

David E. LaBarge, Sr. Project Manager
Project Directorate II-4
Division of Reactor Projects - I/II
Office of Nuclear Reactor Regulation

Docket Nos. 50-327 and 50-328

Enclosures: 1. Corrected Figure 5.6-3, Unit 1
2. Corrected Figure 5.6-3, Unit 2

cc w/enclosures: See next page

DOCUMENT NAME: G:\SQN\83068.LTR

To receive a copy of this document, indicate in the box: "C" = Copy without attachment/enclosure
"E" = Copy with attachment/enclosure "N" = No copy

OFFICE	PDII-4/LAC	E	PDII-4/PM	E	PDII-4/D	C		
NAME	BC1/Edon		DLaBarge		FHebdon			
DATE	10/3/94		10/3/94		10/3/94			


OFFICIAL RECORD COPY

050029

9410110143 941003
PDR ADDCK 05000327
P PDR

NRC FILE CENTER COPY


DFU

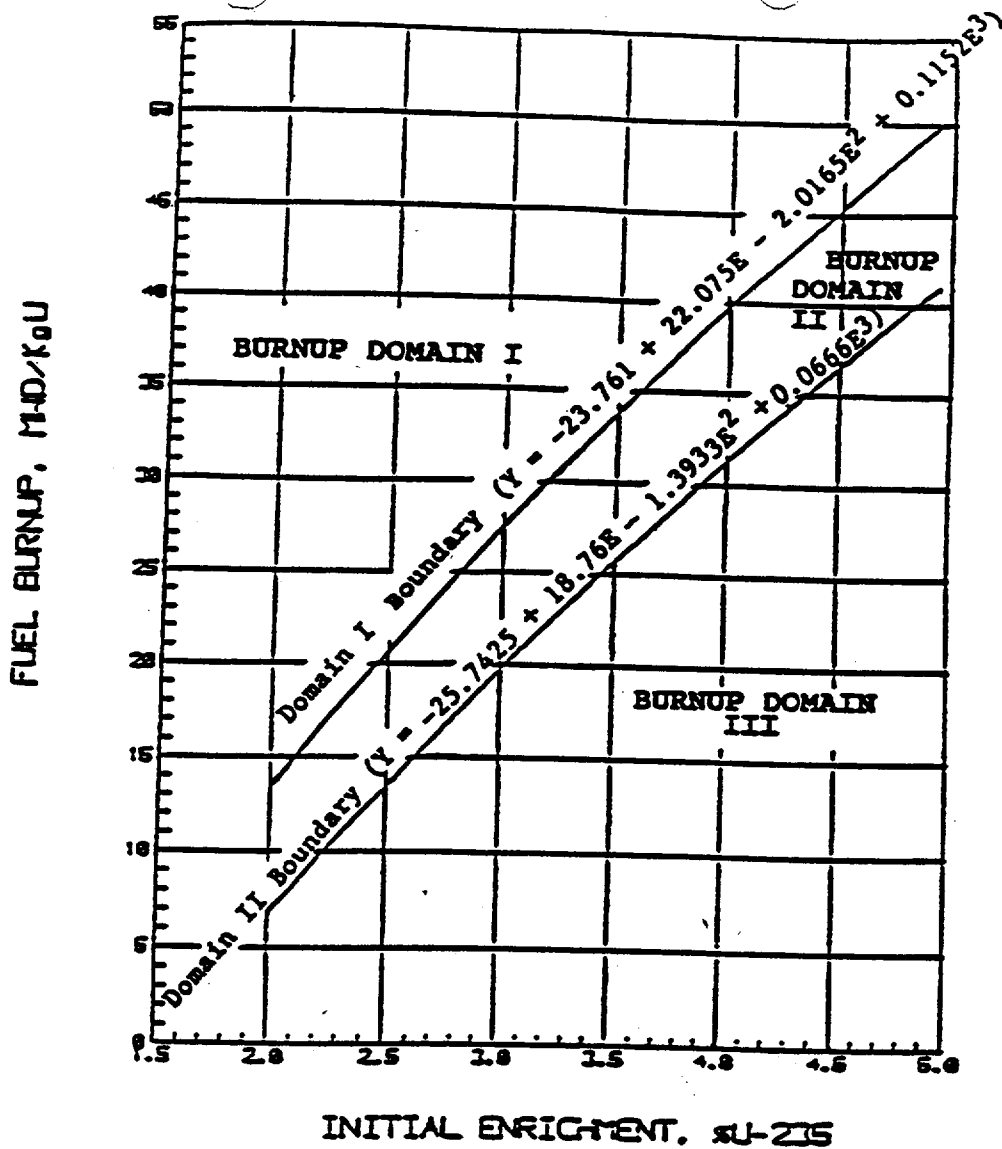

- Domain I:** Fuel assemblies with initial enrichment-burnup combinations in Domain I may be placed in either Region 1, 2, or 3 storage cells.
- Domain II:** Fuel assemblies with initial enrichment-burnup combinations in Domain II shall be placed only in Region 1 or 3 storage cells.
- Domain III:** Fuel assemblies with initial enrichment-burnup combinations in Domain III shall be placed only in Region 1 storage cells

FIGURE 5.6-3

9410110153 941003
PDR ADOCK 05000323
P PDR

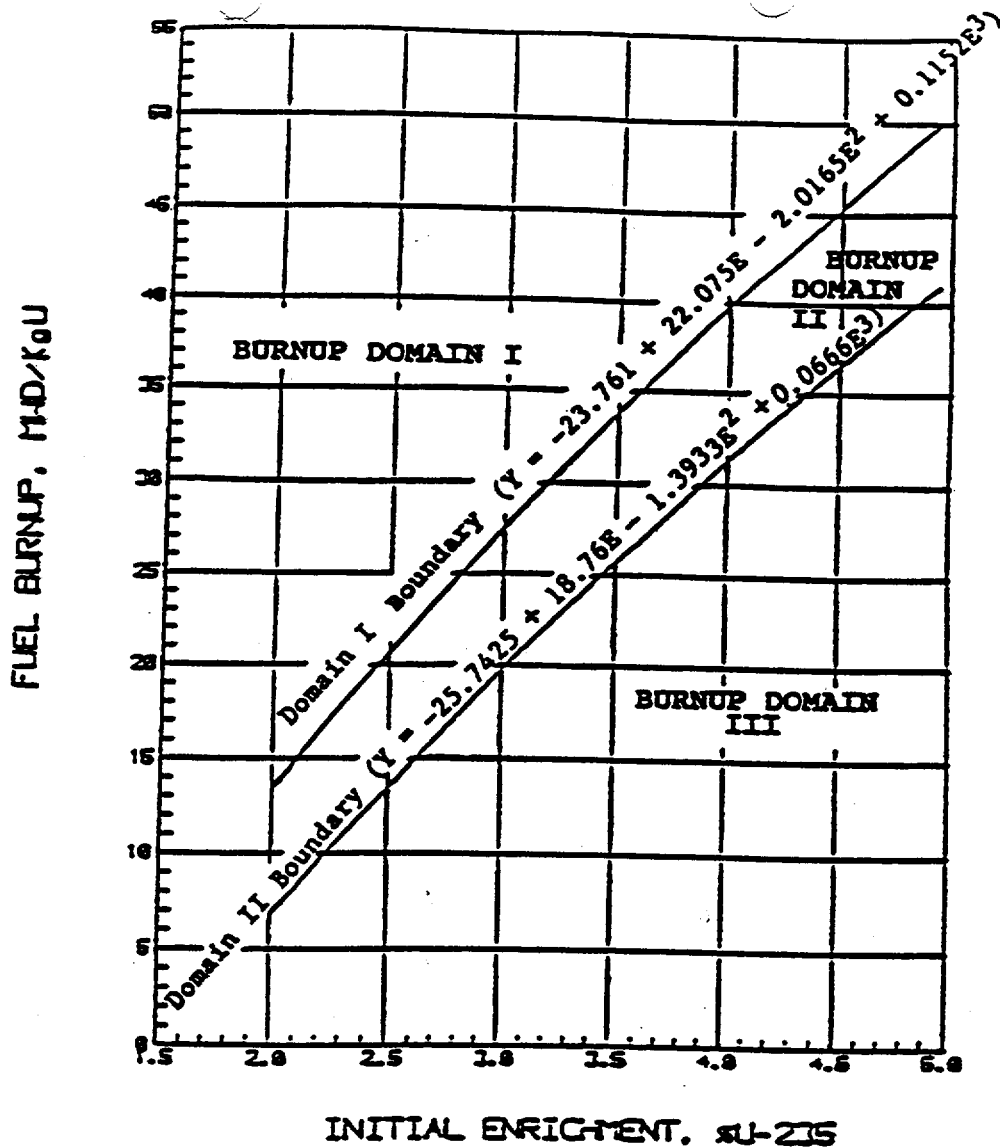

- Domain I:** Fuel assemblies with initial enrichment-burnup combinations in Domain I may be placed in either Region 1, 2, or 3 storage cells.
- Domain II:** Fuel assemblies with initial enrichment-burnup combinations in Domain II shall be placed only in Region 1 or 3 storage cells.
- Domain III:** Fuel assemblies with initial enrichment-burnup combinations in Domain III shall be placed only in Region 1 storage cells

FIGURE 5.6-3

Distribution

Docket File

PUBLIC

SQN Reading

S. Varga

D. Hagan, AEOD/IRB

G. Hill (4)

C. Grimes, DORS/OTSB

W. Jones

J. Minns

M. Sykes

L. Kopp

D. Naujock

S. Jones

ACRS (10)

OPA

OC/LFDCB

P. Fredrickson, RII

B. Boger, RII