

DISTRIBUTION

Docket Files  
NRC PDR  
Local PDR  
NSIC  
TERA  
ORB L File  
D. Eisenhut  
S. Varga  
M. Grotenhuis  
C. Parrish  
OELD  
I&E (5)  
G. Deegan (8)  
D. Brinkman  
ACRS (10)

DEC 4 1981

Docket Nos. 50-250  
and 50-251

Dr. Robert E. Uhrig, Vice President  
Advanced Systems and Technology  
Florida Power and Light Company  
Post Office Box 529100  
Miami, Florida 33152

Dear Dr. Uhrig:

On November 4, 1981 Amendment Nos. 73 and 67 to Facility Operating License Nos. DPR-31 and DPR-41 for the Turkey Point Plant Unit Nos. 3 and 4. Inadvertently page 1-6 item 1.16 had an incorrect title and Page 4.10-1 was not included. Enclosed are the correct pages 1-6 and 4.10-1 for your use.


Sincerely,

Original Signed By:

Marshall Grotenhuis, Project Manager  
Operating Reactors Branch No. 1  
Division of Licensing

Enclosures:  
As stated

cc: See next page

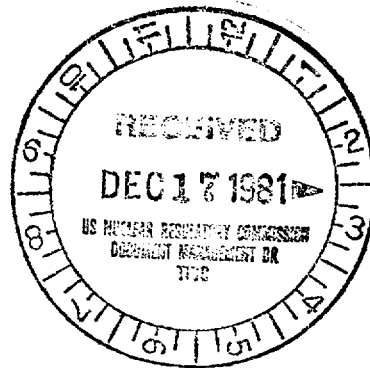

B201060194 B11204  
PDR ADOCK 05000250  
P PDR

OFFICE	ORB 1	ORB 1	ORB-1				
SURNAME	MGrotenhuis	rs SVarga	KParrish				
DATE	11/24/81	11/24/81	11/25/81				

Robert E. Uhrig  
Florida Power and Light Company

cc: Mr. Robert Lowenstein, Esquire  
Lowenstein, Newman, Reis and Axelrad  
1025 Connecticut Avenue, N.W.  
Suite 1214  
Washington, D. C. 20036

Environmental and Urban Affairs Library  
Florida International University  
Miami, Florida 33199

Mr. Norman A. Coll, Esquire  
Steel, Hector and Davis  
1400 Southeast First National  
Bank Building  
Miami, Florida 33131

Mr. Henry Yaeger, Plant Manager  
Turkey Point Plant  
Florida Power and Light Company  
P. O. Box 013100  
Miami, Florida 33101

Honorable Dewey Knight  
County Manager of Metropolitan  
Dade County  
Miami, Florida 33130

Bureau of Intergovernmental Relations  
660 Apalachee Parkway  
Tallahassee, Florida 32304

Resident Inspector  
Turkey Point Nuclear Generating Station  
U. S. Nuclear Regulatory Commission  
Post Office Box 1207  
Homestead, Florida 33030

Regional Radiation Representative  
EPA Region IV  
345 Courtland Street, N.W.  
Atlanta, Georgia 30308

Mr. Jack Shreve  
Office of the Public Counsel  
Room 4, Holland Building  
Tallahassee, Florida 32304

Administrator  
Department of Environmental  
Regulation  
Power Plant Siting Section  
State of Florida  
2600 Blair Stone Road  
Tallahassee, Florida 32301

1.16 REACTOR COOLANT PUMPS

The reactor shall not be operated with less than three reactor coolant pumps in operation.

1.17 LOW POWER PHYSICS TESTS

Low power physics tests are tests below a nominal 5% of rated power which measure fundamental characteristics of the reactor core and related instrumentation.

1.18 ENGINEERED SAFETY FEATURES

Features such as containment, emergency core cooling, and containment atmospheric cleanup systems for mitigating the consequences of postulated accidents.

1.19 REACTOR PROTECTION SYSTEM

Systems provided to act, if needed, to avoid exceeding a safety limit in anticipated transients and to activate appropriate engineered safety features as necessary.

1.20 SAFETY RELATED SYSTEMS AND COMPONENTS

Those plant features necessary to assure the integrity of the reactor coolant pressure boundary, the capability to shutdown the reactor and maintain it in a safe shutdown condition, or the capability to prevent or mitigate the consequences of accidents which could result in off-site exposures comparable to the guideline exposures of 10 CFR 100.

1.21 PER ANNUM

During each calendar year.

## 4.10

## AUXILIARY FEEDWATER SYSTEM

Applicability: Applies to periodic testing requirements of the auxiliary feedwater system.

Objective: To verify the operability of the auxiliary feedwater system and its ability to respond properly when required.

- Specifications:
1. Each turbine-driven auxiliary feedwater pump shall be started at intervals not greater than one month, run for 15 minutes and a flow rate of 600 gpm established to the steam generators. The monthly frequency is not intended to require the test while at cold shutdown. The testing requirement is met by performing this test during startup subsequent to cold shutdown.
  2. The auxiliary feedwater discharge valves shall be tested by operator action during pump tests.
  3. Steam supply and turbine pressure valves shall be tested during pump tests.
  4. These tests shall be considered satisfactory if control panel indication and visual observation of the equipment demonstrate that all components have operated properly.
  5. At least once per 18 months:
    - a. Verify that such automatic valve in the flow path actuates to its correct position upon receipt of each auxiliary feedwater actuation test signal.
    - b. Verify that each auxiliary feedwater pump receives a start signal as designed automatically upon receipt of each auxiliary feedwater actuation test signal.

N.A. during cold or refueling shutdowns (only for the Unit at cold or refueling shutdown). The specified tests, however shall be performed within one surveillance interval prior to starting the turbine.

Amendment No. 73 & 67