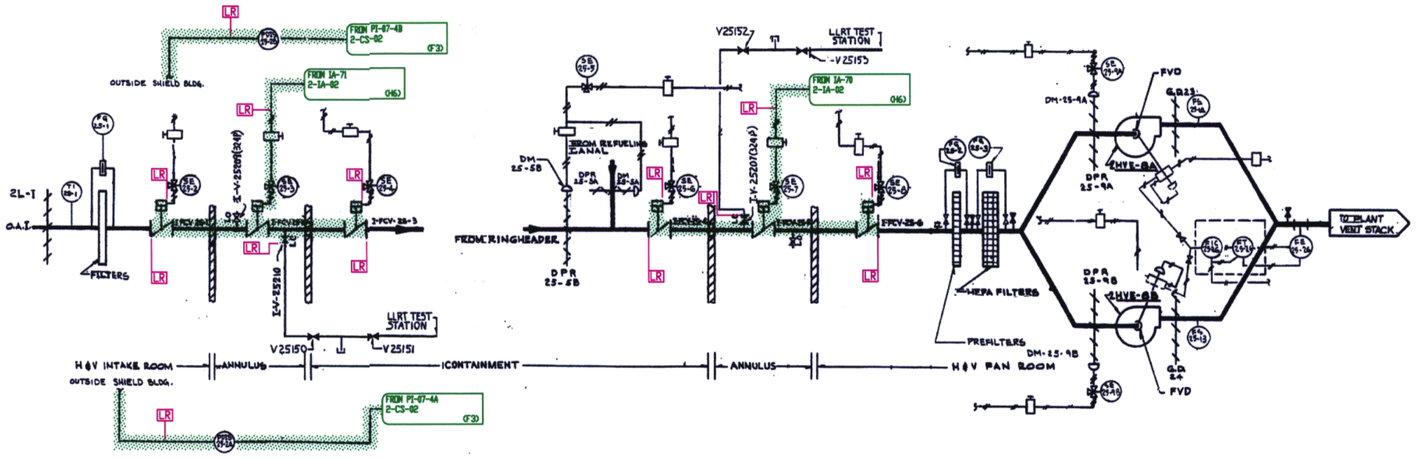

CONTAINMENT PURGE SYSTEM

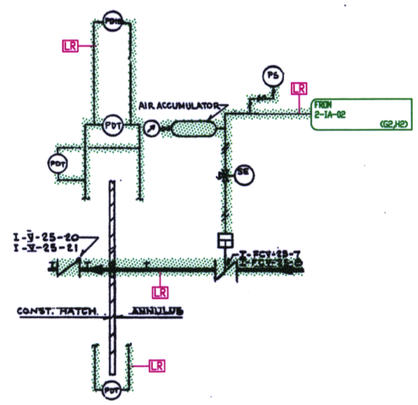

CONTAINMENT VACUUM RELIEF

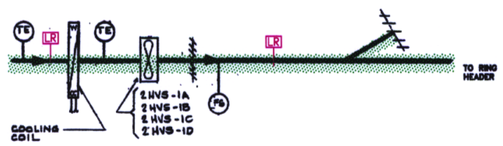

CONTAINMENT COOLING



INTAKE STRUCTURE EXHAUST [LR]

D-050

NOTES:

1. FOR GENERAL NOTES & LEGEND SEE DRAWING NO. 2-NOTES-01.

FLORIDA POWER & LIGHT
ST. LUCIE NUCLEAR UNIT 2

CONTAINMENT & MISCELLANEOUS HVAC

LICENSE RENEWAL BOUNDARY DRAWING

DRAWING NUMBER	REVISION
2-HVAC-01	0

2HVAC02.DWG