

February 17, 1994

Docket Nos. 50-338
and 50-339

DISTRIBUTION
See attached sheet

Mr. W. L. Stewart
Senior Vice President - Nuclear
Virginia Electric and Power Company
5000 Dominion Blvd.
Glen Allen, Virginia 23060

Dear Mr. Stewart:

SUBJECT: NORTH ANNA UNITS 1 AND 2 - ISSUANCE OF AMENDMENTS RE: IMPLEMENTATION
OF THE REVISED 10 CFR PART 20 (TAC NOS. M87027 AND M87028)

The Commission has issued the enclosed Amendment Nos. 178 and 159 to Facility Operating License Nos. NPF-4 and NPF-7 for the North Anna Power Station, Units No. 1 and No. 2 (NA-1&2). The amendments revise the Technical Specifications (TS) in response to your letter dated July 16, 1993, as supplemented by letter dated November 15, 1993.

The amendments implement the revised 10 CFR Part 20, Standards for Protection Against Radiation.

We are continuing the evaluation of your proposed revision to the definition of "UNRESTRICTED AREA" and, therefore, will not address this change at this time. We will notify you when this matter is resolved.

A copy of the Safety Evaluation is also enclosed. The Notice of Issuance will be included in the Commission's biweekly Federal Register notice.

Sincerely,

(Original Signed By)

Leon B. Engle, Project Manager
Project Directorate II-2
Division of Reactor Projects - I/II
Office of Nuclear Reactor Regulation

9403030124 940217
PDR ADOCK 05000338
P PDR

Enclosures:

1. Amendment No. 178 to NPF-4
2. Amendment No. 159 to NPF-7
3. Safety Evaluation

cc w/enclosures:
See next page

Distribution - See next page

OFC	:LA:PDII-2	:PM:PDII-2	:D:PDII-2	:OGC	:	:
NAME	:ETana <i>ETT</i>	:L. Engle <i>LE</i>	:H. Berkov <i>Berkov</i>	:	:	:
DATE	:12/3/93	:12/3/93	:2/17/93	:02/13/94	:	:
	2	4	2	94		

OFFICIAL RECORD COPY - DOCUMENT NAME: C:\AUTOS\WPDOCS\NOANNA\NA87027.AMD

240048

NRG FILE CENTER COPY

CP-1

DF01

DATED: February 17, 1994

AMENDMENT NO. 178 TO FACILITY OPERATING LICENSE NO. NPF-4-NORTH ANNA UNIT 1
AMENDMENT NO. 159 TO FACILITY OPERATING LICENSE NO. NPF-7-NORTH ANNA UNIT 2

Docket File
NRC & Local PDRs
PDII-2 Reading
S. Varga, 14/E/4
H. Berkow
E. Tana
L. Engle
OGC
D. Hagan, 3302 MNBB
G. Hill (2), P-137
C. Grimes, 11/F/23
ACRS (10)
OPA
OC/LFDCB
M. Sinkule, R-II

DATED: February 17, 1994

AMENDMENT NO. 178 TO FACILITY OPERATING LICENSE NO. NPF-4-NORTH ANNA UNIT 1
AMENDMENT NO. 159 TO FACILITY OPERATING LICENSE NO. NPF-7-NORTH ANNA UNIT 2

Docket File
NRC & Local PDRs
PDII-2 Reading
S. Varga, 14/E/4
H. Berkow
E. Tana
L. Engle
OGC
D. Hagan, 3302 MNBB
G. Hill (2), P-137
C. Grimes, 11/F/23
ACRS (10)
OPA
OC/LFDCB
M. Sinkule, R-II

February 17, 1994

Docket Nos. 50-338
and 50-339

DISTRIBUTION
See attached sheet

Mr. W. L. Stewart
Senior Vice President - Nuclear
Virginia Electric and Power Company
5000 Dominion Blvd.
Glen Allen, Virginia 23060

Dear Mr. Stewart:

SUBJECT: NORTH ANNA UNITS 1 AND 2 - ISSUANCE OF AMENDMENTS RE: IMPLEMENTATION
OF THE REVISED 10 CFR PART 20 (TAC NOS. M87027 AND M87028)

The Commission has issued the enclosed Amendment Nos. 178 and 159 to Facility Operating License Nos. NPF-4 and NPF-7 for the North Anna Power Station, Units No. 1 and No. 2 (NA-1&2). The amendments revise the Technical Specifications (TS) in response to your letter dated July 16, 1993, as supplemented by letter dated November 15, 1993.

The amendments implement the revised 10 CFR Part 20, Standards for Protection Against Radiation.

We are continuing the evaluation of your proposed revision to the definition of "UNRESTRICTED AREA" and, therefore, will not address this change at this time. We will notify you when this matter is resolved.

A copy of the Safety Evaluation is also enclosed. The Notice of Issuance will be included in the Commission's biweekly Federal Register notice.

Sincerely,

(Original Signed By)

Leon B. Engle, Project Manager
Project Directorate II-2
Division of Reactor Projects - I/II
Office of Nuclear Reactor Regulation

Enclosures:

1. Amendment No. 178 to NPF-4
2. Amendment No. 159 to NPF-7
3. Safety Evaluation

cc w/enclosures:

See next page

Distribution - See next page

OFC :LA:PDII-2 :PM:PDII-2 :D:PDII-2 :OGC : :

NAME :ETana *ETT* :L. *Engle* :H. *Berkow* : *(signature)* : :

DATE :12/3/93 :12/3/93 :2/17/93 :2/3/94 : :

OFFICIAL RECORD COPY - DOCUMENT NAME: C:\AUTOS\WPDOS\NOANNA\NA87027.AMD

Mr. W. L. Stewart
Virginia Electric & Power Company

North Anna Power Station
Units 1 and 2

cc:
Mr. William C. Porter, Jr.
County Administrator
Louisa County
P.O. Box 160
Louisa, Virginia 23093

Robert B. Strobe, M.D., M.P.H.
State Health Commissioner
Office of the Commissioner
Virginia Department of Health
P.O. Box 2448
Richmond, Virginia 23218

Michael W. Maupin, Esq.
Hunton and Williams
Riverfront Plaza, East Tower
951 E. Byrd Street
Richmond, Virginia 23219

Regional Administrator, RII
U.S. Nuclear Regulatory Commission
101 Marietta Street, N.W., Suite 2900
Atlanta, Georgia 30323

Dr. W. T. Lough
Virginia State Corporation Commission
Division of Energy Regulation
P.O. Box 1197
Richmond, Virginia 23209

Mr. G. E. Kane, Manager
North Anna Power Station
P.O. Box 402
Mineral, Virginia 23117

Old Dominion Electric Cooperative
4201 Dominion Blvd.
Glen Allen, Virginia 23060

Mr. M. L. Bowling, Manager
Nuclear Licensing & Programs
Virginia Electric and Power Company
Innsbrook Technical Center
5000 Dominion Blvd.
Glen Allen, Virginia 23060

Office of the Attorney General
Supreme Court Building
101 North 8th Street
Richmond, Virginia 23219

Senior Resident Inspector
North Anna Power Station
U.S. Nuclear Regulatory Commission
Route 2, Box 78
Mineral, Virginia 231172



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555-0001

VIRGINIA ELECTRIC AND POWER COMPANY

OLD DOMINION ELECTRIC COOPERATIVE

DOCKET NO. 50-338

NORTH ANNA POWER STATION, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 178
License No. NPF-4

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Virginia Electric and Power Company et al., (the licensee) dated July 16, 1993, as supplemented by letter dated November 15, 1993, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

940303012B 940217
PDR ADDCK 05000338
P PDR

2. Accordingly, the License is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.D.(2) of Facility Operating License No. NPF-4 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 178, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of its date of issuance and shall be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION

B. C. Buckley for

Herbert N. Berkow, Director
Project Directorate II-2
Division of Reactor Projects - I/II
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: February 17, 1994

ATTACHMENT TO LICENSE AMENDMENT NO. 178

TO FACILITY OPERATING LICENSE NO. NPF-4

DOCKET NO. 50-338

Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages as indicated. The revised pages are identified by amendment number and contain vertical lines indicating the area of change. The corresponding overleaf pages are also provided to maintain document completeness.

Remove Pages

1-4

B 3/4 7-7

B 3/4 11-2

5-1

5-2

6-13 b

6-15

6-20

6-24

6-26

Insert Pages

1-4

B 3/4 7-7

B 3/4 11-2

5-1

5-2

6-13 b

6-15

6-20

6-24

6-26

1.0 DEFINITIONS (Continued)

ENGINEERED SAFETY FEATURE RESPONSE TIME

1.12 The ENGINEERED SAFETY FEATURE RESPONSE TIME shall be that time interval from when the monitored parameter exceeds its ESF actuation setpoint at the channel sensor until the ESF equipment is capable of performing its safety function (i.e., the valves travel to their required positions, pump discharge pressures reach their required values, etc.). Times shall include diesel generator starting and sequence loading delays where applicable.

FREQUENCY NOTATION

1.13 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1.2.

FULLY WITHDRAWN

1.13a The control bank FULLY WITHDRAWN position shall be within the interval of 225 to 229 steps withdrawn, inclusive. Definition of the FULLY WITHDRAWN position for each specific cycle shall be documented in the rod insertion limit operator curve.

GASEOUS RADWASTE TREATMENT SYSTEM

1.14 A GASEOUS RADWASTE TREATMENT SYSTEM is the system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment. The system is composed of the waste gas decay tanks, regenerative heat exchanger, waste gas charcoal filters, process vent blowers, waste gas surge tanks and waste gas diaphragm compressor.

IDENTIFIED LEAKAGE

1.15 IDENTIFIED LEAKAGE shall be:

- a. Leakage (except CONTROLLED LEAKAGE) into closed systems, such as pump seal or valve packing leaks that are captured and conducted to a sump or collecting tank, or
- b. Leakage into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be PRESSURE BOUNDARY LEAKAGE, or
- c. Reactor coolant system leakage through a steam generator to the secondary system.

MEMBER(S) OF THE PUBLIC

1.16 MEMBER(S) OF THE PUBLIC shall include all individuals who by virtue of their occupational status have no formal association with the plant. This category shall include non-employees of the licensee who are permitted to use portions of the site for recreational, occupational, or other purposes not associated with plant functions. This category shall not include non-employees such as vending machine servicemen or postman who, as part of their formal job function, occasionally enter an area that is controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials.

1.0 DEFINITIONS (Continued)

OFFSITE DOSE CALCULATION MANUAL (ODCM)

1.17 The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm/trip setpoints, and in the conduct of the Environmental Radiological Monitoring Program. The ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Section 6.8.4 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Radioactive Effluent Release Reports required by Specifications 6.9.1.8 and 6.9.1.9.

OPERABLE - OPERABILITY

1.18 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, normal and emergency electrical power sources, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

OPERATIONAL MODE - MODE

1.19 An OPERATIONAL MODE (i.e., MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 1.1.

PHYSICS TESTS

1.20 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and 1) described in Chapter 14.0 of the FSAR, 2) authorized under the provisions of 10 CFR 50.59, or 3) otherwise approved by the Commission.

PRESSURE BOUNDARY LEAKAGE

1.21 PRESSURE BOUNDARY LEAKAGE shall be leakage (except steam generator tube leakage) through a non-isolable fault in a Reactor Coolant System component body, pipe wall or vessel wall.

PROCESS CONTROL PROGRAM

1.22 The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analyses, tests and determinations to be made to ensure that the processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of the radioactive waste.

PURGE - PURGING

1.23 PURGE or PURGING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

PLANT SYSTEMS

BASES

The service life of a snubber is evaluated via manufacturer input and information through consideration of the snubber service conditions and associated installation and maintenance records (newly installed snubber, seal replaced, spring replaced, in high radiation area, in high temperature area, etc...). The requirement to monitor the snubber service life is included to ensure that the snubbers periodically undergo a performance evaluation in view of their age and operating conditions. These records will provide statistical bases for future consideration of snubber service life. The requirements for the maintenance of records and the snubber service life review are not intended to affect plant operation.

3/4.7.11 SEALED SOURCE CONTAMINATION

The limitations on sealed source removable contamination ensure that the total body or individual organ irradiation does not exceed allowable limits in the event of ingestion or inhalation of the source material. The limitations on removable contamination for sources requiring leak testing, including alpha emitters, is based on 10 CFR 70.39(c) limits for plutonium. Sealed sources are classified into three groups according to their use, with surveillance requirements commensurate with the probability of damage to a source in that group. Those sources which are frequently handled are required to be tested more often than those which are not. Sealed sources which are continuously enclosed within a shielded mechanism (i.e., sealed sources within radiation monitoring or boron measuring devices) are considered to be stored and need not be tested unless they are removed from the shielded mechanism.

Specifications 3/4.11.1.1 through 3/4.11.1.3 have been deleted

RADIOACTIVE STORAGE

3/4.11.1 LIQUID STORAGE

BASES

3/4.11.1.4 LIQUID HOLDUP TANKS

The tanks listed in this Specification include all those outdoor tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank overflows and surrounding area drains connected to the liquid radwaste treatment system.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tanks' contents, the resulting concentrations would be less than the limits of 10 CFR Part 20, Appendix B, Table 2, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.

Specifications 3/4.11.2.1 through 3/4.11.2.4 have been deleted.

5.0 DESIGN FEATURES

5.1 SITE

EXCLUSION AREA

5.1.1 The exclusion area (site boundary) shall be as shown in Figure 5.1-1.

LOW POPULATION ZONE

5.1.2 The low population zone shall be as shown in Figure 5.1-2.

MAP DEFINING UNRESTRICTED AREAS FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS


5.1.3 Information regarding radioactive gaseous and liquid effluents, which allows identification of structures and release points as well as definition of UNRESTRICTED AREAS within the SITE BOUNDARY that are accessible to MEMBERS OF THE PUBLIC, shall be as shown in Figure 5.1-1.

5.2 CONTAINMENT

CONFIGURATION

5.2.1 The reactor containment building is a steel lined, reinforced concrete building of cylindrical shape with a dome roof and having the following design features:

- a. Nominal inside diameter = 126 feet.
- b. Nominal inside height = 190 feet, 7 inches.
- c. Minimum thickness of concrete walls = 4.5 feet.
- d. Minimum thickness of concrete roof = 2.5 feet.
- e. Minimum thickness of concrete floor pad = 10 feet.
- f. Nominal thickness of the cylindrical portion of the steel liner = 3/8 inches.
- g. Net free volume = 1.825×10^6 cubic feet.
- h. Nominal thickness of hemispherical dome portion of the steel liner = 1/2 inch.

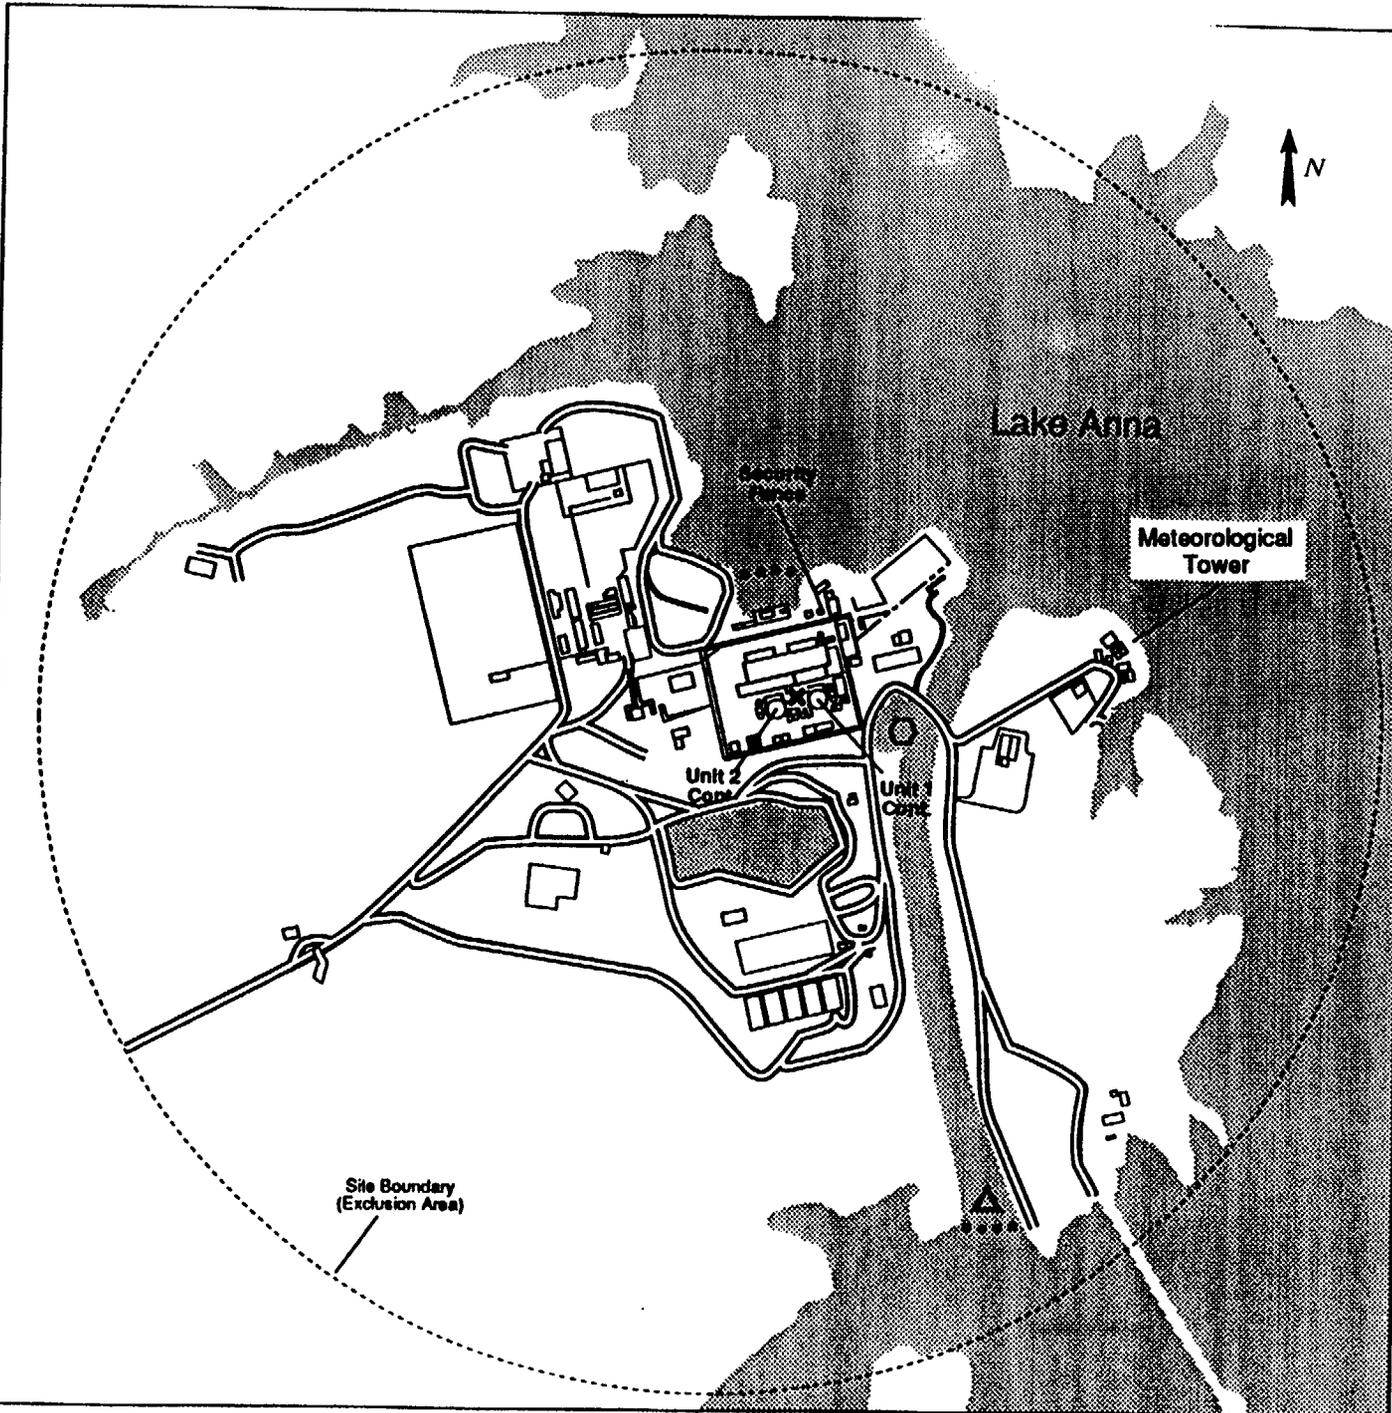

Notes:

- X Gaseous Releases
 1. Process Vent - 157.5 Ft.
 2. Vent - Vent A & B and other release points considered ground level releases.
- Liquid Release to the Discharge Canal
- △ Liquid Release to the Unrestricted Area
- Buoy Barriers
- - - - - Site Boundary - Area at or beyond which is unrestricted for gaseous effluents.

Land Maximum Member of the Public Occupancy = 336 hrs/year

Lake Maximum Member of the Public Occupancy = 2232 hrs/year

Figure 5.1.1

Map Defining Unrestricted Areas for Radioactive Gaseous and Liquid Effluents

e. Radioactive Effluent Controls Program

A program shall be provided conforming with 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to MEMBERS OF THE PUBLIC from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by operating procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- 1) Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM,
- 2) Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS conforming to ten times 10 CFR Part 20, Appendix B, Table 2, Column 2,
- 3) Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM,
- 4) Limitations on the annual and quarterly doses or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS conforming to Appendix I to 10 CFR Part 50,
- 5) Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days,
- 6) Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that the appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a 31-day period would exceed 2 percent of the guidelines for the annual dose or dose commitment conforming to Appendix I to 10 CFR Part 50,
- 7) Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas at or beyond the SITE BOUNDARY shall be limited to the following:
 - a) For noble gases: Less than or equal to a dose rate of 500 mrem/yr. to the total body and less than or equal to a dose rate of 3000 mrem/yr. to the skin, and
 - b) For Iodine-131, Iodine-133, Tritium, and all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to a dose rate of 1500 mrem/yr. to any organ.

ADMINISTRATIVE CONTROLS

ANNUAL REPORTS^{1/}

6.9.1.4 Annual reports covering the activities of the unit as described below for the previous calendar year shall be submitted prior to March 1 of each year. The initial report shall be submitted prior to March 1 of the year following initial criticality.

6.9.1.5 Reports required on an annual basis shall include:

- a. A tabulation on an annual basis of the number of station, utility, and other personnel (including contractors) receiving exposures greater than 100 mrem/yr and their associated man-rem exposure according to work and job functions,^{2/} e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignments to various duty functions may be estimated based on pocket dosimeter, TLD, or film badge measurements. Small exposures totalling less than 20 percent of the individual total dose need not be accounted for. In the aggregate, at least 80 percent of the total whole body dose received from external sources should be assigned to specific major work functions.
- b. The complete results of the steam generator tube inservice inspections performed during the report period (Reference Specification 4.4.5.5.b.).
- c. The results of specific activity analysis in which the primary coolant exceeded the limits of Specification 3.4.8. The following information shall be included: (1) Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded; (2) Results of the last isotopic analysis for radioiodine performed prior to exceeding the limit, results of analysis while limit was exceeded and results of one analysis after the radioiodine activity was reduced to less than limit. Each result should include date and time of sampling and the radioiodine concentrations; (3) Clean-up system flow history starting 48 hours prior to the first sample in which the limit was exceeded; (4) Graph of the I-131 concentration and one other radioiodine isotope concentration in microcuries per gram as function of time for the duration of the specific activity above the steady-state level; and (5) The time duration when the specific activity of the primary coolant exceeded the radioiodine limit.

^{1/} A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station.

^{2/} This tabulation supplements the requirements of §20.2206 of 10 CFR Part 20.

ADMINISTRATIVE CONTROLS

MONTHLY OPERATING REPORT

6.9.1.6 Routine reports of operating statistics and shutdown experience, including documentation of all challenges to the Reactor Coolant System PORVs or safety valves, shall be submitted on a monthly basis to the Director, Office of Management and Program Analysis, U. S. Nuclear Regulatory Commission, Washington, D. C. 20555, with a copy to the Regional Office of Inspection and Enforcement, no later than the 15th of each month following the calendar month covered by the report.

ADMINISTRATIVE CONTROLS (Continued)

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT*

6.9.1.8 The Annual Radiological Environmental Operating Report covering the operation of the unit during the previous calendar year shall be submitted before May 1 of each year. The report shall include summaries, interpretations, and analysis of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the ODCM and (2) Sections IV.B.2, IV.B.3, and IV.C of Appendix I to 10 CFR Part 50.

* A single submittal may be made for a multiple unit station.

ANNUAL RADIOLOGICAL EFFLUENT RELEASE REPORT*

6.9.1.9 The Annual Radioactive Effluent Release Report covering the operation of the unit during the previous calendar year shall be submitted by May 1 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be (1) consistent with the objectives outlined in the ODCM and PCP and (2) in conformance with 10 CFR 50.36a and Section IV.B.1 of Appendix I to 10 CFR Part 50.

- * A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

ADMINISTRATIVE CONTROLS

- a. Records and drawing changes reflecting facility design modifications made to systems and equipment described in the Final Safety Analysis Report.
- b. Records of new and irradiated fuel inventory, fuel transfers and assembly burnup histories.
- c. Records of facility radiation and contamination surveys.
- d. Records of radiation exposure for all individuals entering radiation control areas.
- e. Records of gaseous and liquid radioactive material released to the environs.
- f. Records of transient operational cycles for those facility components identified in Table 5.9-1.
- g. Records of reactor tests and experiments.
- h. Records of training and qualification for current members of the plant staff.
- i. Records of in-service inspections performed pursuant to these Technical Specifications.
- j. Records of Quality Assurance activities required by the QA Manual.
- k. Records of reviews performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59.
- l. Records of meetings of the SNSOC.
- m. Records of meetings of the System Nuclear Safety and Operating Committee to issuance of Amendment No. 30.
- n. Records of the service lives of all hydraulic and mechanical snubbers required to be OPERABLE by Technical Specification 3.7.10 including the date at which the service life commences and associated installation and maintenance records.
- o. Records of secondary water sampling and water quality.
- p. Records of Environmental Qualification which are covered under the provisions of Paragraph 6.13.
- q. Records of analyses required by the radiological environmental monitoring program that would permit evaluation of the accuracy of the analysis at a later date. This would include procedures effective at specified times and QA records showing that these procedures were followed.
- r. Records of reviews performed for changes made to the OFFSITE DOSE - CALCULATION MANUAL and the PROCESS CONTROL PROGRAM.

6.11 RADIATION PROTECTION PROGRAM

Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained and adhered to for all operations involving personnel radiation exposure.

6.12 HIGH RADIATION AREA

6.12.1 In lieu of the "control device" or "alarm signal" required by paragraph 20.1601 of 10 CFR 20, each high radiation area in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mrem/hr shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Work Permit.* Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area.
- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate level in the area has been established and personnel have been made knowledgeable of them.
- c. An individual qualified in radiation protection procedures who is equipped with a radiation dose rate monitoring device. This individual shall be responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the facility Health Physicist in the Radiation Work Permit.

6.12.2 The requirements of 6.12.1, above, shall also apply to each high radiation area in which the intensity of radiation is greater than 1000 mrem/hr, but less than 500 rads/hr at one meter from a radiation source or any surface through which radiation penetrates. In addition, locked doors shall be provided to prevent unauthorized entry into such areas and the keys shall be maintained under the administrative control of the Shift Supervisor on duty and/or the Plant Health Physicist.

*Health Physics personnel shall be exempt from the RWP issuance requirement during the performance of their assigned radiation protection duties, provided they comply with approved radiation protection procedures for entry into high radiation areas.

6.13 DELETED

6.14 PROCESS CONTROL PROGRAM (PCP)

6.14.1 Changes to the PCP:

1. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.r. This documentation shall contain:
 - a) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
 - b) A determination that the change will maintain the overall conformance of the solidified waste product to existing requirements of Federal, State, or other applicable regulations.
2. Shall become effective after review and acceptance by the SNSOC and the approval of the Plant Manager.

ADMINISTRATIVE CONTROLS

6.15 OFFSITE DOSE CALCULATION MANUAL (ODCM)

Changes to the ODCM: - -

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.r. This documentation shall contain:
 - 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
 - 2) A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.1302, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after review and acceptance by the SNSOC and the approval of the Plant Manager.
- c. Shall be submitted to the Commission in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Annual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.

6.16 DELETED



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555-0001

VIRGINIA ELECTRIC AND POWER COMPANY

OLD DOMINION ELECTRIC COOPERATIVE

DOCKET NO. 50-339

NORTH ANNA POWER STATION, UNIT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 159
License No. NPF-7

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Virginia Electric and Power Company et al., (the licensee) dated July 16, 1993, as supplemented by letter dated November 15, 1993, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-7 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 159, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of its date of issuance and shall be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION

B.C. Buckley for

Herbert N. Berkow, Director
Project Directorate II-2
Division of Reactor Projects - I/II
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: February 17, 1994

ATTACHMENT TO LICENSE AMENDMENT NO. 159

TO FACILITY OPERATING LICENSE NO. NPF-7

DOCKET NO. 50-339

Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages as indicated. The revised pages are identified by amendment number and contain vertical lines indicating the area of change. The corresponding overleaf pages are also provided to maintain document completeness.

Remove Pages

1-4

B 3/4 7-7

B 3/4 11-2

5-1

5-2

6-14 b

6-15

6-20

6-23

6-24

6-25

Insert Pages

1-4

B 3/4 7-7

B 3/4 11-2

5-1

5-2

6-14 b

6-15

6-20

6-23

6-24

6-25

1.0 DEFINITIONS (Continued)

ENGINEERED SAFETY FEATURE RESPONSE TIME

1.12 The ENGINEERED SAFETY FEATURE RESPONSE TIME shall be that time interval from when the monitored parameter exceeds its ESF actuation setpoint at the channel sensor until the ESF equipment is capable of performing its safety function (i.e., the valves travel to their required positions, pump discharge pressures reach their required values, etc.). Times shall include diesel generator starting and sequence loading delays where applicable.

FREQUENCY NOTATION

1.13 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1.2.

FULLY WITHDRAWN

1.13a The control bank FULLY WITHDRAWN position shall be within the interval of 225 to 229 steps withdrawn, inclusive. Definition of the FULLY WITHDRAWN position for each specific cycle shall be documented in the rod insertion limit operator curve.

GASEOUS RADWASTE TREATMENT SYSTEM

1.14 A GASEOUS RADWASTE TREATMENT SYSTEM is the system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment. The system is composed of the waste gas decay tanks, regenerative heat exchanger, waste gas charcoal filters, process vent blowers, waste gas surge tanks and waste gas diaphragm compressor.

IDENTIFIED LEAKAGE

1.15 IDENTIFIED LEAKAGE shall be:

- a. Leakage (except CONTROLLED LEAKAGE) into closed systems, such as pump seal or valve packing leaks that are captured and conducted to a sump or collecting tank, or
- b. Leakage into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be PRESSURE BOUNDARY LEAKAGE, or
- c. Reactor coolant system leakage through a steam generator to the secondary system.

MEMBER(S) OF THE PUBLIC

1.16 MEMBER(S) OF THE PUBLIC shall include all individuals who by virtue of their occupational status have no formal association with the plant. This category shall include non-employees of the licensee who are permitted to use portions of the site for recreational, occupational, or other purposes not associated with plant functions. This category shall not include non-employees such as vending machine servicemen or postman who, as part of their formal job function, occasionally enter an area that is controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials.

1.0 DEFINITIONS (Continued)

OFFSITE DOSE CALCULATION MANUAL (ODCM)

1.17 The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm/trip setpoints, and in the conduct of the Environmental Radiological Monitoring Program. The ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Section 6.8.4 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Radioactive Effluent Release Reports required by Specifications 6.9.1.8 and 6.9.1.9.

OPERABLE - OPERABILITY

1.18 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, normal and emergency electrical power sources, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

OPERATIONAL MODE - MODE

1.19 An OPERATIONAL MODE (i.e., MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 1.1.

PHYSICS TESTS

1.20 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and 1) described in Chapter 14.0 of the FSAR, 2) authorized under the provisions of 10 CFR 50.59, or 3) otherwise approved by the Commission.

PRESSURE BOUNDARY LEAKAGE

1.21 PRESSURE BOUNDARY LEAKAGE shall be leakage (except steam generator tube leakage) through a non-isolable fault in a Reactor Coolant System component body, pipe wall or vessel wall.

PROCESS CONTROL PROGRAM

1.22 The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analyses, tests and determinations to be made to ensure that the processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of the radioactive waste.

PURGE - PURGING

1.23 PURGE or PURGING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

3/4.7.11 SEALED SOURCE CONTAMINATION

The limitations on sealed source removable contamination ensure that the total body or individual organ irradiation does not exceed allowable limits in the event of ingestion or inhalation of the source material. The limitations on removable contamination for sources requiring leak testing, including alpha emitters, is based on 10 CFR 70.39(c) limits for plutonium. Sealed sources are classified into three groups according to their use, with surveillance requirements commensurate with the probability of damage to a source in that group. Those sources which are frequently handled are required to be tested more often than those which are not. Sealed sources which are continuously enclosed within a shielded mechanism (i.e., sealed sources within radiation monitoring or boron measuring devices) are considered to be stored and need not be tested unless they are removed from the shielded mechanism.

3/4.7.12 SETTLEMENT OF CLASS 1 STRUCTURES

In order to assure that settlement does not exceed allowable values, a program has been established to conduct a survey of a specified number of points at the site on a semiannual basis. The first survey was conducted in May 1976 to establish baseline elevations for most of the points. Where applicable, the baseline elevations of points established subsequent to the May 1976 survey have been adjusted to the May 1976 survey by an evaluation of the settlement records of settlement points on the same structure or on nearby structures. Baseline elevations for points established on dates other than May 1976 are indicated in Table 3.7-5. Additional surveys will be performed semiannually. The determination of the elevation of the points shall be by precise leveling with second order Class II accuracy as defined by the U.S. Department of Commerce National Oceanic and Atmospheric Administration, National Ocean Survey, 1974. When any settlement point listed in Table 3.7-5 is inaccessible during a survey, comparison to allowable settlement shall be based on settlement of other points on the same structure or on nearby structures having similar foundation conditions. When any settlement point listed in Table 3.7-5 is dislocated or replaced, a documented review of the settlement records of points on the same structure and additionally points on nearby structures having similar foundation conditions shall provide a new reference elevation for the point that reflects the estimated settlement since the baseline survey. If the total settlement or differential settlement exceeds 75 percent of the allowable value, the frequency of surveillance shall be increased as dictated by the engineering review. Measurements of certain points are required to be performed at least once per 31 days for the first five years of facility operation to provide additional settlement information.

Specifications 3/4.11.1.1 through 3/4.11.1.3 have been deleted

RADIOACTIVE STORAGE

3/4.11.1 LIQUID STORAGE

BASES

3/4.11.1.4 LIQUID HOLDUP TANKS

The tanks listed in this Specification include all those outdoor tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank overflows and surrounding area drains connected to the liquid radwaste treatment system.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tanks' contents, the resulting concentrations would be less than the limits of 10 CFR Part 20, Appendix B, Table 2, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.

Specifications 3/4.11.2.1 through 3/4.11.2.4 have been deleted.

5.0 DESIGN FEATURES

5.1 SITE

EXCLUSION AREA

5.1.1 The exclusion area (site boundary) shall be as shown in Figure 5.1-1.

LOW POPULATION ZONE

5.1.2 The low population zone shall be as shown in Figure 5.1-2.

MAP DEFINING UNRESTRICTED AREAS FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS

5.1.3 Information regarding radioactive gaseous and liquid effluents, which allows identification of structures and release points as well as definition of UNRESTRICTED AREAS within the SITE BOUNDARY that are accessible to MEMBERS OF THE PUBLIC, shall be as shown in Figure 5.1-1.

5.2 CONTAINMENT


CONFIGURATION

5.2.1 The reactor containment building is a steel lined, reinforced concrete building of cylindrical shape with a dome roof and having the following design features:

- a. Nominal inside diameter = 126 feet.
- b. Nominal inside height = 190 feet, 7 inches.
- c. Minimum thickness of concrete walls = 4.5 feet.
- d. Minimum thickness of concrete roof = 2.5 feet.
- e. Minimum thickness of concrete floor pad = 10 feet.
- f. Nominal thickness of the cylindrical portion of the steel liner = 3/8 inches.
- g. Net free volume = 1.825×10^6 cubic feet.
- h. Nominal thickness of hemispherical dome portion of the steel liner = 1/2 inch.

DESIGN PRESSURE AND TEMPERATURE

5.2.2 The reactor containment building is designed and shall be maintained for a maximum internal pressure of 45 psig and a temperature of 280°F.

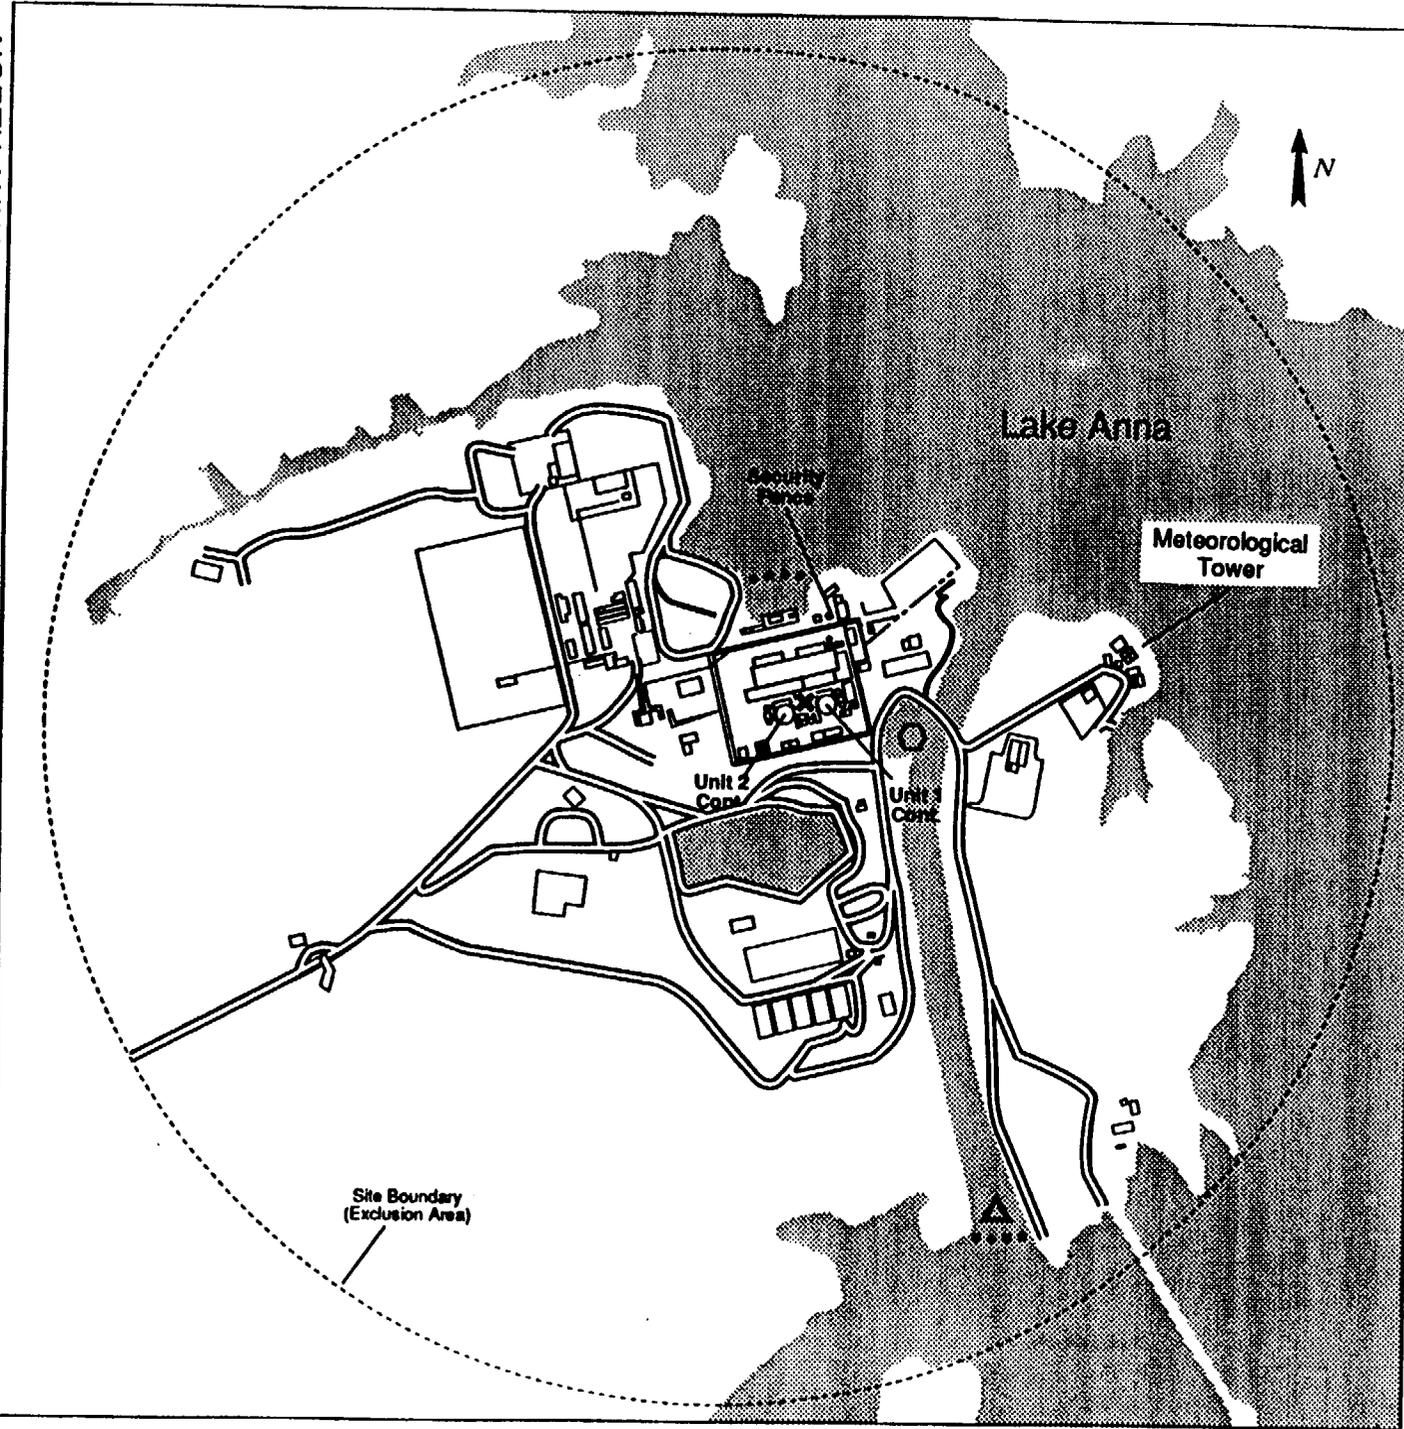

Notes:

- X Gaseous Releases
 1. Process Vent - 157.5 Ft.
 2. Vent - Vent A & B and other release points considered ground level releases.
- Liquid Release to the Discharge Canal
- △ Liquid Release to the Unrestricted Area
- Buoy Barriers
- - - Site Boundary - Area at or beyond which is unrestricted for gaseous effluents.

Land Maximum Member of the Public Occupancy = 336 hrs/year

Lake Maximum Member of the Public Occupancy = 2232 hrs/year

Figure 5.1.1

Map Defining Unrestricted Areas for Radioactive Gaseous and Liquid Effluents

ADMINISTRATIVE CONTROLS

b. In-Plant Radiation Monitoring

A program which will ensure the capability to accurately determine the airborne iodine concentration in vital areas under accident conditions. This program shall include the following:

- (i) Training of personnel,
- (ii) Procedures for monitoring, and
- (iii) Provisions for maintenance of sampling and analysis equipment.

c. Secondary Water Chemistry

A program for monitoring of secondary water chemistry to inhibit steam generator tube degradation. This program shall include:

- (i) Identification of a sampling schedule for the critical variables and control points for these variables,
- (ii) Identification of the procedures used to measure the values of the critical variables,
- (iii) Identification of process sampling points, which shall include monitoring the discharge of the condensate pumps for evidence of condenser inlet leakage,
- (iv) Procedures for the recording and management of data,
- (v) Procedures defining corrective actions for all control point chemistry conditions, and
- (vi) A procedure identifying (a) the authority responsible for the interpretation of the data, and (b) the sequence and timing of administrative events required to initiate corrective action.

d. Post-Accident Sampling

A program which will ensure the capability to obtain and analyze reactor coolant, radioactive iodines and particulates in plant gaseous effluents, and containment atmosphere samples under accident conditions. The program shall include the following:

- (i) Training of personnel,
- (ii) Procedures for sampling and analysis,
- (iii) Provisions for maintenance of sampling and analysis equipment.

e. Radioactive Effluent Controls Program

A program shall be provided conforming with 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to MEMBERS OF THE PUBLIC from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by operating procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- 1) Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM,
- 2) Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS conforming to ten times 10 CFR Part 20, Appendix B, Table 2, Column 2,
- 3) Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM,
- 4) Limitations on the annual and quarterly doses or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS conforming to Appendix I to 10 CFR Part 50,
- 5) Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days,
- 6) Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that the appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a 31-day period would exceed 2 percent of the guidelines for the annual dose or dose commitment conforming to Appendix I to 10 CFR Part 50,
- 7) Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas at or beyond the SITE BOUNDARY shall be limited to the following:
 - a) For noble gases: Less than or equal to a dose rate of 500 mrem/yr. to the total body and less than or equal to a dose rate of 3000 mrem/yr. to the skin, and
 - b) For Iodine-131, Iodine-133, Tritium, and all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to a dose rate of 1500 mrem/yr. to any organ.

ADMINISTRATIVE CONTROLS

6.9.1.2 The startup report shall address each of the tests identified in the FSAR and shall include a description of the measured values of the operating conditions or characteristics obtained during the test program and a comparison of these values with design predictions and specifications. Any corrective actions that were required to obtain satisfactory operation shall also be described. Any additional specific details requested in license conditions based on other commitments shall be included in this report.

6.9.1.3 Startup reports shall be submitted within (1) 90 days following completion of the startup test program, (2) 90 days following resumption or commencement of commercial power operation, or (3) 9 months following initial criticality, whichever is earliest. If the Startup Report does not cover all three events (i.e., initial criticality, completion of startup test program, and resumption or commencement of commercial power operation), supplementary reports shall be submitted at least every three months until all three events have been completed.

ANNUAL REPORTS^{1/}

6.9.1.4 Annual reports covering the activities of the unit as described below for the previous calendar year shall be submitted prior to March 1 of each year. The initial report shall be submitted prior to March 1 of the year following initial criticality.

6.9.1.5 Reports required on an annual basis shall include:

- a. A tabulation on an annual basis of the number of station, utility, and other personnel (including contractors) receiving exposures greater than 100 mrem/yr and their associated man-rem exposure according to work and job functions,^{2/} e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignments to various duty functions may be estimated based on pocket dosimeter, TLD, or film badge measurements. Small exposures totalling less than 20 percent of the individual total dose need not be accounted for. In the aggregate, at least 80 percent of the total whole body dose received from external sources should be assigned to specific major work functions.

^{1/} A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station.

^{2/} This tabulation supplements the requirements of §20.2206 of 10 CFR Part 20.

ADMINISTRATIVE CONTROLS

- b. The complete results of the steam generator tube inservice inspections performed during the report period (Reference Specification 4.4.5.5.b.).
- c. The results of specific activity analysis in which the primary coolant exceeded the limits of Specification 3.4.8. The following information shall be included: (1) Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded; (2) Results of the last isotopic analysis for radioiodine performed prior to exceeding the limit, results of analysis while limit was exceeded and results of one analysis after the radioiodine activity was reduced to less than limit. Each result should include date and time of sampling and the radioiodine concentrations; (3) Clean-up system flow history starting 48 hours prior to the first sample in which the limit was exceeded; (4) Graph of the I-131 concentration and one other radioiodine isotope concentration in microcuries per gram as a function of time for the duration of the specific activity above the steady-state level; and (5) The time duration when the specific activity of the primary coolant exceeded the radioiodine limit.

MONTHLY OPERATING REPORT

6.9.1.6 Routine reports of operating statistics and shutdown experience, including documentation of all challenges to the Reactor Coolant System PORVs or safety valves, shall be submitted on a monthly basis to the Director, Office of Management and Program Analysis, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, with a copy to the Regional Office of Inspection and Enforcement, no later than the 15th day of each month following the calendar month covered by the report.

ADMINISTRATIVE CONTROLS (Continued)

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT*

6.9.1.8 The Annual Radiological Environmental Operating Report covering the operation of the unit during the previous-calendar year shall be submitted before May 1 of each year. The report shall include summaries, interpretations, and analysis of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the ODCM and (2) Sections IV.B.2, IV.B.3, and IV.C of Appendix I to 10 CFR Part 50.

* A single submittal may be made for a multiple unit station.

ANNUAL RADIOLOGICAL EFFLUENT RELEASE REPORT*

6.9.1.9 The Annual Radioactive Effluent Release Report covering the operation of the unit during the previous calendar year shall be submitted by May 1 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be (1) consistent with the objectives outlined in the ODCM and PCP and (2) in conformance with 10 CFR 50.36a and Section IV.B.1 of Appendix I to 10 CFR Part 50.

- * A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

ADMINISTRATIVE CONTROLS (Continued)

- g. Records of reactor tests and experiments.
- h. Records of training and qualification for current members of the plant staff.
- i. Records of in-service inspections performed pursuant to these Technical Specifications.
- j. Records of Quality Assurance activities required by the QA Manual.
- k. Records of the service life of all hydraulic and mechanical snubbers required to be operable by Technical Specification 3.7.10 including the date at which the service life commences and associated installation and maintenance records.
- l. Records of review performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59.
- m. Records of meetings of the SNSOC.
- n. Records of meetings of the System Nuclear Safety and Operating Committee to issuance of Amendment No. 11.
- o. Records of secondary water sampling and water quality.
- p. Records for Environmental Qualification which are covered under the provisions of Paragraph 2.C(4) (3) of License No. NPF-7.
- q. Records of analyses required by the radiological environmental monitoring program that would permit evaluation of the accuracy of the analysis at a later date. This would include procedures effective at specified times and QA records showing that these procedures were followed.
- r. Records of reviews performed for changes made to the OFFSITE DOSE CALCULATION MANUAL and the PROCESS CONTROL PROGRAM.

6.11 RADIATION PROTECTION PROGRAM

Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained and adhered to for all operations involving personnel radiation exposure.

6.12 HIGH RADIATION AREA

6.12.1 In lieu of the "control device" or "alarm signal" required by paragraph 20.1601 of 10 CFR 20, each high radiation area in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mrem/hr shall be barricaded and conspicuously posted a high radiation area and entrance

thereto shall be controlled by requiring issuance of a Radiation Work Permit.* Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area.
- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate level in the area has been established and personnel have been made knowledgeable of them.
- c. An individual qualified in the protection procedures who is equipped with a radiation dose rate monitoring device. This individual shall be responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the facility Health Physicist in the Radiation Work Permit.

6.12.2 The requirements of 6.12.1, above, shall also apply to each high radiation area in which the intensity of radiation is greater than 1000 mrem/hr, but less than 500 rads/hr at one meter from a radiation source or any surface through which radiation penetrates. In addition, locked doors shall be provided to prevent unauthorized entry into such areas and the keys shall be maintained under the administrative control of the Shift Supervisor on duty and/or the Plant Health Physicist.

*Health Physics personnel or personnel escorted by Health Physics personnel shall be exempt from the RWP issuance requirement during the performance of their assigned radiation protection duties, provided they comply with approved radiation protection procedures for entry in high radiation areas.

ADMINISTRATIVE CONTROLS

6.13 PROCESS CONTROL PROGRAM (PCP)

Changes to the PCP:

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.r. This documentation shall contain:
 - 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
 - 2) A determination that the change will maintain the overall conformance of the solidified waste product to existing requirements of Federal, State, or other applicable regulations.
- b. Shall become effective after review and acceptance by the SNSOC and the approval of the Plant Manager.

6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)

Changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.r. This documentation shall contain:
 - 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
 - 2) A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.1302, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after review and acceptance by the SNSOC and the approval of the Plant Manager.
- c. Shall be submitted to the Commission in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Annual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.

6-15 is DELETED



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555-0001

SAFETY EVALUATION BY THE OFFICE OF NUCLEAR REACTOR REGULATION

RELATED TO AMENDMENT NOS. 179 AND 158 TO

FACILITY OPERATING LICENSE NOS. NPF-4 AND NPF-7

VIRGINIA ELECTRIC AND POWER COMPANY

OLD DOMINION ELECTRIC COOPERATIVE

NORTH ANNA POWER STATION, UNITS NO. 1 AND NO. 2

DOCKET NOS. 50-338 AND 50-339

1.0 Introduction

By letter dated July 16, 1993, as supplemented on November 15, 1993, Virginia Electric and Power Company (the licensee), submitted proposed changes to the North Anna Power Station, Units 1 and 2 Technical Specifications (TS) in support of its plan to implement the revised 10 CFR Part 20.

The November 15, 1993, letter provided additional information requested by the staff. This additional information did not alter the proposed action or affect the staff's determination of no significant hazards consideration as noticed in the Federal Register on August 18, 1993 (58 FR 43937).

2.0 Evaluation

The licensee has revised the TS to include wording that is consistent with the revised 10 CFR Part 20, Standards for Protection Against Radiation, and will retain the same overall level of effluent control required to meet the design objectives of Appendix I to 10 CFR Part 50. An evaluation was not performed on item 2 regarding the definition of "UNRESTRICTED AREA" because this item is still being evaluated.

The proposed TS changes and evaluations follow:

1. Section 1.0 DEFINITIONS

The licensee has proposed to change definition 1.17, OFFSITE DOSE CALCULATION MANUAL (ODCM). The ODCM refers to the Semiannual Radioactive Effluent Release Report. The word "Semiannual" is being changed to "Annual."

The change is administrative in nature to implement the revised reporting requirement in 10 CFR 50.36a and is acceptable.

9403030130 940217
PDR ADOCK 05000338
P PDR

2. Section 1.0 DEFINITIONS

The licensee has proposed to change definition 1.35, UNRESTRICTED AREA to conform to the definition used in 10 CFR 20.1003.

The staff is continuing the evaluation of this item and therefore will not address it at this time.

3. Technical Specification BASES 3/4.7.11 SEALED SOURCE CONTAMINATION

The licensee has proposed to delete the third sentence in the paragraph description of the bases for sealed source contamination. The information contained in the sentence includes internal dose terminology, i.e., "maximum permissible body burden" (MPBB) from the International Commission on Radiological Protection (ICRP 2). The revised 10 CFR Part 20 has eliminated the term "MPBB" from the regulation. Sealed source contamination is governed by 10 CFR 70.39(c).

The change to the BASES is administrative in nature and does not conflict with the revised 10 CFR Part 20. The change is acceptable.

4. Technical Specification BASES 3/4.11.1.4 LIQUID HOLDUP TANKS

The licensee has proposed to change the 10 CFR Part 20 reference and activity limit basis for liquid holdup tanks such "that in the event of an uncontrolled release of the tank's contents, the resulting radioactive material concentrations would be less than the limits of 10 CFR Part 20; Appendix B, Table 2, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA."

The change to the BASES is administrative in nature and is consistent with the revised 10 CFR Part 20. The change is acceptable.

5. Technical Specification 5.1.1 EXCLUSION AREA

The licensee has proposed to revise this TS to ensure consistency between TS 5.1-1 and Figure 5.1-1.

The change is administrative in nature and is acceptable.

6. Figure 5.1-1 Map Defining Unrestricted Areas for Radioactive Gaseous and Liquid Effluents

The licensee has proposed to revise this figure to show that the unrestricted area for gaseous effluents is at or beyond the site boundary rather than at the security fence.

The change is administrative in nature and is acceptable.

7. Technical Specification 6.8.4.e Radioactive Effluent Controls Program

The licensee has proposed to revise item 2 of this TS to change the liquid effluent release rate from maximum permissible concentration values in 10 CFR Part 20 to "ten times 10 CFR Part 20, Appendix B, Table 2, Column 2."

The licensee has proposed this change in order to retain operational flexibility consistent with Appendix I to 10 CFR Part 50, concurrent with the implementation of the revised 10 CFR Part 20.

The current requirements for the content of the licensee's TS concerning radioactive effluents are contained in 10 CFR 50.36a. 10 CFR 50.36a requires licensees to maintain control over radioactive material in gaseous and liquid effluents to unrestricted areas, produced during normal reactor operations, to levels that are as low as reasonably achievable (ALARA). For power reactors, Appendix I to 10 CFR Part 50 contains the numerical guidance to meet the ALARA requirement. The dose values specified in Appendix I of 10 CFR Part 50 are small percentages of the implicit limits in 10 CFR 20.106 and the explicit limits in 10 CFR 20.1301. As secondary controls, the instantaneous dose rates required by this TS were chosen by the staff to help maintain annual average releases of radioactive material in gaseous and liquid effluents to within the dose values specified in Appendix I of 10 CFR Part 50. For the purposes of this TS, 10 CFR Part 20 is used as a source of reference values only. These TS requirements allow operational flexibility, compatible with considerations of health and safety, which may temporarily result in release rates which, if continued for the calendar quarter, would result in radiation doses higher than specified in Appendix I of 10 CFR Part 50. However, these releases are within the implicit limits in 10 CFR 20.106 and the explicit limits in 10 CFR 20.1302 which references Appendix B, Table II concentrations. These referenced concentrations in the old 10 CFR Part 20 are specific values which relate to an annual dose of 500 mrem. The liquid effluent radioactive effluent concentration limits given in Appendix B, Table 2, Column 2 to 10 CFR 20.1001 - 20.2401 are based on an annual dose of 50 mrem total effective dose equivalent. Since an instantaneous release concentration corresponding to a dose rate of 500 mrem/year has been acceptable as a TS limit for liquid effluents, which applies at all times to assure that the values in Appendix I of 10 CFR Part 50 are not likely to be exceeded, it is not necessary to reduce this limit by a factor of ten.

The licensee states that operational history at the North Anna Power Station has demonstrated that the use of the concentration values associated with 10 CFR 20.106 as TS limits has resulted in calculated maximum individual doses to a member of the public that are small percentages of the values given in Appendix I to 10 CFR Part 50. Therefore, the use of effluent concentration values that are ten times those listed in Appendix B, Table 2, Column 2 to 10 CFR 20.1001 - 20.2401 will not have a negative impact on the ability to continue to operate within the design objectives in Appendix I to 10 CFR Part 50 and 40 CFR Part 190 which are a fraction of the 10 CFR 20.1301 limits.

Based on the above, it is acceptable that the instantaneous limits associated with the liquid release rate TS are based on ten times the effluent concentration values given in Appendix B, Table 2, Column 2 to 10 CFR 20.1001 - 20.2401.

8. Technical Specification 6.8.4.e Radioactive Effluent Controls Program

The licensee has proposed to revise item 3 of this TS to replace the reference to "10 CFR 20.106" with "10 CFR 20.1302."

The change is administrative in nature to incorporate the corresponding revised 10 CFR Part 20 section number and is acceptable.

9. Technical Specification 6.8.4.e Radioactive Effluent Controls Program

The licensee has proposed to revise item 7 of this TS which specifies the limitations on the concentrations of radioactive material released in gaseous effluents. The licensee has proposed that the TS be revised to read as follows:

"Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas at or beyond the SITE BOUNDARY shall be limited to the following:

- a) For noble gases: Less than or equal to a dose rate of 500 mrem/yr. to the total body and less than or equal to a dose rate of 3000 mrem/yr. to the skin, and
- b) For Iodine-131, Iodine-133, Tritium, and all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to a dose rate of 1500 mrem/yr. to any organ."

The licensee has proposed this change in order to retain operational flexibility consistent with 10 CFR Part 50, Appendix I, concurrent with the implementation of the revised 10 CFR Part 20.

The current requirements for the content of the licensee's TS concerning radioactive effluents are contained in 10 CFR 50.36a. 10 CFR 50.36a requires licensees to maintain control over radioactive material in gaseous and liquid effluents to unrestricted areas, produced during normal reactor operations, to levels that are as low as reasonably achievable (ALARA). For power reactors, Appendix I to 10 CFR Part 50 contains the numerical guidance to meet the ALARA requirement. The dose values specified in Appendix I of 10 CFR Part 50 are small percentages of the implicit limits in 10 CFR 20.106 and the explicit limits in 10 CFR 20.1301. As secondary controls, the instantaneous dose rates required by this specification were chosen by the staff to help maintain annual average releases of radioactive material in gaseous and liquid effluents to within the dose values specified in Appendix I of 10 CFR Part 50. For purpose of the bases of this TS, 10 CFR Part 20 is used as a source of

reference values only. These TS requirements allow operational flexibility, compatible with considerations of health and safety, which may temporarily result in release rates which, if continued for the calendar quarter, would result in radiation doses higher than specified in Appendix I of 10 CFR Part 50. However, these releases are within the limits specified in 10 CFR 20.106 (10 CFR 20.1302).

This specification, which is based on guidance contained in NUREG-0133, is acceptable as a TS limit for gaseous effluents, which applies at all times as an assurance that the values in Appendix I of 10 CFR Part 50 are not likely to be exceeded.

The licensee states that the proposed TS change will not have a negative impact on the ability to continue to operate within the design objectives in Appendix I of 10 CFR Part 50.

Based on the above, it is acceptable that the gaseous release rate TS for radioactive material be based on the stated dose rates.

10. Technical Specification 6.9.1.5 ANNUAL REPORTS

The licensee has proposed to revise this TS to replace the reference to "10 CFR 20.407" with "10 CFR 20.2206."

This change is administrative in nature to incorporate the corresponding revised 10 CFR Part 20 section number and is acceptable.

11. Technical Specification 6.9.1.9 ANNUAL RADIOLOGICAL EFFLUENT RELEASE REPORT

The licensee has proposed to revise the title of the "Semiannual Radioactive Effluent Release Report" to "Annual Radioactive Effluent Release Report." The report submittal date is also being changed to May 1.

The changes are administrative in nature and are consistent with the revised 10 CFR 50.36a. The changes are acceptable.

12. Technical Specification 6.12 HIGH RADIATION AREA

The licensee has proposed to replace the reference "20.203(c)(2)" with "20.1601" and to add an upper limit on the TS of "but less than 500 rads/hr. at one meter from a radiation source or any surface through which radiation penetrates."

The changes are consistent with the requirements of the revised 10 CFR Part 20 and are acceptable.

13. Unit 1 Technical Specification 6.15 OFFSITE DOSE CALCULATION MANUAL
Unit 2 Technical Specification 6.14 OFFSITE DOSE CALCULATION MANUAL

The licensee has proposed to revise item a.2 in each of these TS to change the reference "10 CFR 106" to "10 CFR 20.1302."

This change is administrative in nature to incorporate the corresponding revised 10 CFR Part 20 section number and is acceptable.

14. Unit 1 Technical Specification 6.15 OFFSITE DOSE CALCULATION MANUAL
Unit 2 Technical Specification 6.14 OFFSITE DOSE CALCULATION MANUAL

The licensee has proposed to revise item c in each of these TS which refer to the reporting frequency for the Semiannual Radioactive Effluent Release Report. The word "Semiannual" is being changed to "Annual."

The change is administrative in nature to implement the revised reporting requirement in 10 CFR 50.36a and is acceptable.

3.0 STATE CONSULTATION

In accordance with the Commission's regulations, the Virginia State official was notified of the proposed issuance of the amendment. The State official had no comment.

4.0 ENVIRONMENTAL CONSIDERATION

Pursuant to 10 CFR 51.21, 51.32, and 51.35, an environmental assessment and finding of no significant impact was published in the Federal Register on January 18, 1994 (59 FR 2629).

Accordingly, based upon the environmental assessment, the Commission has determined that issuance of the amendments will not have a significant effect on the quality of the human environment.

5.0 CONCLUSION

The Commission has concluded, based on the considerations discussed above, that: (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, (2) such activities will be conducted in compliance with the Commission's regulations, and (3) the issuance of the amendments will not be inimical to the common defense and security or to the health and safety of the public.

Principal Contributor: S. Klementowicz

Date: February 17, 1994